

GENERAL NOTES

1. The underdrain pipe shall be either 4" smooth or 5" corrugated tubing unless otherwise shown in the plans. The size to be furnished will be based on the nominal internal diameter of a pipe with a smooth interior wall. Except when prohibited by the plans, the special provisions or this standard pipe with a corrugated interior wall may be provided based on the following size equivalency.

- 4" smooth interior equivalent to 5" corrugated interior
- 5" smooth interior equivalent to 6" corrugated interior
- 6" smooth interior equivalent to 8" corrugated interior
- 8" smooth interior equivalent to 10" corrugated interior

2. Fine aggregate shall be quartz sand meeting the requirements of Sections 902-4 of the Standard Specifications.

3. Coarse aggregate shall be gravel or stone meeting the requirements of Sections 901-2 or 901-3. The gradation shall meet Section 901, Grades 4, 467, 5, 56 or 57 stone unless otherwise shown restricted in the plans.

4. Underdrain Type I, II, III and IV shall be in accordance with Section 440.

5. Filter fabric shall be Type D-3 (See Index No. 199). The internal filter fabric of Type IV underdrain shall have a permeability of 0.7 /sec and an ADS of # 40 sieve.

6. When corrugated polyethylene tubing with slots or 360° perforations is used in conjunction with fine aggregate, a filter fabric sock meeting Section 948 is required.


7. See index no. 500 for the standard location of Type I, II, and III underdrain. The location of Type IV underdrain and non-standard locations of Type I, II, and III underdrain will be as detailed in the plans.

8. All filter fabric joints shall overlap a minimum of 1'. The internal filter fabric of Type IV underdrain shall overlap into the coarse aggregate or the fine aggregate a minimum of 1'.

9. Underdrain outlet pipes shall be non-perforated and all bends shall be made using 1/8" (45 deg.) elbows. 90 deg. bends shall be constructed with two 1/8" elbows separated by at least 1' of straight pipe. Outlet pipes stubbed into inlets or other drainage structures shall be not less than 6" above the structure flow line. Outlet pipes discharging to grassed areas shall have concrete aprons, hardware cloth, and bordering sod as shown in index no. 287 for Edgedrain outlets.

10. Pay item shall be based on the size of the smooth interior products. The contract unit price for Underdrain, LF, shall include the cost of pipe, fittings, aggregate, sock, filter fabric, underdrain cleanouts, and concrete aprons. The contract unit price for Underdrain Outlet Pipe, LF, shall be full compensation for trench excavation, pipe and fittings, concrete aprons, hardware cloth for concrete aprons, stubbing into drainage structures, backfill in place, and disposal of excess materials.

The contract unit price for Underdrain Inspection Box, EA, shall be for the number completed and accepted.

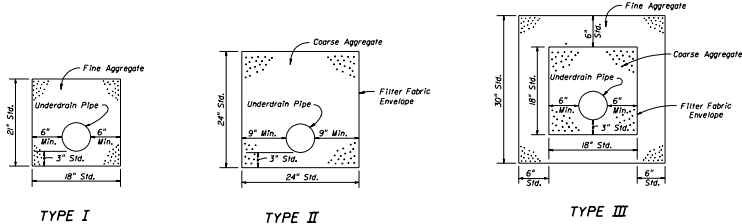

TYPE I

TYPE II

TYPE III


DESIGN NOTES

1. The type of underdrain should be selected to meet design water removal rate and soil conditions. Caution is prescribed in the use of these typical sections since special designs may be required to satisfy project conditions.
2. Type I underdrain is intended for minimum water removal conditions.
3. Type II underdrain is intended for moderate water removal conditions. Where reactive conditions may create chemical clogging, the use of an inert material and/or elimination of the filter fabric may be necessary.
4. Type III underdrain is intended for maximum water removal conditions. Filter fabric is required between the coarse aggregate or fine aggregate including those described in general notes 2 and 1. Design note 3 applies for reactive conditions.
5. Type IV underdrain is intended for use in detention basins and other locations which require a filtration system. The standard fine aggregate specified for Type IV underdrain conforms to filtration gradation requirements of Chapter 62-25 F.A.C.
6. The designer should detail in the plans, the location of: (a) Type IV underdrain, (b) non-standard locations of Type I, II, and III underdrain, (c) underdrain inspection boxes, (d) cleanouts for Type IV underdrain, and (e) underdrain outlet pipes.
7. The designer should specify the flow line elevations at the beginning, bends, junctions and ends of underdrain pipes and outlet pipes.
8. The designer should evaluate whether an external filter fabric envelope is required around underdrain Types I and III. When required, fabric shall be specified in the plans.


STATE OF FLORIDA DEPARTMENT OF TRANSPORTATION
ROAD DESIGN

UNDERDRAIN


Revised	Date	Approved By
DES	02/05	<i>J. A. McNamee</i>
Designed By	DES	DATE
02/05	02/05	02
Drawn By	DES	DATE
02/05	02/05	02
Checked By	DES	DATE
02/05	02/05	02

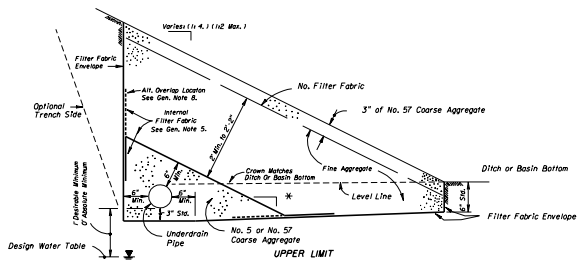


* Slope To Match Top of Fine Aggregate

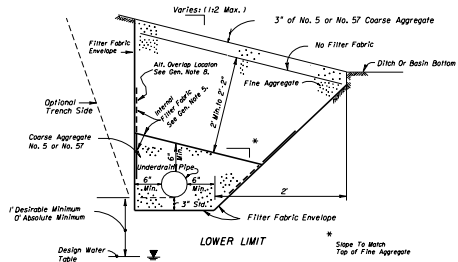

TYPE V a

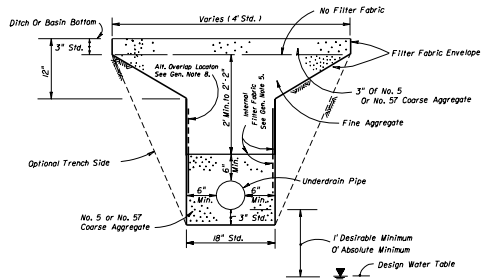

TYPE V b

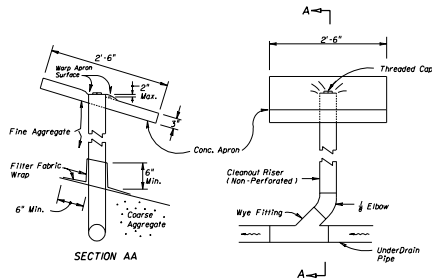

CLEANOUT FOR TYPE V UNDERDRAIN

STATE OF FLORIDA DEPARTMENT OF TRANSPORTATION ROAD DESIGN					
UNDERDRAIN					
Drawn By	Checked By	Scale	Date	Approved By	Project No.
				A. A. McHanna	
					2 of 2
					286