



Foundations apply only to slopes of 1:4 or flatter.

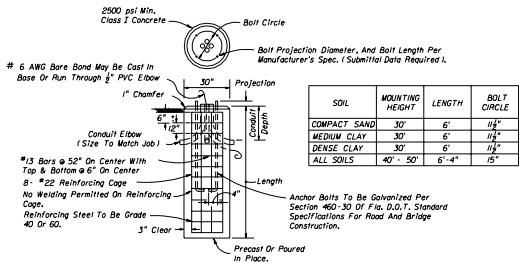

METAL POLE CONCRETE FOUNDATION DETAIL

At All Pull Boxes, And Pole Bases,
Ends Of Conduit Shall Be Sealed
In Accordance With Section 630
Of The Standard Specifications
For Road And Bridge Construction.

All Splices Shall Be Made In Pull Box
Or Pole Base With Compression Sleeves
Or Split Bolt Connectors Properly Taped
And Weatherproofed.

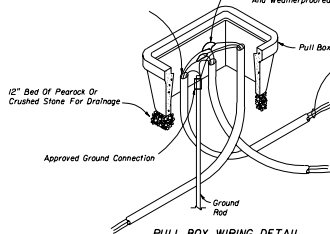

1 #6 AWG Insulated (TW Green) Stranded CU Bond
Wire Connecting All Poles, And Insulated (THW or
THWN) Stranded Copper Circuit Conductors In
Schedule 40 PVC Conduit. Circuit Conductors And
Conduit Sizes As Shown In Plans. (Typical)

PULL BOX WIRING DETAIL

STATE OF FLORIDA DEPARTMENT OF TRANSPORTATION
TRAFFIC DESIGN

ROADWAY LIGHTING DETAILS

DESIGNED BY	DRAWN BY	CHECKED BY	DATE	APPROVED BY
				<i>Charles A. Scott</i>
				STATE TRAFFIC ENGINEER
			00	1 of 1
				17503