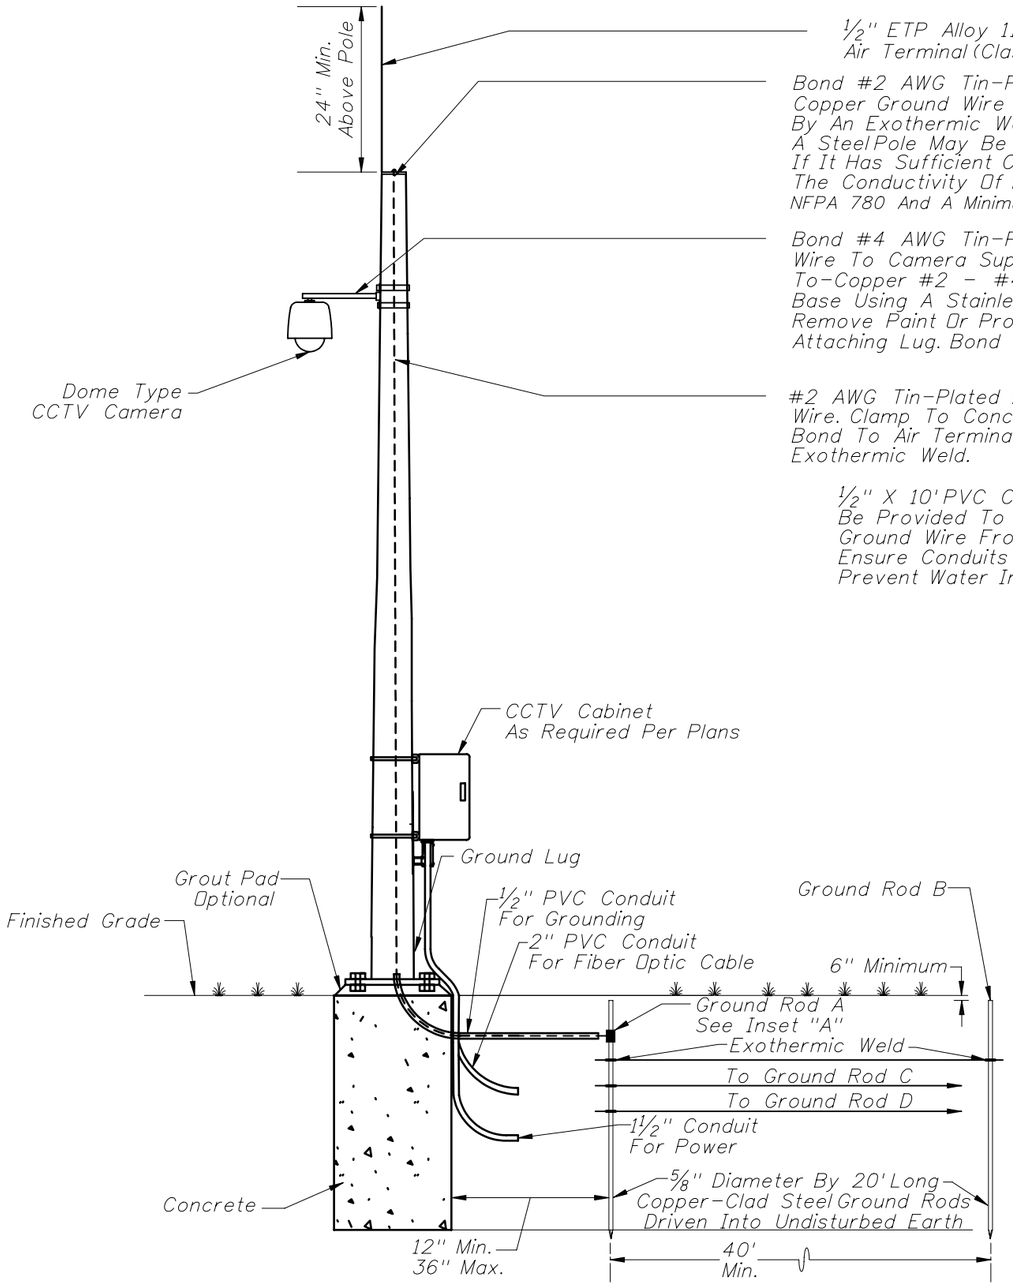

STEEL POLE

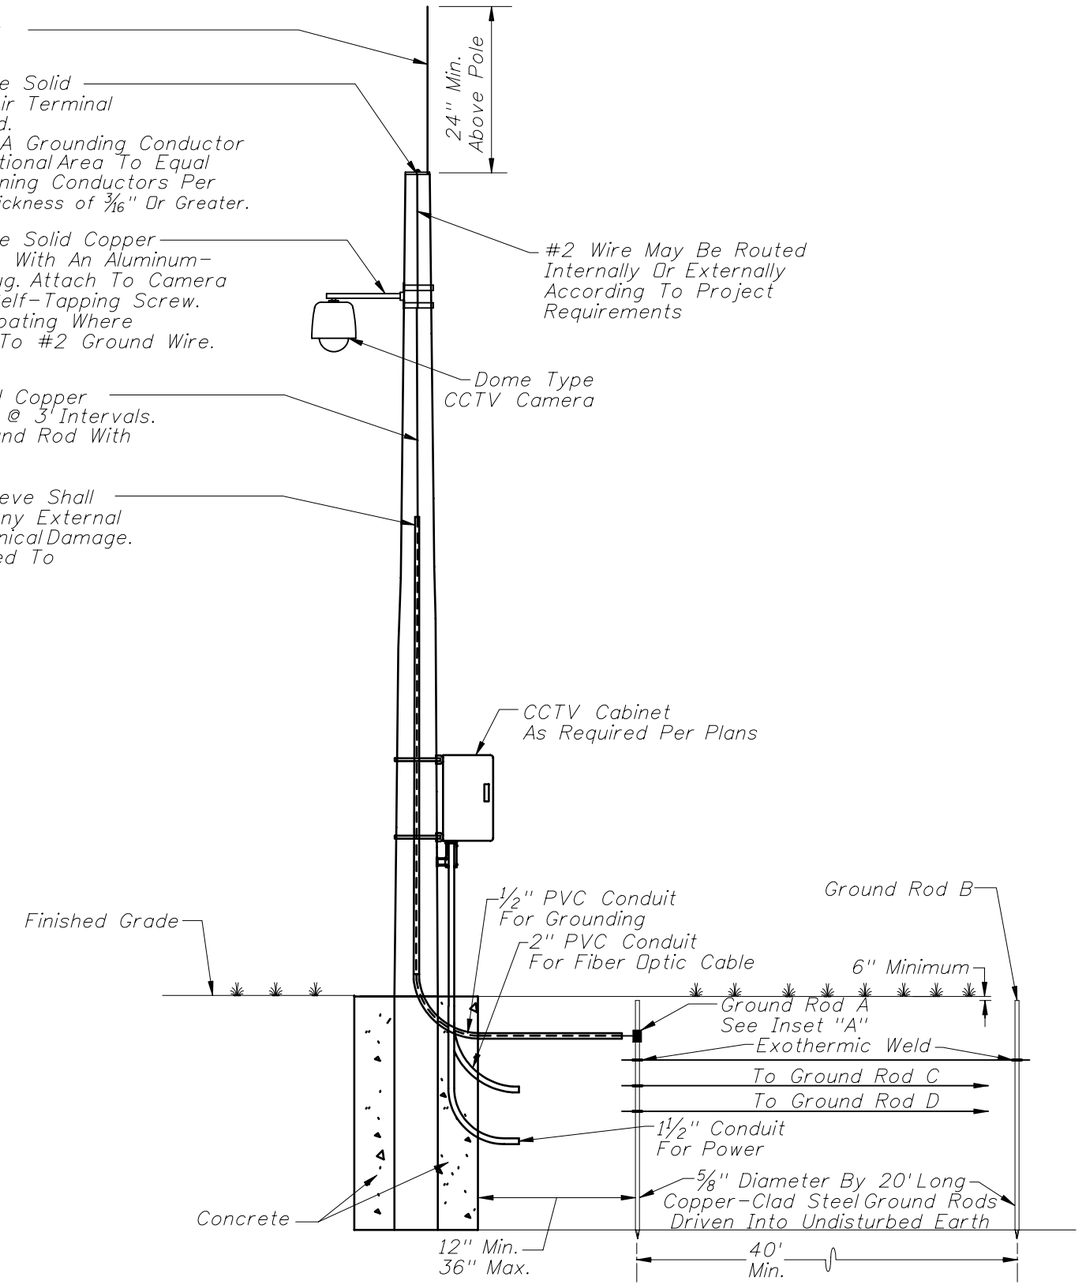

CONCRETE POLE

Not To Scale

STATE OF FLORIDA DEPARTMENT OF TRANSPORTATION	2008 FDOT Design Standards	Last Revision 07/01/07	Sheet No. 1 of 2
	CCTV POLE GROUNDING	Index No.	18102

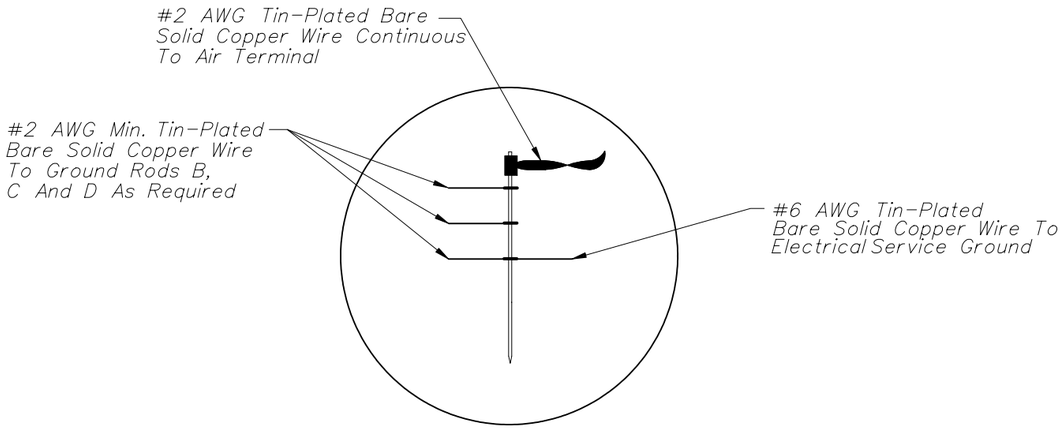

INSET "A"

GENERAL NOTES:

1. Distance must be in accordance with project design documents and greater than or equal to minimum clear zone requirements.
2. Exothermically weld all connections to ground rods.
3. Install marker tape directly above all grounding electrodes and conductors at a depth of 6".
4. All data, coaxial and power cables to the camera shall be completely concealed.
5. All air terminals must meet UL-96A.
6. Ground rod A is required. Ground rods B, C and D will be required as necessary to meet the ground resistance requirements in the contract documents.
7. Place ground system within right of way.
8. Route all camera cables inside arm of mounting bracket.
9. Main ground rod to be placed immediately adjacent to pole.

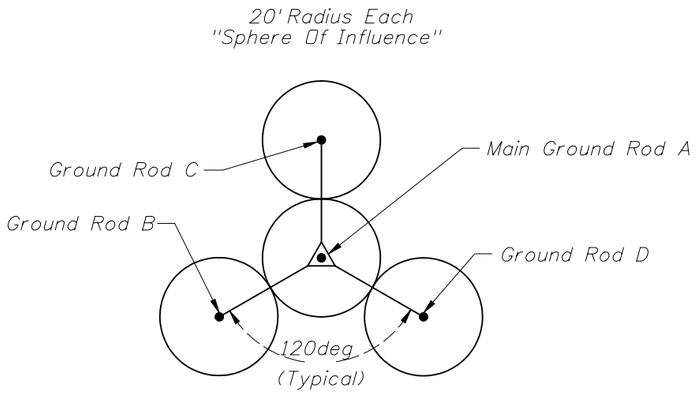

GROUND ROD PLACEMENT DETAIL
(Typical Each Pole)

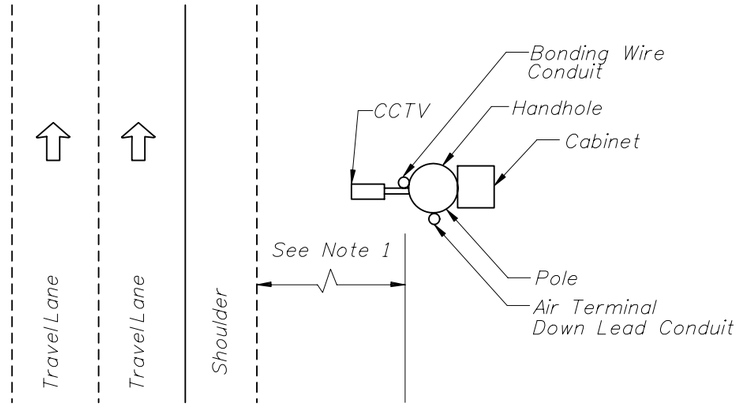

ORIENTATION OF CONDUITS
AND DEVICES ON POLE

Not To Scale

	2008 FDOT Design Standards	Last Revision 07/01/07	Sheet No. 2 of 2
STATE OF FLORIDA DEPARTMENT OF TRANSPORTATION	CCTV POLE GROUNDING		Index No. 18102