

SECTION B-B (See Pile Splice Reinforcement Details)

© Pile &

₹ Void

ALTERNATE STRAND PATTERNS

Prestressing Strands, see

Alternate Strand Patterns

20 ~ \%" \Phi, Grade 270 (Spec) LRS, at 39.7 kips

20 $\sim \%6''$ ϕ , Grade 270 LRS, at 39.0 kips

20 ~ 0.6" Φ, Grade 270 LRS, at 41 kips

24 $\sim \frac{1}{2}$ " ϕ , Grade 270 (Spec) LRS, at 34.0 kips

24 ~ $\frac{9}{16}$ " \emptyset , Grade 270 SR, at 35 kips

24 ~ $\frac{9}{16}$ " Φ , Grade 270 (Spec) SR, at 35.2 kips

28 ~ $\frac{1}{2}$ " ϕ , Grade 270 LRS, at 29.0 kips

28 ~ $\frac{1}{2}$ " \emptyset , Grade 270 (Spec) SR, at 30.2 kips

Prestressing Strands, see

Alternate Strand Patterns

1. Venting shall be provided by the use of a 1" \emptyset PVC conduit through a substructure cap or column. Voids between segments of spliced piles shall be connected by 2" ∅ hole(s).


© Pile &

€ Hole

SECTION C-C

(See Pile Splice Reinforcement Details)

- 2. Any of the given Alternate Strand Patterns may be utilized. The strands shall be located as follows: Place one strand at each corner and place the remaining strands equally spaced between the corner strands. The total strand pattern shall be concentric with the nominal concrete section of the pile.
- 3. CONTRACTOR OPTION: The 30" pile may be cast SOLID by omitting the 18" ϕ void and the 2" ϕ vent hole. In this event, the Contractor shall submit calculations for approval and a proposed strand configuration that provide net prestressing after losses equal to 1000 psi. Alternate configurations for the Diagonal Ties, to maintain the position of the 4 ~ No. 8 Bars, may be approved by the Engineer.

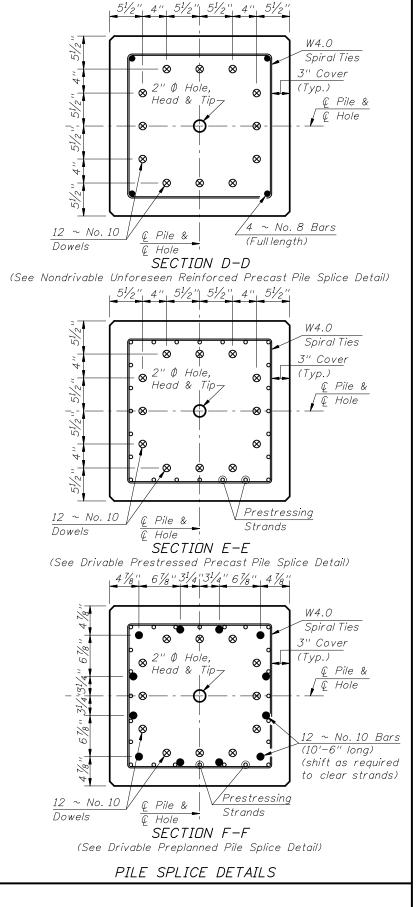



** Omit 4 ~ No. 8 Bars and Diagonal Ties

in pre-planned mechanical splice.

2008 FDOT Design Standards

07/01/07 20630

Sheet No.

1 of 1