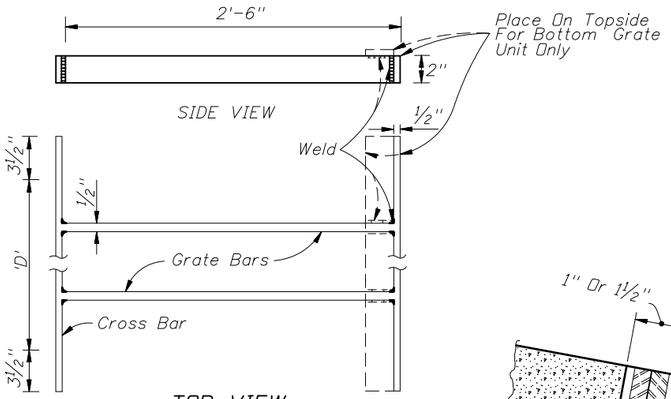

TOP VIEW

GRATE TYPE NO. 1

Pipe Size	Grate Bars Reqd.	Grate LB.
15"	2	28.93

Bars to be evenly spaced across dimension 'D'.
All bars ½" x 2".

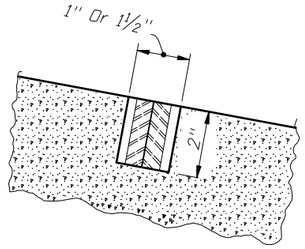

SECTION AA

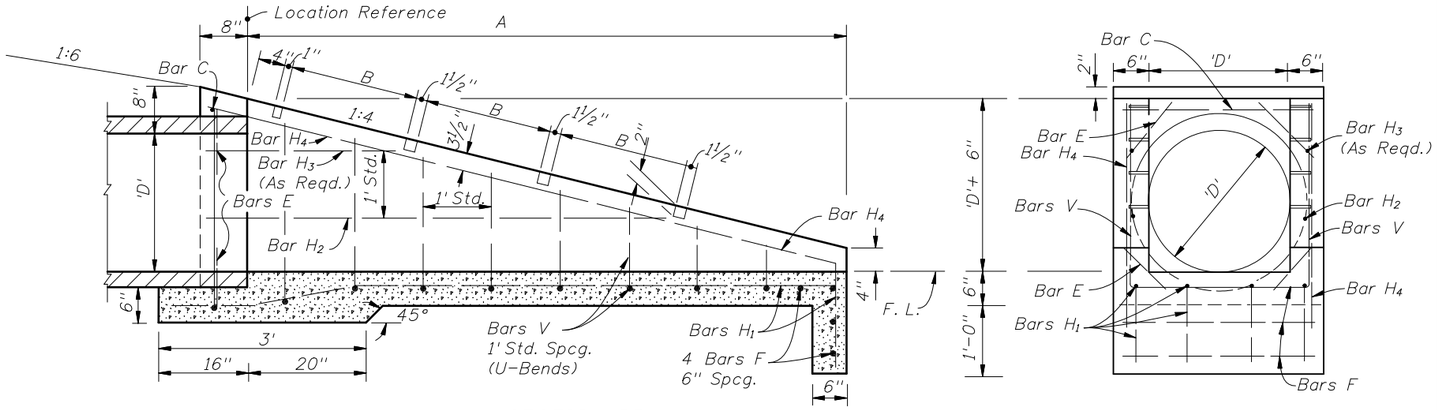

SECTION BB

END VIEW

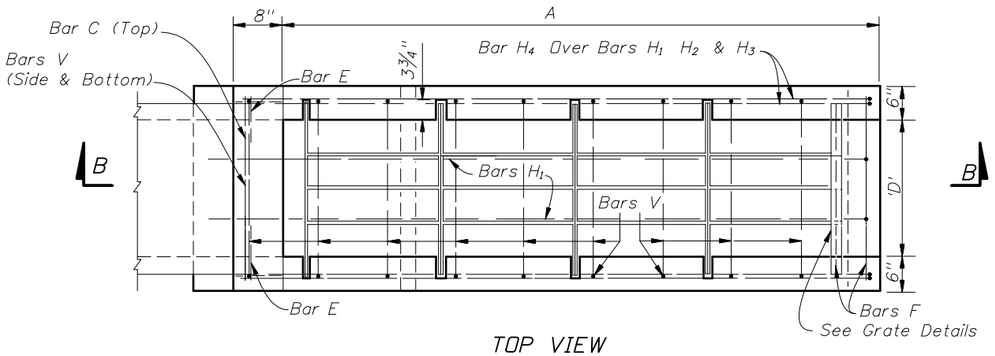

TOP VIEW

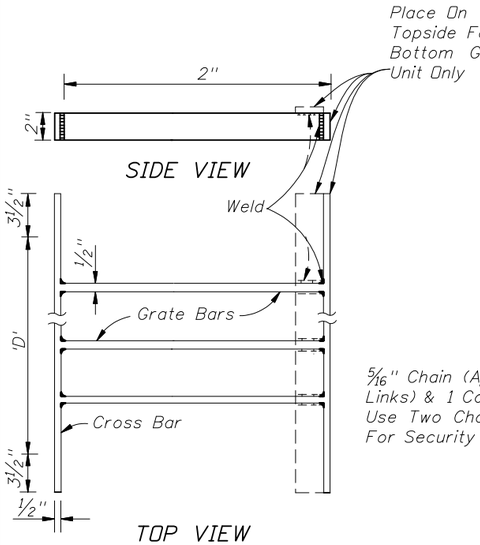

TOP VIEW

GRATE TYPE NO. 2

Pipe Size	Grate Bars Reqd.	Grate LB.
18"	3	33.69
24"	4	43.63
30"	5	53.55

Bars to be evenly spaced across dimension 'D'.
All bars ½" x 2".

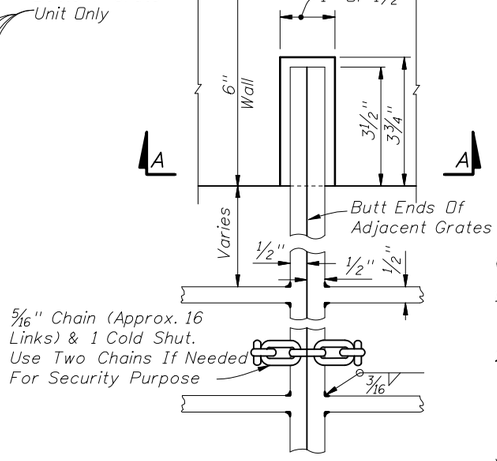

TOP VIEW

GRATE, SEAT, WELD & CHAIN DETAIL

TABLE OF DIMENSIONS AND QUANTITIES

Slope	Pipe Size D	A	B	Class I Conc. (CY)	Reinf. Steel (Lbs.)	Number Of Grates Reqd. Type No. 1	Number Of Grates Reqd. Type No. 2	Total Grate Wt. (Lbs.)	Sodding (SY)	Slope Transition Offset	Slope Transition L
1:4	15"	5.67'	2.38'	0.85	56	2	0	57.86	15	4.2'	42'
	18"	6.67'	1.875'	1.01	73	0	3	101.08	16	4.8'	48'
	24"	8.67'	1.875'	1.65	97	0	4	174.52	19	5.8'	58'
	30"	10.67'	1.875'	2.33	129	0	5	267.75	21	6.9'	69'

GENERAL NOTES

1. This endwall is to be used only in the clear zone for the drainage of medians and other areas having low design velocities and negligible debris.

2. Reinforcing steel: All bars are size #4. Spacings shown are center to center. Laps to be 12" minimum. Clearance is 2" except as noted.
   Square welded wire fabric (two cages max.) having an equivalent cross sectional area (0.20 sq. in.) may be substituted for bar reinforcement.

3. Grates shall be ASTM A242/A242M, A572/A572M or ASTM A5888/A588M, Grade 50 steel. When "Alt. G" grates are specified in the plans, grates shall be galvanized in accordance with Section 962 and 425.3.2 of the Standard Specifications.

4. Endwall to be paid for under the contract unit price for U-Endwall, Each. Payment shall include cost of concrete, reinforcing steel, grate, and accessories. Quantities shown are for estimating purposes only.

5. Sod slopes 5' each side and above endwall. Sodding to be paid for under contract unit price for Performance Turf, SY.

6. Precasting of this endwall will be permitted. Precast units shall conform to the dimensions shown or in accordance with approved shop drawings. Request for shop drawing approval shall be directed to the State Drainage Engineer. Use Index No. 201 for opening and grouting details.

7. Concrete meeting the requirements of ASTM C 478 (4,000 P.S.I.) may be used in lieu of Class I Concrete for precast units manufactured in plants which are under the Standard Operating Procedures for the inspection of precast drainage products.

FRONT SLOPE TRANSITION AT ENDWALL

2008 FDOT Design Standards

U-TYPE CONCRETE ENDWALLS WITH GRATES 15" TO 30" PIPE

Last Revision 07/01/07

Sheet No. 1 of 1

Index No. 260