




### <u>DETAIL A - FACE INSPECTED</u> ANCHOR WITH GROUT OUTLET






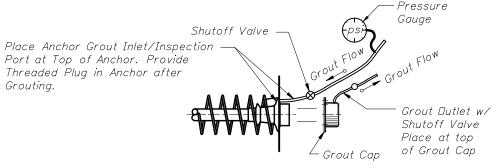

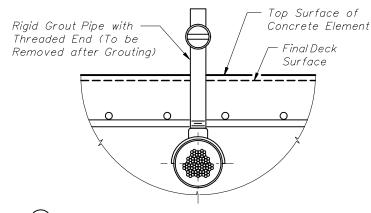



(3) <u>FILLING POCKET</u>




(2) POCKET PREPARATION

#### PROCEDURE


- 1. Remove Rigid Grout Pipe.
- 2. Inspect Tendon for Voids as Necessary.
- 3. Vacuum Grout as Required and Allow Grout to Cure. Remove Pipe used for Vacuum Grouting.
- 4. Clean Threads and Rethread as Required.
- 5. Install Threaded Plug into Outlet to Form a Tight Fit.
- 6. Over-Ream Hole (1/4" Ø Over-Ream) Clean and Roughen Sides.
- 7. Fill Pocket with Epoxy Grout.

GROUT DUTLET DETAIL AT HORIZONTAL SURFACES

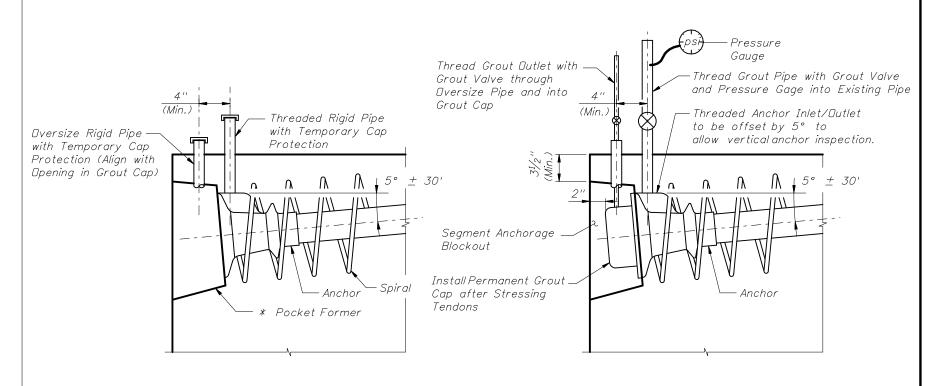

## 1) INSTALLATION & SHIPPING

# 2) <u>GROUTING</u>

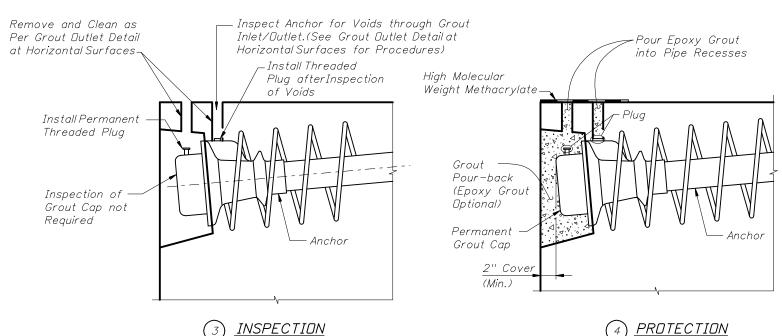

#### NOTES

1. Holes used for the Inspection and Grout Inlets/Outlets may be Formed using Tapered Pipes or Mandrels.

## <u>TOP INSPECTED ANCHOR WITH GROUT INLET</u> INSTALLATION, GROUTING, INSPECTION & PROTECTION

\* Round O Pocket Former - Gravity Fed Placement of Grout Acceptable

Modified Square Pocket Former - Gravity Fed Placement of Grout Acceptable


Square Pocket Former - Vacuum Grouting Required





2010 FDOT Design Standards

POST-TENSIONING ANCHORAGE AND GROUTING DETAILS

21803

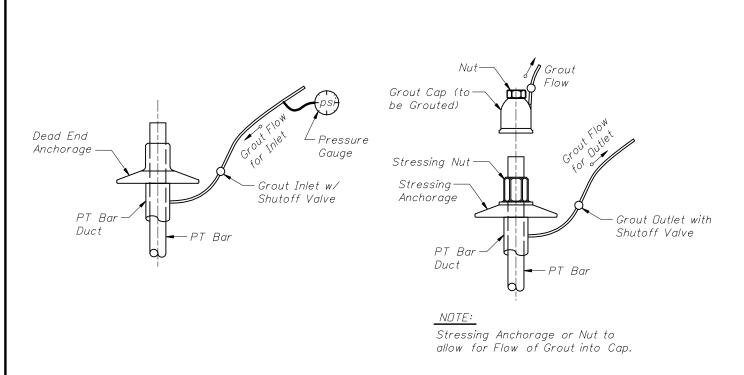


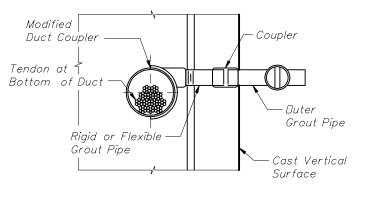

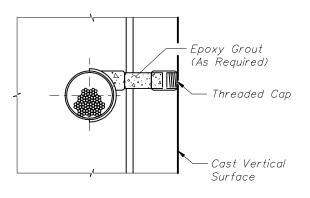

1)GROUT OUTLET CONNECTION TO TENDON

# 3 <u>FILLING POCKE</u>T

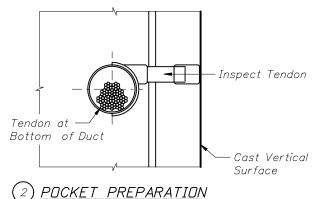


#### **PROCEDURE**

- 1. Remove Rigid Grout Pipe. or Drill Grout in Flexible Pipe.
- 2. Inspect Tendon for Voids as Necessary.
- 3. Vacuum Grout as Required and Allow Grout to Cure for 24 hr. (min.). Remove Pipe used for Vacuum Grouting.
- 4. Plug Recess with Threaded Cap on Inside Surfaces of Box Sections and Inside (nonfascia) Surfaces of I-Girders. For all other Surfaces, Plug Recess with both Threaded Cap and Epoxy Grout.

<u>PT BAR</u> ANCHORAGE STRESSING END

GROUT OUTLET DETAIL AT VERTICAL SURFACES

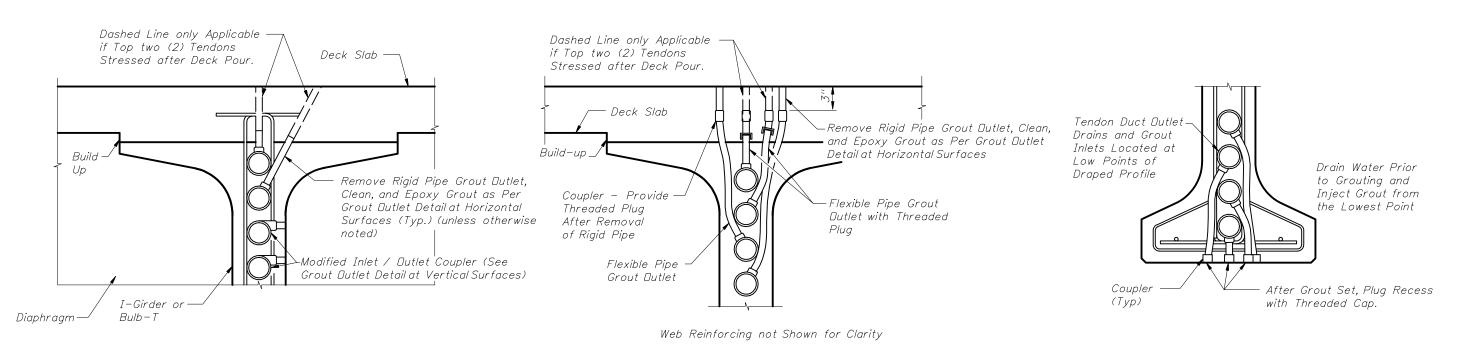

<u>HIGH POINT INSPECTION</u> LOCATION AT GROUT OUTLET

<u>PT\_BAR</u> ANCHORAGE NON-STRESSING END

> TENDONS AT 3'TO 6' FROM HIGH POINTS (GROUT OUTLET)

TENDONS AT LOW POINTS
(GROUT INLET / DRAIN)

Details Shown for I-Girders/Bulb-T's - Details for C.I.P. Boxes with Internal Tendons Similar




2010 FDOT Design Standards

Revision Sheet No. 01/01/09 2 of 3


POST-TENSIONING ANCHORAGE AND GROUTING DETAILS


21803

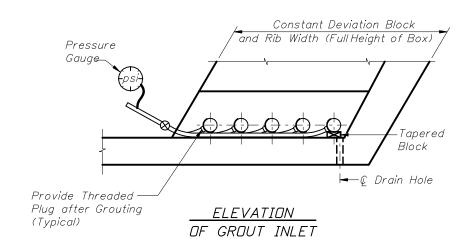


#### NOTES:


Place Tapered Blocks Under Each Tendon to be Grouted to Raise Duct off Tendon Strands. Center Strands within Duct before Grouting Blocks Shall be Removed after Grout has Set. Blocks Shall not Damage or Permanently Deform

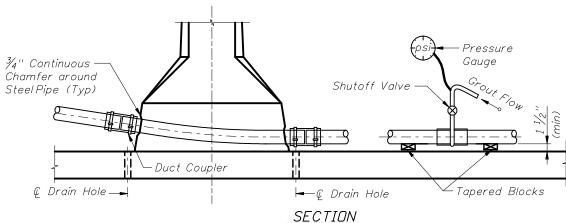

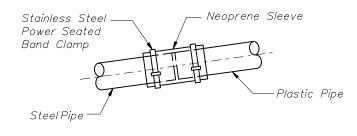




DUCT COUPLER DETAIL Use Approved Duct Couplers with Post-Tensioned System



DETAIL OF DRIP LEDGE AT ABUTMENTS AND EXPANSION JOINTS FOR SEGMENTAL AND CAST-IN-PLACE BOX CONSTRUCTION

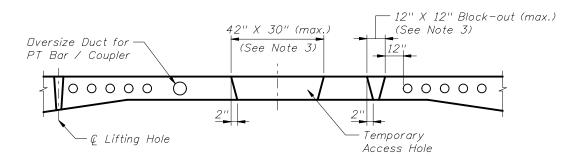

#### TEMPORARY ACCESS HOLES

#### Notes: Temporary Access Holes

- 1. Temporary access holes to facilitate access for erection, jacking and grouting operations inside the box during construction are allowed. The access holes shall be limited to a maximum size of 42" wide x 30" long and shall be limited to (1) per span.
- 2. Slab block-outs for temporary / permanent longitudinal post-tensioning bars are not allowed. Temporary / permanent PT bars in the top slab shall be placed in oversized ducts in the slab to accommodate both the bar and coupler.
- 3. In lieu of (1) 42" x 30" temporary access hole, a maximum of 2 top slab blockouts (12" x 12" (max.)) between the webs is allowed for construction per span. Block-outs shall be a minimum of 12" from the nearest duct or anchor and shall be located as to prevent direct drip onto bottom slab anchors.

## Notes: Repair of Temporary Access Holes,

### Block-outs, and Lifting Holes

- 1. Form all large blockouts with tapered sides.
- 2. Immediately before casting the concrete, mechanically clean the mating concrete surfaces to remove any laitance and to expose small aggregate.
- 3. Repair all holes and blockouts with Magnesium Ammonium Phosphate Concrete within 24 hours of cleaning concrete.
- 4. After completion of the deck grooving, coat the repaired and surrounding concrete surfaces with High Molecular Weight Methacrylate.
- 5. Alternately, epoxy grout may be used to repair holes. High Molecular Weight Methacrylate is not required with epoxy grout.

