



**SIGN COLUMN & STUB COLUMN ELEVATION  
BASE CONNECTION**

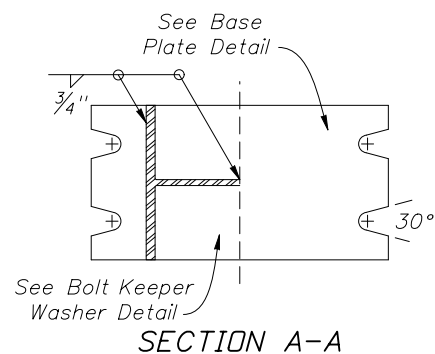


**SECTION A-A**


Provide 2- 0.0149" Thick (28 gauge) and 2- 0.0329" Thick (21 gauge) Per Post.




**SHIM DETAIL**

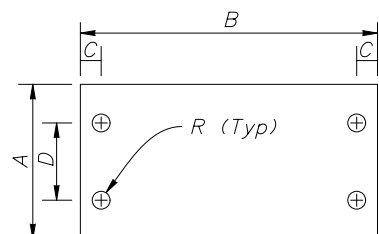

**BOLT KEEPER PLATE**  
Plate Thickness=0.0149" (28 GAUGE)

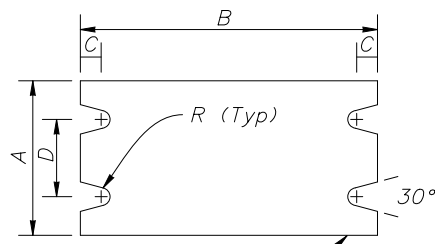

**BASE PLATE**  
Plate Thickness=t<sub>1</sub>

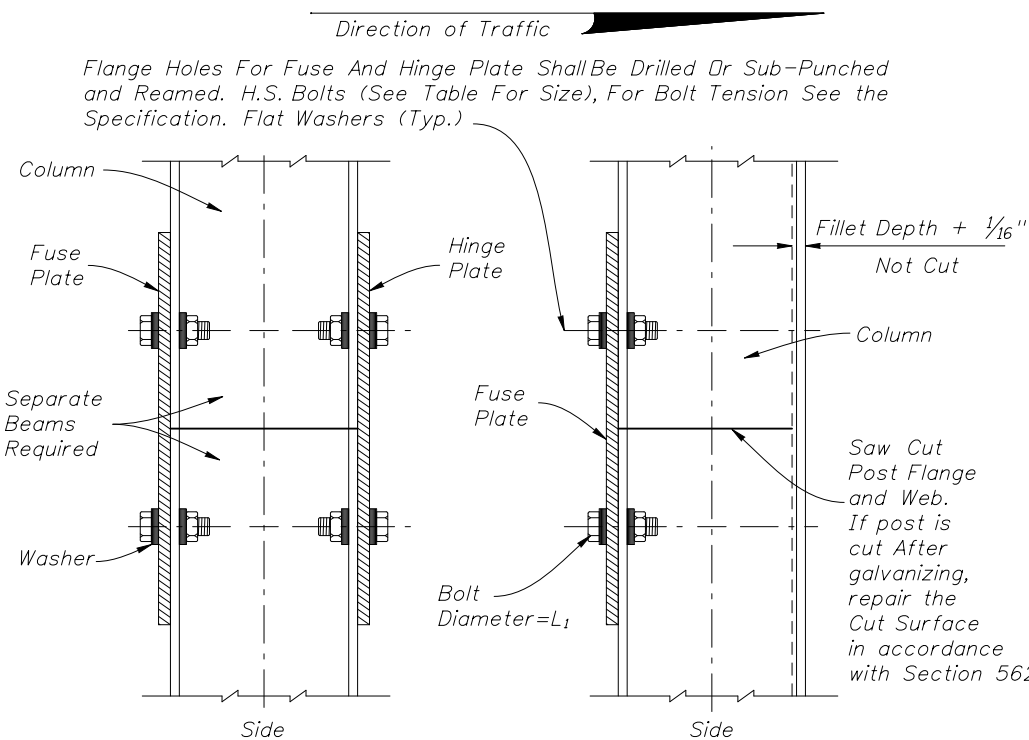


**OPTIONAL HINGE ELEVATION**      **TYPICAL HINGE ELEVATION**

**FUSE & HINGE PLATES**


(See Fabricator Note on Sheet 1 of 2)

**DETAIL B**

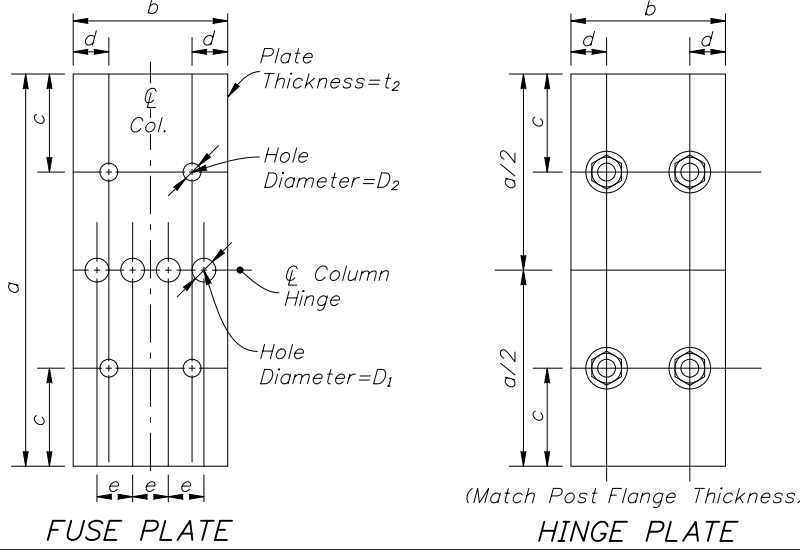

**FUSE PLATE**

**HINGE PLATE**

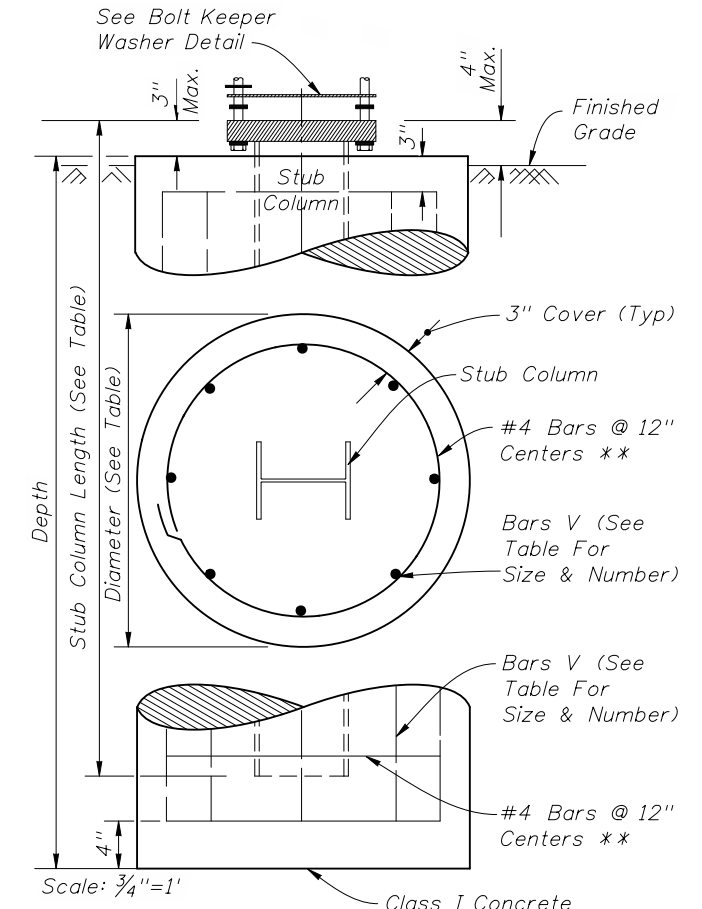

**FOUNDATION ELEVATION**

**NOTE: All Reinforcing To Be Grade 60.**

\*\* At the Option of the Contractor, D10 Spiral Wire @ 6" Pitch, Three Flat Turns Top and One Flat Turn Bottom may be Utilized in Lieu of Specified.

Shop-weld assemblies of foundation stirrup reinforcing bars are permitted in reinforced concrete foundation provided that:

1. The reinforcing bars conform to ASTM Specification A706/706M.
2. The holding wires conform to ASTM Specification A1064.
3. The Shop welding is performed by machines under a continuous, controlled process, approved by the Engineer.
4. Quality control test are preformed on shop-welded specimens and the test results are available, upon request, to the Engineer.

**PROCEDURE FOR ASSEMBLY OF BASE CONNECTION**

1. Assemble post to stub with bolts and flat washers as shown.
2. Shim as required to plumb post (see shim detail).
3. Tighten all L<sub>2</sub> bolts the maximum possible with 1'-0" to 1'-3" wrench to bed washers and shims and to clean bolt threads.
4. Burr threads at junction with nut using a center punch to prevent nut loosening.

**BASE CONNECTION DATA**

Section*	A	B	C	D	R	t <sub>1</sub>	L <sub>2</sub>	Torque (lbf*in)
S 3x5.7	4"	7"	3/4"	2"	5/16"	1"	1/2"	90 ± 20
W 6x12	4"	10"	3/4"	2"	3/8"	1-5/8"	5/8"	270 ± 45
W 8x18	5-1/4"	11-1/4"	7/8"	2-3/4"	7/16"	1-3/4"	3/4"	445 ± 75
W 8x24	6-1/2"	12-1/2"	7/8"	3-1/4"	7/16"	1-3/4"	3/4"	445 ± 75
W 10x33	8"	16"	1-1/4"	4-3/4"	9/16"	2"	1"	580 ± 90
W 12x45	10"	18"	1-1/4"	6"	9/16"	2"	1"	580 ± 90

**FUSE (HINGE) PLATE DATA**

a	b	c	d	e	t <sub>2</sub>	D <sub>1</sub>	D <sub>2</sub>	L <sub>1</sub>
7-1/4"	2-3/8"	1-1/4"	1/2"	9/16"	3/8"	7/16"	9/16"	1/2"
7-1/4"	4"	1-1/4"	7/8"	15/16"	3/8"	13/16"	11/16"	5/8"
8-1/4"	5-1/4"	1-3/8"	1-1/8"	1-1/4"	3/8"	1"	13/16"	3/4"
8-1/4"	6-1/2"	1-3/8"	1-1/2"	1-1/2"	1/2"	1"	13/16"	3/4"
9-1/4"	8"	2"	1-3/4"	1-3/4"	5/8"	1-1/8"	1-1/16"	1"
11"	8"	2"	1-3/4"	1-3/4"	3/4"	1-5/16"	1-1/16"	1"

**SHIM**

L	M
1-1/4"	9/16"
1-3/8"	11/16"
1-3/4"	13/16"
2-1/8"	13/16"
2-3/8"	1-1/16"
2-3/4"	1-1/16"


**FOUNDATION DATA**

Di.	Depth	Stub Length	Reinf. Bars V
2'-0"	4'-0"	3'-0"	10-#6
2'-0"	6'-0"	3'-0"	10-#6
2'-4"	7'-6"	4'-0"	8-#8
2'-4"	8'-6"	4'-0"	8-#8
2'-4"	10'-3"	4'-0"	8-#8
2'-8"	11'-3"	5'-0"	10-#8

\* Designations: Normal Depth in inches and weight in pounds per linear foot.

**STEEL POST, BASE, FOUNDATION & FUSE PLATE DETAILS**

REVISIONS			
DATE	BY	DESCRIPTION	
04/27/10	DYW	Weld symbol revised. Detail B revised.	
06/15/10	DYW	Brass Shims added to Shim Detail.	
01/01/11	DYW	Added W 8x18 to table and updated values.	



2010 Interim Design Standard  
**MULTI-COLUMN GROUND SIGN**

Interim Date: 01/01/11  
Sheet No.: 2 of 2  
Index No.: 11200