TYPE 1



No. of Laps = N

TYPE 2



TYPE 3



TYPE 4



TYPE 5



TYPE 6



TYPE 7



TYPE 8



TYPE 9



TYPE 10



TYPE 1 1



TYPE 12



TYPE 13



TYPE 14



TYPE 15

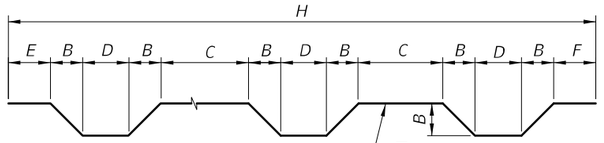

TYPE 16

Number of Beams or Walls = N
Number of D's = N-1
Number of B's = 2N-2
Number of C's = N-2
45° Typical



TYPE 17



TYPE 18



TYPE 19



TYPE 20



TYPE 21



TYPE 22



TYPE 23



TYPE 24

NOTE: Type 17 Bars used in Superstructures shall be tilted to obtain Minimum cover.



TYPE 25



TYPE 26



TYPE 27



TYPE 28



TYPE 29



TYPE 30



TYPE 31



TYPE 32



Style 6 = No Hook

TYPE 33



TYPE 34



TYPE 35



TYPE 36



TYPE 37

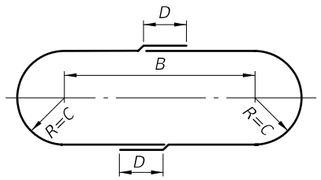

TYPE 38



TYPE 39

C = Pitch
B = Overall Height
Ø = Spirals shall be made of ASTM A615 Grade 60 billet steel using either plain or deformed bars ASTM A615 or Cold drawn steel wire ASTM A82.
N = Total number of closed turns at Top and Bottom of columns
Splices may be accomplished by lapping 1.5 turns. Cost of Channel Spacers and Splices shall be included in the Contract Unit Price for Reinf. Steel (Substructure)



Number of Beams or Walls = N
Number of D's = N-1
Number of B's = 2N-1
Number of C's = N-1
45° Typical

TYPE 40

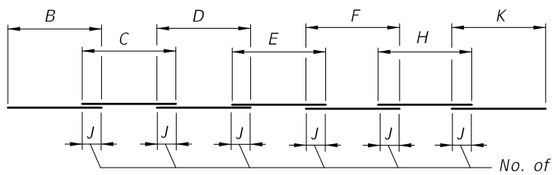

TYPE 41



TYPE 42

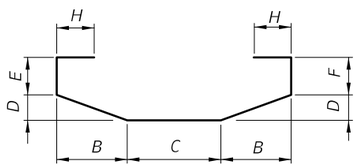

TYPE 43

HOOK DETAILS

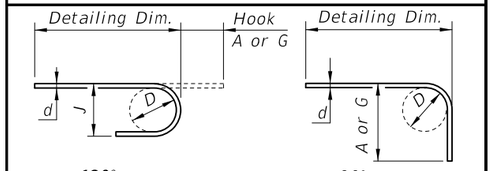

180° 90°

BAR SIZE	D	180° HOOKS A OR G	180° HOOKS J	90° HOOKS A OR G
#3	2¼"	5"	3"	6"
#4	3"	6"	4"	8"
#5	3¾"	7"	5"	10"
#6	4½"	8"	6"	1'-0"
#7	5¼"	10"	7"	1'-2"
#8	6"	11"	8"	1'-4"
#9	9½"	1'-3"	11¾"	1'-7"
#10	10¾"	1'-5"	1'-1¼"	1'-10"
#11	12"	1'-7"	1'-2¾"	2'-0"
#14	18¼"	2'-3"	1'-9¾"	2'-7"
#18	24"	3'-0"	2'-4½"	3'-5"
STYLE		1		3

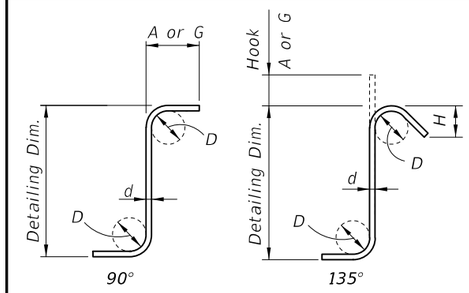

90° 135°

STIRRUPS (TIES SIMILAR)

RECOMMENDED STIRRUP & TIE HOOK DIMENSIONS

BAR SIZE	D	90° HOOKS A or G	135° HOOKS A or G	135° HOOKS H *
#3	1½"	4"	4"	2½"
#4	2"	4½"	4½"	3"
#5	2½"	6"	5½"	3¾"
#6	4½"	1'-0"	8"	4½"
#7	5¼"	1'-2"	9"	5¼"
#8	6"	1'-4"	10½"	6"
STYLE		4	5	

STYLE 6 = NO HOOK

* Dimension is approximate.

Hook Styles Detailed on this sheet are for Illustration Only.

Actual Hook Style for any particular bar will be shown under A or G Heading on REINFORCING BAR LIST sheet(s) in Structures Plans.

All Dimensions are out-to-out.

NOTE: For Bar Dimensions See REINFORCING BAR LIST Sheet(s) in Structures Plans.

REVISIONS

DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION
01/01/11	GJM	Added dimension "H" to Bar TYPE 25			

STATE OF FLORIDA DEPARTMENT OF TRANSPORTATION

2010 Interim Design Standard

STANDARD BAR BENDING DETAILS

Interim Date 01/01/11

Sheet No. 1 of 1

Index No. 21300