



(TYPE F SHOWN, TYPE G SIMILAR)  
PIPE OPENING SCHEMATIC

**GENERAL NOTES**


1. These inlets are designed for use in ditches, medians, pavement areas, or other areas subject to heavy wheel loads, minimal debris, and bicycle traffic. This inlet may be placed in areas subject to occasional pedestrian traffic such as landscaped areas and pavement areas where pedestrians can walk around the inlet. When inlet is placed in areas subject to bicycle traffic, install filler bar when clearance or gap is greater than 1" as shown in Index 218 Inset B.
2. When Alternate G grate is specified in plans, the grate is to be hot dip galvanized after fabrication.
3. These inlets may be used with Alternate B structure bottoms, Index 200. The inlet and bottom combinations are to be paid for under the contract unit price for inlets (DT Bot) (Type F (or G)) (J Bot, Depth), Ea.
4. All exposed edges and corners shall be 3/4" chamfer or tooled to 1/4" radius.
5. For supplemental details, see Index 201.
6. All reinforcing is Grade 60 bars with 2" min. cover unless otherwise noted. Bars to be cut or bent for 1 1/2" clearance around pipe opening. Provide one additional #4 bar above and at each side of pipe opening, as shown.
7. All dimensions are for both precast and cast-in-place inlets unless otherwise noted.

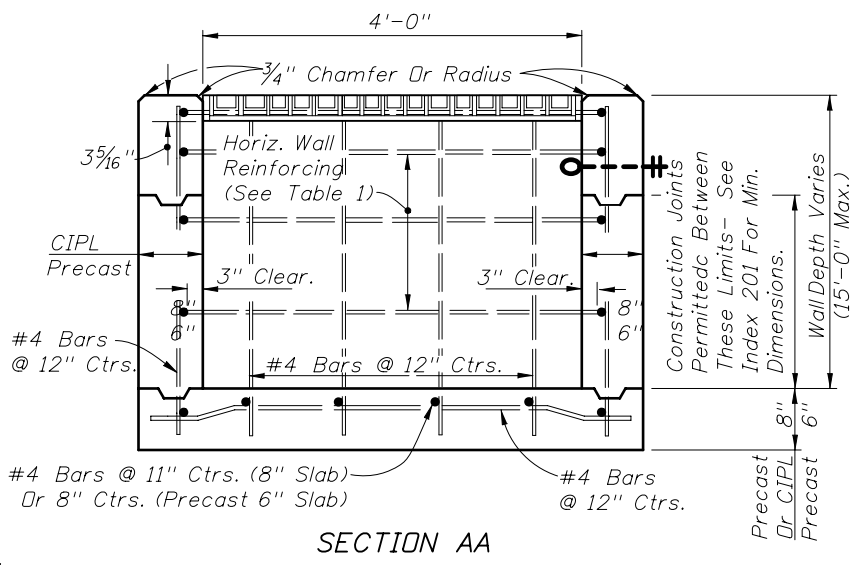

SECTION AA

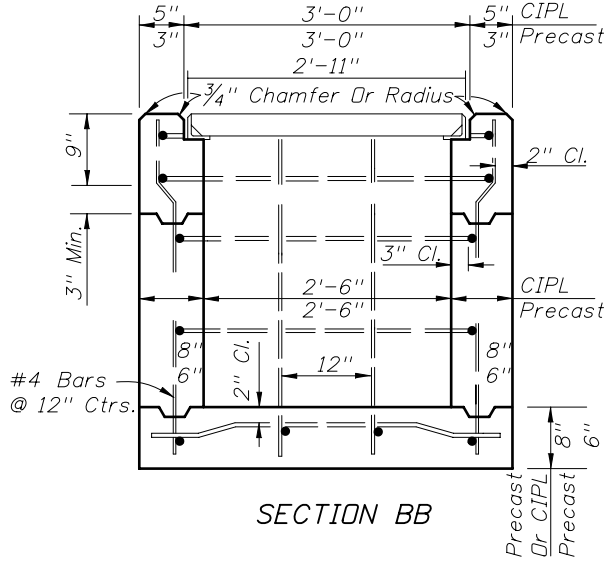


SECTION BB

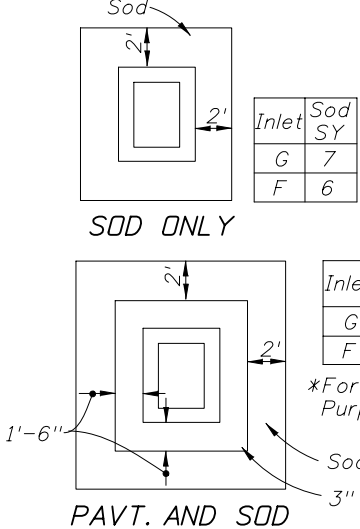

SOD ONLY


PAVT. AND SOD

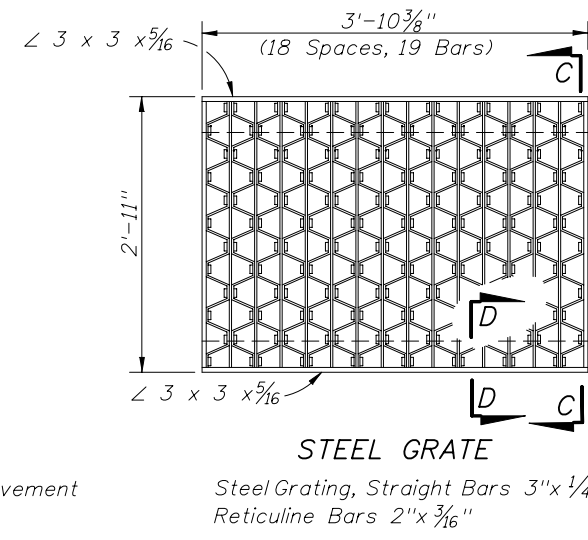

STEEL GRATE

Steel Grating, Straight Bars 3"x 1/4"  
Reticuline Bars 2"x 3/16"

TYPE F

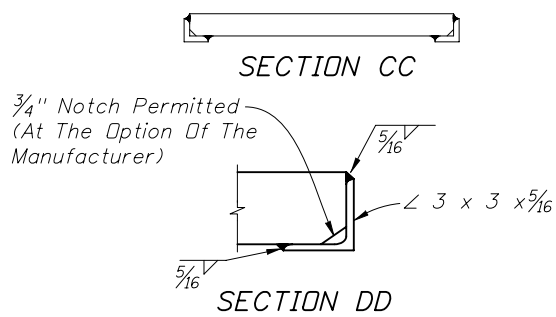

SECTION CC

SECTION DD

HORIZONTAL WALL REINF. SCHEDULES  
TYPE F INLET (TABLE 1)

WALL DEPTH	SCHEDULE	AREA (in. <sup>2</sup> /ft.)	MAX. SPACING	
			BARS	WWF
0' - 4'	A12	0.20	12"	8"
4' - 7'	A6	0.20	6"	5"
7' - 12'	B5.5	0.24	5 1/2"	5"
12' - 15'	Special 1	0.267	5"	4"

RECOMMENDED MAXIMUM PIPE SIZES	
INLET INSIDE WIDTH	PIPE SIZE
2'-6" (Type F)	18"
4'-0" (Type F)	30"
4'-10" / 5'-0" (Type G)	42"


Note: Recommended sizes are for concrete pipe. Sizes for other types of pipe must be verified for fit in accordance with Index No. 201. For larger pipe sizes see Note 3.

- Notes:
1. Pavement and/or sod to be used only where called for in the plans.
  2. Cost of paving to be included in cost of inlet.

**PAVEMENT AND SODDING**

**REVISIONS**



DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION
12/16/09	JG	Added Center of Box Location Reference point to PLAN detail.			



2010 Interim Design Standard

**DITCH BOTTOM INLET  
TYPES F & G**



Interim Date  
01/01/10  
Sheet No.  
1 of 2  
Index No.  
**233**

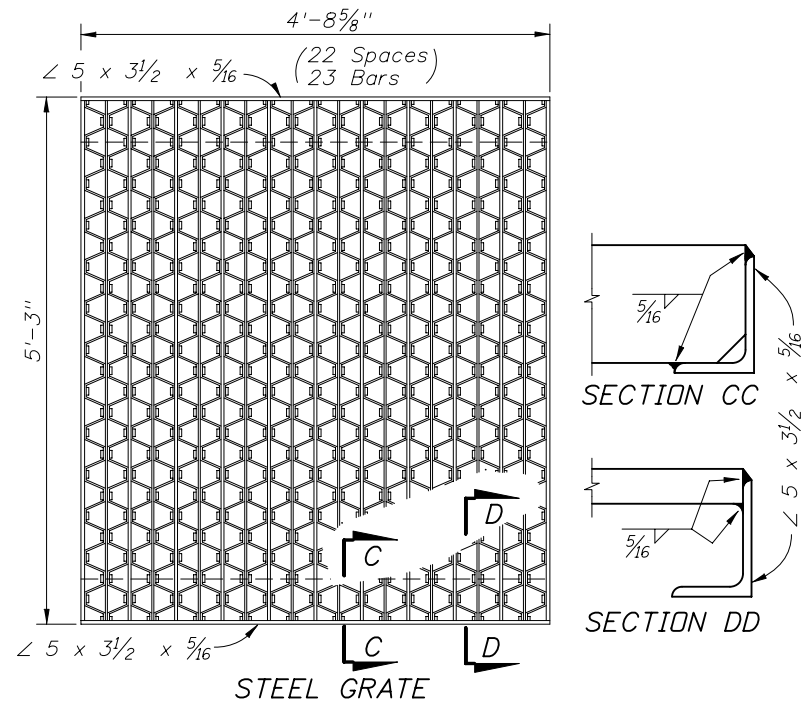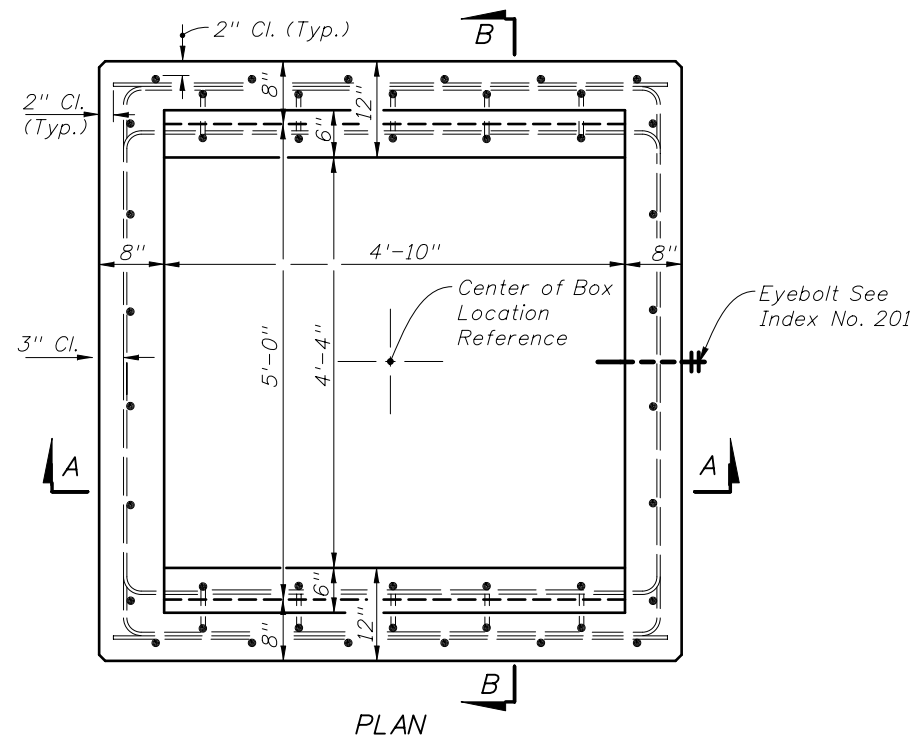

STEEL GRATE  
5" Steel Decking, Weight 630 Lbs. Main Bars 5" x 1/4"  
Intermediate Bars 1 1/2" x 1/4", Reticuline Bars 1 1/4" x 3/16"

TYPE G INLET (TABLE 2)


WALL DEPTH	SCHEDULE	AREA (in. <sup>2</sup> /ft.)	MAX. SPACING	
			BARS	WWF
0' - 3'	A12	0.20	12"	8"
3' - 7'	A6	0.20	6"	5"
7' - 10'	B5.5	0.24	5 1/2"	5"
10' - 15'	C6.5	0.37	6 1/2"	6"

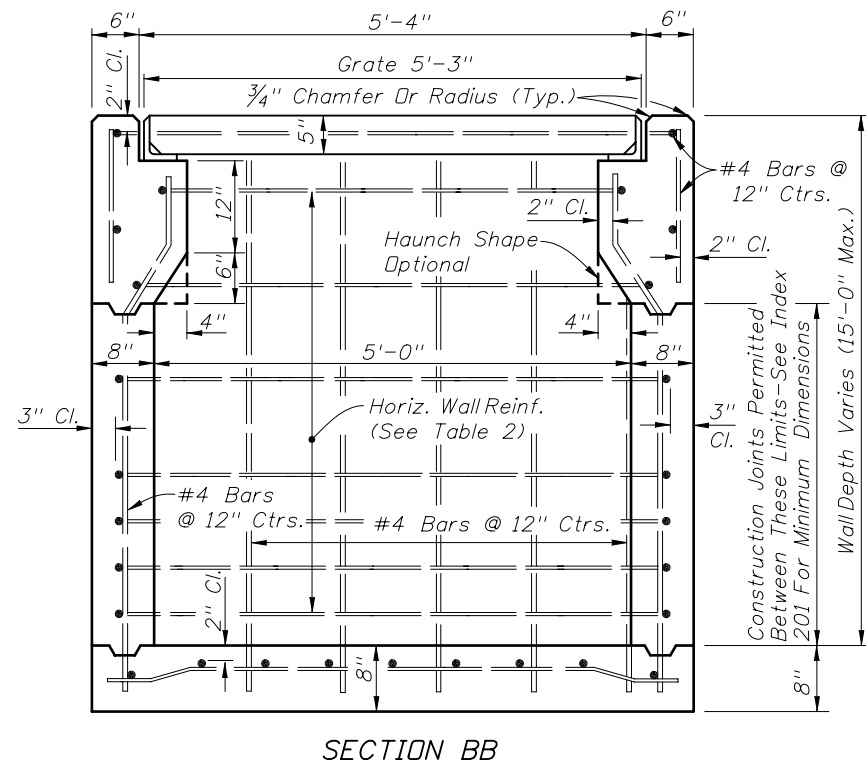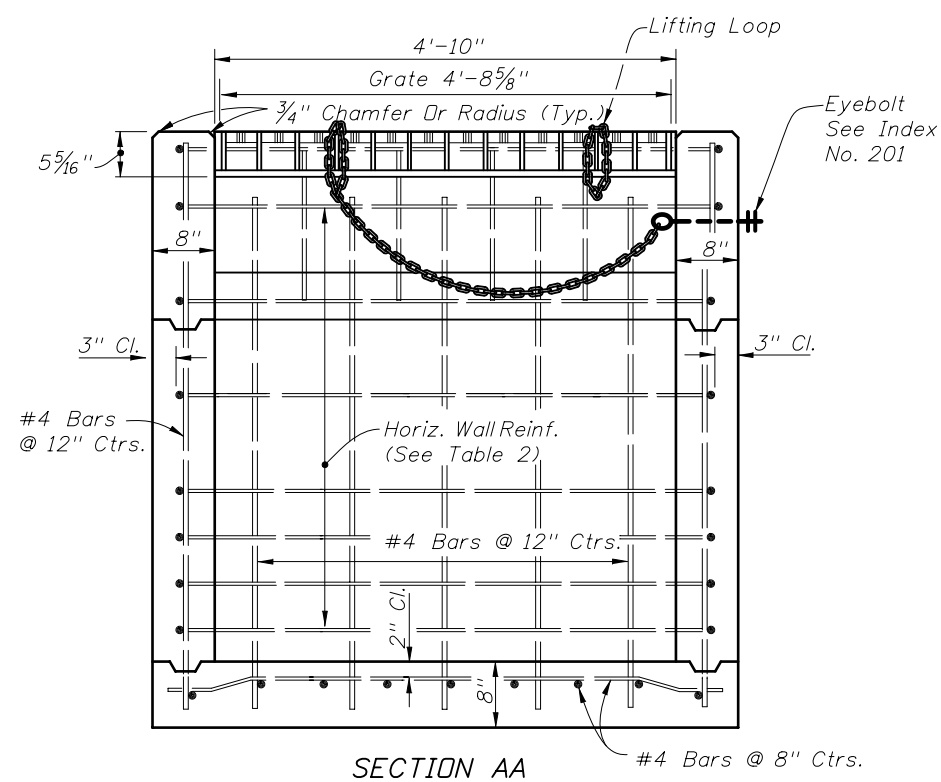

TYPE G

REVISIONS

DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION
12/15/09	JG	Added to PLAN detail Center of Box Location Reference point.			



2010 Interim Design Standard  
DITCH BOTTOM INLET  
TYPES F & G

Interim Date 01/01/10  
Sheet No. 2 of 2  
Index No. 233