NOTES

APPLICABILITY NOTE TO DESIGNER:

This railing is not applicable for shielding drop-off hazards for vehicular traffic. This railing is applicable for all cases where a pedestrian or bicyclist drop-off hazard exceeds 2'-6" or when a drop-off hazard is less than 2'-6" and is required by design. See Index No. 851 for special requirements and modifications for use on bridges. Adequate foundation support shall be provided for anchorage and stability against overturning. For unusual site conditions a site specific railing is to be designed by the responsible engineer. The railing shown on these drawings requires a handrail for ramps steeper than a 5% grade to conform with the requirements of the Americans with Disabilities Act (ADA). Refer to FDOT Plans Preparation Manual (Volume I) Chapters 4 & 8, for the definition of vehicular, pedestrian and bicyclist "drop-off hazards".

ALTERNATE DESIGN:

Manufacturers seeking approval of proprietary railing systems for inclusion on the Qualified Products List as pre-approved alternate designs must submit application along with design documentation showing the proprietary railing system is designed to meet the design life, live loads, geometry and deflection requirements specified herein. All fixed joints are to be either welded or commercially designed fixed joint systems. Each field section of railing must be identified with a permanently affixed label with the manufacturer's name and the FDOT QPL approval number. Labels must be a maximum of 1½" by 3" and located at the base of a post within the field section. Project specific shop drawings are required for QPL approved railings, see Shop Drawings note.

In lieu of design calculations, submit certified test reports from an approved independent testing agency. Test railing systems in accordance with ASTM E935 (Test Method A & C) using test loads at least 175% of the design load. Test proprietary or nonstandard anchorage systems in accordance with ASTM E894 (Flexural Test). Anchorage systems must resist the minimum of 175% of the design load for failure of the steel anchors or 220% of the design load for failure in the concrete foundation.

PAYMENT:

Railing shall be paid for per linear foot (Item No. 515-2-abb). Payment will be plan quantity measured as the length along the center line of the top rail, and includes rails, posts, pickets, rail splice assembly, base plates, anchor bolts, nuts, washers, resilient or neoprene pads and all incidental materials and labor required to complete installation of the railing.

RAILS, PICKETS & POSTS:

Pipe Rails and Pickets shall be in accordance with ASTM A500 Grade B, C or D, or ASTM A53 Grade B for standard weight pipe (Schedule 40) or ASTM A36 for bars. Structural Tube Posts shall be in accordance with ASTM A500 Grade A, B, C or D, or ASTM A501. Posts and End Rails shall be fabricated and installed plumb, ± 1" tolerance when measured at 3'-6" above the foundation. Pickets shall be fabricated parallel to the posts. Corners and changes in tangential longitudinal alignment shall be made continuous with a 9" bend radius or terminate at adjoining sections with mitered end sections when handrails are not required. For changes in tangential longitudinal alignment greater than 45°, posts shall be positioned at a maximum distance of 2'-0" each side of the corner and shall not be located at the corner apex. For curved longitudinal alignments the top and bottom rails and handrails shall be shop bent to match the alignment radius.

RAILING MEMBER DIMENSIONS TABLE

MEMBER	DESIGNATION	OUTSIDE DIMENSION	WALL THICKNESS
Posts	2" x 4" Rectangular Tube	2.00" x 4.00"	0.188"
Rails	2" NPS (Sch. 40)	2.375"	0.154"
Rail Joint/Splice Sleeves	1½" NPS (Sch. 40)	1.900"	0.145"
Handrail Joint/Splice Sleeves	1" NPS (Sch. 40)	1.315"	0.133"
Handrails	1½" NPS (Sch. 40)	1.900"	0.145"
Handrail Support Bar	1" Ø Round Bar	1.000"	N/A
Pickets	½" NPS (Sch. 40)	0.840"	0.109"
	¾" Ø Round Bar	0.750"	N/A

BASE PLATES & POST CAPS:

Base Plates and Post Cap plates shall be in accordance with ASTM A36 or ASTM A709 Grade 36.

SHIM PLATES:

Shim Plates shall be aluminum in accordance with ASTM B209, Alloy 6061 or 6063. Shim plates shall be used for foundation height adjustments greater than ¼" and localized irregularities greater than ⅛". Field trim shim plates when necessary to match the contours of the foundation. Beveled shim plates may be used in lieu of trimmed flat shim plates shown. Stacked shim plates must be bonded together with an adhesive bonding material and limited to a maximum total thickness of ½", unless longer anchor bolts are provided for the exposed thread length.

COATINGS:

The railing shall be hot-dip galvanized after fabrication in accordance with Section 962 of the Specifications. All nuts, bolts and washers shall be hot-dip galvanized in accordance with Section 962 of the Specifications.

ANCHOR BOLTS:

Anchor bolts shall be in accordance with ASTM F1554 Grade 36. Headless anchor bolts for Adhesive Anchors shall be threaded full length. Cutting of reinforcing steel is permitted for drilled hole installation. Expansion Anchors are not permitted. All anchor bolts shall have single self-locking hex nuts. Tack welding of the nut to the anchor bolt may be used in lieu of self-locking nuts. All nuts shall be in accordance with ASTM A563 or ASTM A194. Flat Washers shall be in accordance with ASTM F436 and Plate Washers (for long slotted holes only), shall be in accordance with ASTM A36 or ASTM A709 Grade 36. After the nuts have been snug tightened, the anchor bolt threads shall be distorted to prevent removal of the nuts. Distorted threads and tack welds shall be coated with a galvanizing compound in accordance with the Specifications.

RESILIENT AND NEOPRENE PADS:

Resilient and Neoprene pads shall be in accordance with Specification Section 932 except that testing of the finished pads shall not be required. Neoprene pads shall be PRESTRESSED hardness 60 or 70.

JOINTS:

All fixed joints are to be welded all around and ground smooth. Expansion joints shall be spaced at a maximum 40'-0". Field splices similar to the expansion joint detail may be approved by the Engineer to facilitate hot-dip galvanizing and handling, but railing must be continuous across a minimum of two posts. Only use the Continuity Field Splice (Detail "E") to make the railing continuous for unforeseen field adjustments. Metallize rail ends with a galvanizing compound when field adjustments are required.

WELDING:

All welding shall be in accordance with the American Welding Society Structural Welding Code (Steel) ANSI/AWS D1.1 (current edition). Weld metal shall be E60XX or E70XX. Nondestructive testing of welds is not required.

WEEP HOLES:

Weep holes shall be ¼" Ø and located at the low point between adjacent posts for both top and bottom rails. Holes shall be drilled through the underside of the rails prior to hot-dip galvanizing.

SHOP DRAWINGS:

Complete details addressing project specific geometry (line & grade) showing post and expansion joint locations, anchor bolt installation "Case" or lengths, and venting holes for galvanizing, must be submitted by the Contractor for the Engineer's approval prior to fabrication of the railing. Shop drawings shall be in accordance with the Specifications.

REVISIONS

DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION
01/01/10	SJN	Added "ASTM A500 Grade B, C or D" for Pipe Rails and Pickets in RAILS, PICKETS AND POSTS note.			
07/01/10	SJN	Deleted Design Criteria Notes.			

STATE OF FLORIDA DEPARTMENT OF TRANSPORTATION

2010 Interim Design Standard

STEEL PEDESTRIAN/BICYCLE PICKET RAILING

Interim Date 07/01/10

Sheet No. 1 of 5

Index No. 850

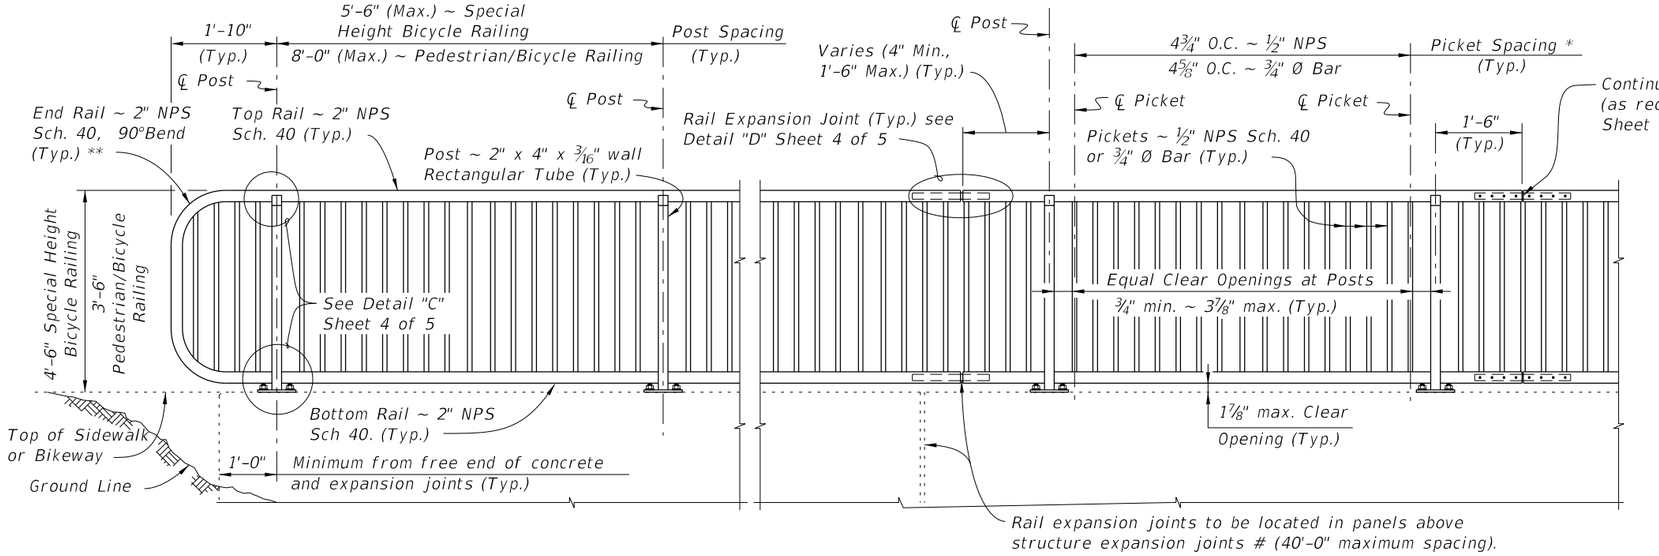

ELEVATION
(Showing Outside Face of Railing)

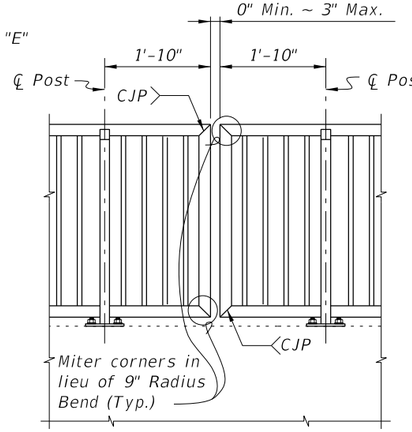

Note: Non-continuous corners are permitted when handrails are not required.

EXPANDED ELEVATION AT CORNERS

TYPICAL RAILING DETAILS & RAILINGS ON GRADES 0% TO 5%

DETAIL FOR NON-CONTINUOUS RAILING AT CORNERS

NOTES:
* Picket Spacing based on the optional picket members shown. If an alternate design is used maintain a maximum clear opening of 3⅞".
** End Rail bend varies for Railings on grades steeper than 2.4%.
NPS = Nominal Pipe Size

STRUCTURES EXPANSION JOINTS NOTE:
Keyed construction joints in Index No. 520 Gravity Wall are not considered to be expansion joints.

CROSS REFERENCE:
For Details "C", "D" and "E", see Sheet 4 of 5.

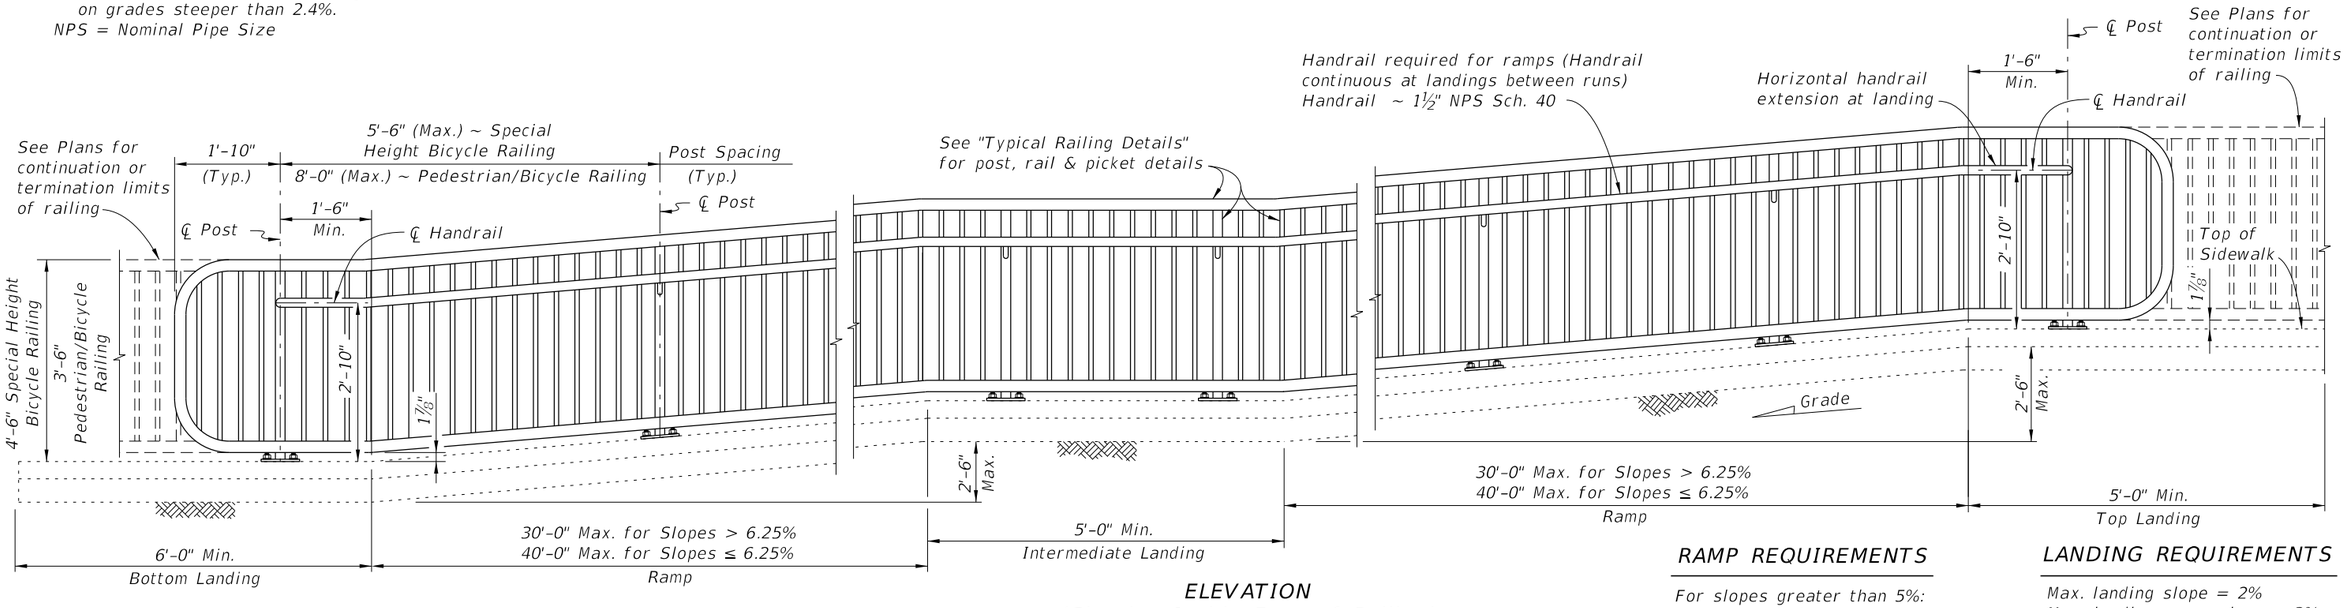

ELEVATION
(Showing Inside Face of Railing)

RAMP REQUIREMENTS

For slopes greater than 5%:
Max. ramp slope = 8.33%
Max. ramp cross-slope = 2.0%

LANDING REQUIREMENTS

Max. landing slope = 2%
Max. landing cross-slope = 2%

RAILINGS ON GRADES STEEPER THAN 5% TO 8.33%

REVISIONS					
DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION
07/01/10	SJN	Changed 2'-10" dimension to mid-height of handrail.			

STATE OF FLORIDA DEPARTMENT OF TRANSPORTATION

2010 Interim Design Standard

STEEL PEDESTRIAN/BICYCLE PICKET RAILING

Interim Date 07/01/10

Sheet No. 2 of 5

Index No. 850

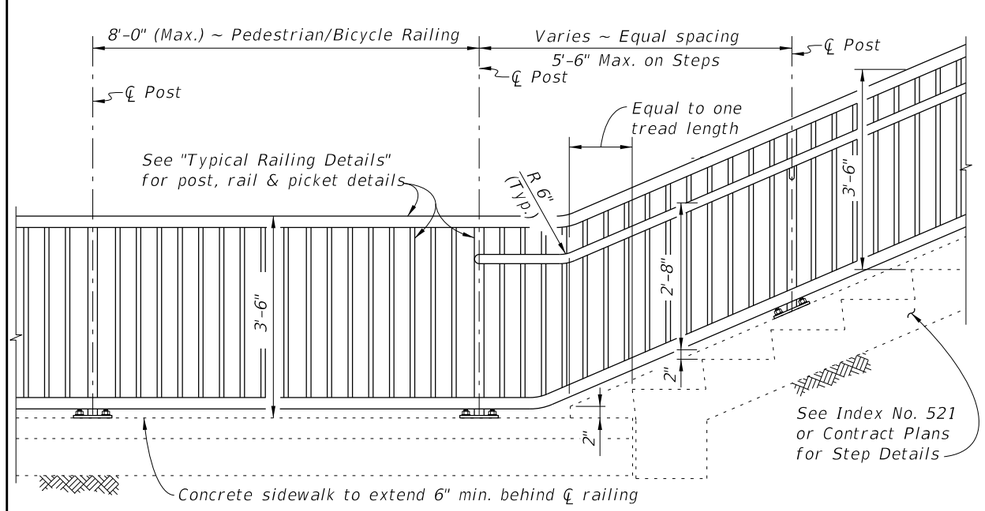

RAILING CONTINUATION BEYOND STEPS OR STAIRS
(Bottom shown, Top similar)

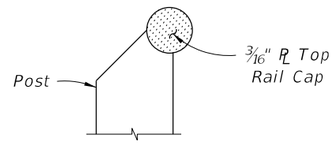

VIEW J-J

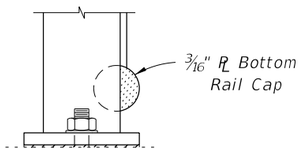

VIEW K-K



DETAIL "L" - PLAN VIEW
HANDRAIL TERMINATION

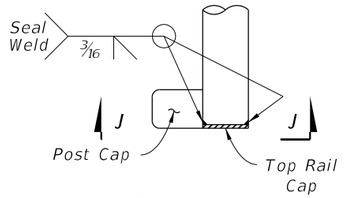

DETAIL "J"
TOP RAIL TERMINATION

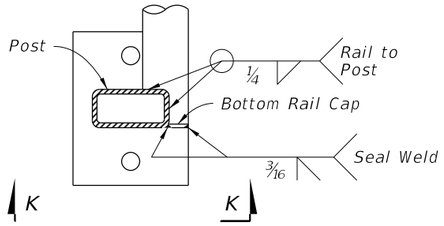

DETAIL "K"
BOTTOM RAIL TERMINATION

ALTERNATE END TREATMENT DETAILS

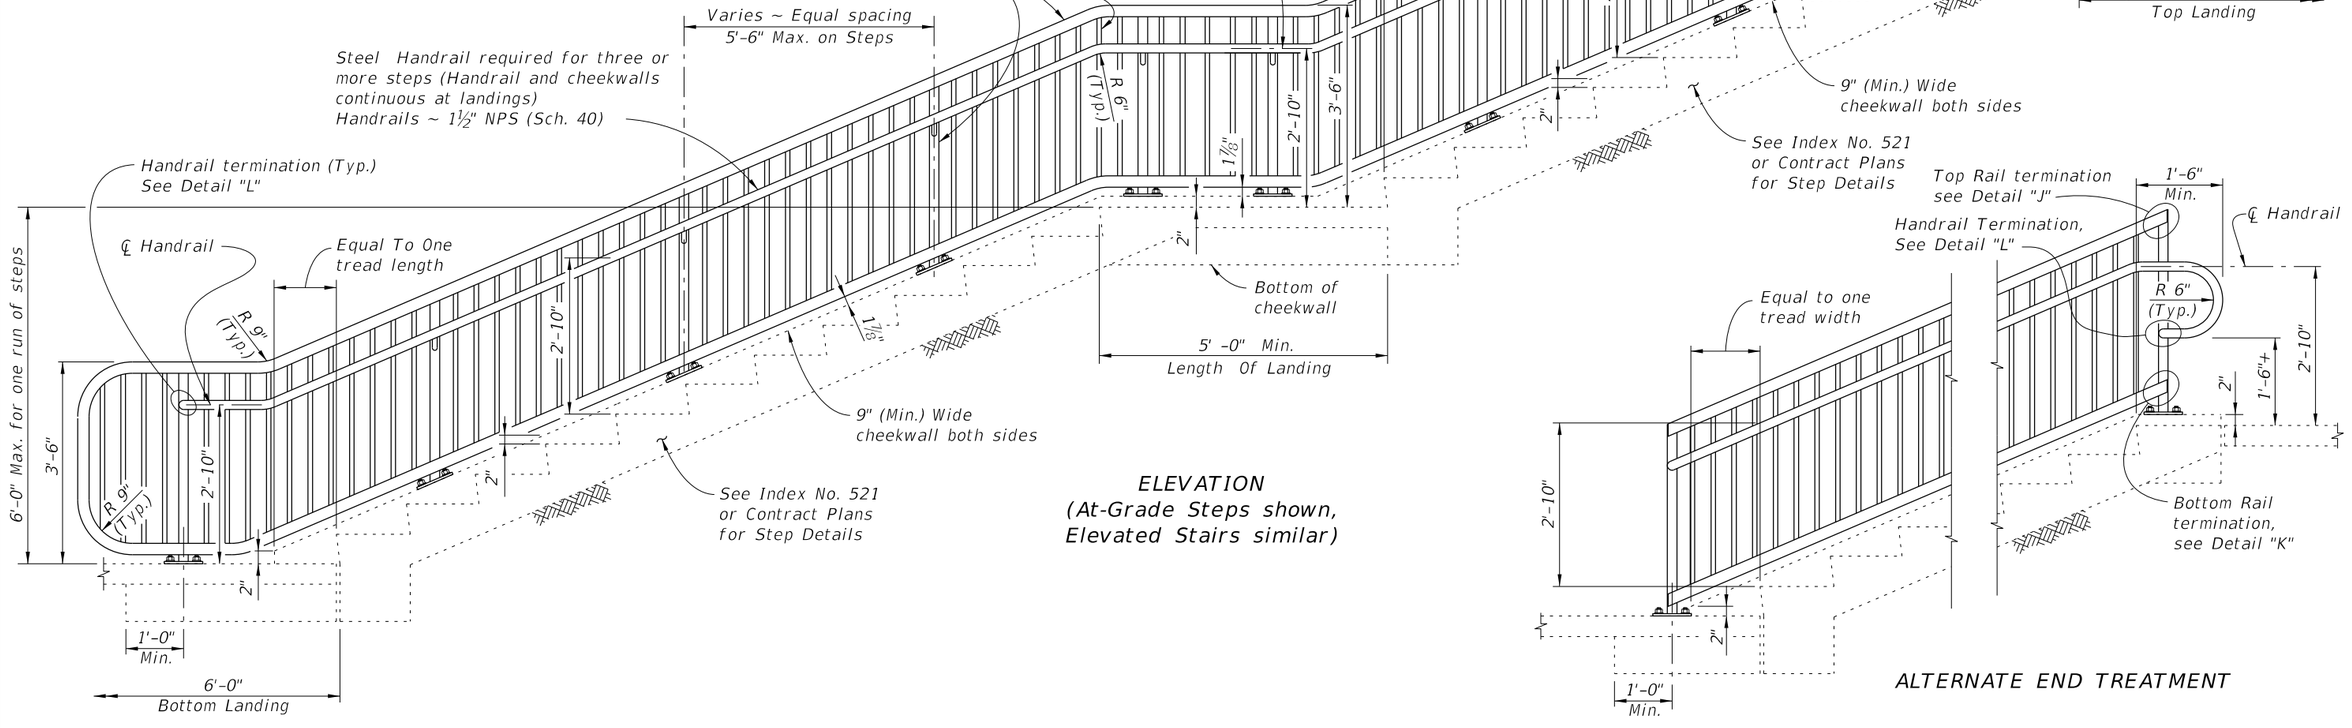

ELEVATION
(At-Grade Steps shown,
Elevated Stairs similar)

ALTERNATE END TREATMENT

RAILINGS ON STEPS & STAIRS

REVISIONS					
DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION
07/01/10	SJN	Deleted minimum extension of handrail at base of steps. Changed 2'-10" dimension to mid-height of handrail.			

2010 Interim Design Standard

STEEL PEDESTRIAN/BICYCLE PICKET RAILING

Interim Date 07/01/10

Sheet No. 3 of 5

Index No. 850

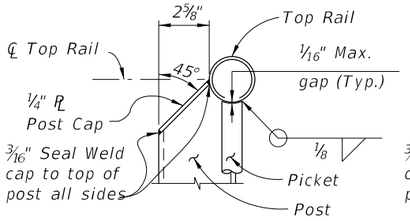

TYPE A (WELDED)

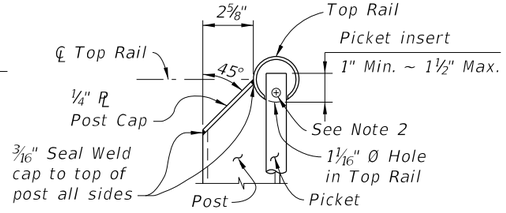

TYPE B (NONWELDED)

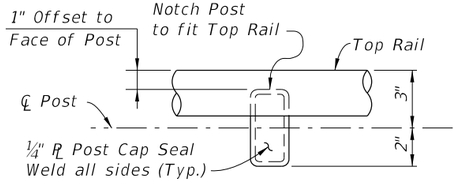

VIEW F-F
TOP RAIL CONNECTION
(Base Plate Not Shown for Clarity)

SECTION A-A
(Top of Picket Connection)

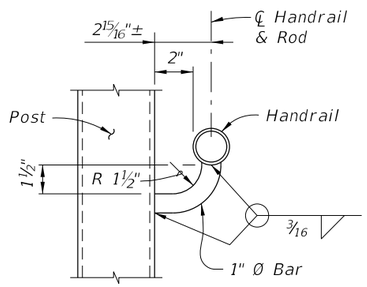

SECTION B-B
(Handrail Connection)

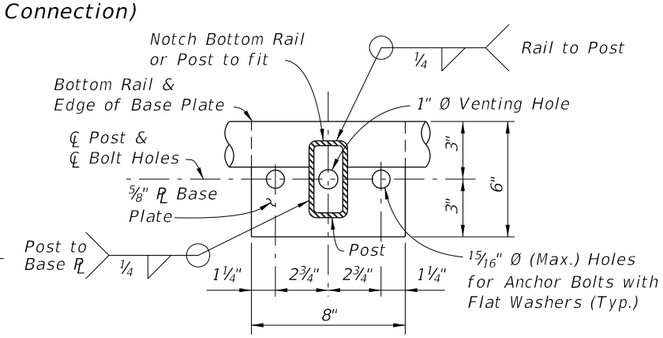

SECTION G-G
BASE PLATE & BOTTOM RAIL CONNECTION

Notes:
1. Type A or Type B connection may be used on either top or bottom picket connection.
2. Provide #10 x ½" Pan Head Stainless Steel (316 or 18-8 Alloy) Screw in the last picket at each expansion or field splice joint to secure the end of the top rail.

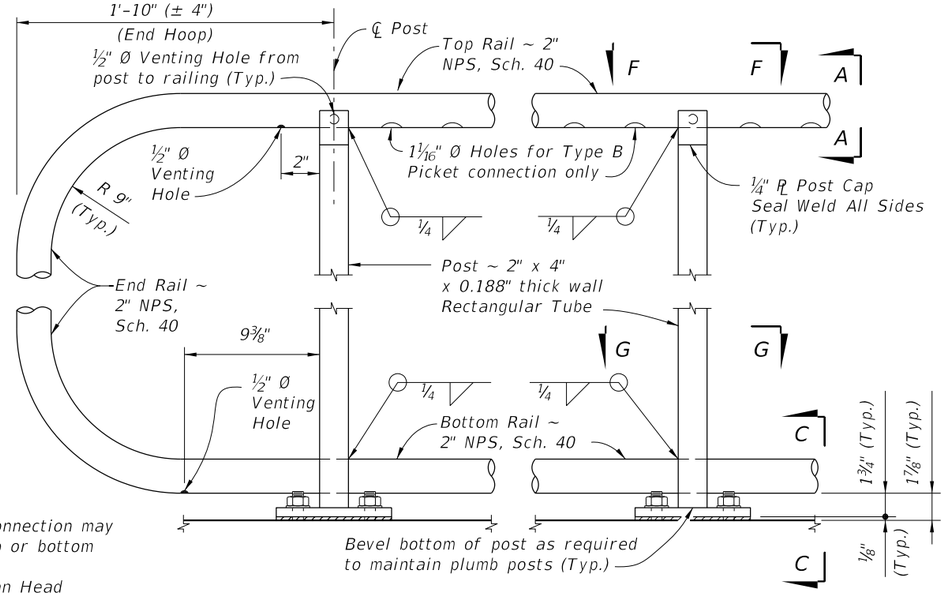

DETAIL "C" - RAIL CONNECTIONS
(Showing Outside Face of Structure and Railing,
Pickets and Handrail Not Shown for Clarity)

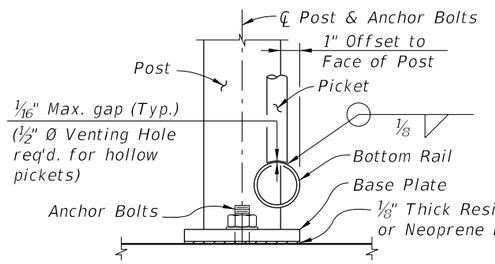

SECTION C-C
(Bottom of Picket Connection)

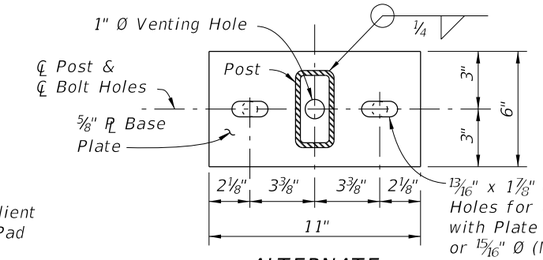

ALTERNATE
BASE PLATE DETAIL
(Recommended for Top of Step Cheekwalls)



SHIM PLATE
DETAIL



PLATE WASHER
DETAIL

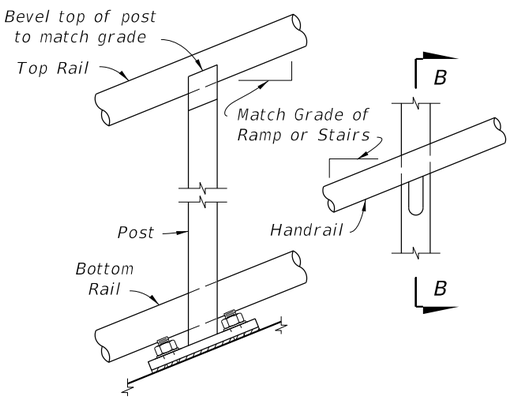

DETAIL "B" - RAIL AND HANDRAIL
(Showing Sloped Condition for Stairs or Ramp)

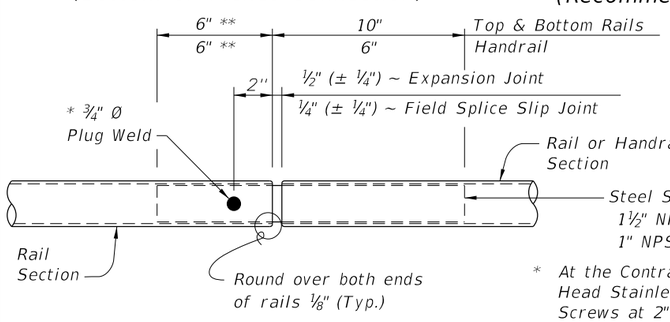

DETAIL "D" - EXPANSION JOINT
(FIELD SPLICE SLIP JOINT SIMILAR)

* ¾" Ø Plug Weld. Set screws must be set flush against the outside face of rail and underside of handrail.

** Embedded length may be 4" for plug welded connection. Maintain venting of ends of pickets during galvanizing.

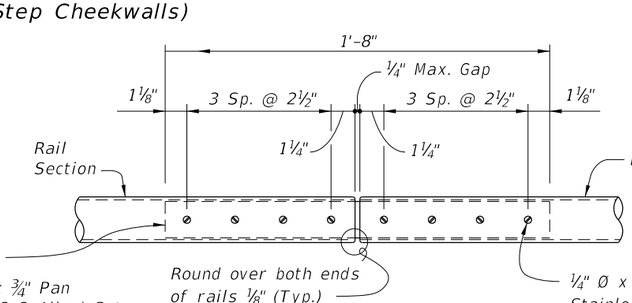

DETAIL "E" - CONTINUITY
FIELD SPLICE

¼" Ø x ¾" Pan Head Stainless Steel (Type 316 or 18-8 Alloy) Set Screws. Set Screws must penetrate the full wall thickness of the inner sleeve and be set flush against the outside face of rail. (Typ.)



SLEEVE MODIFICATION FOR
TYPE B CONNECTION
(Top Rail Sleeve Shown, Bottom Rail Sleeve Similar)

CROSS REFERENCE:
For locations of Details "C", "D" and "E", see Sheet 2 of 5.

REVISIONS

DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION
01/01/10	SJN	Added (± 4") tolerance to End Hoop length in Detail "C".			
07/01/10	SJN	Added Type B connection for pickets.			

STATE OF FLORIDA DEPARTMENT OF TRANSPORTATION

2010 Interim Design Standard

STEEL PEDESTRIAN/BICYCLE PICKET RAILING

Interim Date 07/01/10

Sheet No. 4 of 5

Index No. 850

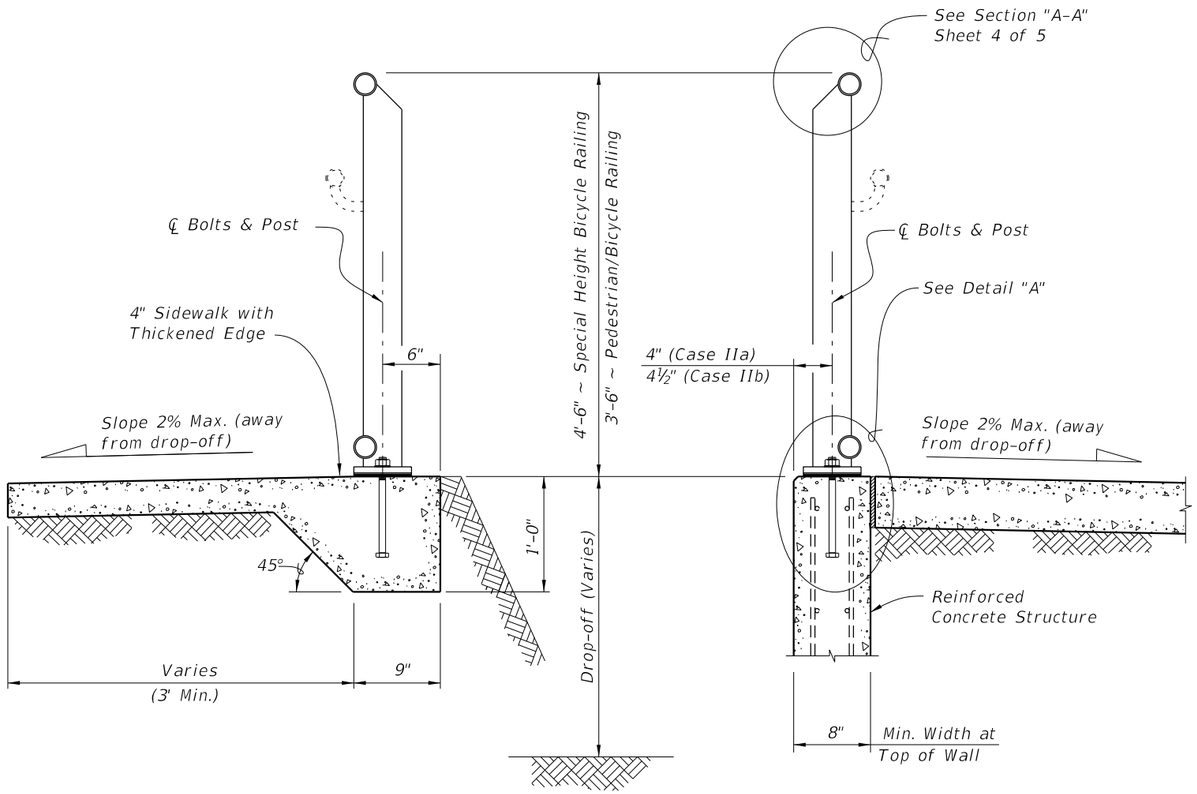

TYPICAL SECTION ON CONCRETE SIDEWALK
(Case I)

TYPICAL SECTION ON RETAINING WALL
(Case II)

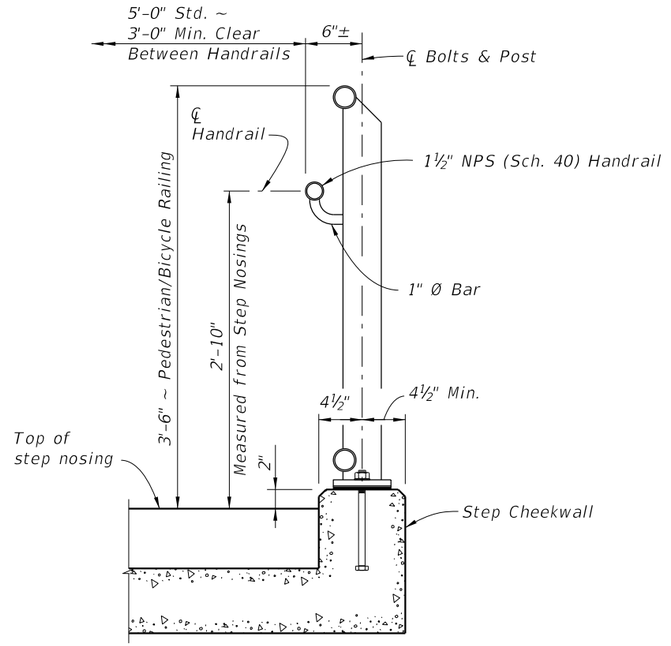

TYPICAL SECTION ON STEPS & STAIRS
(Case III)

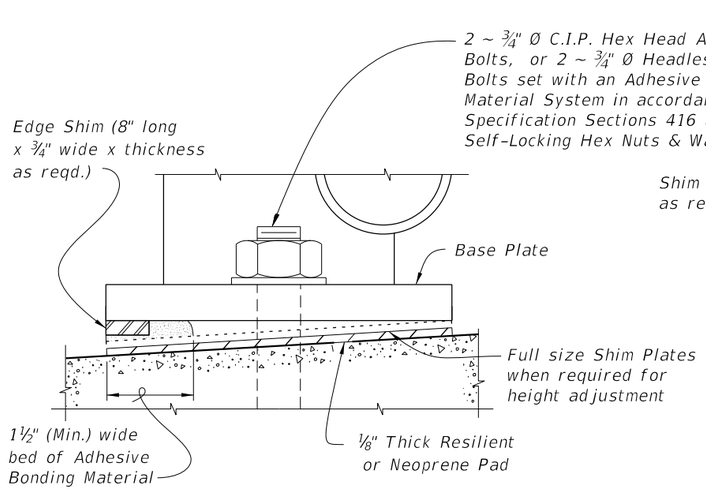

DETAIL "F" (OPTIONAL SHIMMING DETAIL
FOR CROSS SLOPE CORRECTION)
(Used in lieu of Beveled Shim Plates)

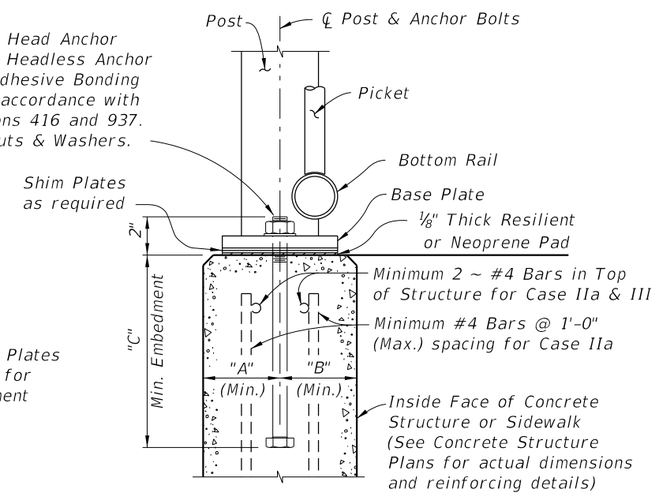

DETAIL "A"
(Cast-In-Place Anchor Bolts shown,
Adhesive Anchors similar)

ANCHOR BOLT TABLE

CASE	STRUCTURE TYPE	DIMENSIONS			ANCHOR LENGTH		ANCHOR SIZE
		"A" Edge Dist.	"B" Edge Dist.	"C" Embedment	C.I.P Hex Head Bolt	Adhesive Anchor	
I	Unreinforced Concrete	6"	1'-2"	9"	10½"	11"	¾" Ø
IIa	Reinforced Concrete	4"	4"	9"	10½"	11"	¾" Ø
IIb	Gravity Wall Index No. 520	4½"	3½" @ top	1'-0" *	1'-1½"	1'-2"	¾" Ø
III	Step Cheekwall	4½"	4½"	9"	10½"	11"	¾" Ø

* Embedment length "C" may be reduced to 9" for the 3'-6" height railings for Case IIb, when the post spacing does not exceed 5'-0".

REVISIONS

DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION
07/01/10	SJN	Changed 2'-10" dimension to mid-height of handrail.			

2010 Interim Design Standard

STEEL PEDESTRIAN/BICYCLE PICKET RAILING

Interim Date 07/01/10

Sheet No. 5 of 5

Index No. 850