

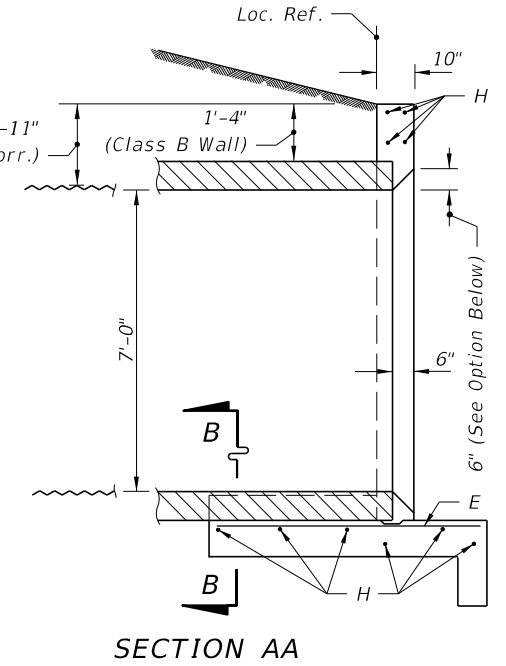


C:\projects\standards\roadway\0200-s\02055-01.dgn  
r0960rh  
11:39:50 AM  
12/30/2011

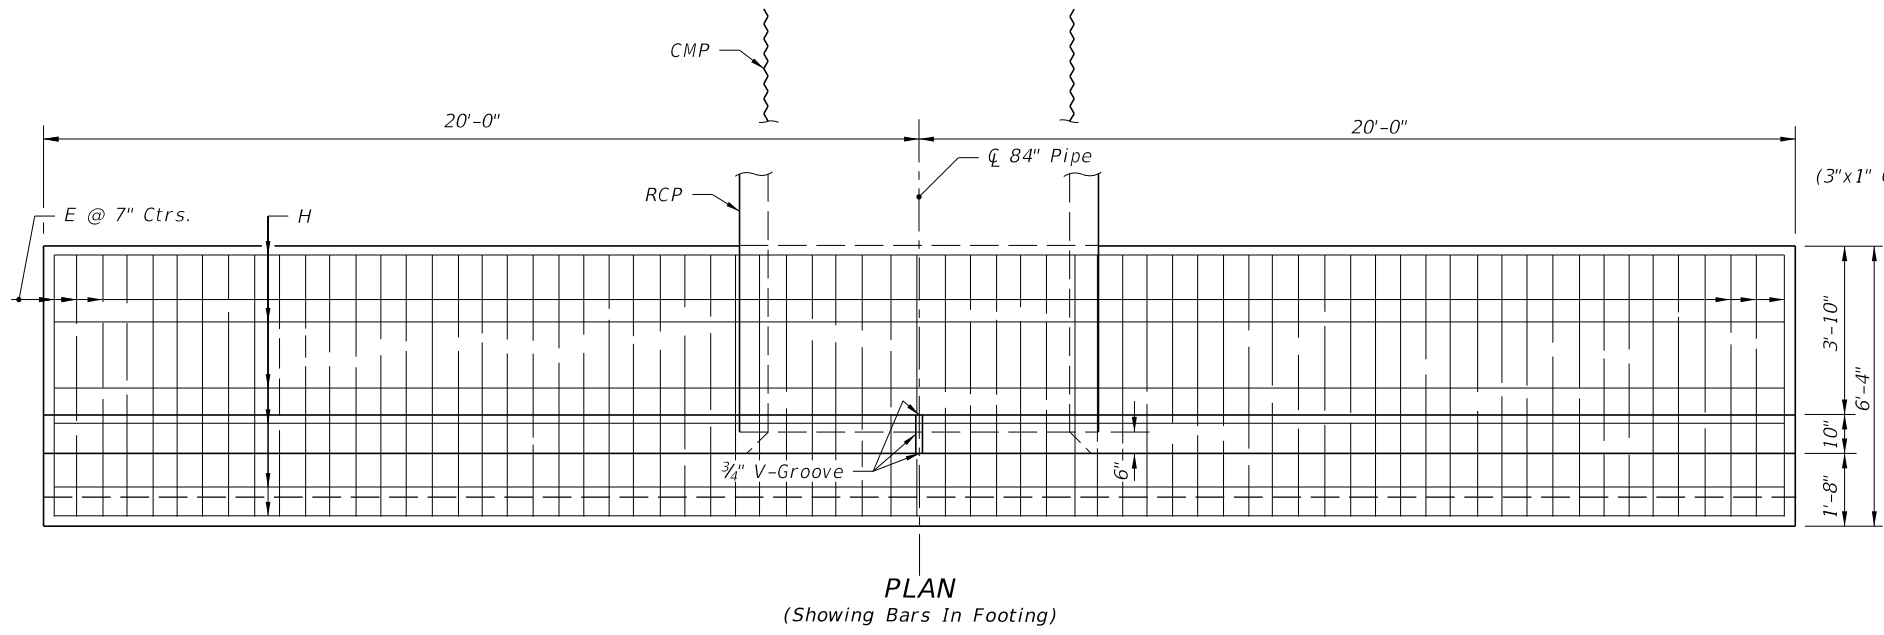

BILL OF REINFORCING STEEL			
MARK	SIZE	NO. REQD.	LENGTH
E	6	69	6'-0"
H	4	20	39'-8"
V <sub>1</sub>	6	26	12'-4"
V <sub>2</sub>	6	26	7'-10"
V <sub>3</sub>	4	22	10'-2"
V <sub>4</sub>	4	4	2'-0"




**BENDING DIAGRAM**

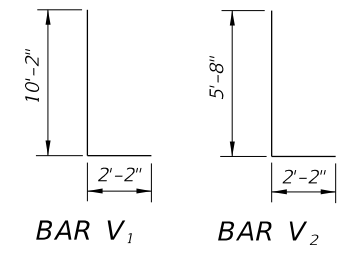

NOTE: All bar dimensions are out to out


**ESTIMATED QUANTITIES**

ITEM	UNIT	RCP	CMP
Class II Concrete	Cu. Yd.	20.0	20.2
Reinforcing Steel	Lb.	2,095	2,095

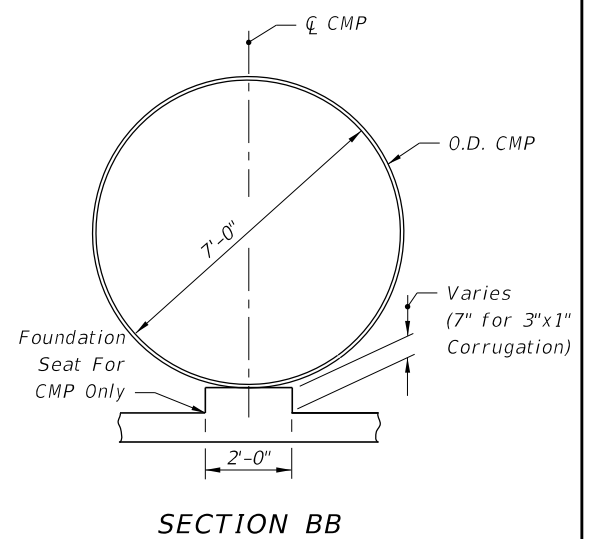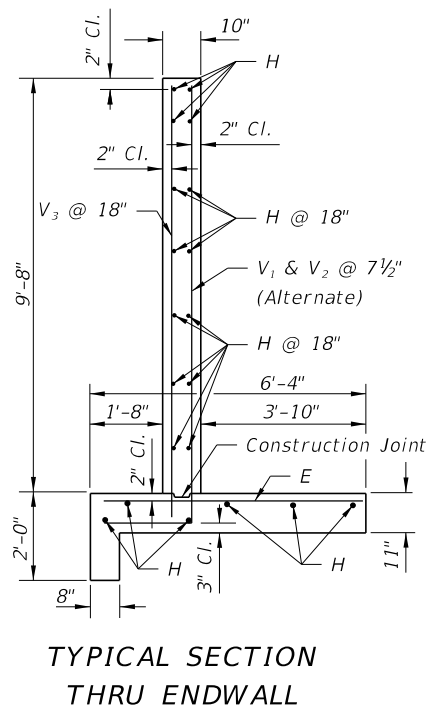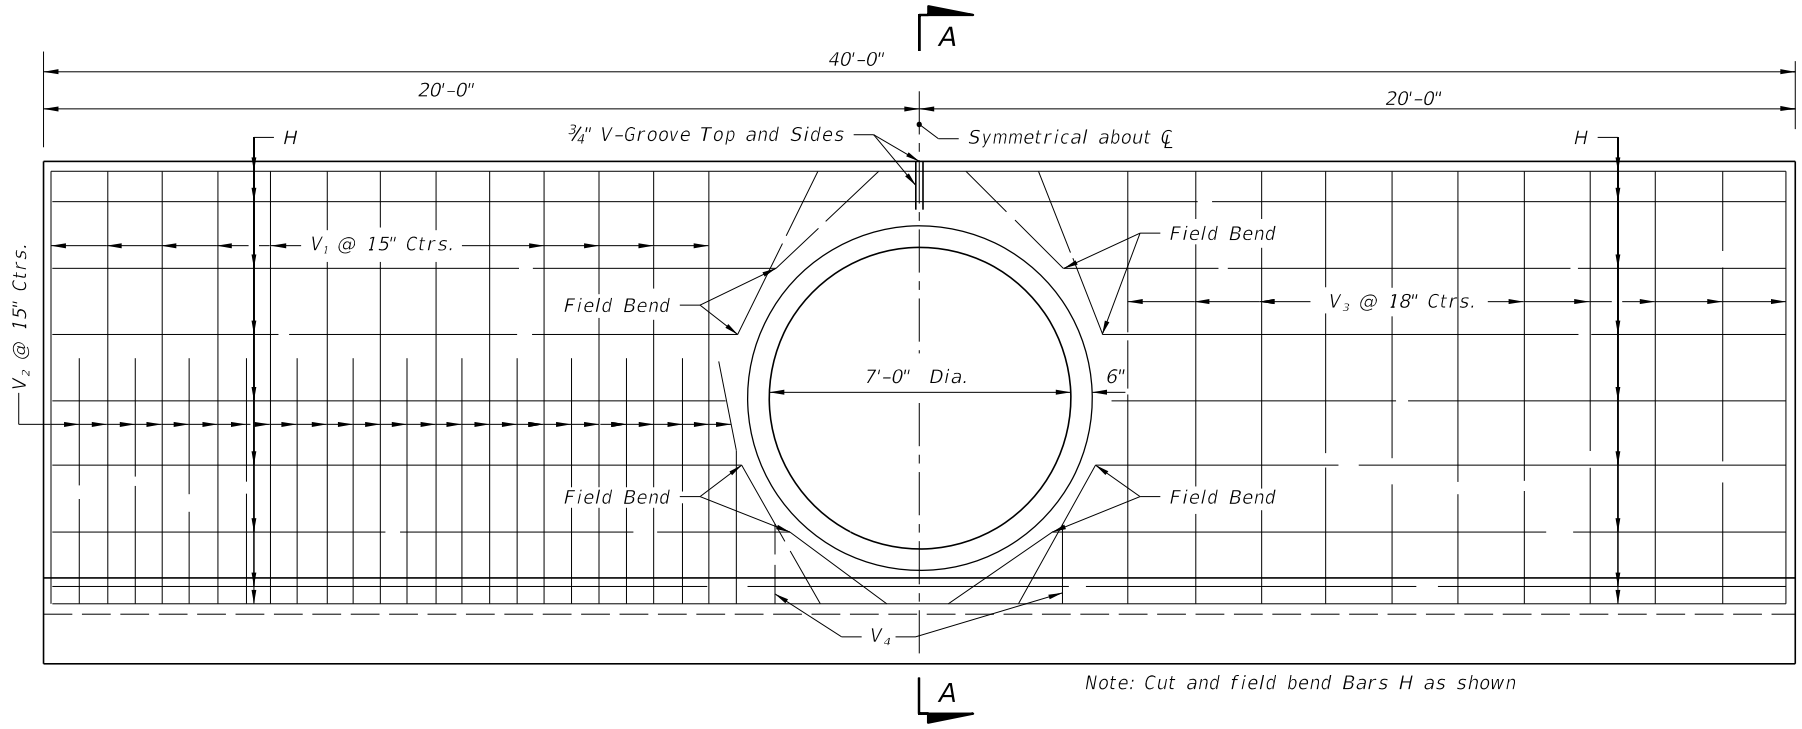

**GENERAL NOTES**

1. Straight concrete endwalls are intended for use outside the clear zone.
2. Endwalls may be cast-in-place or precast construction. Cast-in-place endwalls shall conform to the details on this index, design specifications AASHTO 1989. Precast construction which adheres to this Index, including any additional reinforcement required for handling which shall be determined by the Contractor or supplier, does not require additional approvals. Deviations from this Index, for precast units, shall require the approval of the State Drainage Engineer prior to construction. For precast construction, see Index No. 201 for opening and grouting details.
3. Reinforcing steel shall be either Grade 40 or 60.
4. Concrete shall be Class II, except ASTM C478 (4000 psi) concrete may be substituted for precast items manufactured in plants meeting the requirements of Section 449 of the Specifications.
5. Chamfer: All exposed edges and corners to be chamfered 3/4" unless otherwise shown.
6. That portion of corrugated metal pipe in direct contact with the concrete slab and extending 12" beyond shall have a continuous bituminous coating of 0.004" minimum thickness applied prior to placing of the concrete.
7. Sodding shall be in accordance with Index No. 281 and paid for under the contract unit price for Performance Turf, SY.
8. Basis of payment for either cast-in-place or precast construction shall be the estimated quantities tabulated on the Index. Concrete and reinforcing steel shall be paid for under the contract unit prices for Class II Concrete (Endwalls), CY and Reinforcing Steel (Roadway), LB.



LAST REVISION	DESCRIPTION:	<b>FDOT DESIGN STANDARDS</b> FY 2012/2013	<b>STRAIGHT CONCRETE ENDWALLS</b> <b>SINGLE 84" PIPE</b>	INDEX NO.	SHEET NO.
07/01/09				255	1