NOTES

- A. DESIGN SPECIFICATIONS:
- 1. AASHTO LRFD Specifications for Highway Bridges.
- 2. FDOT Structures Manual (Current Edition).
- 3. Florida Department of Transportation's Plans Preparation Manual, Volume I (Current Edition).
- B. DESIGN CRITERIA:
- The Precast Sound Barriers are pre-designed based on criteria in the Structures Manual, Volume I.
- C. CONCRETE AND GROUT:
- 1. Concrete Class and Compressive Strength:
- a. Cast-In-Place Collars: Class IV (f'c = 5500 psi)
- b. Precast Panels, Collars and Post Caps: Class IV (f'c = 5500 psi)
- c. Posts: Class IV (f'c = 5500 psi)
- 2. Grout for Auger Cast Piles:
- a. Maximum Working Compressive Strength = 2200 psi b. Minimum 28 Day Strength = 5500 psi
- 3. Minimum Compressive Strength for Form Removal and Handling of Posts and Panels:
- a. 2,500 psi for horizontally cast post and panels.
- b. 2,000 psi for vertically cast panels or when tilt-up form tables are used for horizontally cast panels.
- D. REINFORCING STEEL:
- 1. In addition to the requirements of Specification Section 415, tie post and pile stirrups at the following locations as a minimum:
- a. Post Stirrups Tie at all four corner bars and at every third interior bar intersection.
- b. Pile Stirrups Tie to the main vertical reinforcing at alternate intersections for circular configurations and for rectangular configurations at the four corners and at every third interior bar intersection.
- E. SURFACE FINISHES AND AESTHETIC REQUIREMENTS:
- 1. See Sound Barrier Data Tables in the Plans for project requirements.

F PILING

Construct Auger Cast Piling in accordance with the Plans and Specification Section 455.

G. UTILITIES:

Field verify the locations of all overhead and underground utilities shown in the Wall Control Drawings.

H. NEOPRENE PADS AND RESILIENT PADS:

- 1. Neoprene Pads for Panel Bearing Points Between the Stacked Panels: The Neoprene pads for the panel bearing points shall be Plain Pads, Grade 50 durometer hardness in accordance with Specifications Sections 932-2.
- 2. Neoprene Pads for Collar Bearing Points:

Neoprene Pads shall be Fiber Reinforced Pads, with a durometer hardness between Grade 50 and Grade 80, in accordance with Specification Section 932-2. Plain Pads may be substituted for Fiber Reinforced Pads when sufficient bearing area is available on the concrete collar, as follows: a. 10' post spacing: 4" x 4" x 1/2" Plain Pads, Grade 50 durometer hardness.

- b. 20' post spacing and < 18' wall height: $4'' \times 4'' \times \frac{1}{2}''$ Plain Pads, Grade 50 durometer hardness.
- c. 20' post spacing and \geq 18' wall height: 4" x 5" x $\frac{1}{2}$ " Plain Pads, Grade 50 durometer hardness.

I. CASTING TOLERANCES:

- 1. Overall Height & Width: $+/-\frac{1}{4}$ "
- 2. Thickness: +/- 1/4"
- 3. Plane of side mold: $+/-\frac{1}{16}$ "
- 4. Openings: $+/-\frac{1}{2}$ "
- 5. Out of Square: $\frac{1}{8}$ " per 6 ft., but not more than $\frac{3}{8}$ " total along any side
- 6. Warping: $\frac{1}{16}$ " per foot distance to nearest corner
- 7. Bowing: 1/240 panel dimension
- 8. Surface Smoothness for Type "A" (Smooth) Surface Texture Option: $+/-\frac{V_{16}}{V_{16}}$ " along a 10 ft. straightedge.

J. SOUND BARRIER NOTES:


- 1. Post spacing is measured from centerline to centerline of auger cast piles. For this Index, posts and piles have been designed for a spacing between a minimum of 10 ft and a maximum of 20 ft. If pile spacing is greater than 10 ft, use post design based on a 20 ft spacing.
- 2. Total height of wall ranges from a minimum of 12 ft to a maximum of 22 ft. The height of individual panels must be a maximum of 12 ft and a minimum of 6 ft, except for the following. For total wall heights less than 14 ft high, the minimum bottom panel height is 4 ft when graphics must be accommodated in the upper panel. If a fire hose access hole is required, the bottom panels must be a minimum of 6 feet.
- 3. Where special graphics are required, locate horizontal panel joints outside of graphics. Where possible, hold horizontal panel joints at a constant elevation.

LAST	N	DESCRIPTION.
REVISION	ISIO	

07/01/12


GENERAL NOTES

	INDEX NO.	SHEET NO.
ARRIERS	5200	1

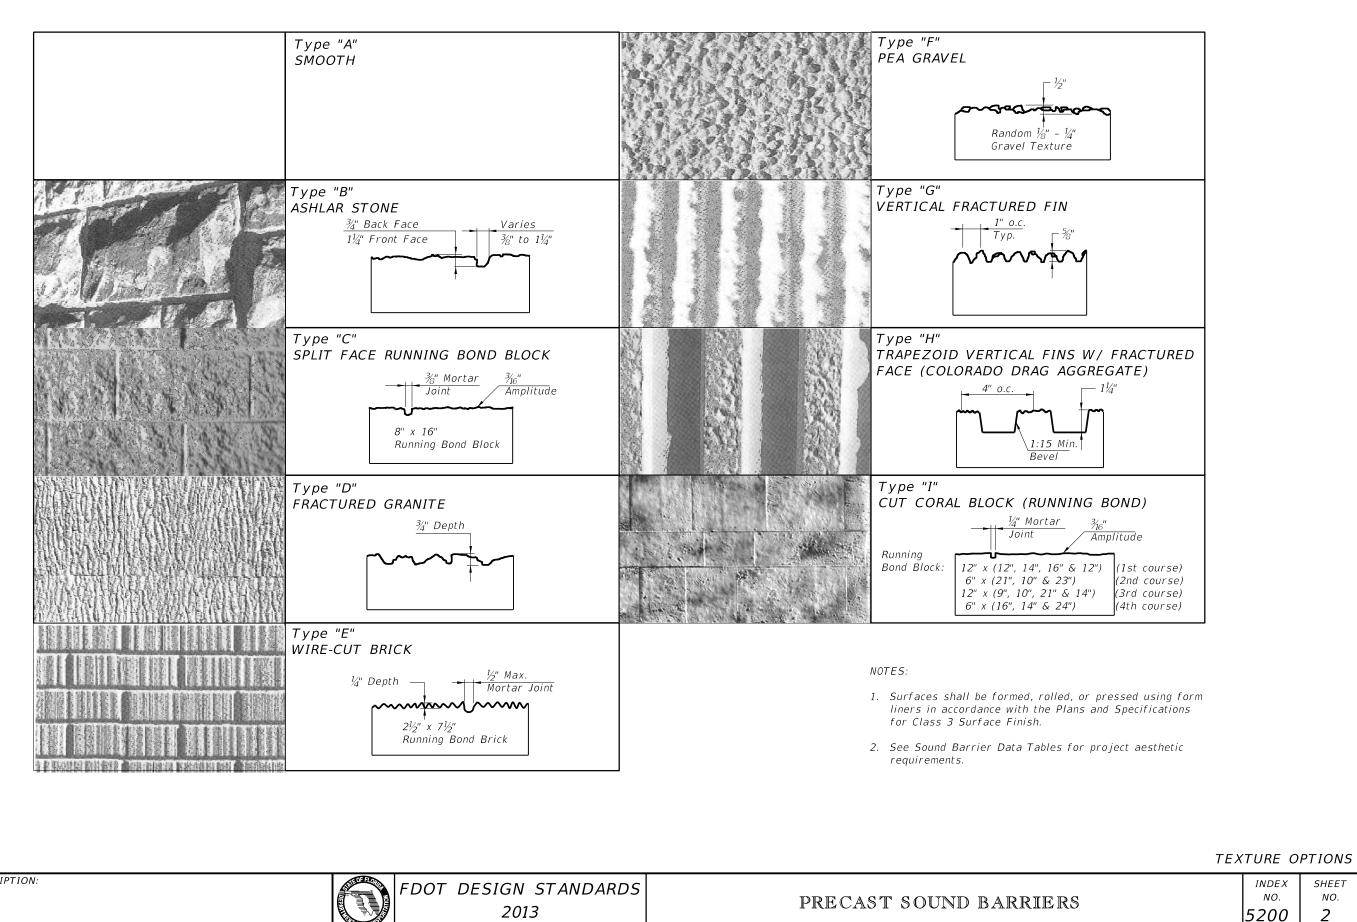

DESCRIPTION: LAST REVISION 07/01/12

FDOT	DESIGN	STANDARDS
	201	3

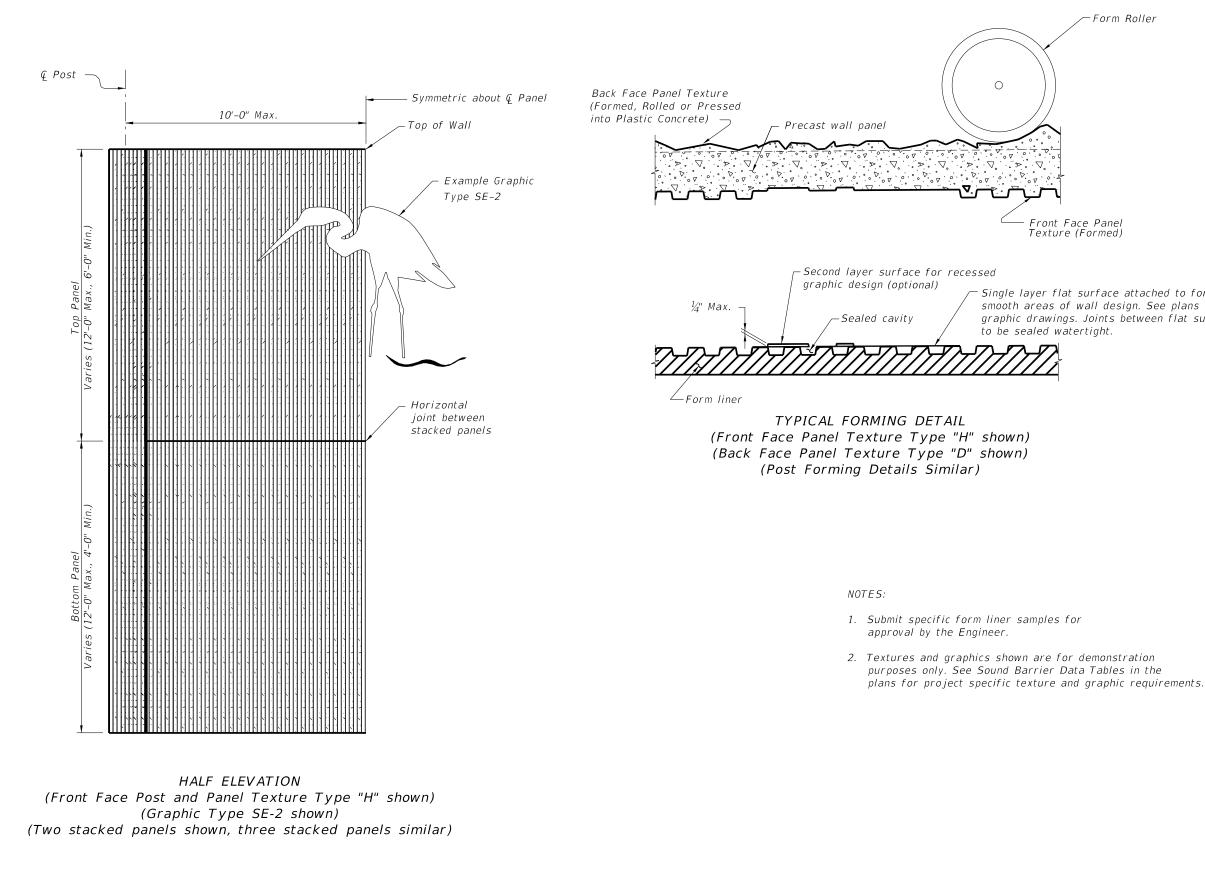


LAST	Ν	DESCRIPTION:
REVISION	SIC	
	/15	
07/01/12	RE	


SUFERIE ST	FDOT	DESIGN	STANDARDS 3
		201	3


PRECAST SOUND BA


Single layer flat surface attached to form liner for casting smooth areas of wall design. See plans for project specific graphic drawings. Joints between flat surface and form liner


	GRAPHICS & TE	XTURE C	DETAILS
RRIERS		^{INDEX} NO. 5200	sнеет NO. З

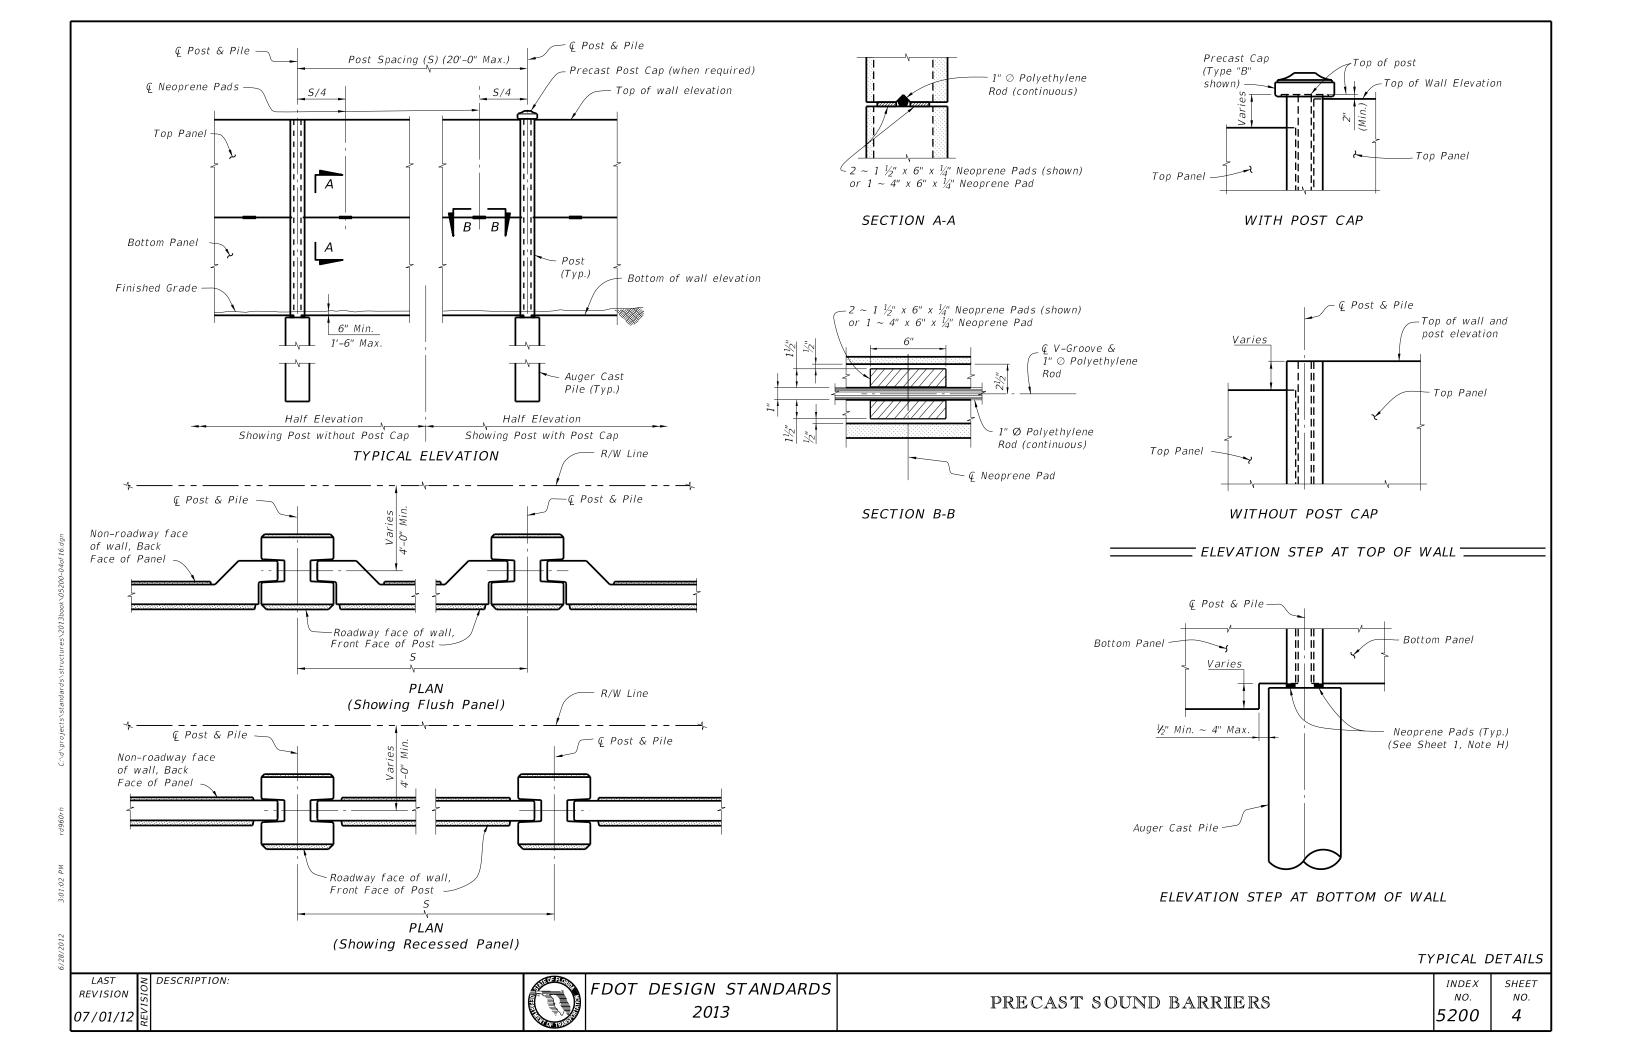


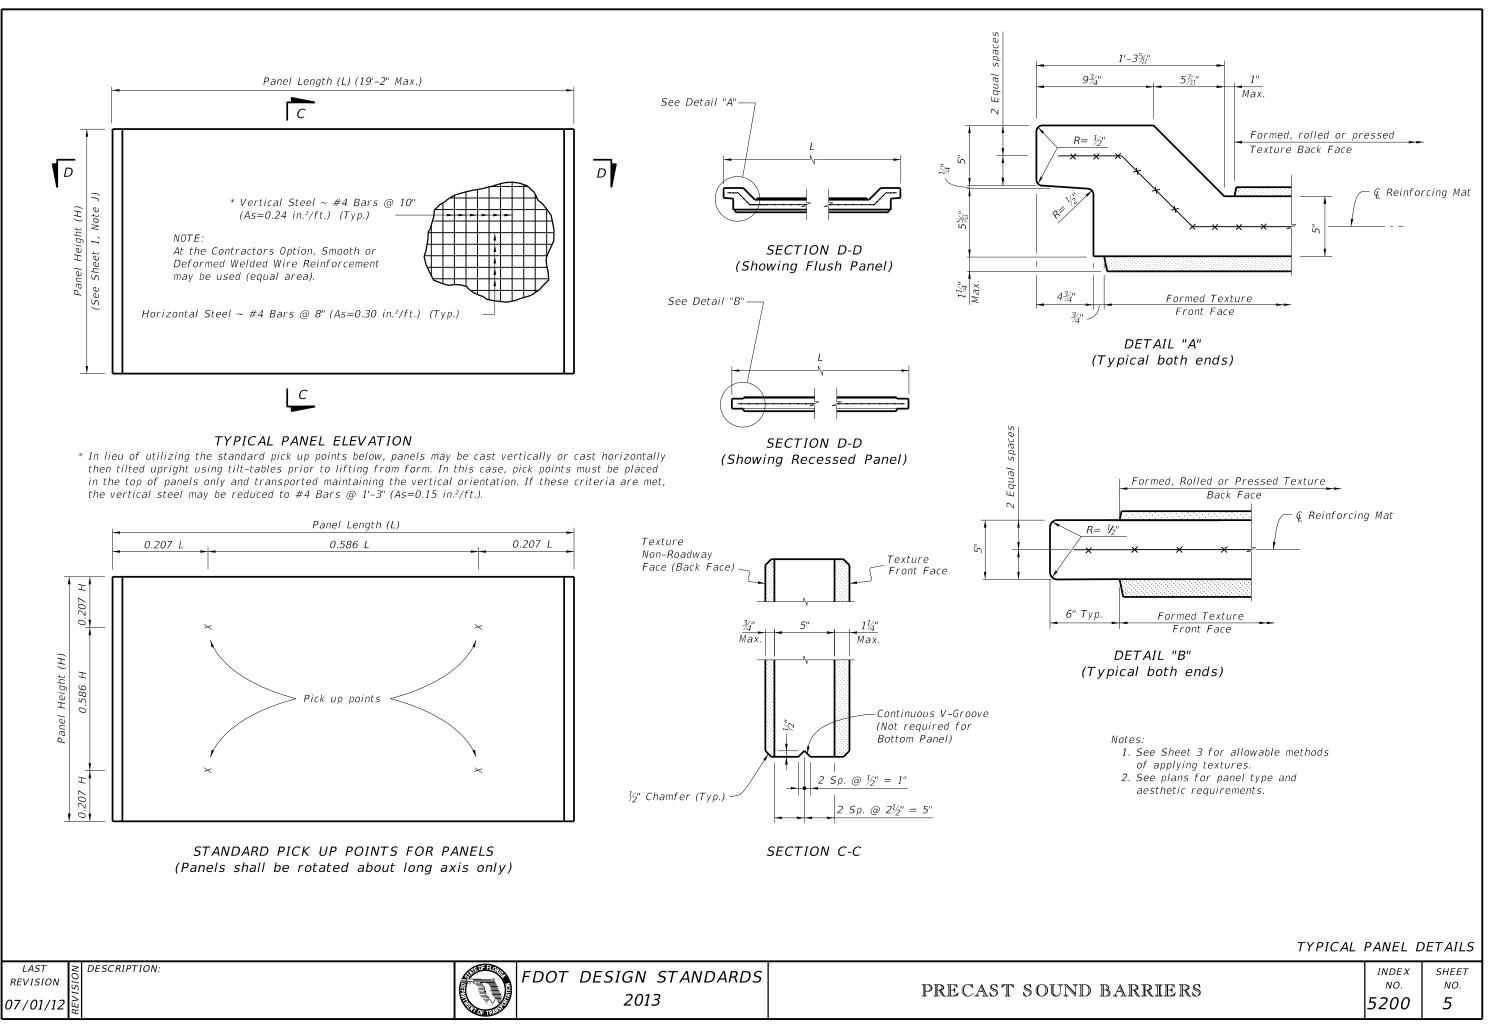


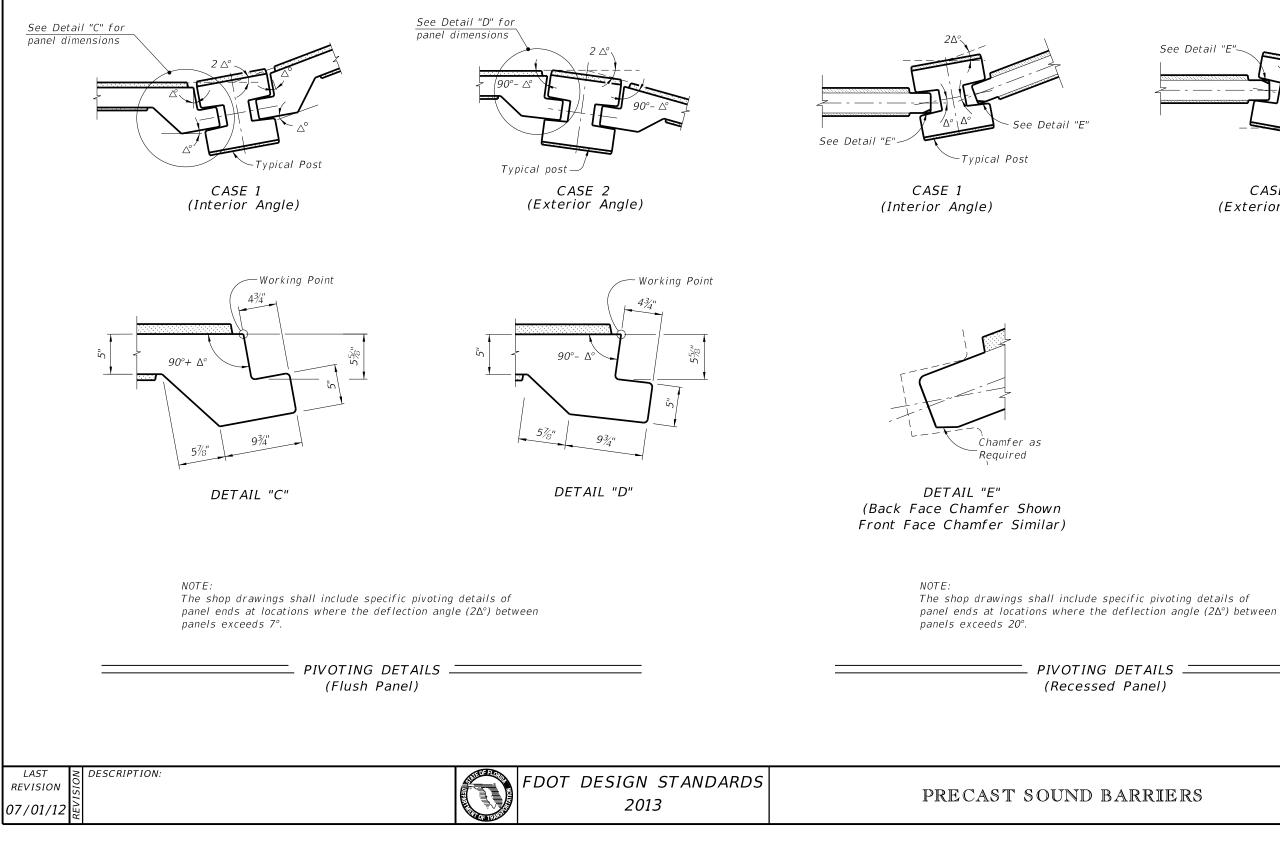


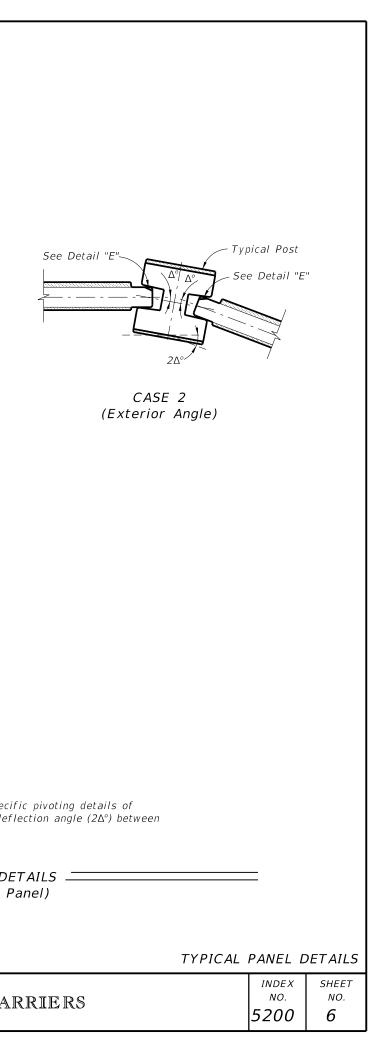


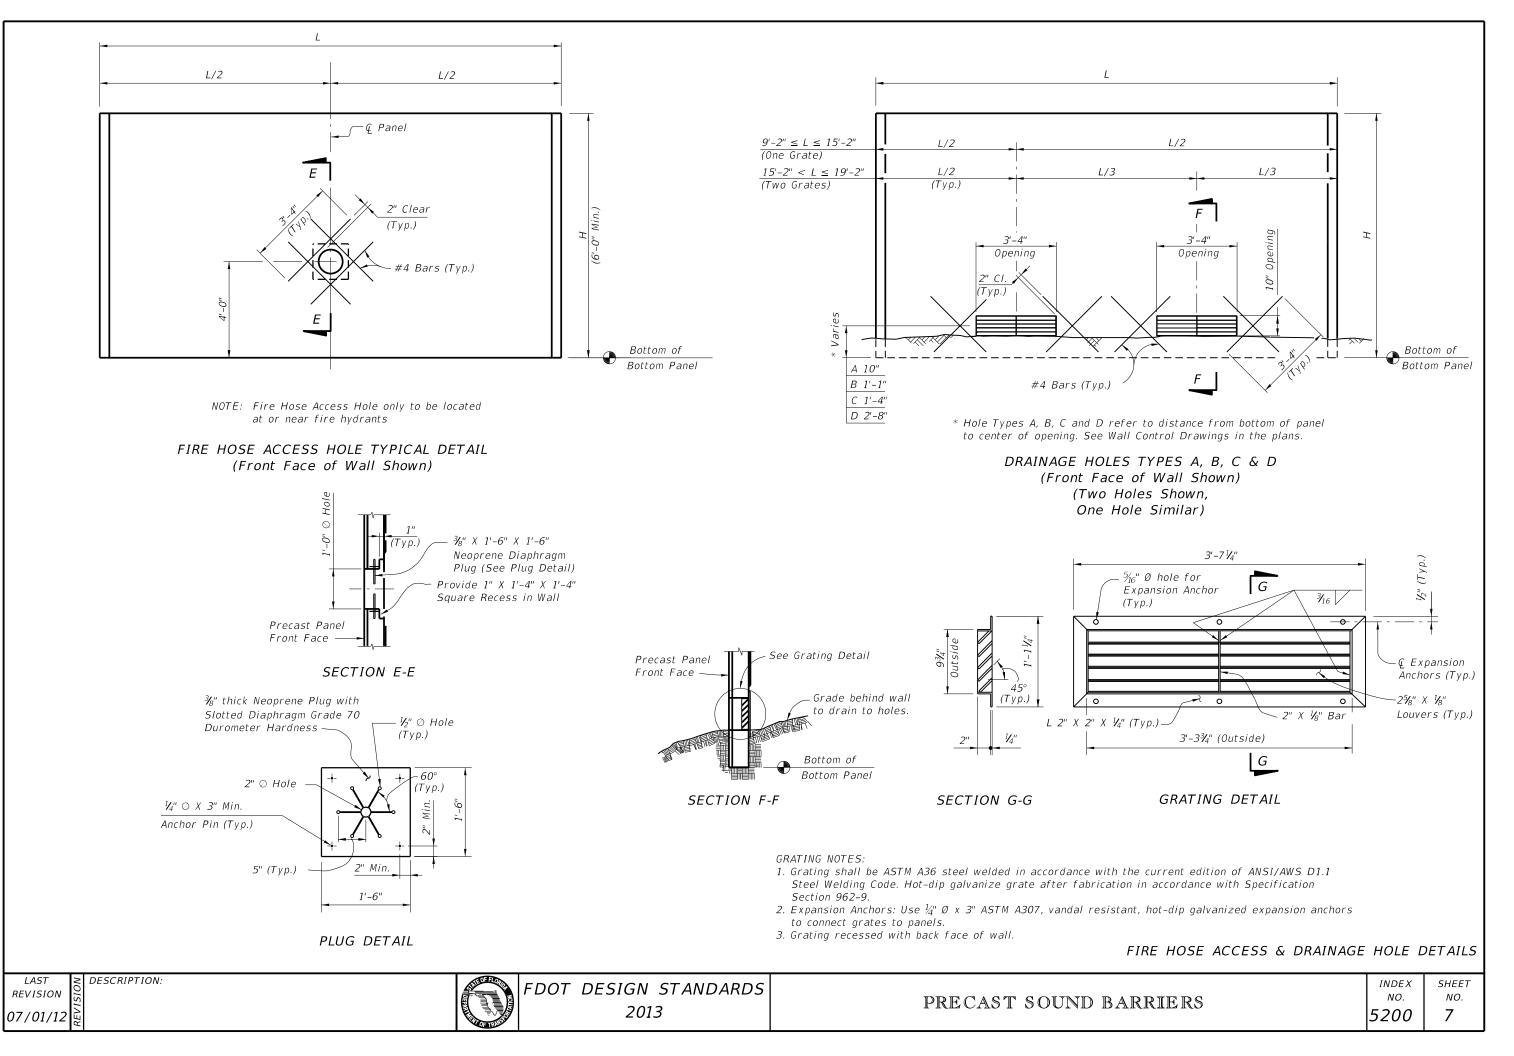

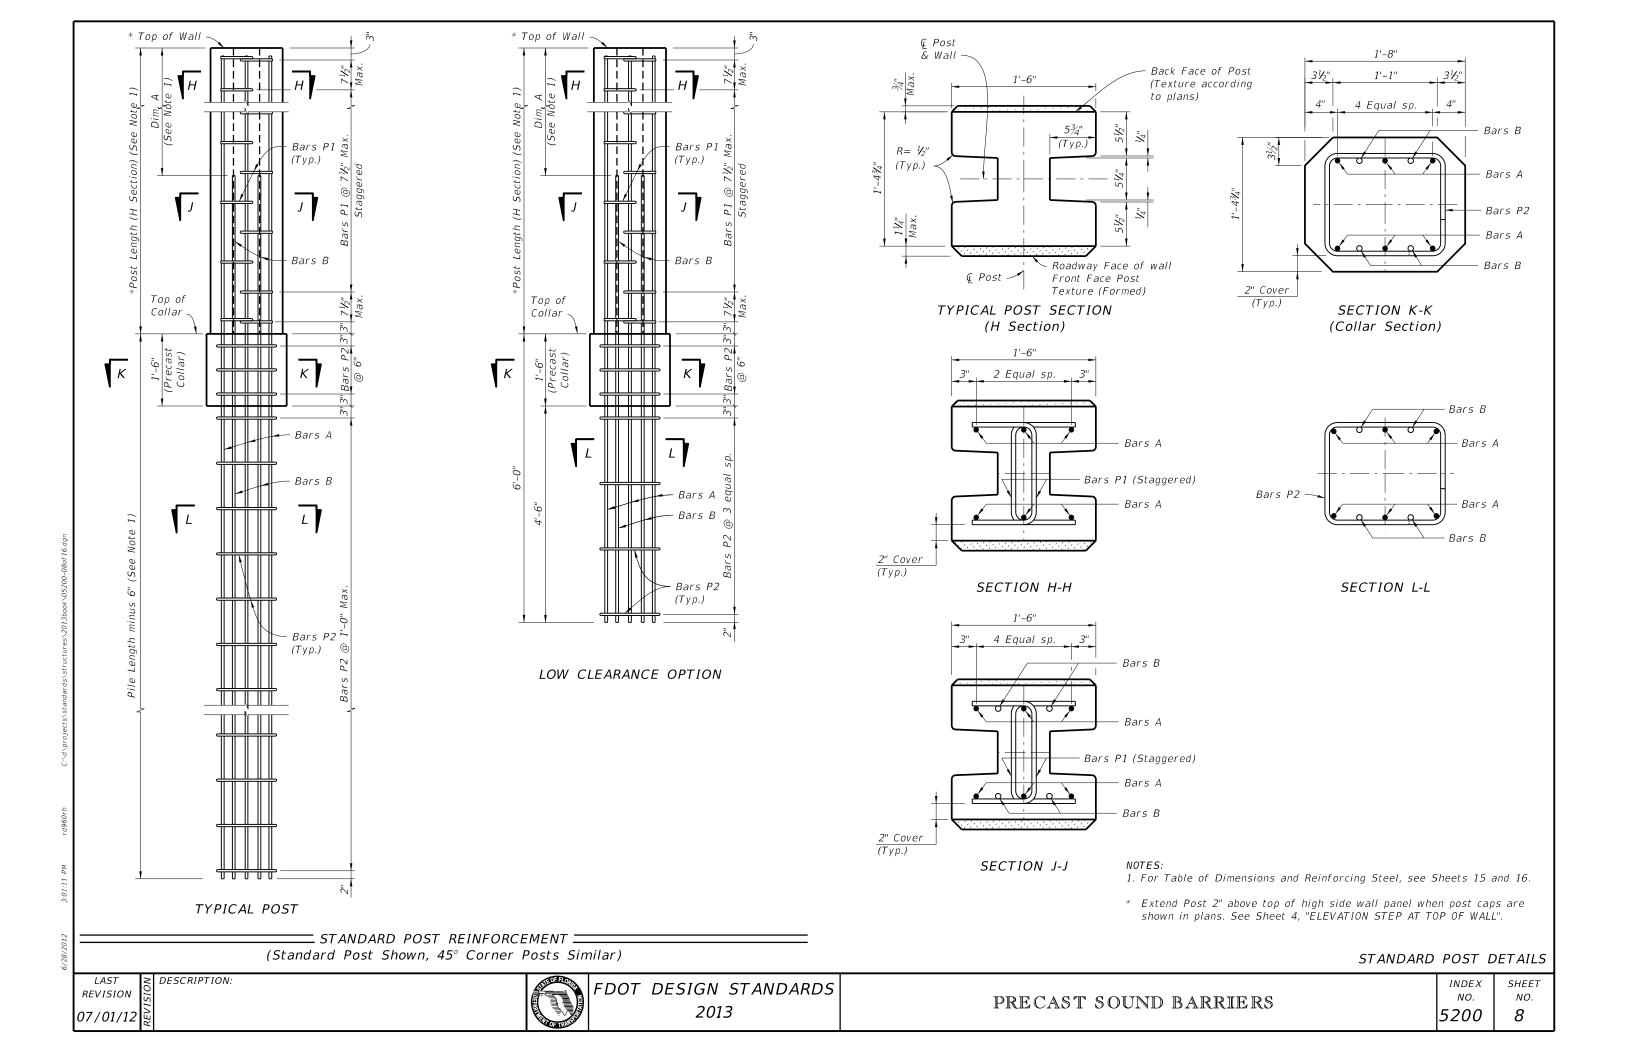


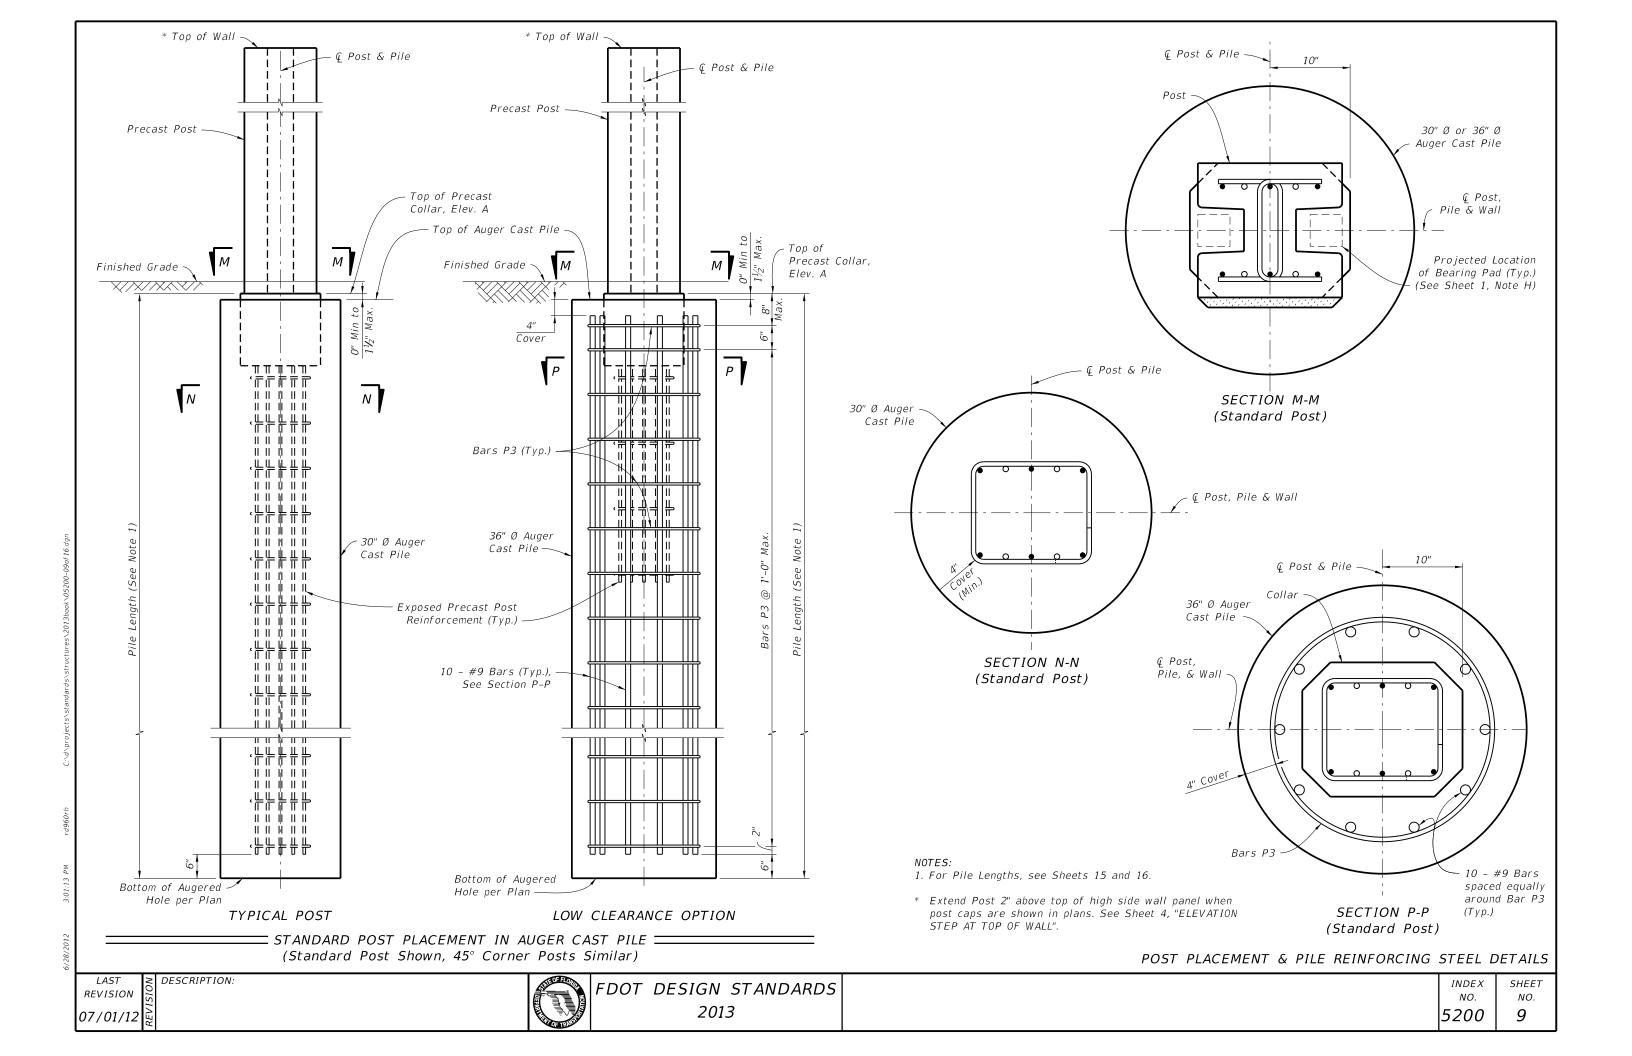


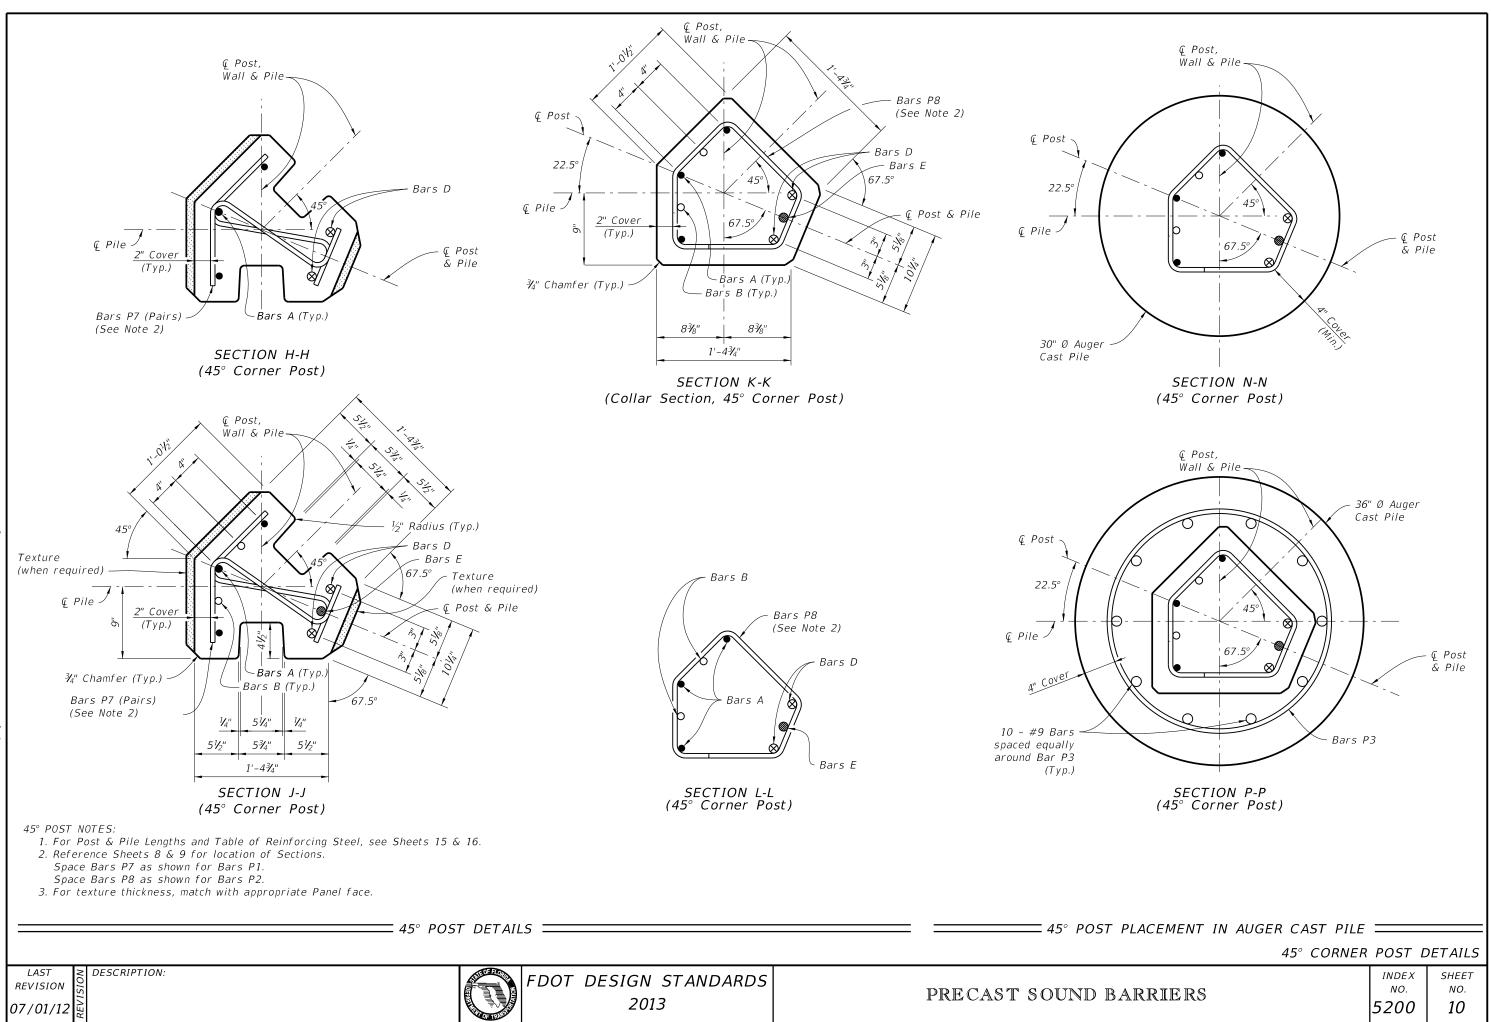


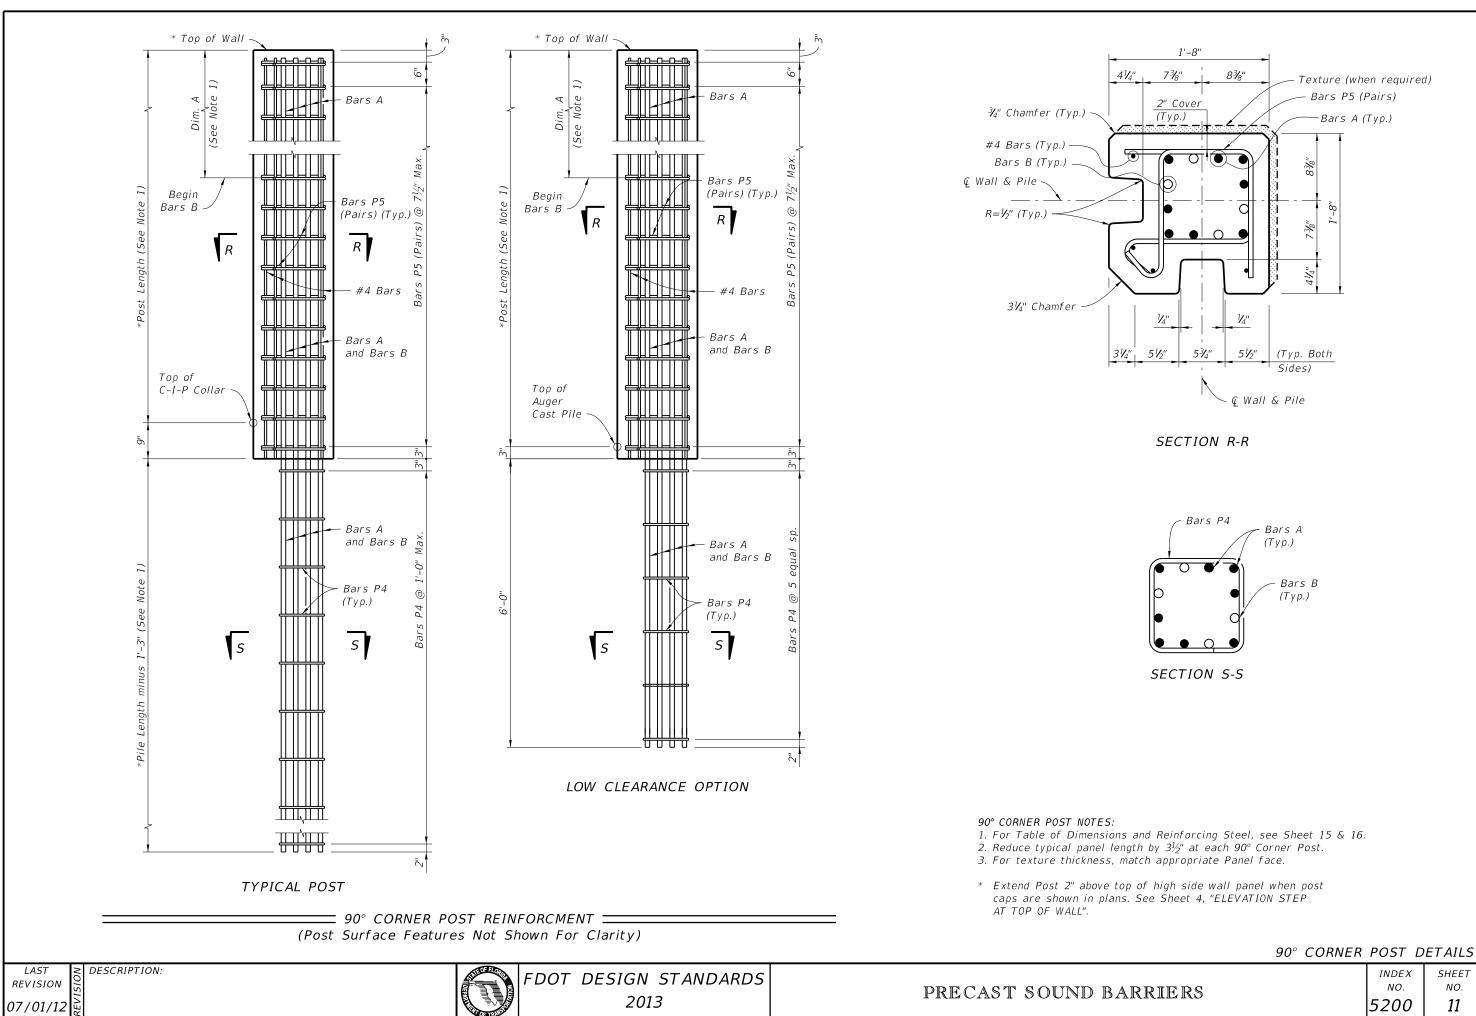


	90° CORNER	POST D	ETAILS
ARRIERS		^{INDEX} NO. 5200	sheet no. 11

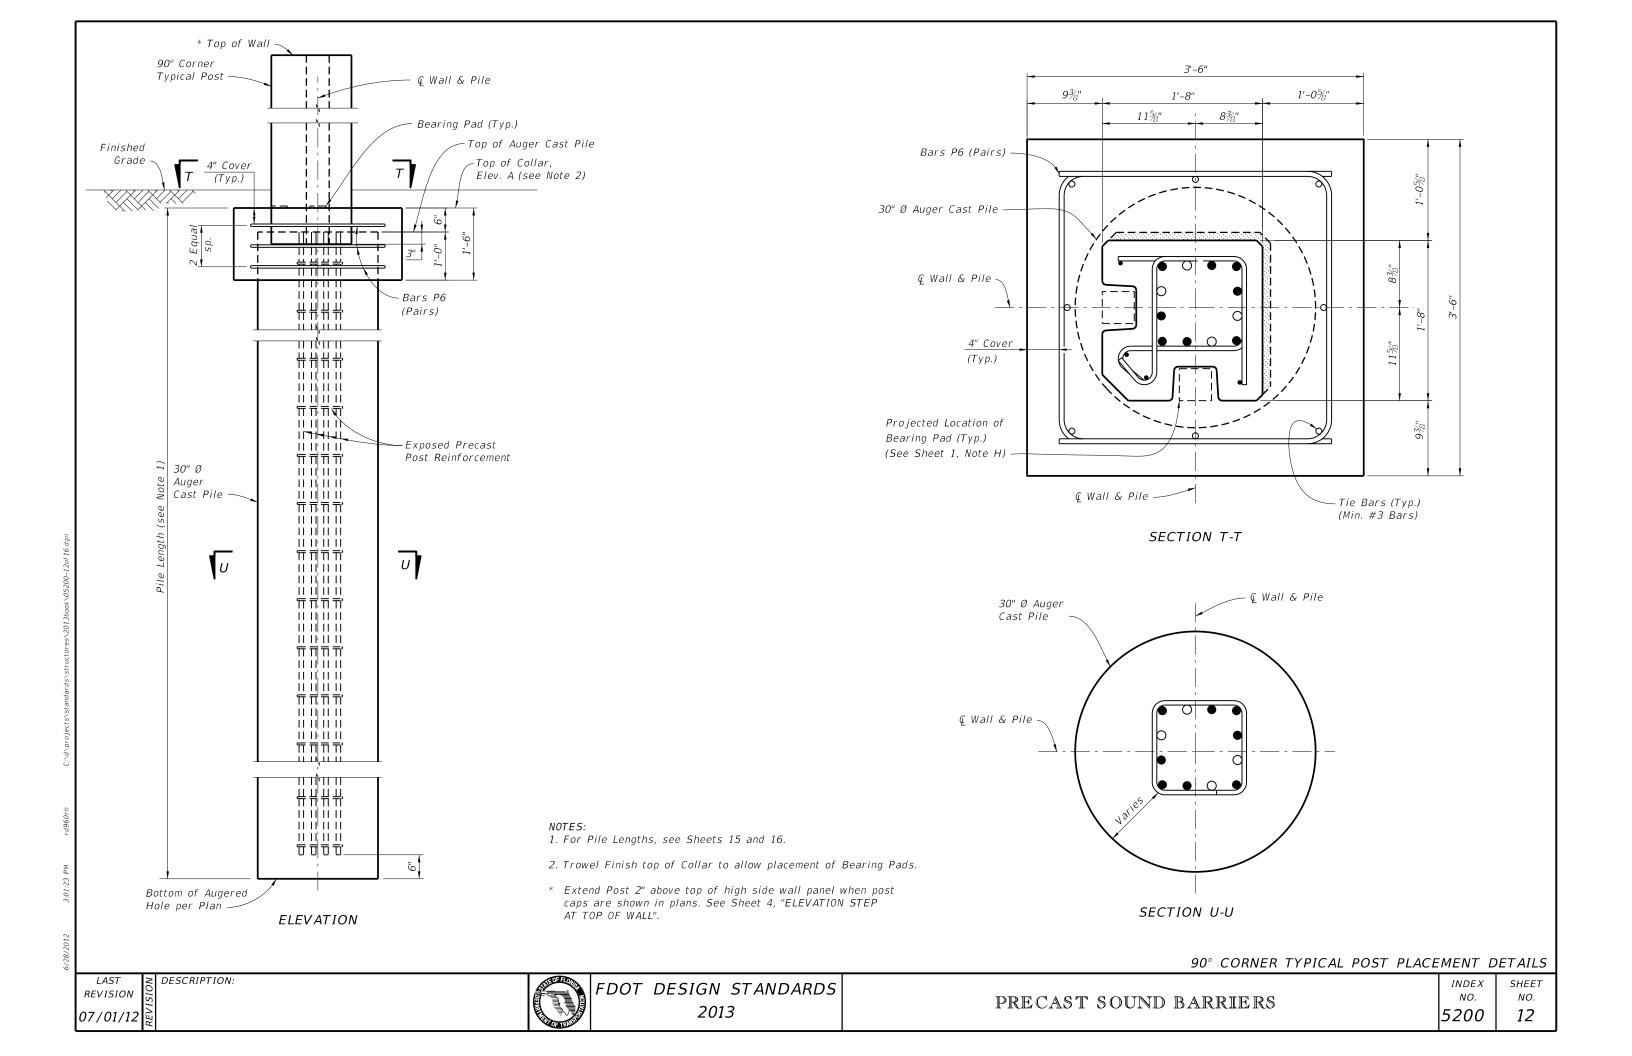

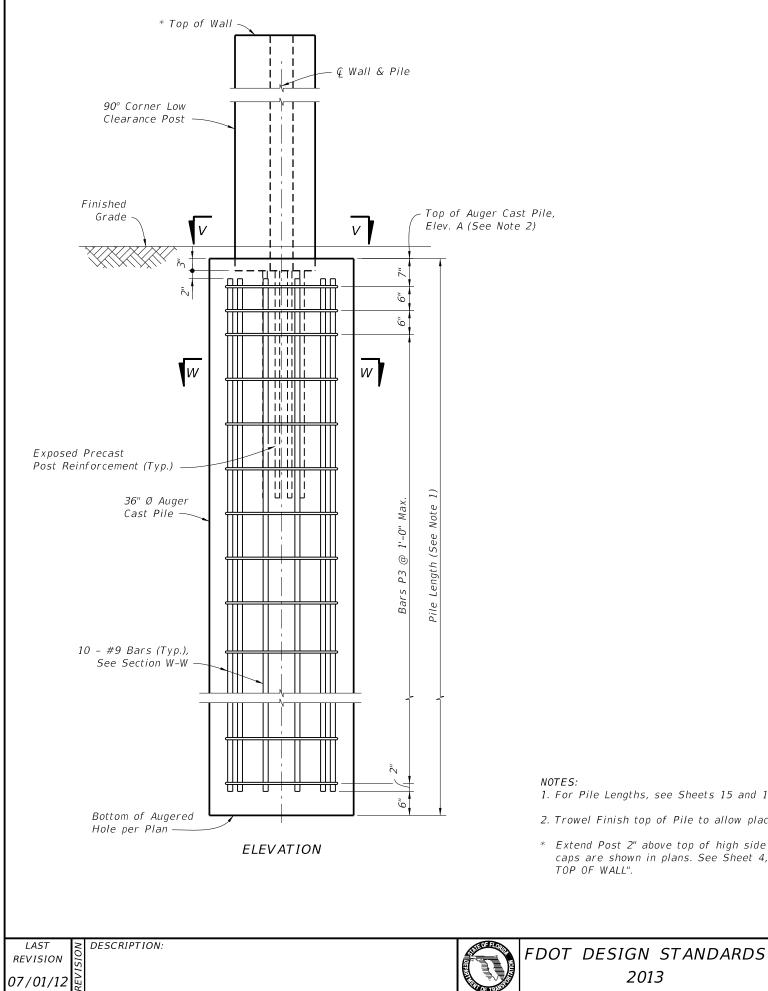


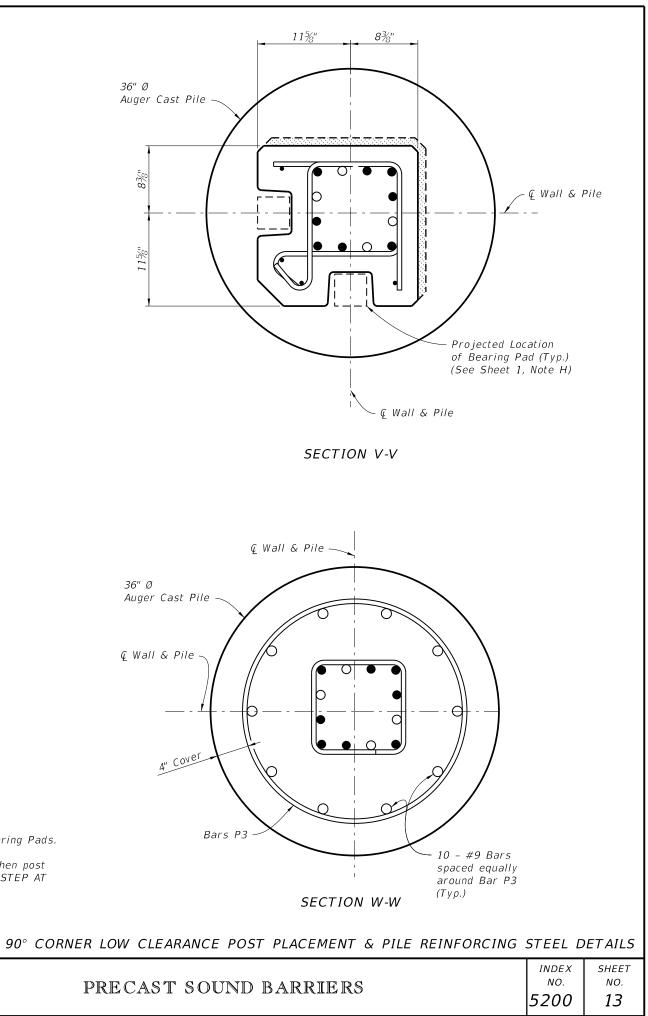

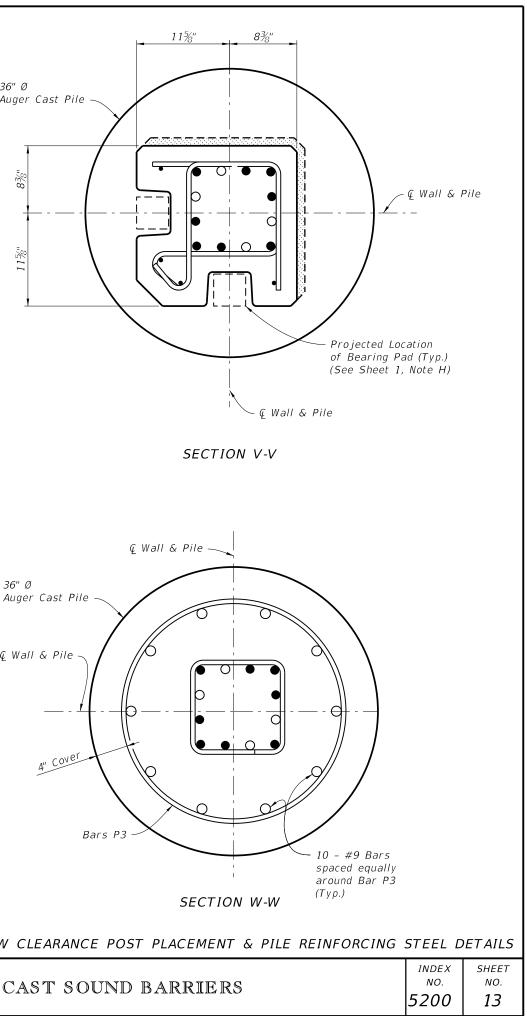

1. For Pile Lengths, see Sheets 15 and 16.

- 2. Trowel Finish top of Pile to allow placement of Bearing Pads.
- * Extend Post 2" above top of high side wall panel when post caps are shown in plans. See Sheet 4, "ELEVATION STEP AT

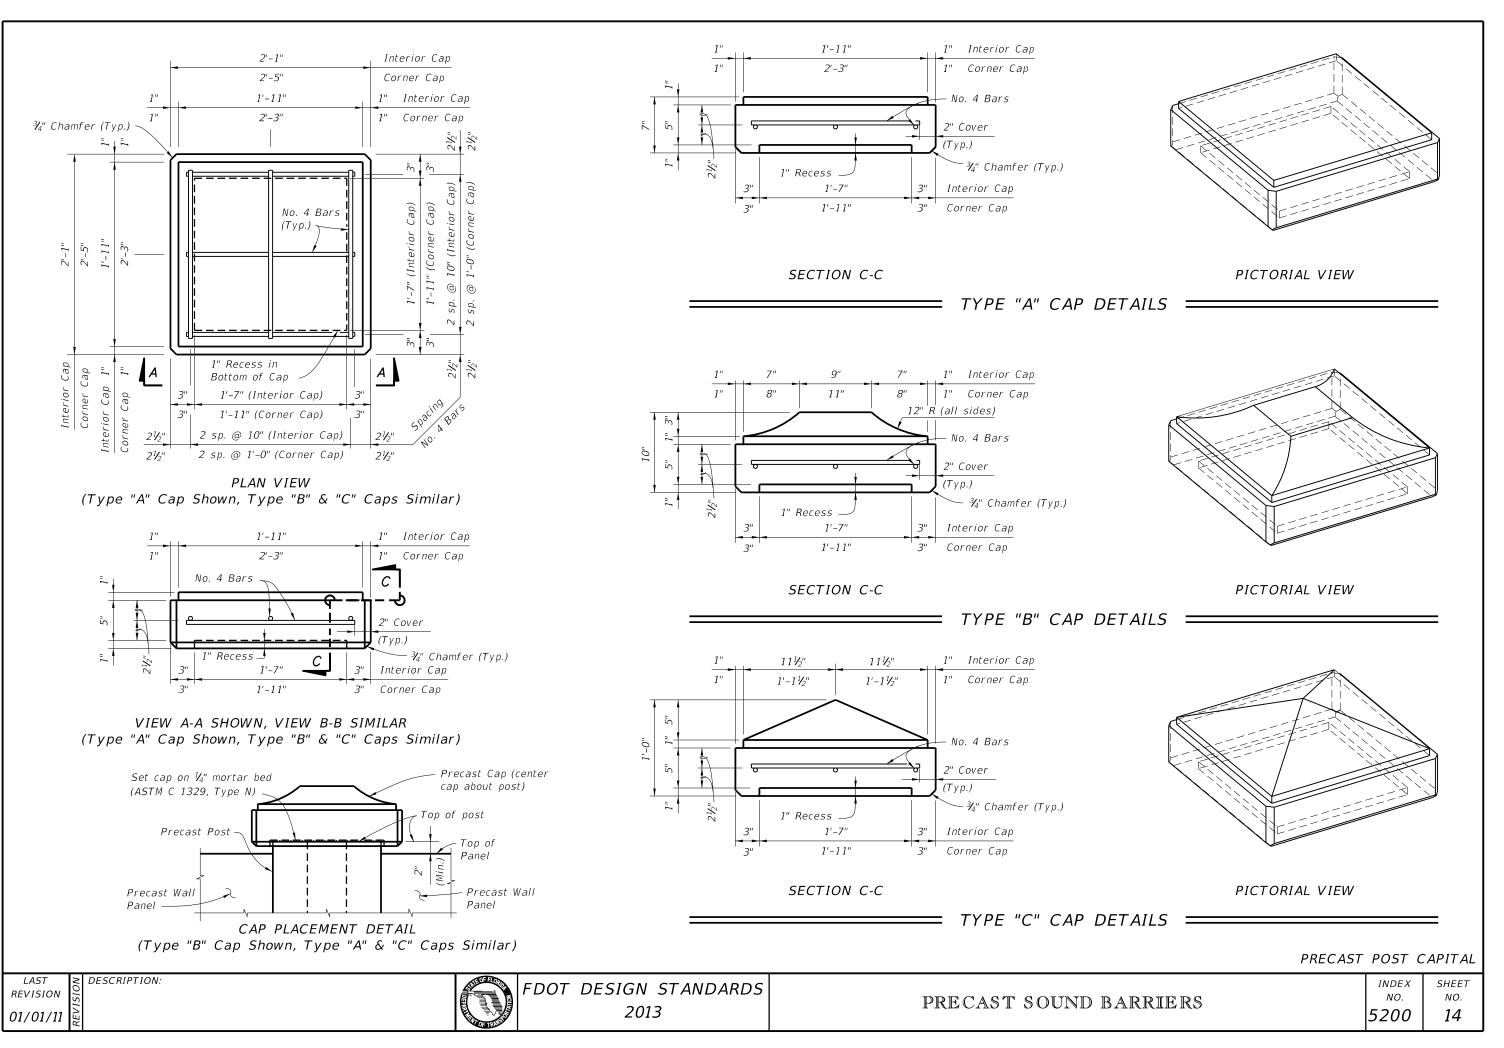

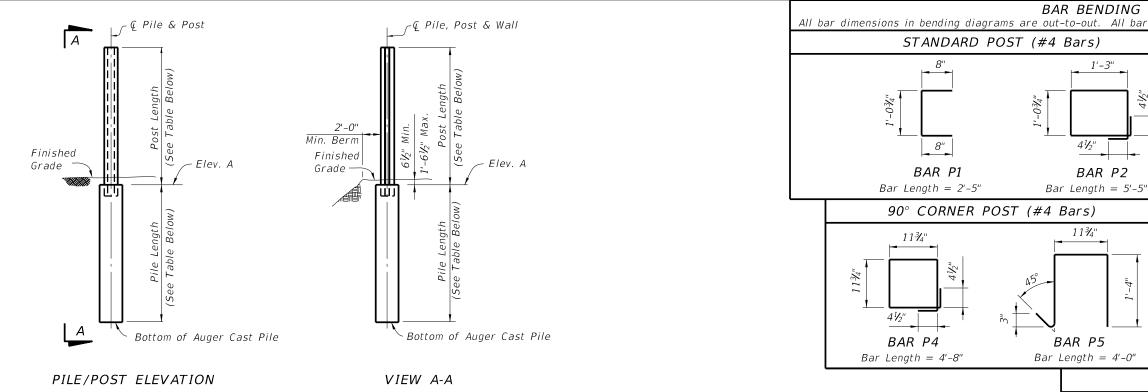


								TABLE	1 - W	IND S	PEED	= 110	МРН										
	POST AND PILE DIMENSIONS													TABLE OF REINFORCING STEEL									
WALL	POST	POST				PILE L	ENGTH				POST REINFORCING												
ΤΥΡΕ	LENGTH WITHOUT CAP	LENGTH WITH CAP	Med.		0 to 40 Granular	- Soil	Lo		4 to 9 anular S	oil			10' POST S	-0" PACING					20' POST S	-0" PACING			
				–0" SPACING	20 POST S	'-0" SPACING		'-0" SPACING		–O" SPACING	BARS A	BARS B		BARS D		ARS E	BARS A		NRS B	BARS D		IRS E	
			30" ⊘	36" ⊘	30" ⊘	36" ⊘	30" ⊘	36" ⊘	30" ⊘	36" ⊘	SIZE	SIZE	DIM 'A'	SIZE	SIZE	DIM 'A'	SIZE	SIZE	DIM 'A'	SIZE	SIZE	DIM 'A'	
A1	12'-0 ¹ ⁄2"	12'-2½"	10	10	14	13	11	10	14	13	#4	#4	11'-5"	#4	#4	11'-5"	#4	#4	8'-5"	#5	#5	9'-2"	
В1	13'-0 ¹ ⁄2"	13'-2 ¹ / ₂ "	11	10	14	13	11	10	15	14	#4	#4	12'-5"	#4	#4	11'-5"	#5	#5	11'-2"	#5	#5	9'-2"	
С1	14'-0½''	14'-2½"	11	10	15	14	12	11	15	14	#4	#4	13'-5"	#4	#4	11'-5"	#5	#5	11'-2"	#6	#6	10'-9"	
D1	15'-0½"	15'-2½"	12	11	16	14	12	11	16	15	#4	#4	13'-5"	#4	#4	11'-5"	#5	#5	11'-2"	#6	#6	10'-9''	
E 1	16'-0 ¹ ⁄2"	16'-2½"	12	11	16	15	13	12	17	15	#4	#4	13'-5"	#5	#5	14'-2"	#6	#6	12'-9"	#7	#7	12'-4"	
F 1	17'-0 ¹ ⁄2"	17'-2 ¹ / ₂ "	13	12	17	15	13	12	17	16	#4	#4	13'-5"	#5	#5	14'-2"	#6	#6	12'-9''	#7	#7	12'-4''	
G 1	18'-0½"	18'-2½"	13	12	17	16	13	13	18	17	#5	#5	16'-2"	#5	#5	14'-2"	#6	#6	12'-9"	#8	#8	13'-10"	
H1	19'-0 ¹ ⁄2"	19'-2½"	13	13	18	17	14	13	18	17	#5	#5	16'-2''	#6	#6	15'-9"	#7	#7	14'-4''	#8	#8	13'-10"	
I 1	20'-0 ¹ /2"	20'-2 ¹ / ₂ "	14	13	18	17	14	13	19	18	#5	#5	16'-2''	#6	#6	15'-9"	#7	#7	14'-4''	#8	#8	13'-10"	
J1	21'-0 ¹ ⁄2"	21'-2 ¹ / ₂ "	14	13	19	17	15	14	19	18	#5	#5	16'-2''	#6	#6	15'-9"	#7	#7	14'-4''	#9	#9	15'-4"	
К1	22'-0 ¹ / ₂ "	22'-2 ¹ ⁄2"	15	14	19	18	15	14	20	19	#6	#6	18'-9"	#7	#7	18'-4"	#8	#8	15'-10"	#9	#9	15'-4"	

DESCRIPTION: LAST REVISION

07/01/12

	FDOT	DESIGN	STANDARDS
		201	3

PRECAST SOUND BARRIERS

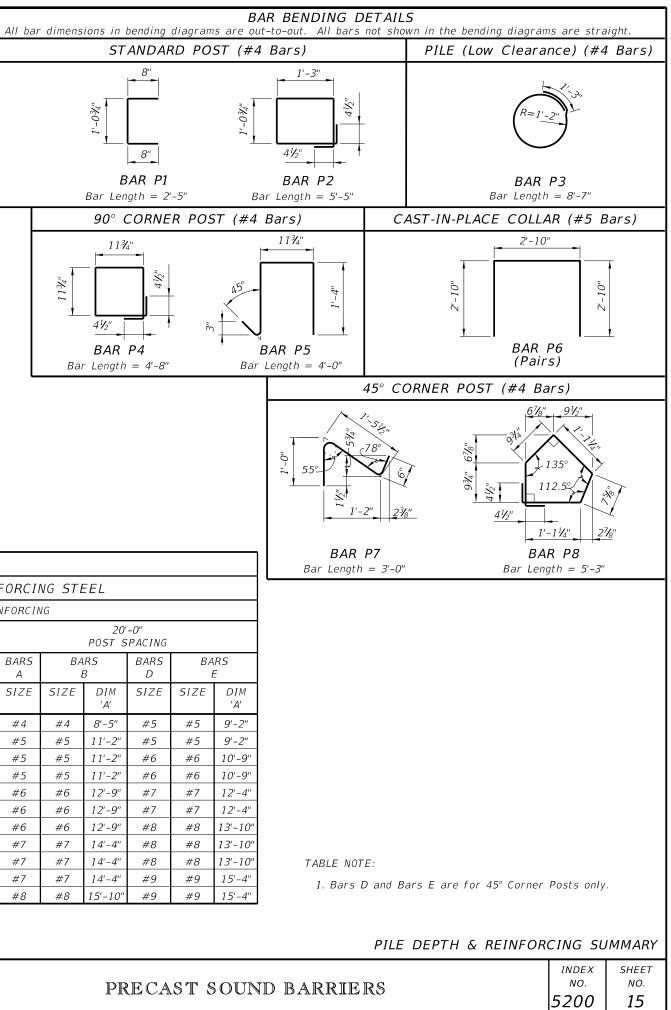


	TABLE 2 - WIND SP												МРН												
	POST AND PILE DIMENSIONS												TABLE OF REINFORCING STEEL												
WALL	POST	POST				PILE L	ENGTH								Р	OST REI	NFORCII	IG							
TYPE	LENGTH WITHOUT CAP	LENGTH WITH CAP	Med.		0 to 40 Granular	- Soil	Lo		4 to 9 anular S	oil		10'-0" 20'-0" POST SPACING POST SPAC									20'-0" ST SPACING				
				–0" PACING	20' POST S	–O" SPACING		–O" FPACING		–0" FPACING							BARS A		NRS B	BARS D		IRS E			
			30" ⊘	36" ⊘	30" ⊘	36" ⊘	30" ⊘	36" ⊘	30" ⊘	36" ⊘	SIZE	SIZE	DIM 'A'	SIZE	SIZE	DIM 'A'	SIZE	SIZE	DIM 'A'	SIZE	SIZE	DIM 'A'			
A2	12'-0½"	12'-2½"	12	11	16	15	12	11	16	15	#4	#4	11'-5"	#4	#4	9'-5''	#5	#5	9'-2"	#6	#6	8'-9"			
В2	13'-0 ¹ /2"	13'-2 ¹ / ₂ "	12	12	16	15	13	12	17	16	#4	#4	11'-5"	#5	#5	12'-2"	#5	#5	9'-2"	#6	#6	8'-9"			
С2	14'-0½''	$14' - 2\frac{1}{2}''$	13	12	17	16	13	12	18	16	#4	#4	11'-5"	#5	#5	12'-2''	#6	#6	10'-9''	#7	#7	10'-4''			
D2	15'-0½"	15'-2½"	13	13	18	16	14	13	18	17	#4	#4	11'-5"	#5	#5	12'-2"	#6	#6	10'-9"	#7	#7	10'-4"			
E2	16'-0½"	16'-2½"	14	13	19	17	14	13	19	18	#5	#5	13'-2"	#6	#6	13'-9"	#7	#7	12'-4"	#8	#8	11'-10"			
F2	17'-0½"	17'-2½"	14	13	19	18	15	14	20	18	#5	#5	13'-2"	#6	#6	13'-9"	#7	#7	12'-4"	#8	#8	11'-10"			
G2	18'-0½''	18'-2½"	15	14	20	18	15	14	20	19	#5	#5	13'-2"	#6	#6	13'-9"	#8	#8	13'-10"	#9	#9	12'-4"			
H2	19'-0½"	19'-2½"	15	14	20	19	16	15	21	20	#6	#6	15'-9"	#7	#7	15'-4"	#8	#8	13'-10"	#9	#10	11'-7"			
12	20'-0 ¹ / ₂ "	20'-2¼″	16	15	21	19	16	15	22	20	#6	#6	15'-9"	#7	#7	15'-4"	#8	#8	12'-10"	#10	#10	13'-7"			
J2	21'-0 ¹ ⁄2"	21'-2½"	16	15	22	20	17	16	22	21	#6	#6	15'-9"	#7	#7	15'-4"	#9	#9	14'-4''	#10	#11	12'-10"			
К2	22'-0 ¹ ⁄2"	22'-2 ¹ ⁄2"	17	16	22	21	17	16	23	21	#7	#7	17'-4"	#8	#8	16'-10''	#9	#9	14'-4''	#11	#11	13'-10"			

							7	FABLE	3 - W	IND S	PEED	= 150	МРН										
		P0.				TAI	BLE OF	REIN	FORCI	NG ST	EEL												
WALL	POST	POST				PILE L	ENGTH				POST REINFORCING												
ΤΥΡΕ	LENGTH WITHOUT CAP	LENGTH WITH CAP	Med.		0 to 40 Granular	Soil	Lo	N = 4 bose Gra	4 to 9 anular S	oil				–0" PACING						'-0" SPACING			
	0,1	0,11		'-0" SPACING	20' POST S	-		'-0" SPACING		'-0" SPACING	BARS A		NRS B	BARS D		IRS E	BARS A		ARS B	BARS D	S BARS E		
			30" ©	36" ⊘	30" ©	36" ©	30" Ø	36" Ø	30" ⊘	36" ⊘	SIZE	SIZE	DIM 'A'	SIZE	SIZE	DIM 'A'	SIZE	SIZE	DIM 'A'	SIZE	SIZE	DIM 'A'	
A3	12'-0½''	12'-2½"	13	12	18	16	14	13	18	17	#4	#4	9'-5"	#5	#5	10'-2"	#6	#6	8'-9"	#6	#7	7'-4'	
B3	13'-0½"	13'-2¼''	14	13	19	17	14	13	19	18	#4	#4	9'-5"	#5	#5	10'-2"	#6	#6	8'-9"	#7	#7	8'-4'	
С3	14'-0½"	14'-2 ¹ / ₂ "	14	13	19	18	15	14	20	19	#5	#5	11'-2"	#6	#6	11'-9"	#7	#7	10'-4''	#8	#8	9'-10	
D3	15'-0½"	15'-2¼''	15	14	20	19	16	14	21	19	#5	#5	11'-2"	#6	#6	11'-9"	#7	#7	10'-4''	#8	#9	9'-4'	
E3	16'-0½"	16'-2¼''	16	14	21	19	16	15	22	20	#5	#5	11'-2"	#6	#6	11'-9"	#8	#8	10'-10''	#9	#9	10'-4	
F3	17'-0½"	17'-2¼''	16	15	22	20	17	16	22	21	#6	#6	13'-9"	#7	#7	13'-4"	#8	#8	10'-10"	#9	#10	9'-7'	
G3	18'-0½"	18'-2¼''	17	16	22	21	17	16	23	21	#6	#6	12'-9"	#7	#7	13'-4''	#9	#9	12'-4''	#10	#10	11'-7	
H3	19'-0½"	19'-2 ¹ / ₂ "	17	16	23	21	18	17	24	22	#6	#6	12'-9"	#8	#8	14'-10''	#9	#9	12'-4"	#11	#11	11'-9	
13	20'-0 ¹ / ₂ "	20'-2 ¹ / ₂ "	18	17	24	22	18	17	25	23	#7	#7	15'-4"	#8	#8	14'-10''	#9	#10	11'-7"	#11	#14	10'-0	
J3	21'-0 ¹ ⁄2"	21'-2 ¹ ⁄2"	18	17	24	23	19	18	25	23	#7	#7	15'-4"	#9	#9	16'-4''	-	-	-	-	-	-	
К3	22'-0 ¹ /2"	22'-2 ¹ / ₂ "	19	17	25	23	19	18	26	24	#8	#8	16'-10"	#9	#9	16'-4"	-	-	-	-	-	-	


TABLE NOTE:


1. Bars D and Bars E are for 45° Corner Posts only.


LAST REVISION 07/01/12


ATT AND	
VI OF TRANSP	

PILE DEPTH & REINFOR	CING SU	IMMARY
RRIERS	^{INDEX} NO. 5200	sнеет NO. 16

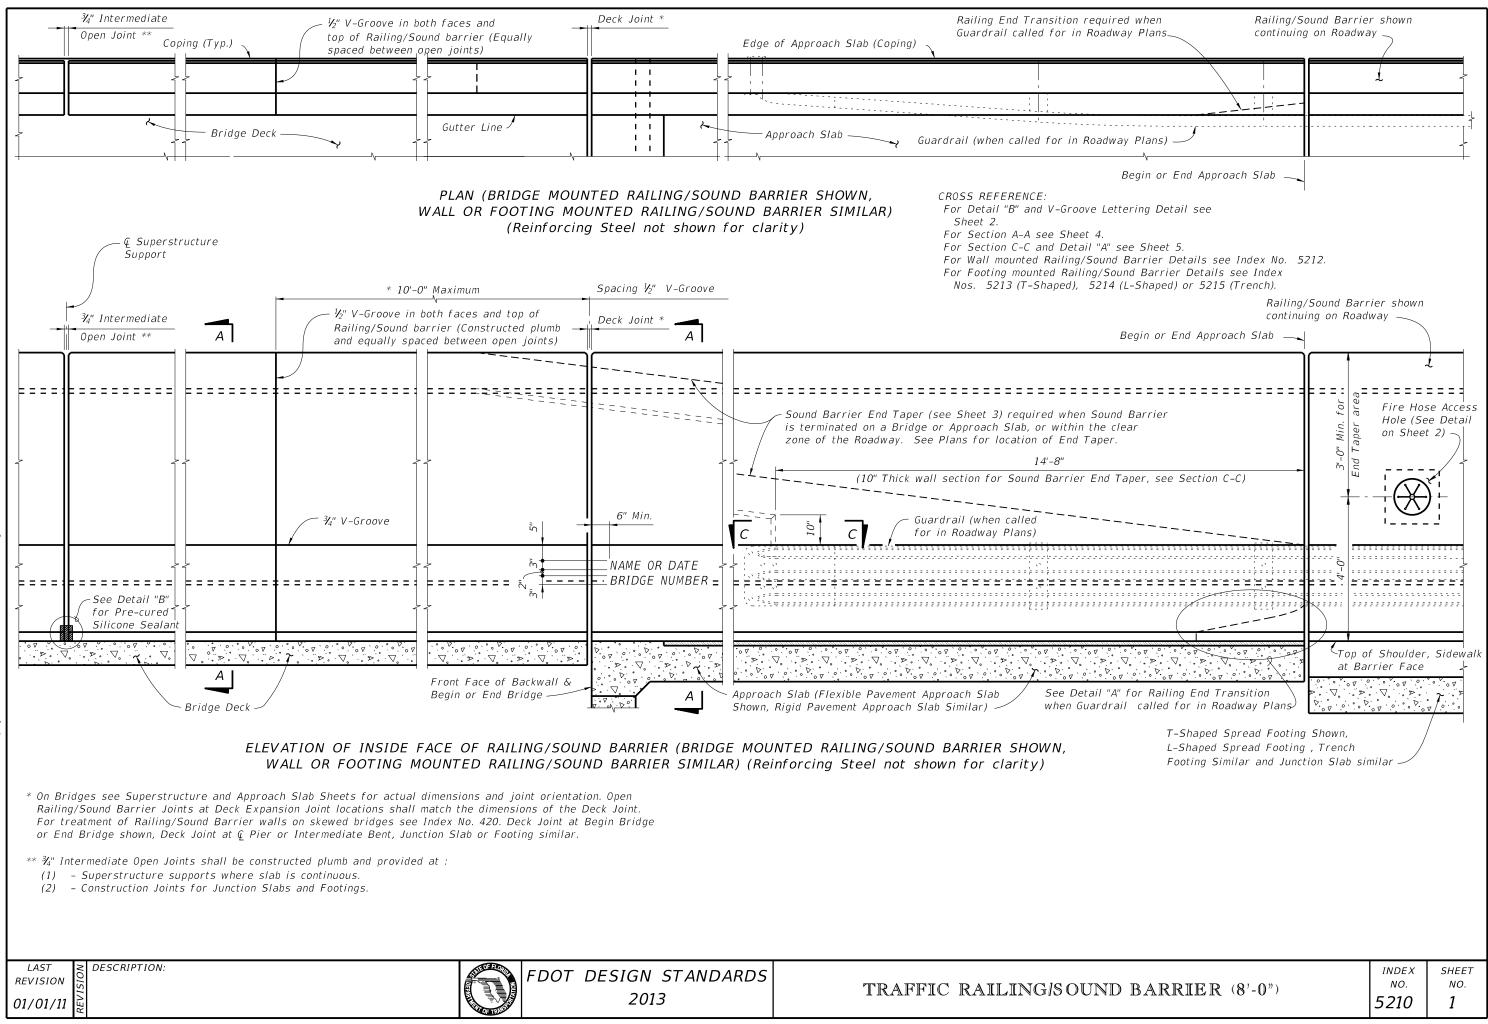

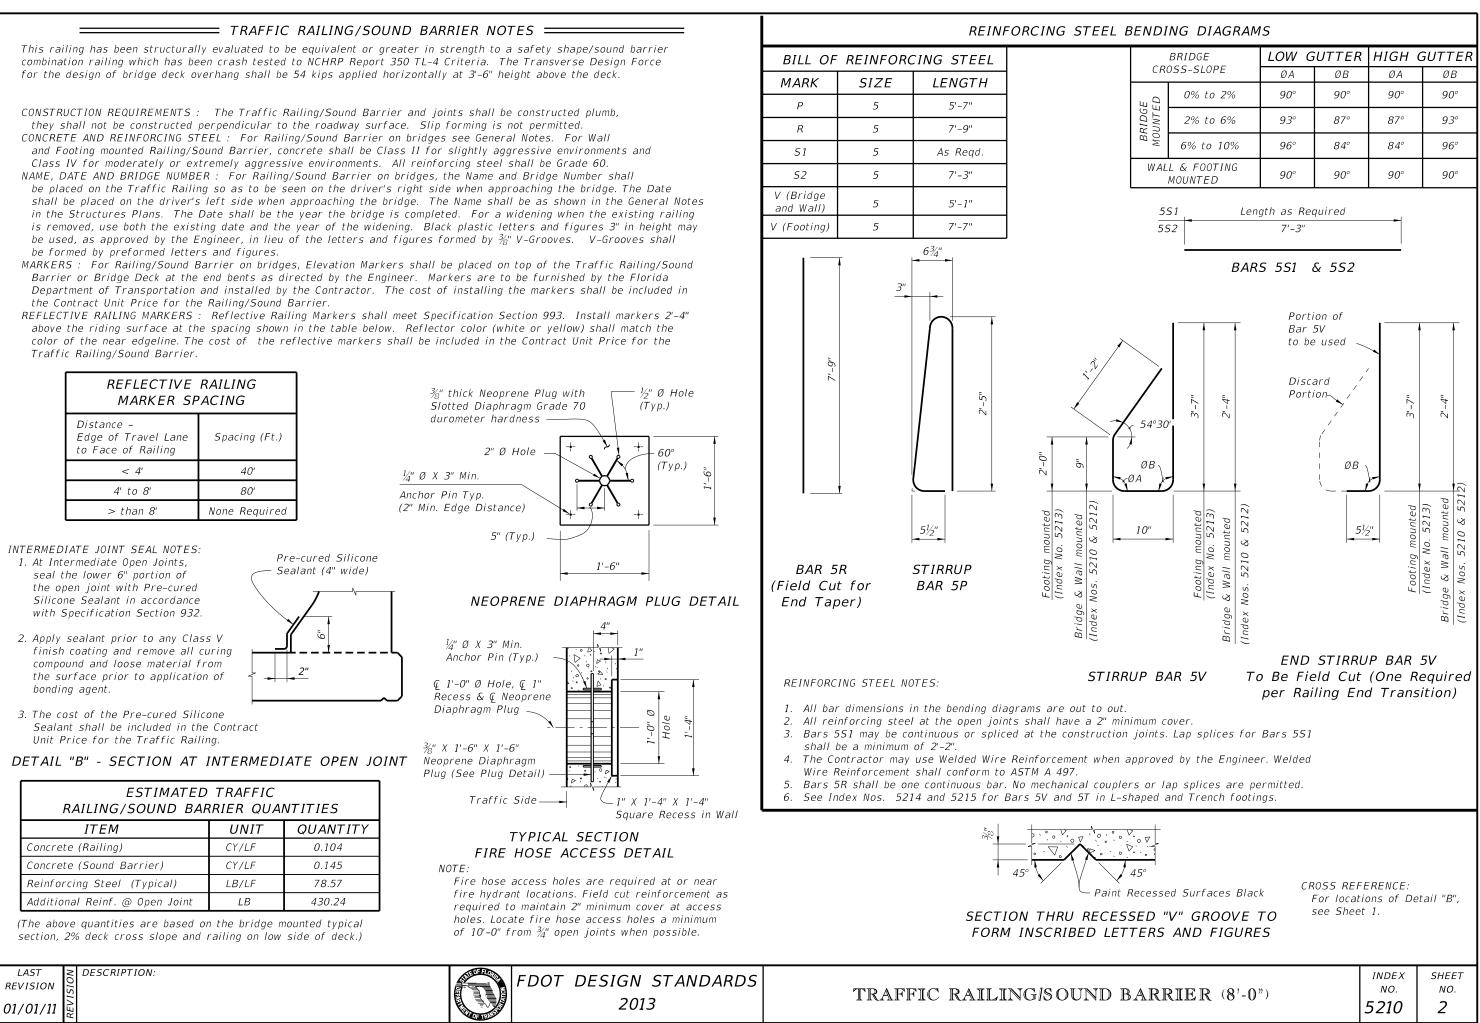


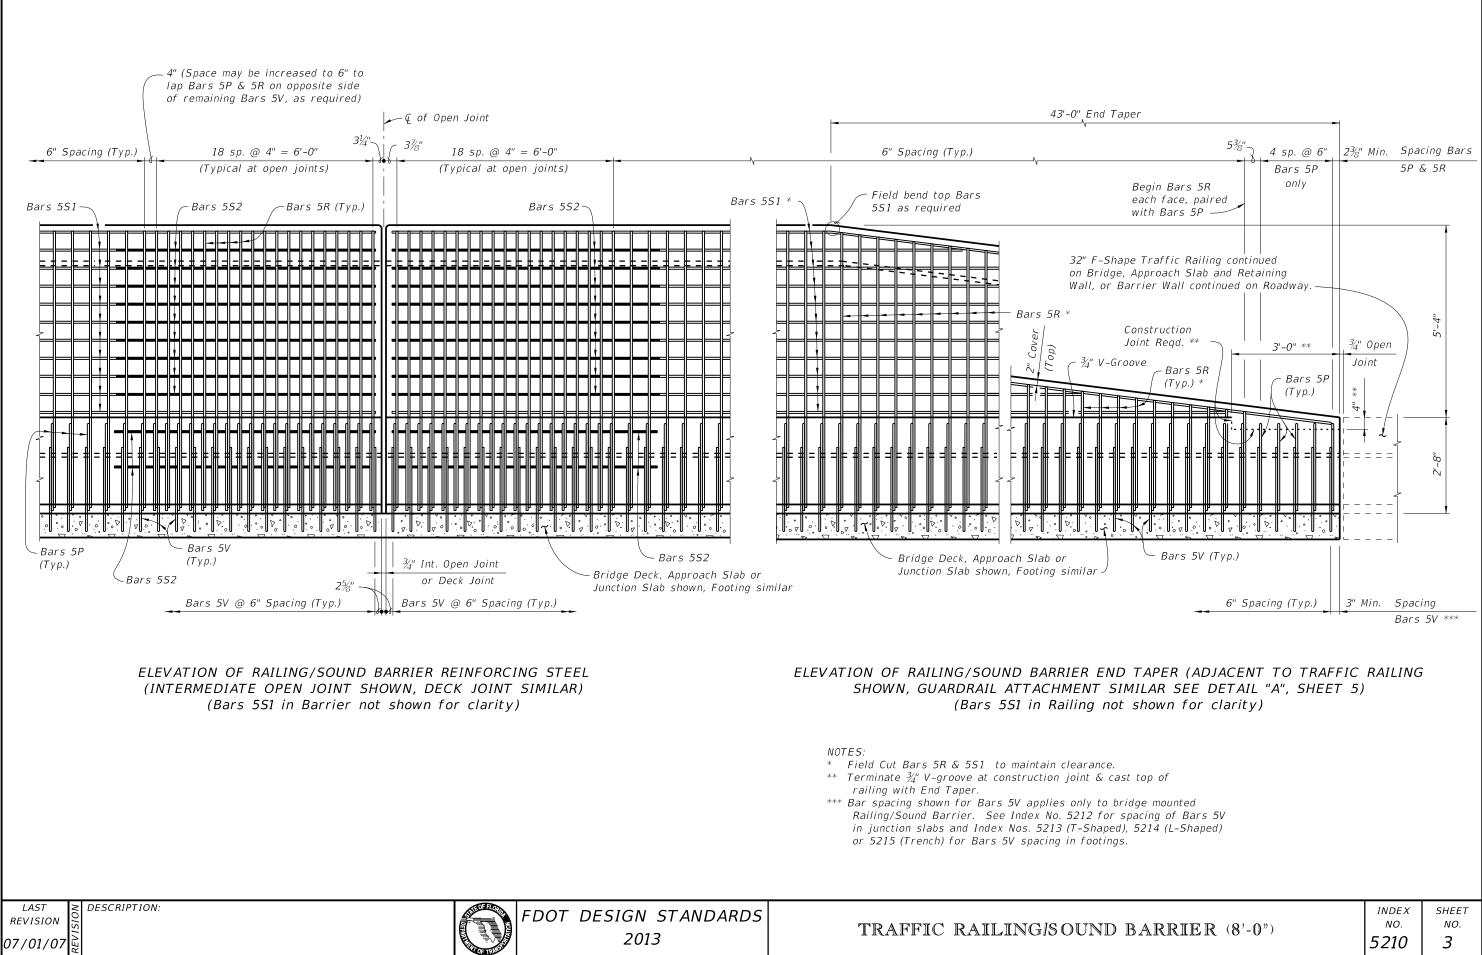


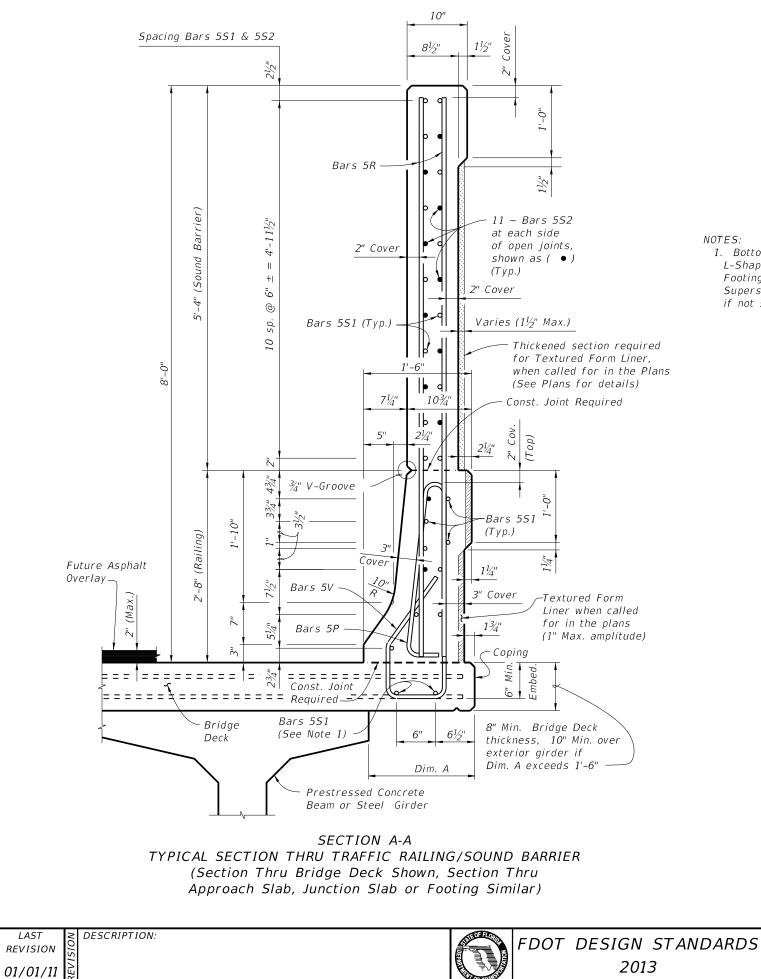

NOTES:


1. Bottom Bars 5S1 and End Bar 5V are not present in L-Shaped (Index No. 5214) or Trench (Index No. 5215) Footings. For Bridge Mounted installations, see the Superstructure Sheets for Deck Steel. Omit Bars 5S1 if not specifically shown on the Superstructure Sheets.

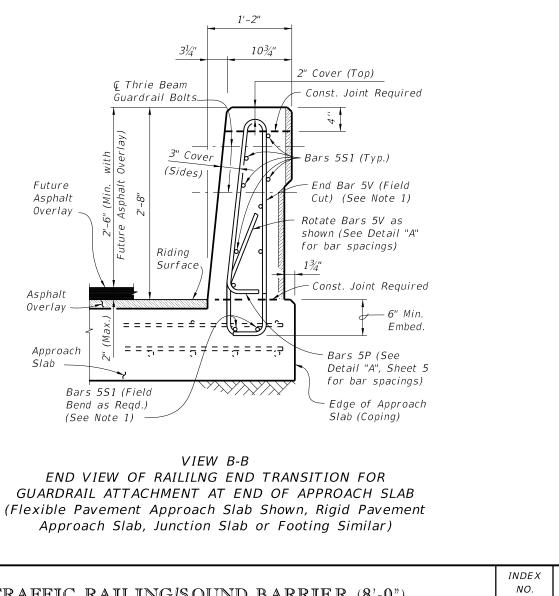




SHEET NO. 4

5210

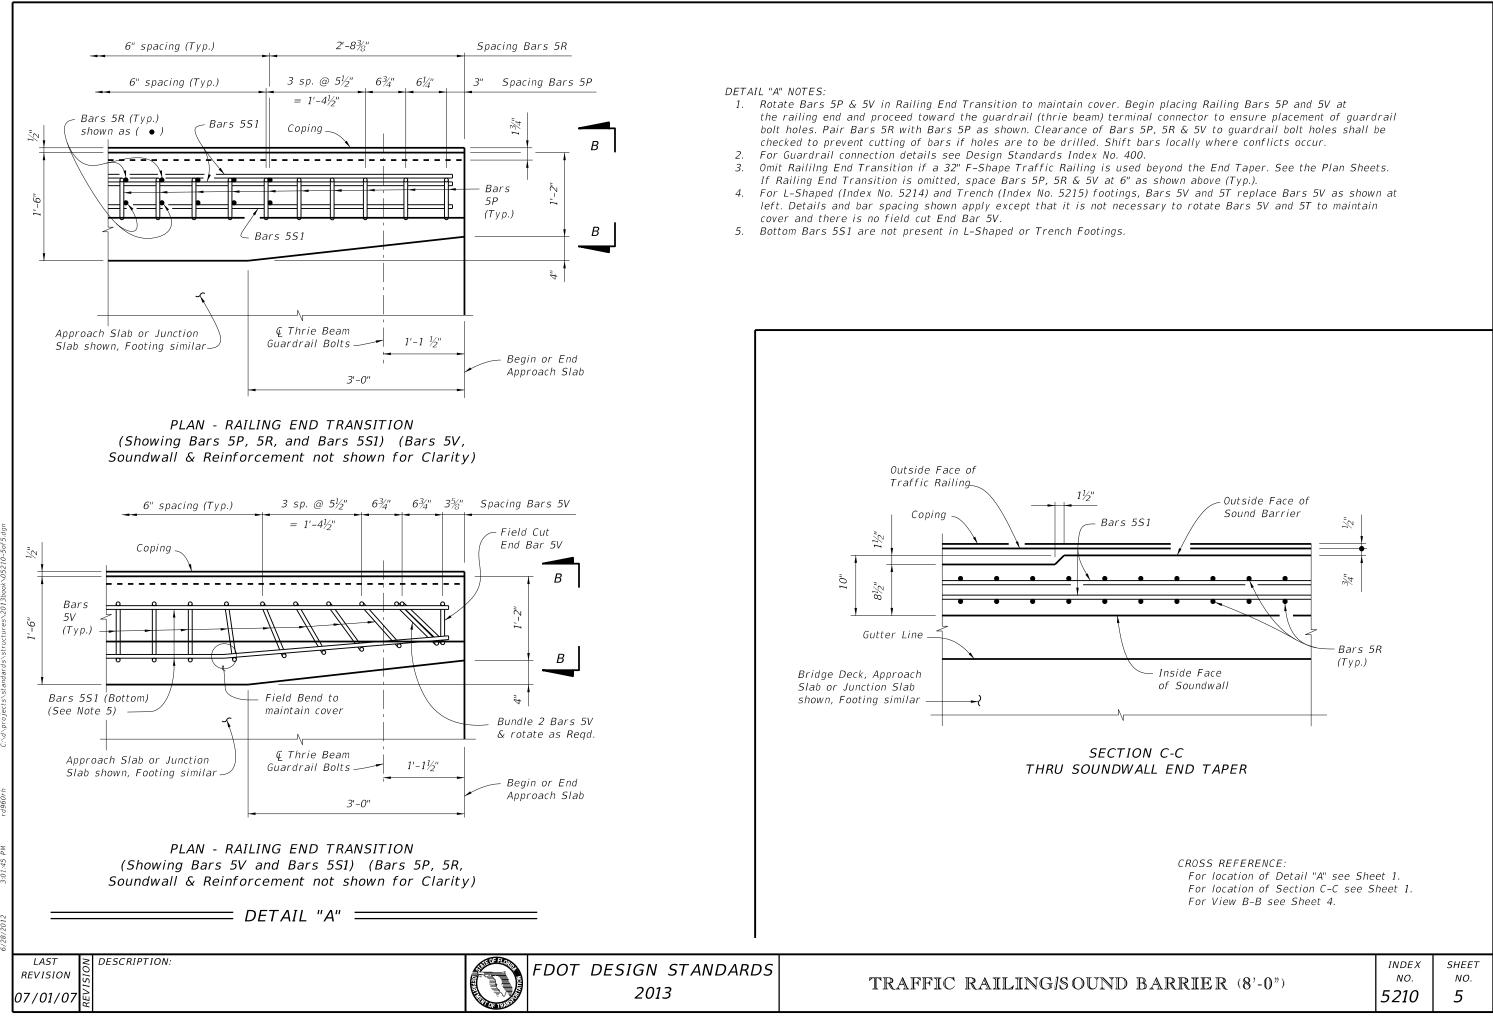


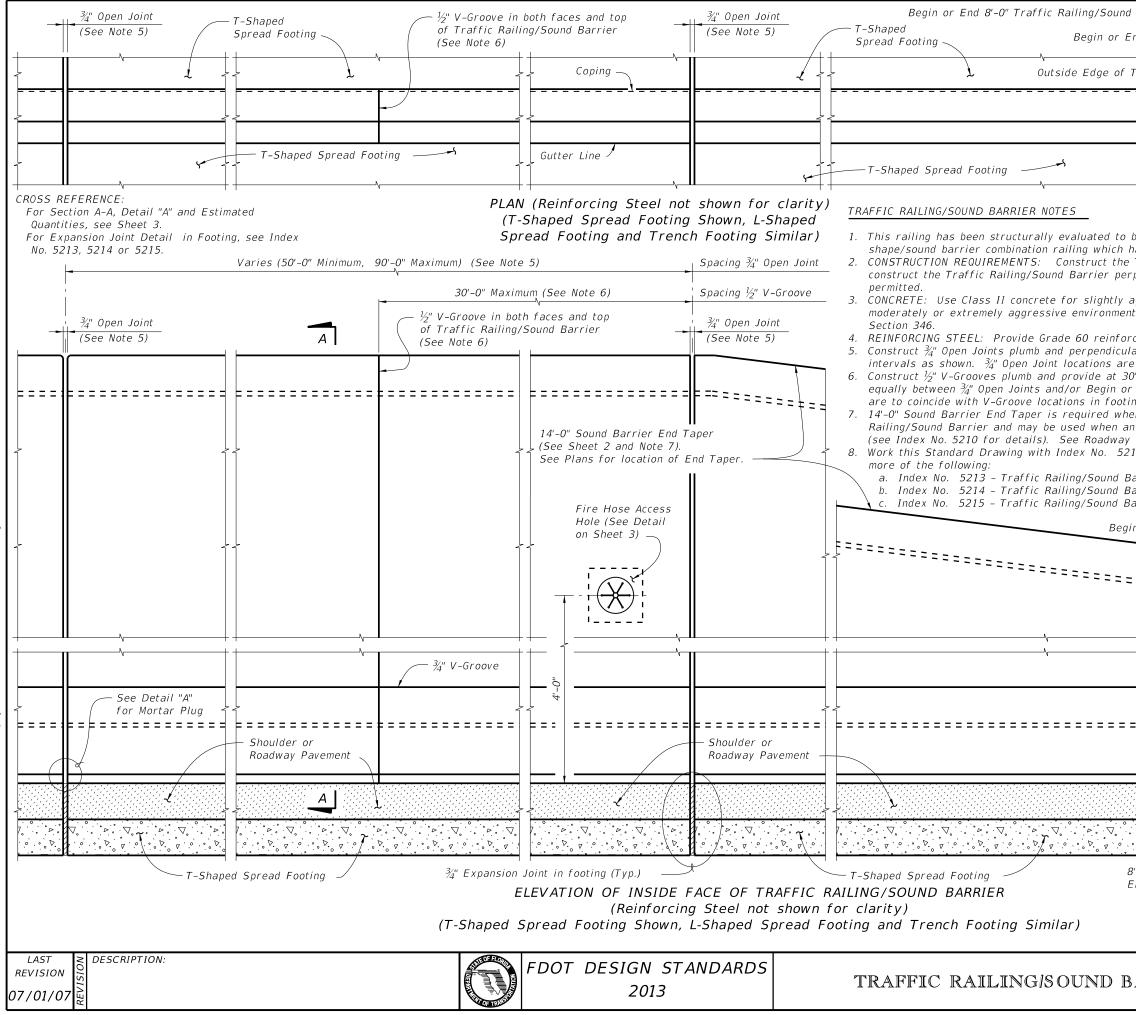



C:\d\projects\standards\structures\2013book\05211-1o!

/28/2012 3:01:48 PM


Barrier or End Taper (See Note 7)		n Joint		
nd 14'-0" Traffic Railing/Sound Barrier 🗕	(See No	te 5)		
Traffic Railing —	1			
	¦= = = = = =	= = = =		
	1	τĻ		
-\ ₁				
8'-0" Traffic Railing/Sound Barrier continu End Taper on Approach Slab or Roadway (
be equivalent or greater in strength to a s has been crash tested to NCHRP Report 350 Traffic Railing/Sound Barrier and joints p rpendicular to the roadway surface. Slip fo) TL-4 Crit lumb; do n	ot		
aggressive environments. Use Class IV com its. Concrete will be in accordance with Sp				
Traing steel in accordance with Specification lar or radial to Gutter Line. Provide at 90'- e to coincide with $\frac{3}{4}$ " Expansion Joints in fo 0'-0" maximum intervals as shown. Space V r End Traffic Railing/Sound Barrier. V-Gro	-O" maximu ootings. -Grooves	m		
ngs. en Railing/Sound Barrier is adjacent to an n 8'-0" Traffic Railing/Sound Barrier End T. Plans for Traffic Railing/Sound Barrier En 10 - Traffic Railing/Sound Barrier (8'-0") a	aper is pr nd Treatme	ovided ent.		
Barrier T-Shaped Spread Footing, Barrier L-Shaped Spread Footing or Barrier Trench Footing.	8'-0"	or End Traffic ng/Sound		
in or End Traffic Railing/Sound Barrier—	Barri End T	er or		
	1			
	FREES I	= = = =		
	1	<u>+</u>		
Y Y	l l			
	1			
		= = = =		
$\begin{array}{cccccccccccccccccccccccccccccccccccc$		Ţ		
8'-0" Traffic Railing/Sound Barrier continuing or End Taper on Approach Slab or Roadway (shown)				
BARRIER (14'-0")	^{INDEX} NO. 5211	sheet NO. 1		

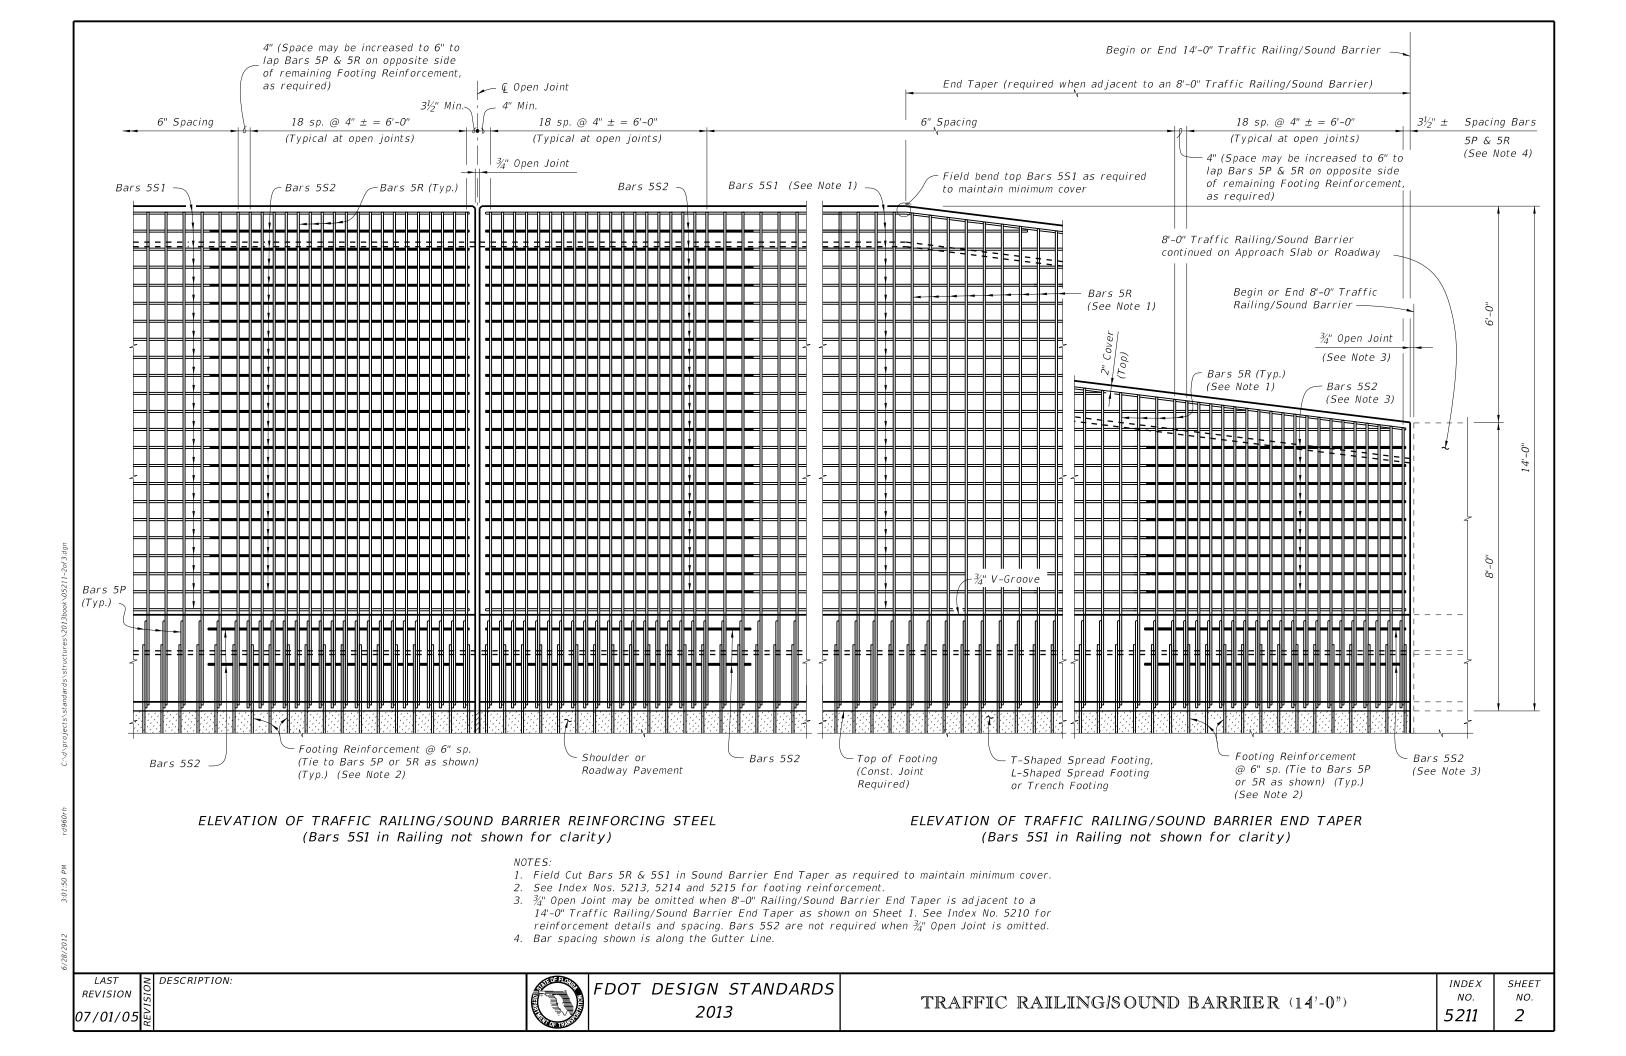

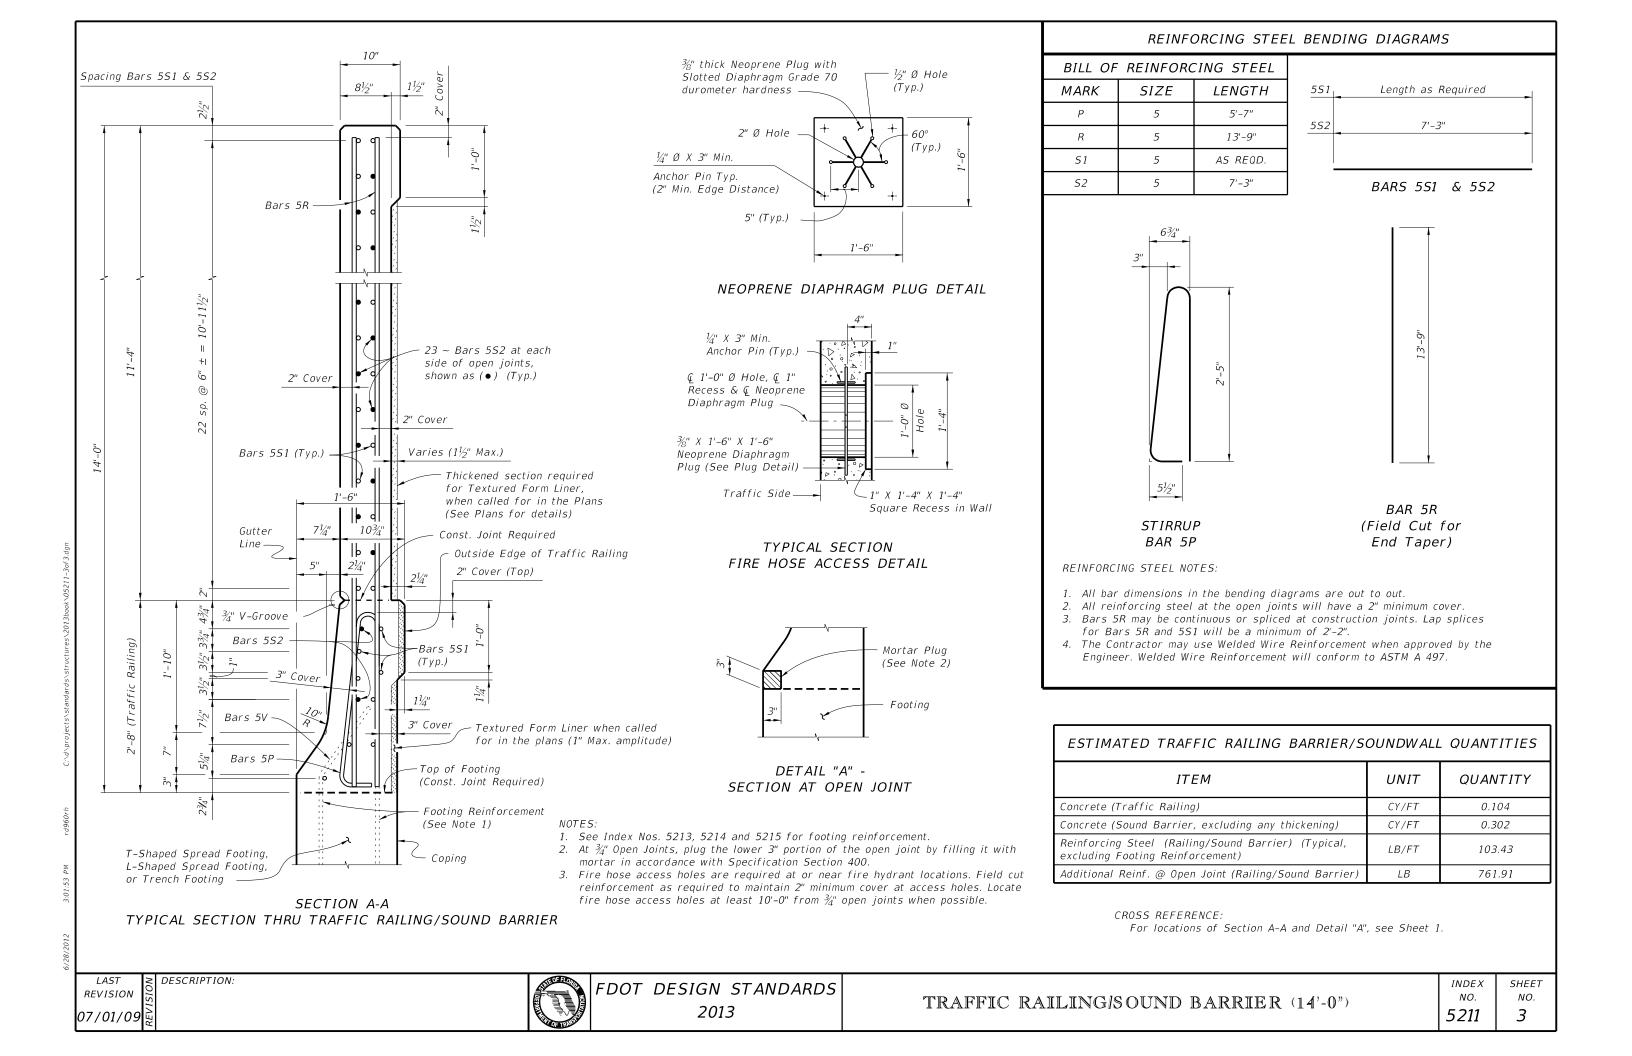


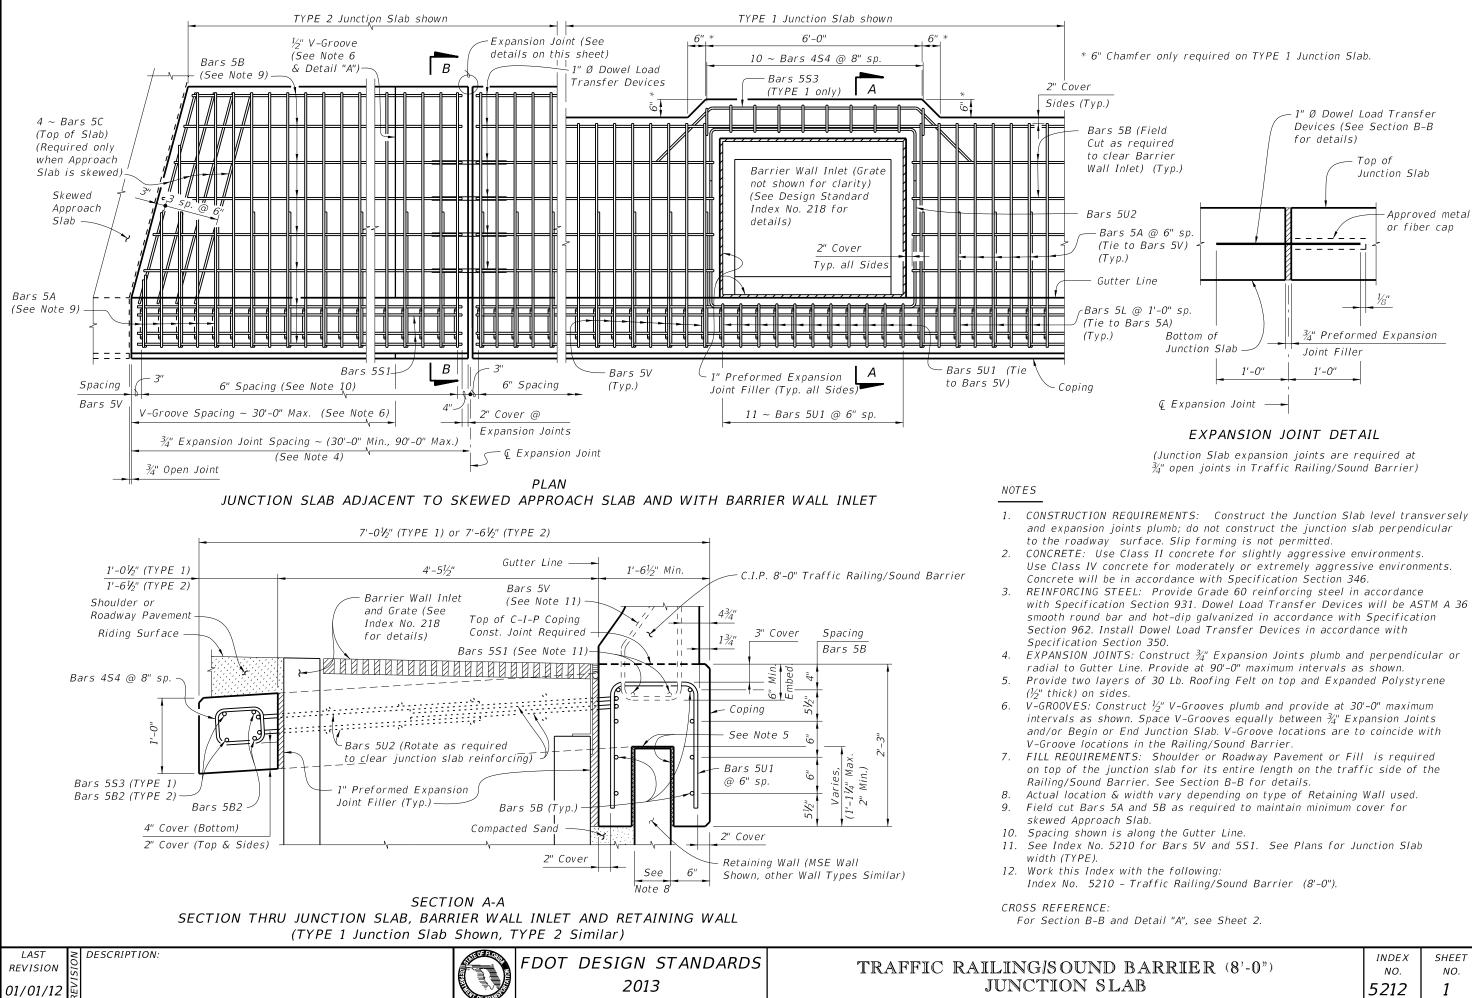



BARRIER (8'-0")	INDEX NO.	SHEET NO.
AB	5212	1

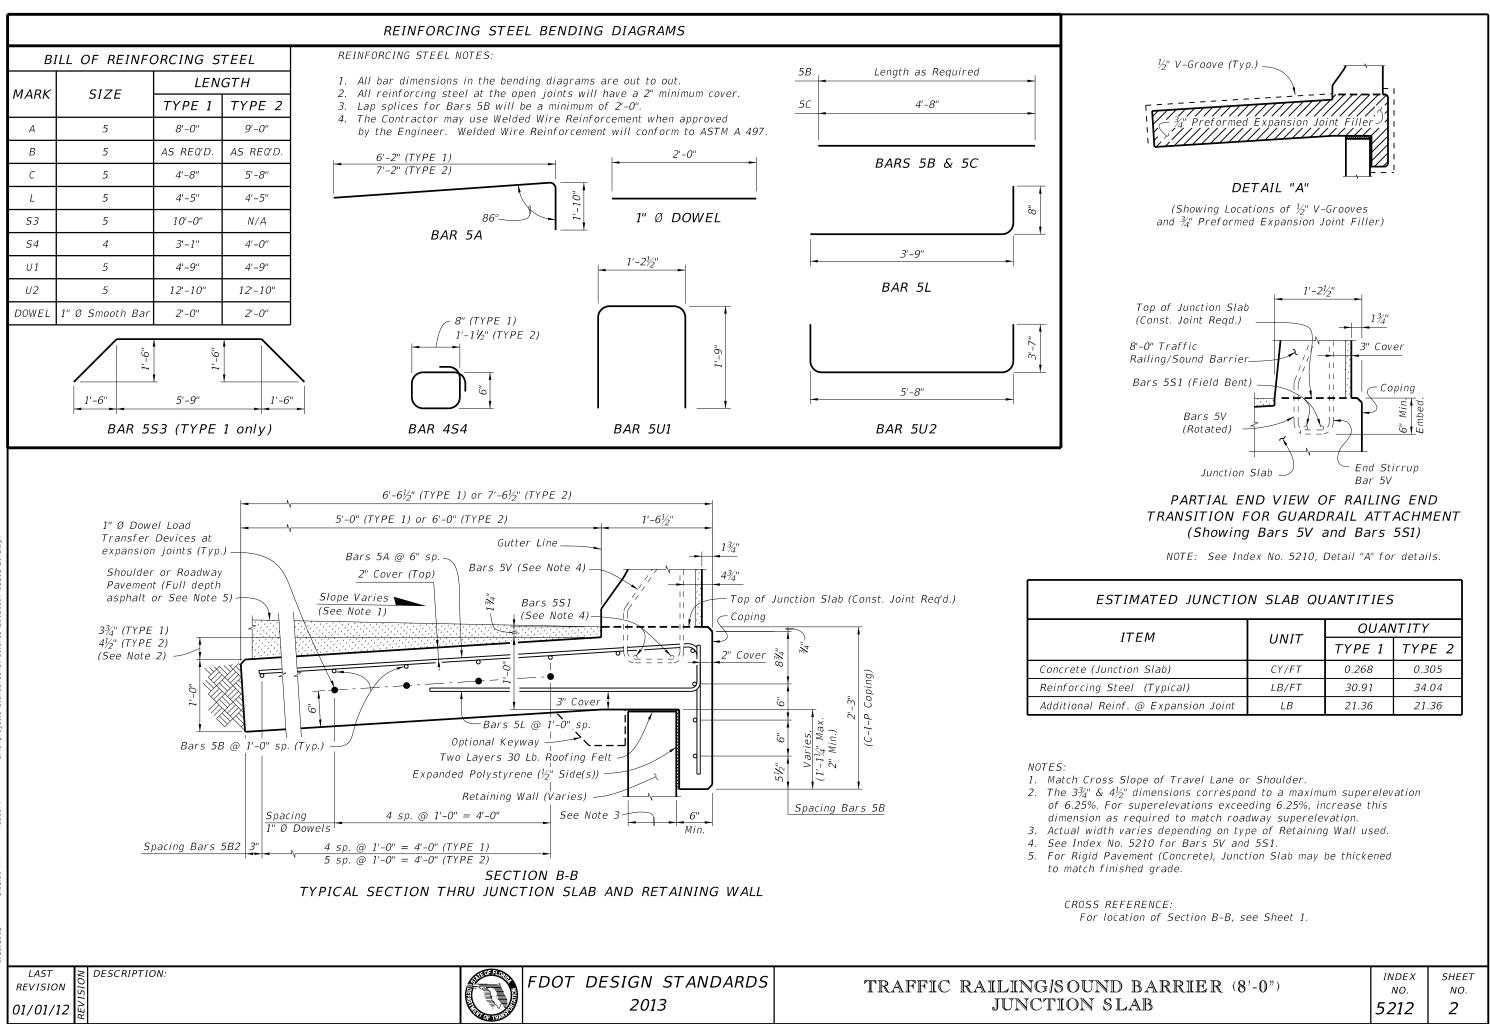


20/2012 3:02:01 PM rd960rh C:\d\u00e7baok\0521

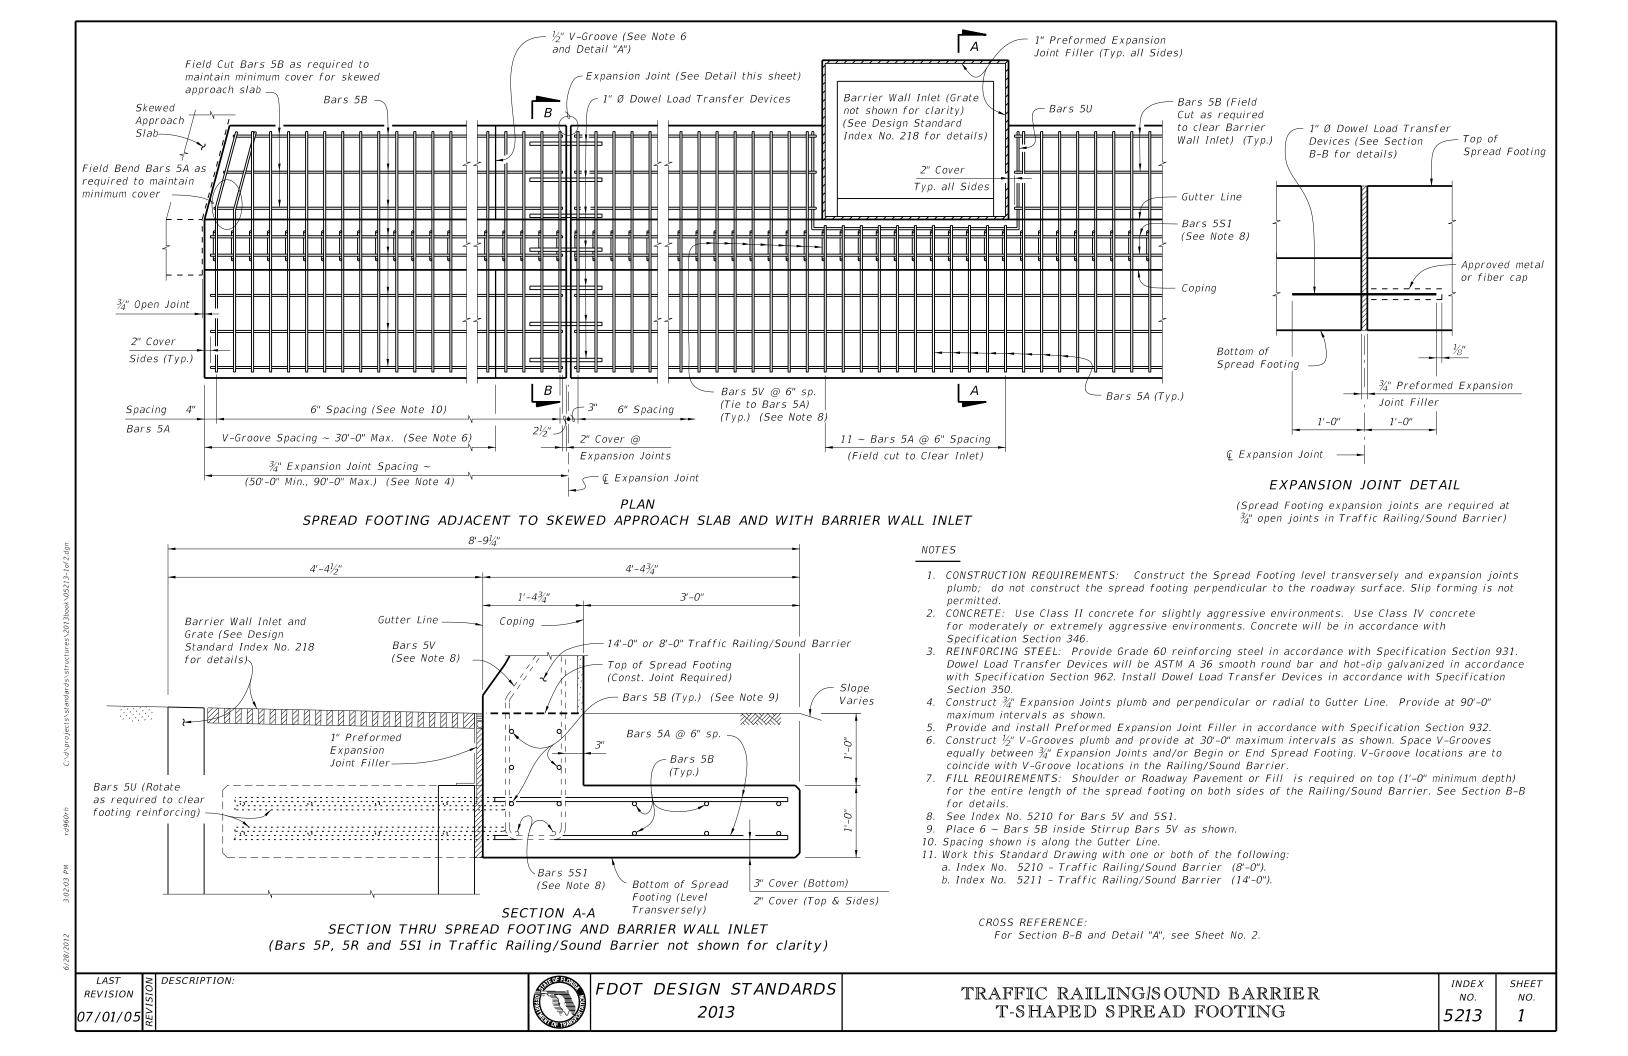

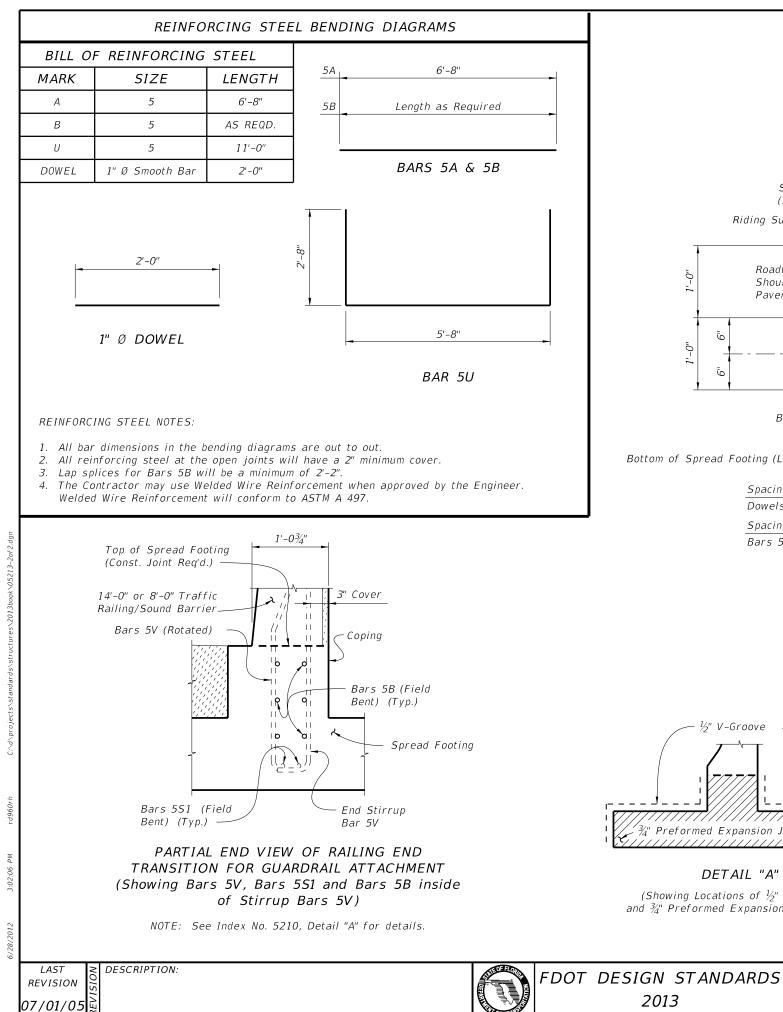

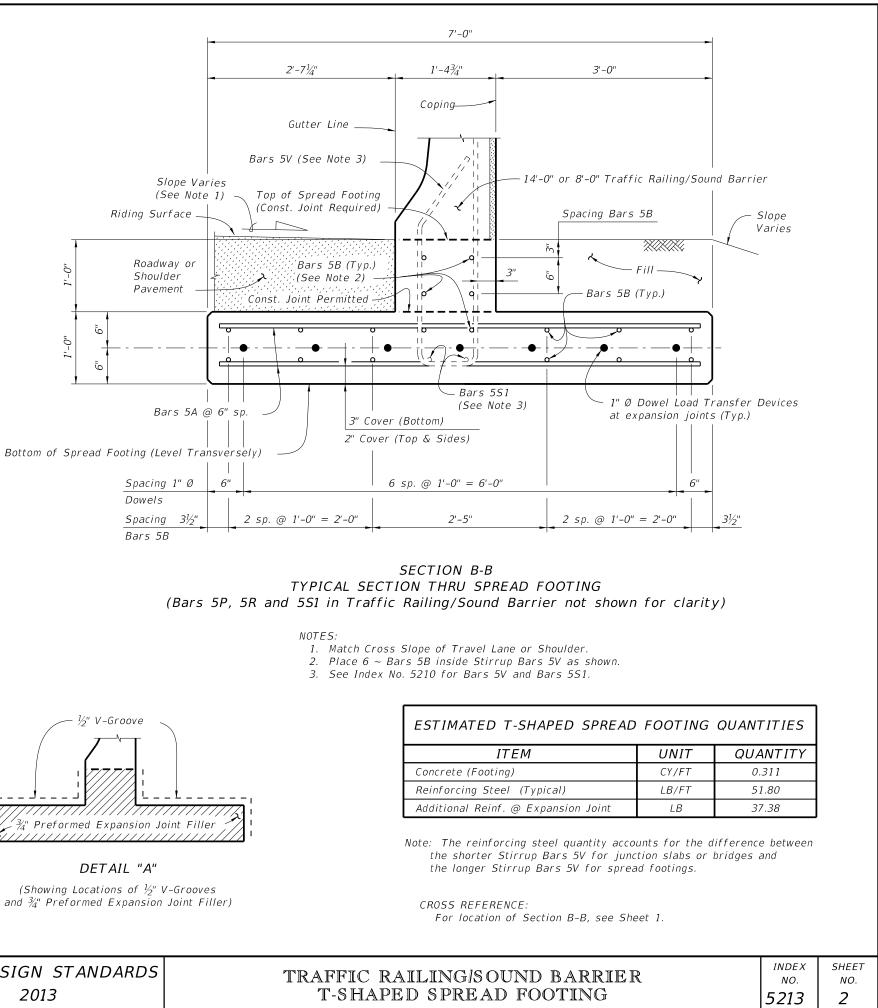

TRAFFIC	RAII	LING/S	SOU	P
T-SHA	PED	SPRE	\mathbb{AD}	ŀ

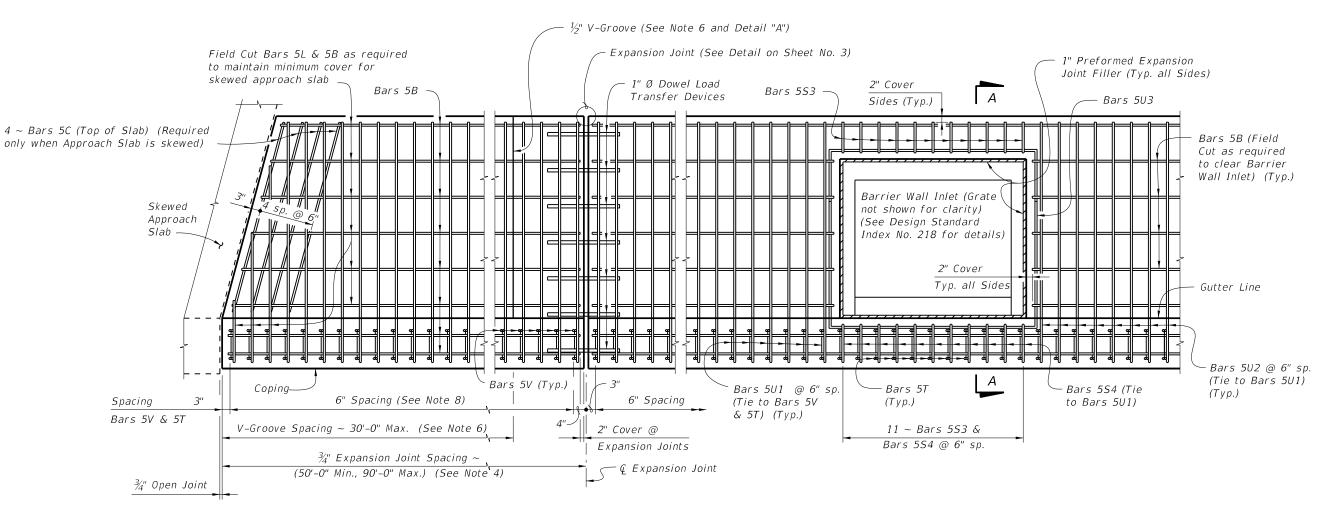

PLAN - OPTION B SPREAD FOOTING ADJACENT TO SKEWED APPROACH SLAB AND WITH BARRIER WALL INLET (Option A Similar)

NOTES


- 1. CONSTRUCTION REQUIREMENTS: Construct the Spread Footing level transversely and expansion joints plumb; do not construct the spread footing perpendicular to the roadway surface. Slip forming is not permitted.
- 2. CONCRETE: Use Class II concrete for slightly aggressive environments. Use Class IV concrete for moderately or extremely aggressive environments. Concrete will be in accordance with Specification Section 346.
- 3. REINFORCING STEEL: Provide Grade 60 reinforcing steel in accordance with Specification Section 931. Dowel Load Transfer Devices will be ASTM A 36 smooth round bar and hot-dip galvanized in accordance with Specification Section 962. Install Dowel Load Transfer Devices in accordance with Specification Section 350.
- 4. Construct $\frac{3}{4}$ " Expansion Joints plumb and perpendicular or radial to Gutter Line. Provide at 90'-0" maximum intervals as shown.
- 5. Provide and install Preformed Expansion Joint Filler in accordance with Specification Section 932.
- 6. Construct 1/2" V-Grooves plumb and provide at 30'-0" maximum intervals as shown. Space V-Grooves equally between 3/4" Expansion Joints and/or Begin or End Spread Footing. V-Groove locations are to coincide with V-Groove locations in the Railing/Sound Barrier.
- 7. FILL REQUIREMENTS: Shoulder or Roadway Pavement and Fill is required on the traffic side of the spread footing for a distance of 4'-0" and the full length of the spread footing (3'-0" minimum depth) on the backside of the spread footing for Option A. Fill is required for a distance of 4'-0" on the backside of the spread footing and the full length of the spread footing (3'-0" minimum depth) on the traffic side of the spread footing for Option B. See Typical Sections on Sheet Nos. 2 and 3 for details.
- 8. Spacing shown is along the Gutter Line.
- 9. Work this Standard Drawing with one or both of the following:
- a. Index No. 5210 Traffic Railing/Sound Barrier (8'-0").
- b. Index No. 5211 Traffic Railing/Sound Barrier (14'-0").

LAST REVISION	SION	DESCRIPTION:
07/01/05	REVIS	


AND THE OWNER	FDOT	DESIGN	STANDARDS
		201	3

TRAFFIC RAILING/SOUN L-SHAPED SPREAD I CROSS REFERENCE: For Detail "A", see Sheet 3. For Section A-A and Estimated Quantities, see Sheet 4.


ND BARRIER	INDEX NO.	SHEET NO.
FOOTING	5214	1

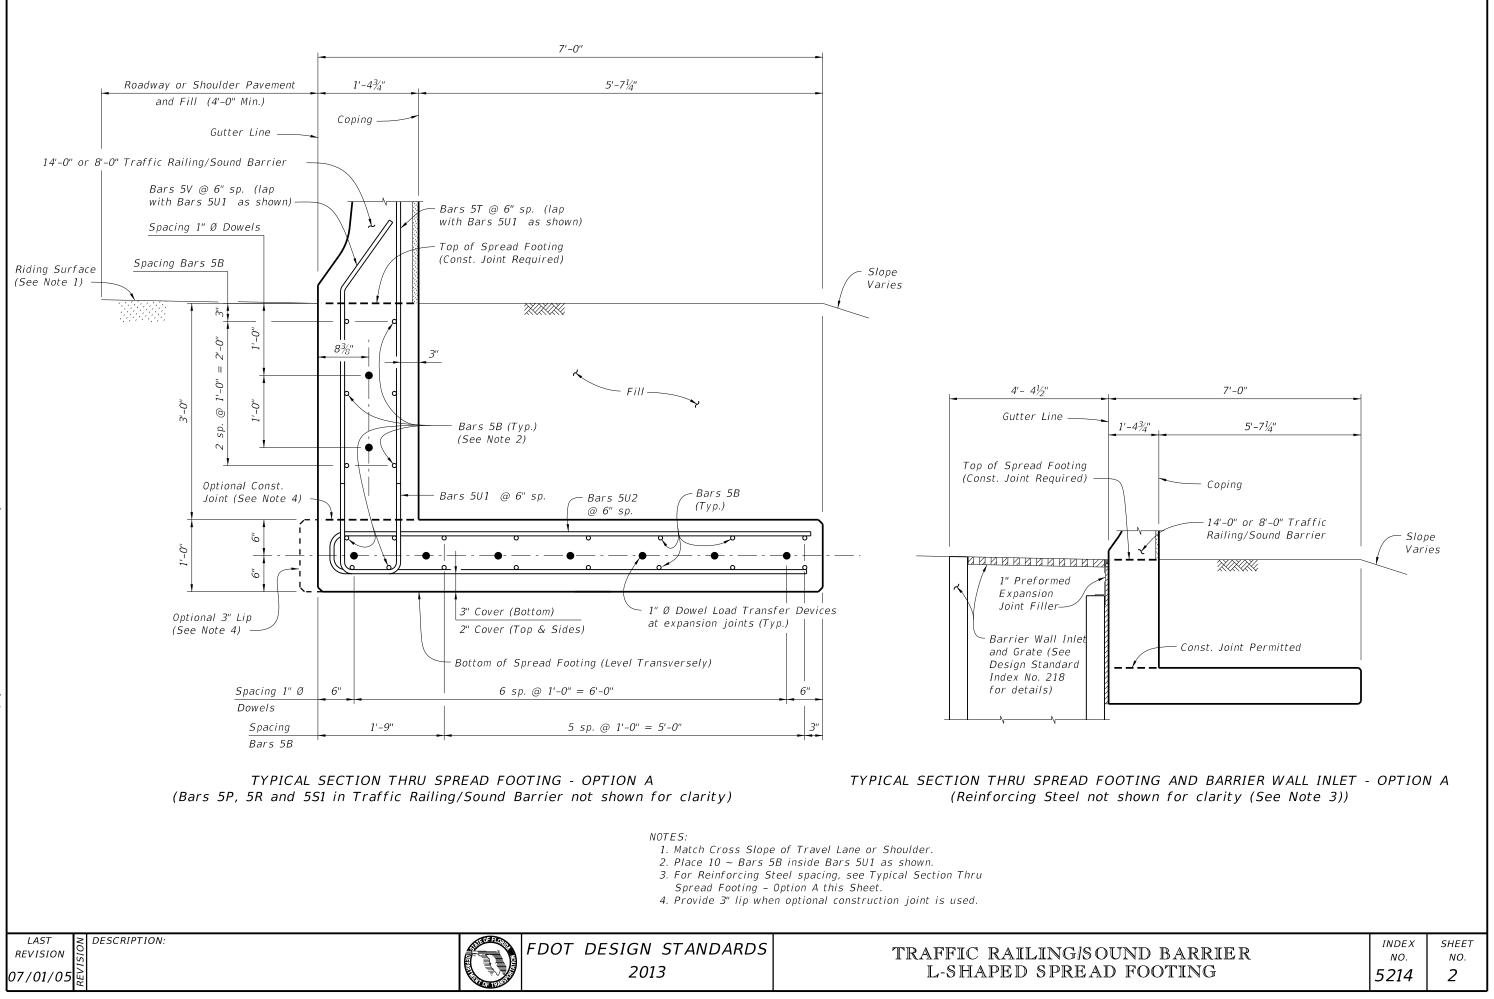


78/2012 3:02:11 PM

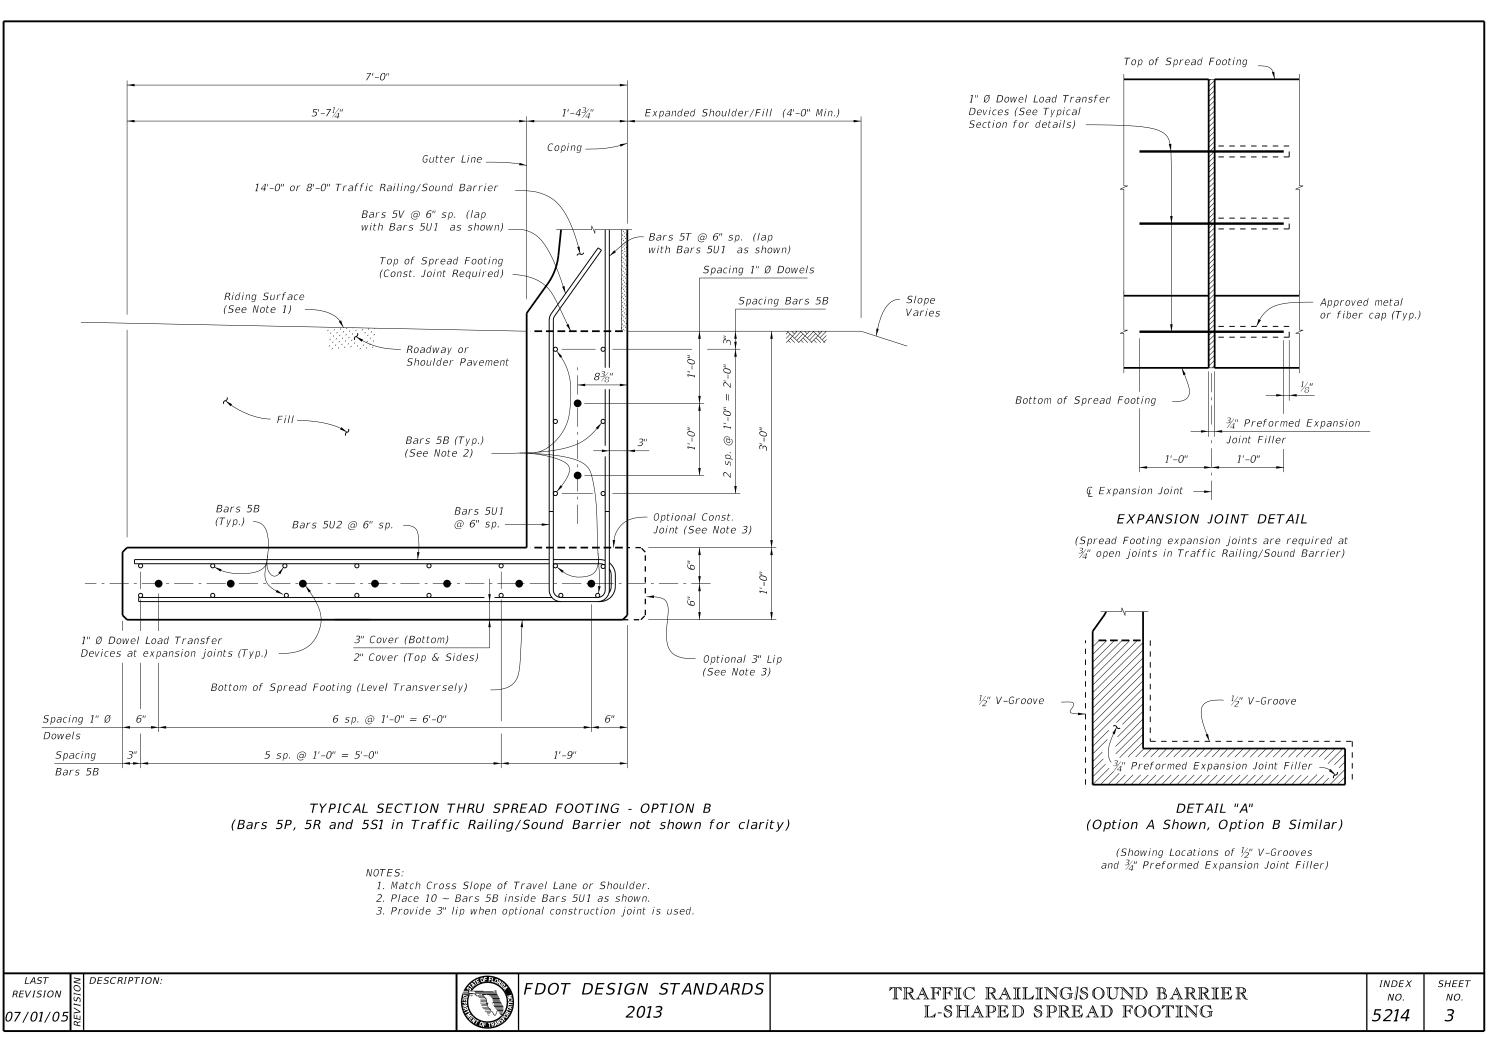

6/28/2012 3:02:14 PM rd96

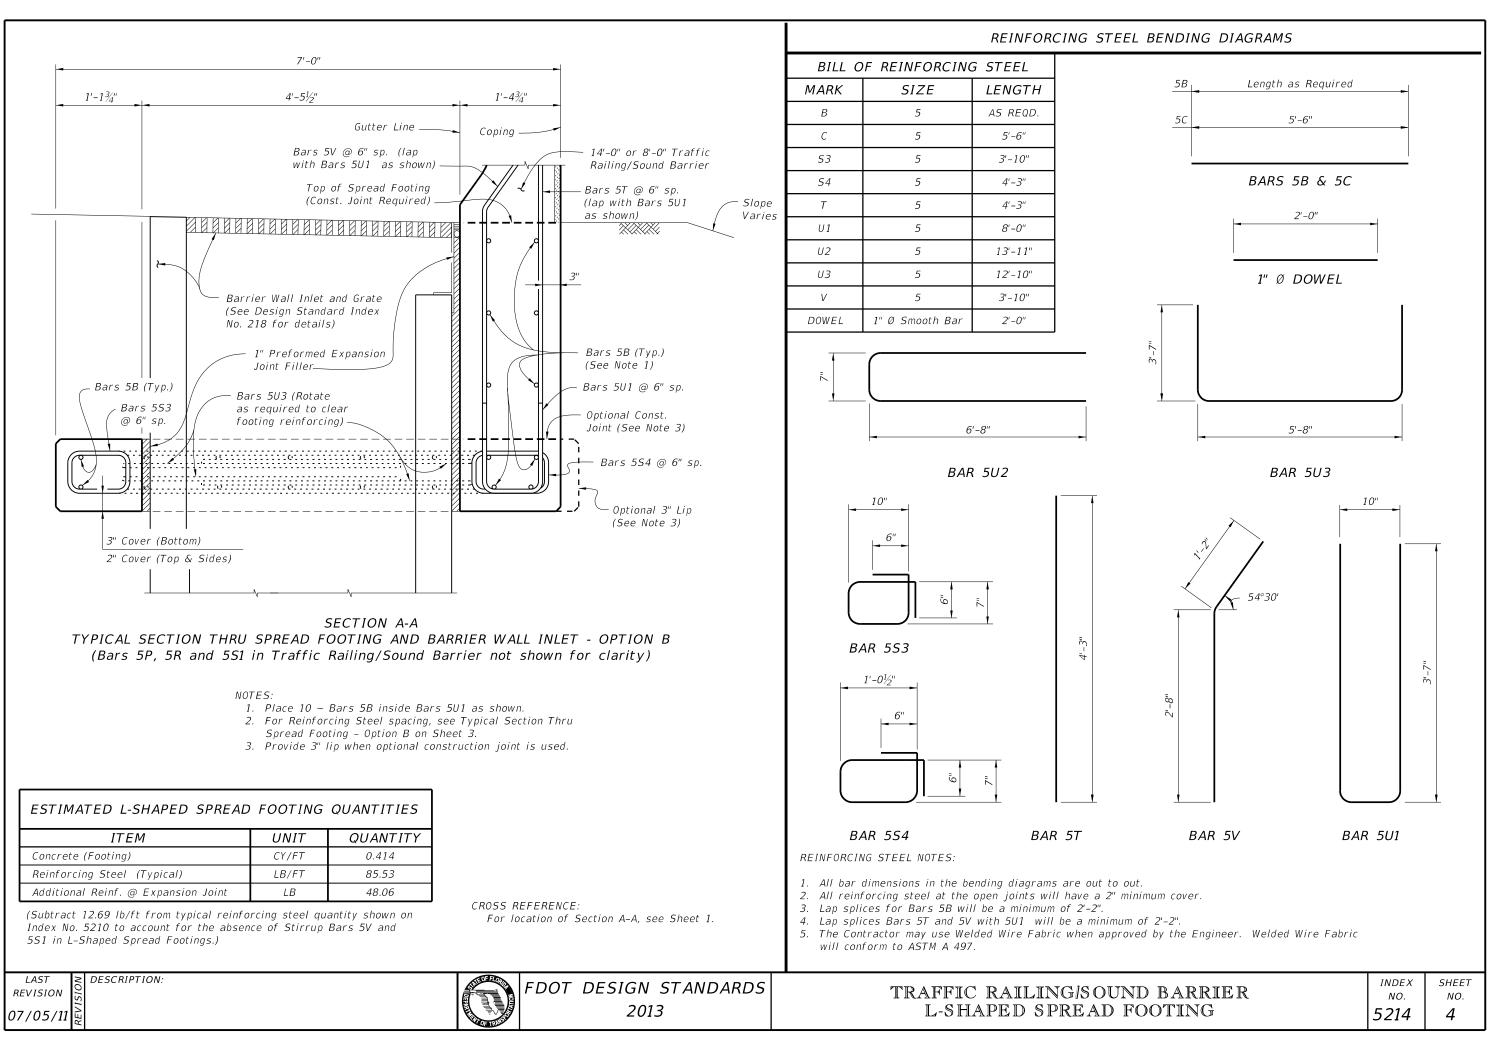

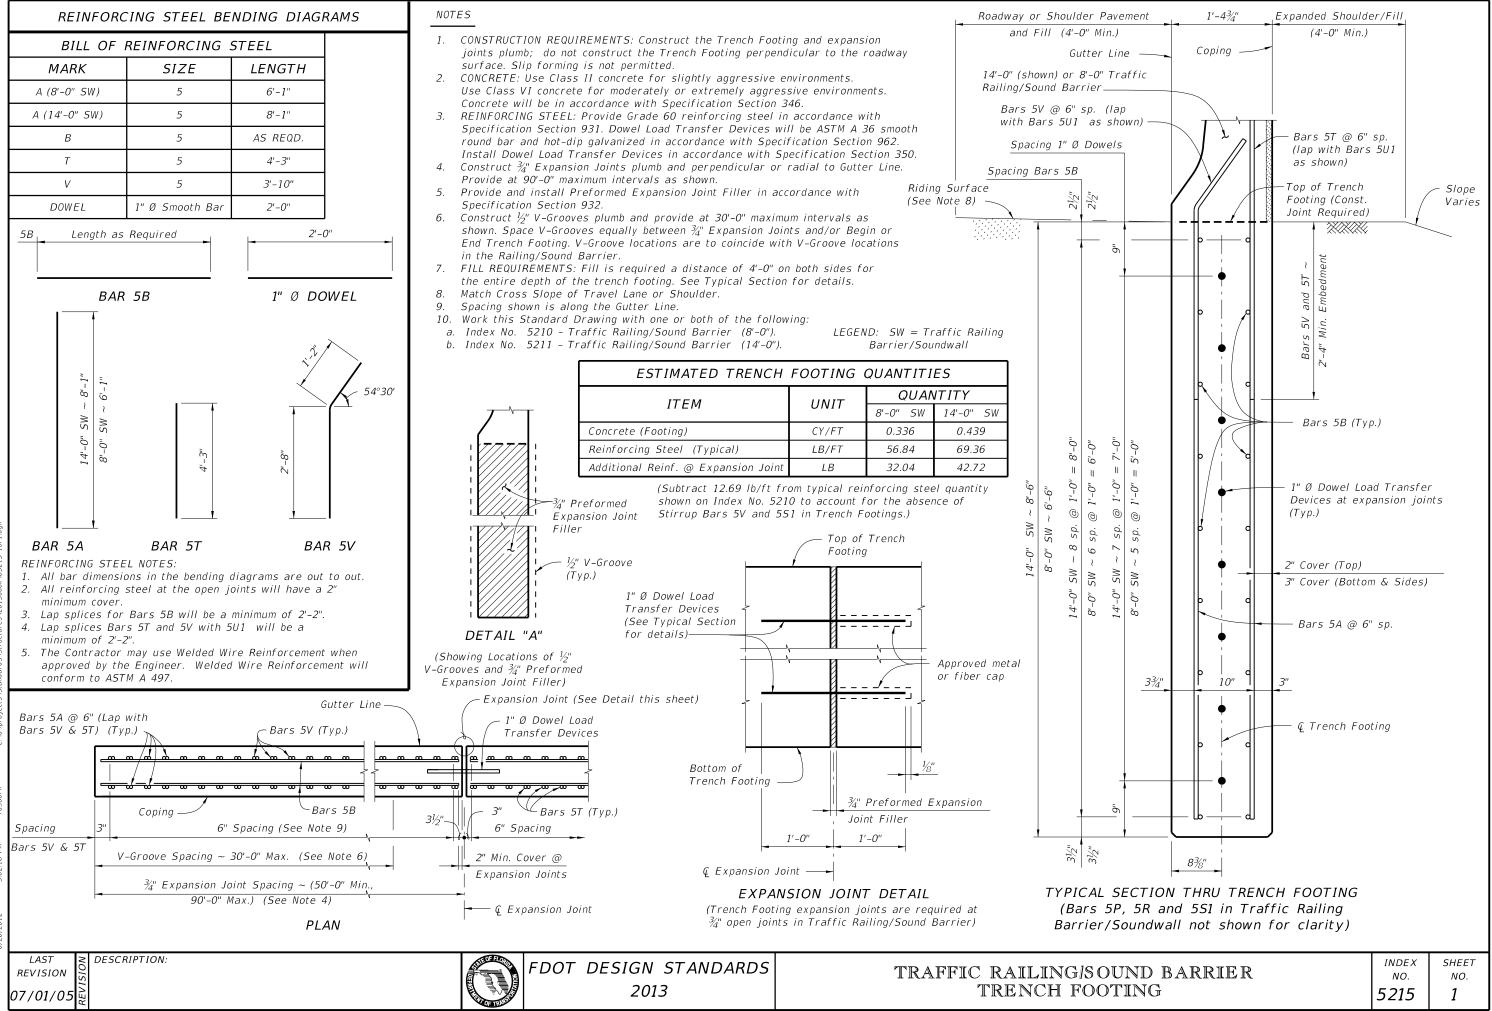

rd960rh C:\d\projects\standards\structures\201

2012 3:02:18 PM rd960rh