


## BENDING DIAGRAM



NOTE: All bar dimensions are out to out

## ESTIMATED QUANTITIES

ITEM	UNIT	RCP	СМР
Class II Concrete	Cu. Yd.	11.3	11.4
Reinforcing Steel	Lb.	695	695



TYPICAL SECTION THRU ENDWALL

## GENERAL NOTES

(Showing Bars In Back Face Of Wall)

- 1. Straight concrete endwalls are intended for use outside the clear zone.
- 2. Endwalls may be cast-in-place or precast construction. Cast-in-place endwalls shall conform to the details on this Index. Precast construction which adheres to this Index, including any additional reinforcement required for handling which shall be determined by the Contractor or supplier, does not require additional approvals. Deviations from this Index, for precast units, shall require the approval of the State Drainage Engineer prior to construction. For precast construction, see Index 425-001 for opening and grouting details.
- 3. Reinforcing steel shall be either Grade 40 or 60.

(Showing Bars In Front Face Of Wall)

4. Concrete shall be Class II, except ASTM C478 (4000 psi) concrete may be substituted for precast items manufactured in plants meeting the requirements of Section 449 of the Specifications.

- 5. Chamfer: All exposed edges and corners to be chamfered 3/4" unless otherwise shown.
- 6. That portion of corrugated metal pipe in direct contact with the concrete slab and extending 12" beyond shall have a continuous bituminous coating of .004" minimum thickness applied prior to placing of the concrete.
- 7. Sodding shall be in accordance with Index 524-001 and paid for under the contract unit price for Performance Turf, SY.
- 8. Basis of payment for either cast-in-place or precast construction shall be the estimated quantities tabulated on the Index. Concrete and reinforcing steel shall be paid for under the contract unit prices for Class II Concrete (Endwalls), CY and Reinforcing Steel (Roadway), LB.

**REVISION** 11/01/17

(3"x1" Corr.)

(Class B Wall) -

Bars B

В

SECTION AA

OPTIONAL ENTRANCE

FOR CONCRETE PIPE

DESCRIPTION:

(See Option Below)




FY 2018-19 STANDARD PLANS

STRAIGHT CONCRETE ENDWALLS

INDEX 430-031

SHEET 1 of 2

SINGLE AND DOUBLE 60" PIPE

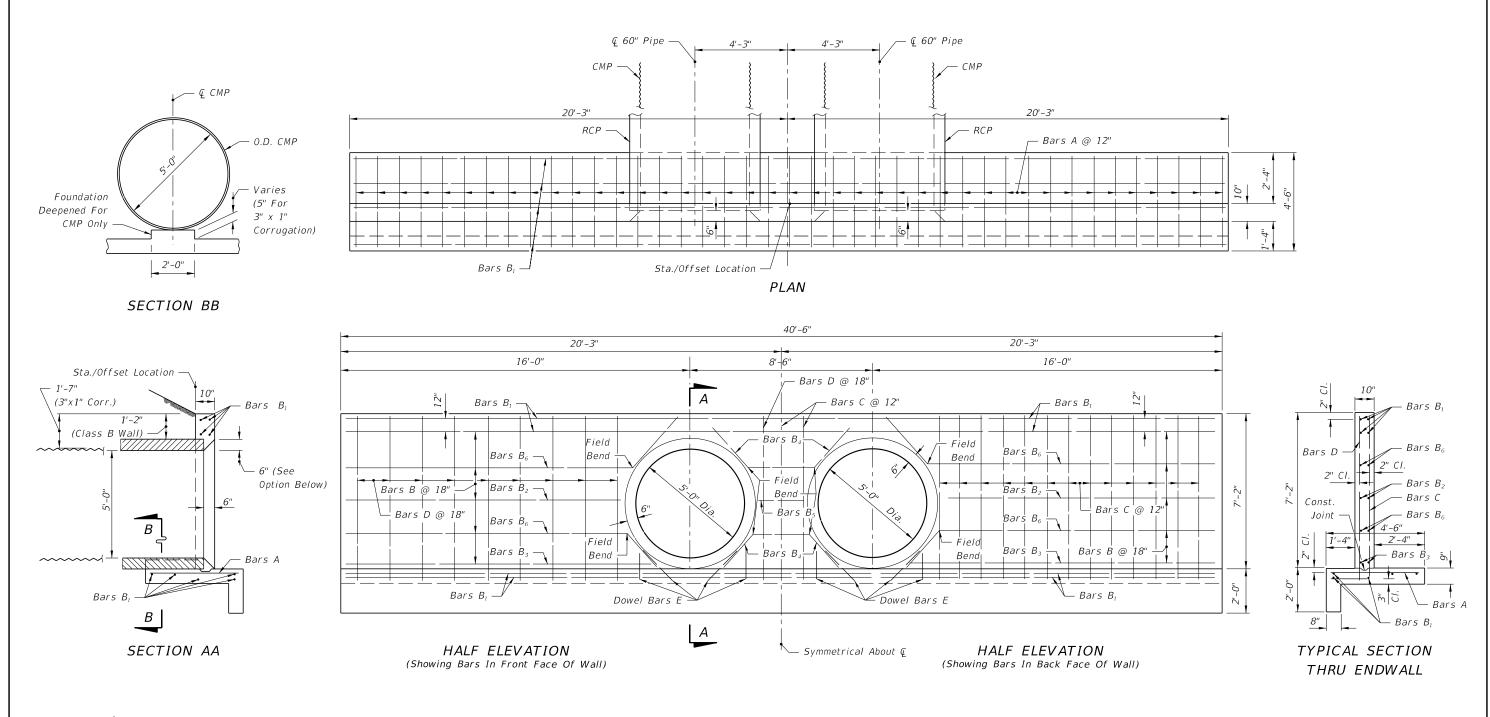



DESCRIPTION:

OPTIONAL ENTRANCE FOR CONCRETE PIPE

BILL OF REINFORCING STEEL							
MARK	SIZE	NO. REQD.	LENGTH	LOCATION	BENDING		
Α	#4	41	4'-2"	Footing	Straight		
$B_1$	#4	9	40'-2"	Footing & Wall	Straight		
$B_2$	#4	4	12'-6"	Wall	Straight		
$B_3$	#4	4	13'-9"	Wall	Straight		
$B_4$	#4	4	6'-0"	Wall	Field Bend		
$B_5$	#4	2	2'-2"	Wall	Straight		
$B_6$	#4	8	15'-0"	Wall	Field Bend		
С	#4	29	9'-4"	Footing & Wall	Bend		
D	#4	20	7'-6"	Footing & Wall	Straight		
Ε	#4	16	1'-8"	Footing & Wall	Straight		

	BENDING DIAGRAM						
ĵ.	7'-6	" ————————————————————————————————————					
	<u> </u>	10"	<u> </u>				
	BAR	·	<u>L</u>				
ıd	NOTE: All bar dimensions are out to out						
	ESTIMATED QUANTITIES						
nd	ITEM	UNIT	RCP	СМР			
	Class II Concrete	Cu. Yd.	13.7	13.8			
	Reinforcing Steel	Lb.	824	824			

NDTE: See Sheet 1 of 2 For General Notes.

REVISION 11/01/17

FDOT

FY 2018-19 STANDARD PLANS

STRAIGHT CONCRETE ENDWALLS

INDEX

SHEET 2 of 2