0.33

0.35

0.37

0.40

0.42

12" For Pipes 14"x23" Through 19"x30"

24" For Pipes 24"x38" And Larger

84"

90"

96'

102'

108"

Allowable Tolerance For Last Full Wrap Of Reinforcing When 1.75 L Using Single Elliptical Cage The Last Full Wrap Of Reinforcing Shall Extend To The Shoulder Alternate Arrangement Of Point And Meet ASTM C-76 Bell Reinforcement --½" Min. Cover :::: 3°Max Min. Cover ::: – Rubber Gasket (Round Or Profile) (Round Rubber Gasket Shown)

> * All circumferential steel located above this line within 1.75 L is defined as bell reinforcement.

> > Varies

BELL AND SPIGOT

Class NS Concrete

materials.

ROUND RUBBER GASKET SHOWN DETAIL OF BELL & SPIGOT CONCRETE PIPE JOINT USING ROUND OR PROFILE RUBBER GASKET

Class NS Concrete Any Wire Mesh Arrangement Which Provides 0.126 Square Inches Of Steel Area Per Linear Foot Both Ways May Be Used; Provided The Wires Are Spaced A Minimum Of 2" And/Or A Maximum Of 6" On Centers

CONCRETE JACKET


0.0195

0.021

0.0225

0.024


0.0255





ISOMETRIC VIEW


DESCRIPTION:



Filter Fabric Jacket Required PROFILE RUBBER GASKET (BEFORE PULL-UP)

Cost of concrete jacket or filter fabric jacket to be included in cost of elliptical concrete pipe culverts.

ELLIPTICAL CONCRETE PIPE JOINTS

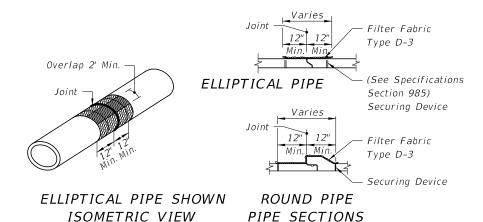

Cost of filter fabric jacket to be included in cost of pipe culverts.

FOR ALL PIPE TYPES - CONCRETE PIPE SHOWN FILTER FABRIC JACKET

CONCRETE JACKET FOR CONNECTING DISSIMILAR TYPES OF PIPE AND CONCRETE PIPES WITH DISSIMILAR JOINTS

12" For Pipes 15" Thru 24"

TONGUE & GROOVE

24" For Pipes 30" And Larger

- Class NS Concrete

Note: For reinforcement see elliptical pipe concrete jacket. (All Pipe Sizes)

DISSIMILAR JOINTS

SECTION AA

Cut Toe Of Existing Endwall

Class NS Concrete

Bituminous Coating Required For

Bituminous Material May Be Field

Extend 12" Beyond Concrete Collar

Applied) Bituminous Coating To

All Metal Pipes (Any Suitable

To Contour Of Pipe

Collar Of Class NS Concrete (May Be Formed

By Any Method Approved By The Engineer)

LONGITUDINAL SECTION

Spigot End To Be Placed In

Existing Endwall Regardless

Of Direction Of Flow

Proposed

Existina

Existing Endwall Less

Than 1' Below Grade

Existing Endwall

Note: Cost for removal and disposal of portions of top and toe of existing endwall and cost of concrete, reinforcing steel and construction of collar to be included in the contract unit price for pipe culvert.


CONCRETE COLLAR FOR EXTENSION OF EXISTING PIPE CULVERTS

2-1/3" Ø Hoops

Set In Adhesive


 $6 - \frac{1}{2}$ " Ø x 16" Dowels

Bonded Material System

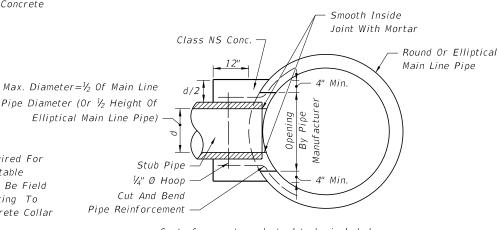

Cost of concrete and steel to be included in contract unit price for pipe culvert.

CONCRETE COLLAR FOR JOINING MAINLINE PIPE AND STUB PIPE



Note: Unless otherwise called for in the plans, the cost of plugging pipes to be included in contract unit price for new pipe.

PIPE PLUG

Note: Cost of concrete and bituminous coating to be included in

contract unit price for either new pipe or Mitered End Section.

Do not use a concrete jacket to join metal pipes of dissimilar


DISSIMILAR TYPES

Alternate connection must be approved by the State Drainage Engineer.

FDOT


REVISION

11/01/17

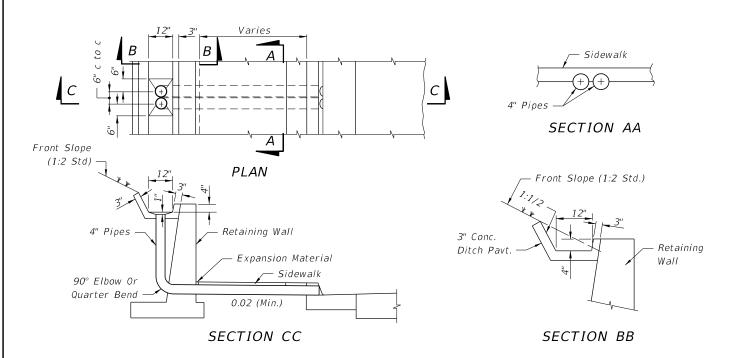

Note: PVC pipe, Schedule 40, to be paid for under the contract unit price for Polyvinyl Chloride Pipe Culvert (4"), LF.


CONCRETE GUTTER AND DRAINS AT RETAINING WALLS

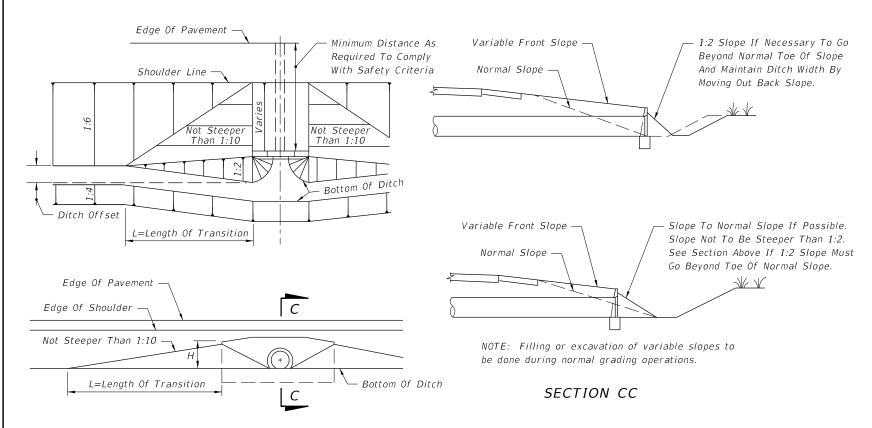


Use Larger Value Of Either:


- 1. L=10xH (No Maximum)
- 2. L=10xDitch Offset (Maximum L=100')

METHOD FOR SETTING LIMITS OF VARIABLE FRONT SLOPES AT DRAINAGE STRUCTURES






CLIP DETAIL

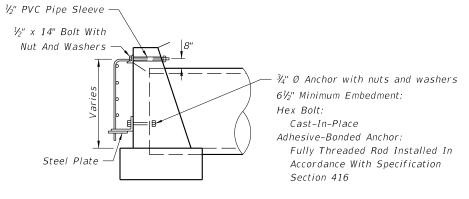

SIDE VIEW

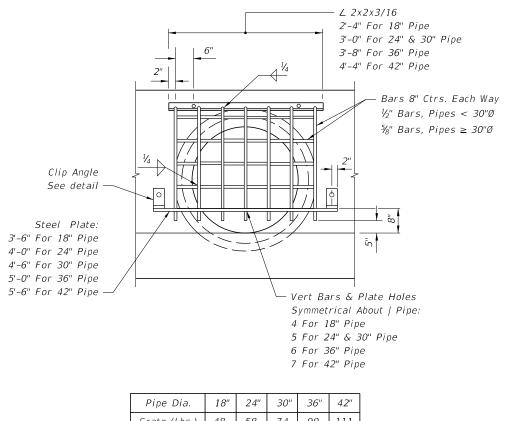

Pipe Dia.	18"	24"	30"	36"	42"
Grate (Lbs.)	48	58	74	90	111

FRONT VIEW

Note: Guards to be constructed only at locations specifically called for in plans.

GUARD AT PIPE ENDS

REVISION 11/01/17

DESCRIPTION:



FY 2019-20 STANDARD PLANS


MISCELLANEOUS DRAINAGE DETAILS

INDEX 430-001


SHEET

	CLEARANCE	STRENGTH
RAILROAD COMPANY	BELOW BOTTOM OF RAIL (FEET) ⁽²⁾	ASTM (C76) CLASS
Alabama & Gulf Coast Railway (Rail America)	5.5	IV
AN Railway & Bay Line Railroad (Genesee & Wyoming)	5.5 / 4.5 (1)	V
CSX Transportation	5.5	V
First Coast Railroad (Genesee & Wyoming)	5.5 / 4.5 (1)	V
Florida Midland, Central, and Northern Railroads (Pinsly Railroad)	5.5	V
Florida East Coast (FEC) Railway Company	5.5	IV
Florida West Coast Railroad Company	5.5	V
Georgia & Florida Railway, Inc.	5.5	V
Norfolk Southern (NS) Railway Corporation	5.5 / 4.5 (1)	V
Port of Palm Beach District Railroad	5.5	IV
Seminole Gulf Railway (LP)	6.0	V
South Central Florida Express	6.0	V
Talleyrand Terminal Railroad (Genesee & Wyoming)	5.5 / 4.5 (1)	V
South Florida Regional Transportation Authority (Tri-County Commuter Rail)	5.5	V

- (1) Distance standard for yard and industrial tracks.
- (2) Clearance is for casing pipe. All subgrade carrier pipelines and wirelines will be installed within a casing pipe which will extend from Right-of-Way line to Right-of-Way line.

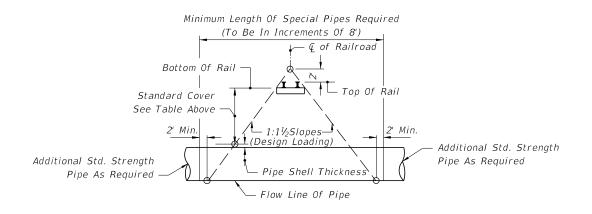

METHOD FOR DETERMINING THE LENGTH OF SPECIAL PIPE REQUIRED UNDER RAILROADS

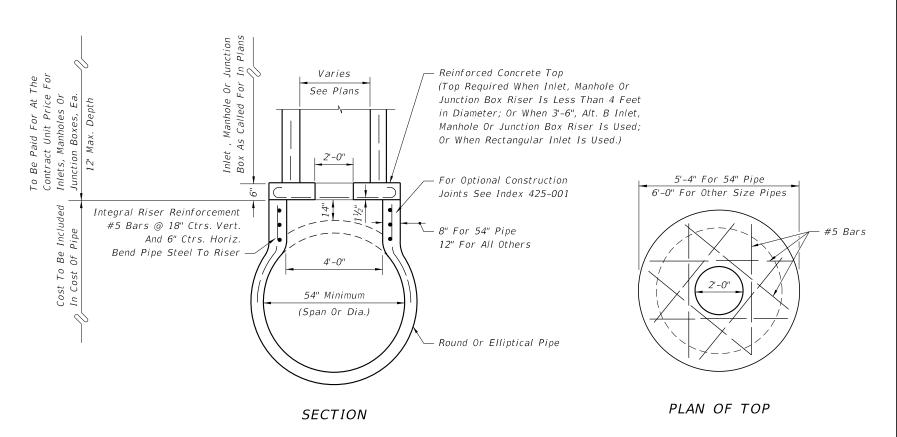

INLETS, MANHOLES OR JUNCTION BOXES ON INTEGRAL PRECAST CONCRETE RISER FOR CONCRETE PIPE