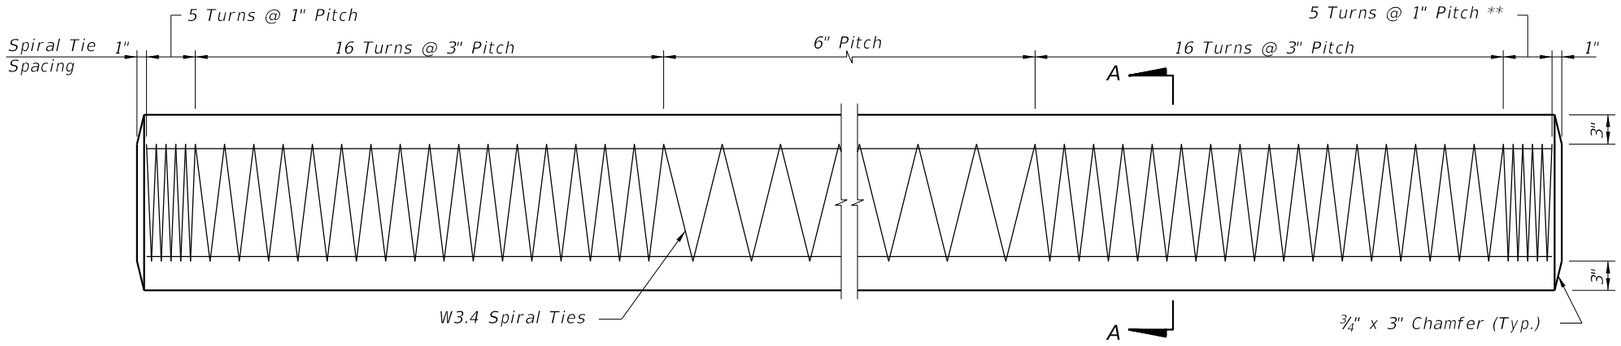

ELEVATION

*** See Note 4 on Index 455-002*

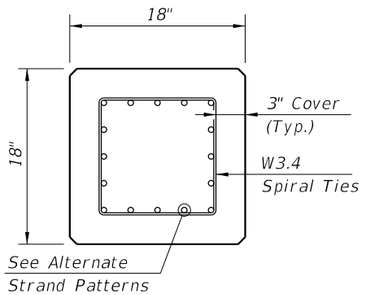

SECTION A-A

ALTERNATE STRAND PATTERNS

12 ~ 0.6" Ø, Grade 270 LRS, at 35 kips
12 ~ ½" Ø (Special), Grade 270 LRS, at 34 kips
16 ~ ½" Ø, Grade 270 LRS, at 26 kips
20 ~ 7/16" Ø, Grade 270 LRS, at 21 kips
24 ~ ⅜" Ø, Grade 270 LRS, at 17 kips

NOTES:
1. *Work this Index with Index 455-001 – Typical Details and Notes for Square Prestressed Concrete Piles and Index 455-002 – Square Prestressed Concrete Pile Splices.*
2. *Any of the given Alternate Strand Patterns may be utilized. The strands shall be located as follows:*
   Place one strand at each corner and place the remaining strands equally spaced between the corner strands.
   The total strand pattern shall be concentric with the nominal concrete section of the pile.

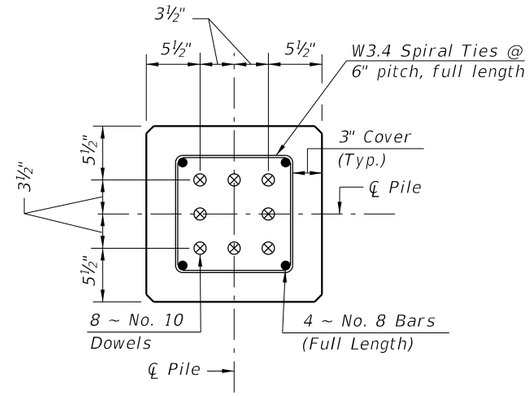

SECTION D-D

(See Non-Drivable Unforeseen Reinforced Precast Splice Detail)

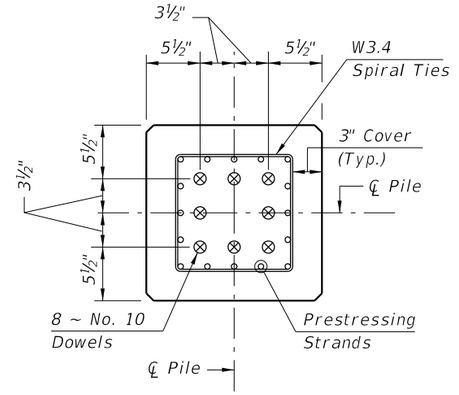

SECTION E-E

(See Drivable Prestressed Precast Splice Detail)

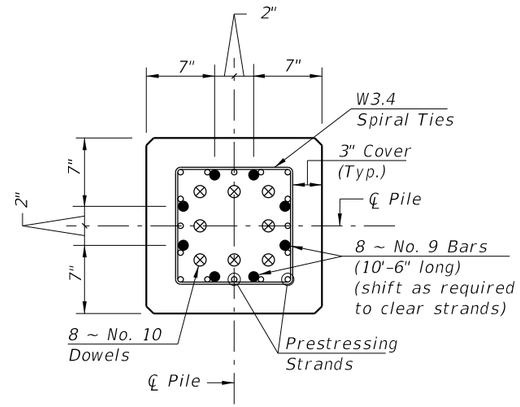

SECTION F-F

(See Drivable Preplanned Splice Detail)

PILE SPLICE REINFORCEMENT DETAILS

10/24/2018 11:39:33 AM

LAST REVISION	REVISION	DESCRIPTION:	FDOT	FY 2019-20 STANDARD PLANS	18" SQUARE PRESTRESSED CONCRETE PILE	INDEX	SHEET
01/01/12						455-018	1 of 1