


ELEVATION

*The 45" \emptyset Void in the pile shall be positively vented to water or air after the final pile installation. If the 3 1/2" \emptyset vents are included in the pile cut-off section, then venting shall be provided by the use of a 1" \emptyset PVC conduit through the substructure cap or column.

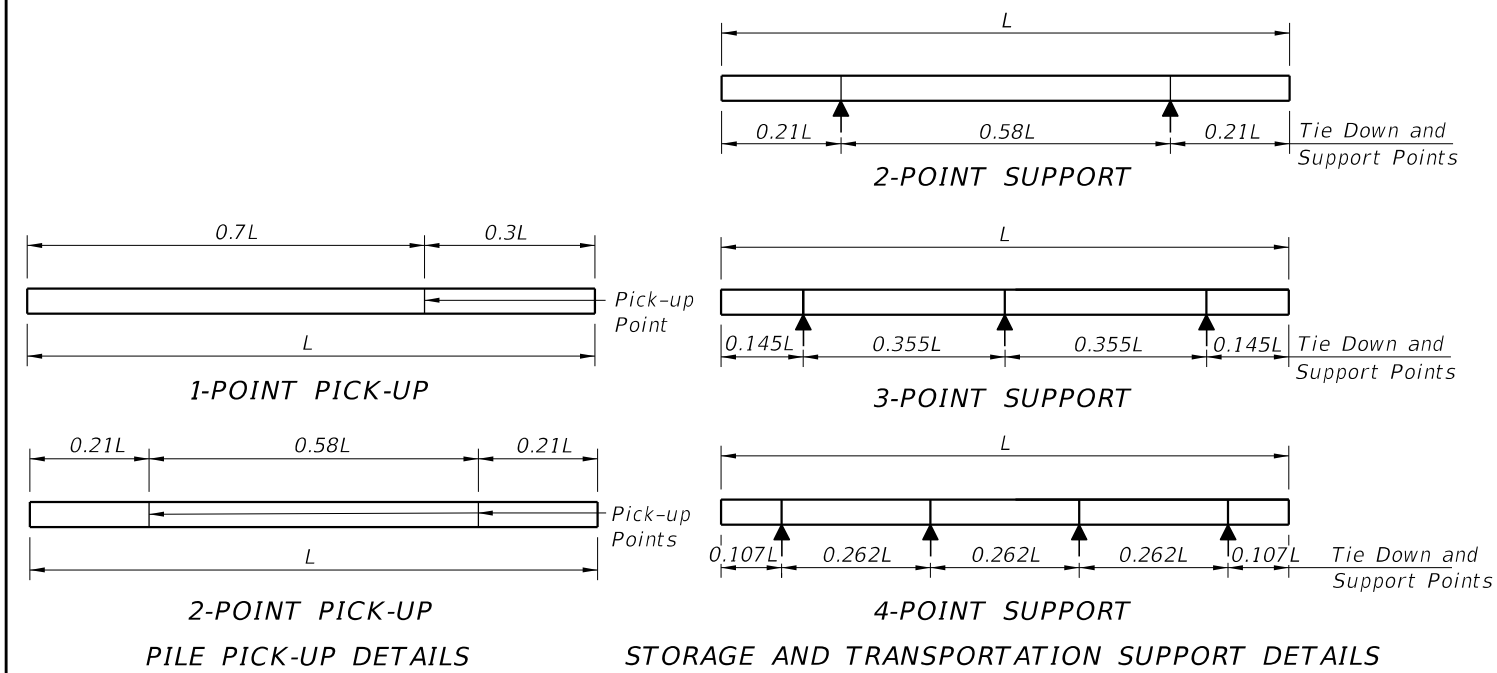


NOTES

1. Work this Index with the Pile Data Table in the Structures Plans.
2. Concrete:
 - A. Piles: Class V (Special)
 - B. Splice Collar: Class IV
 - C. Silica Fume: See "GENERAL NOTES" in the Structures Plans for locations where the use of silica fume, metakaolin or ultra-fine flyash is required.
3. Concrete Strength at time of prestress transfer:
 - A. Piles: 4,000 psi minimum.
4. Reinforcing:
 - A. Bars:
 - a. Stainless Steel: Meet the requirements of Specification Section 931 for Type 304, Grade 75.
 - b. Carbon FRP: Meet the requirements of Specification Section 932.
 - B. Prestressing Strands:
 - a. Stainless Steel: Seven-wire HSSS, UNS S32205 (Type 2205) or UNS S31803 strand, meeting the requirements of Specification Section 933.
 - b. Carbon FRP: Meet the requirements of Specification Section 933.
 - C. Spiral Ties:
 - a. One half turn is required for carbon steel spiral splice.
 - b. One full turn is required at the pile head and tip.
5. Pile Splices:
 - A. Epoxy: Type AB Epoxy Compound or Epoxy Mortar must meet the requirements of Specification Section 926.
 - a. Use a Type AB Epoxy Bonding Compound or Epoxy Mortar, as recommended by the Manufacturer, to form the joint between pile sections
 - b. Use a Type AB Epoxy Bonding Compound as a bonding agent on internal pile surfaces.
 - B. Splices: Resume pile driving after the splice concrete reaches a minimum strength of 5,500 psi.
6. Mark piles at the pick-up points to indicate the proper points for attaching handling lines.


TABLE OF MAXIMUM PILE PICK-UP AND SUPPORT LENGTHS

Maximum Pile Length (Feet)	Required Storage and Transportation Detail	Pick-Up Detail
122	2, 3, or 4 point	1 Point
174	2, 3, or 4 point	2 Point

10/29/2019 2:59:05 PM

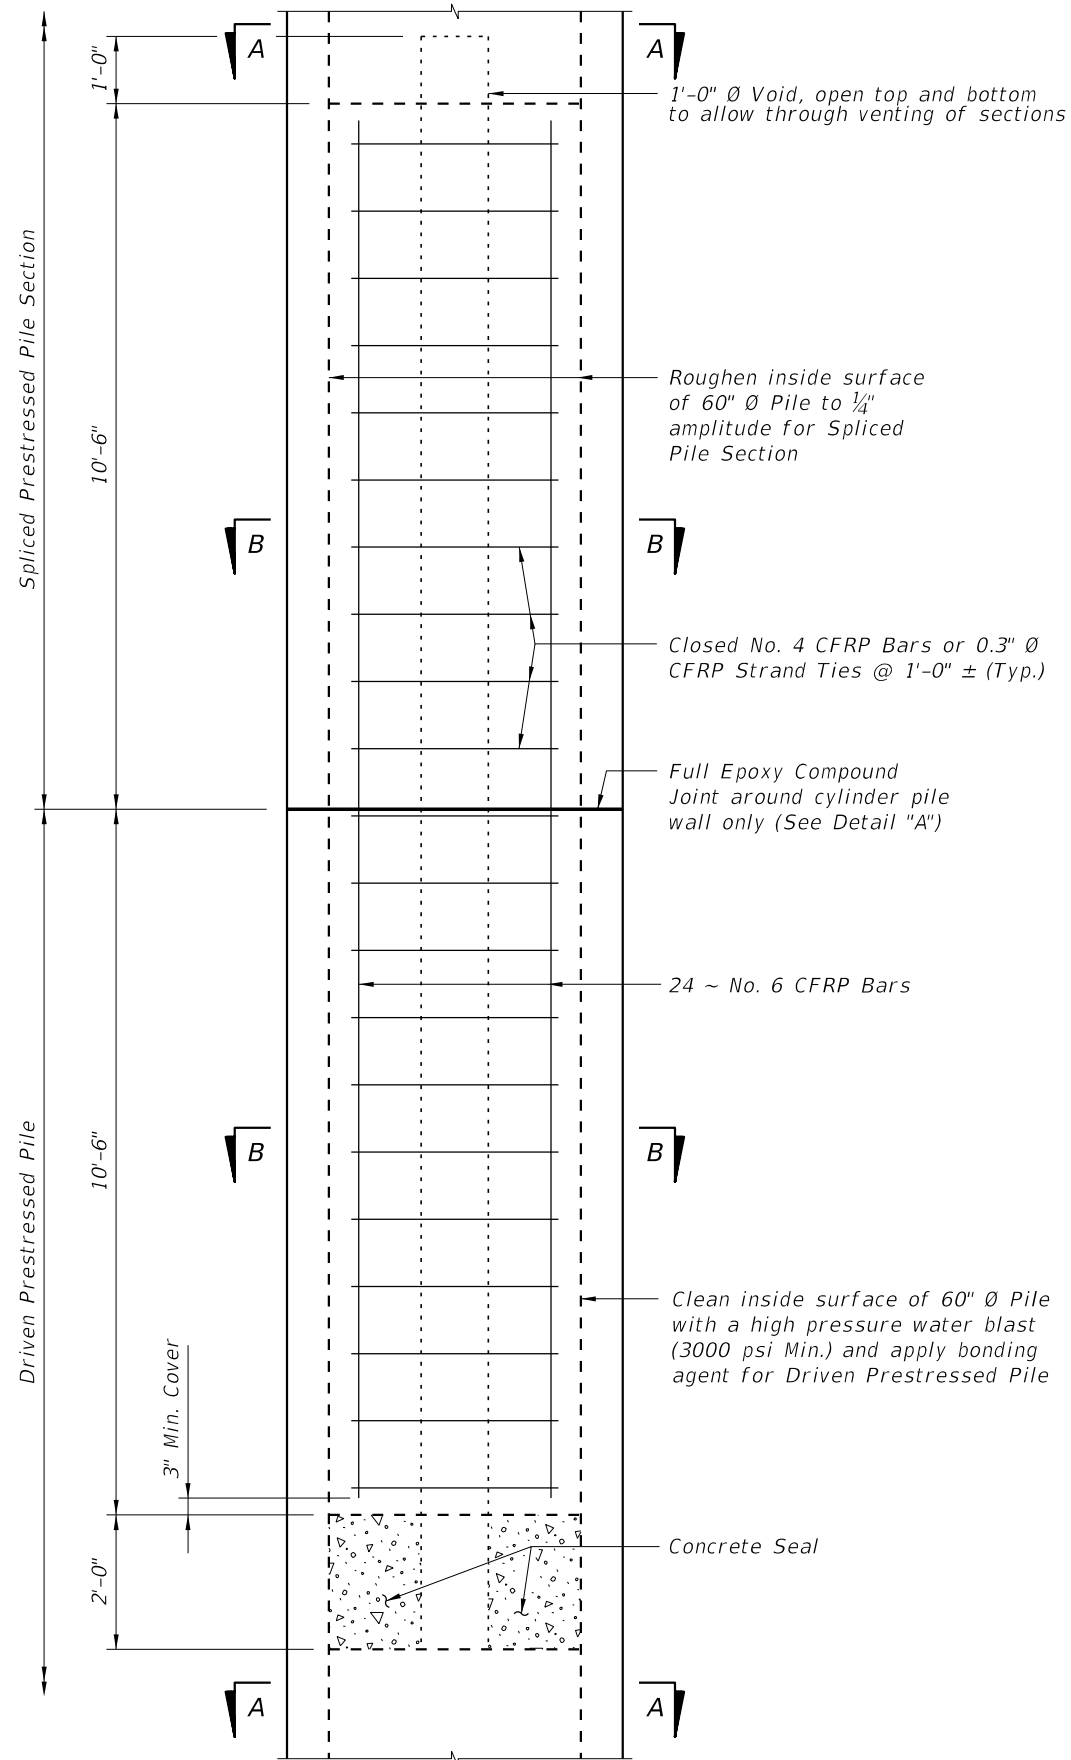


DRIVABLE UNFORESEEN FIELD SPLICE DETAIL
(Cast in Place Plug)

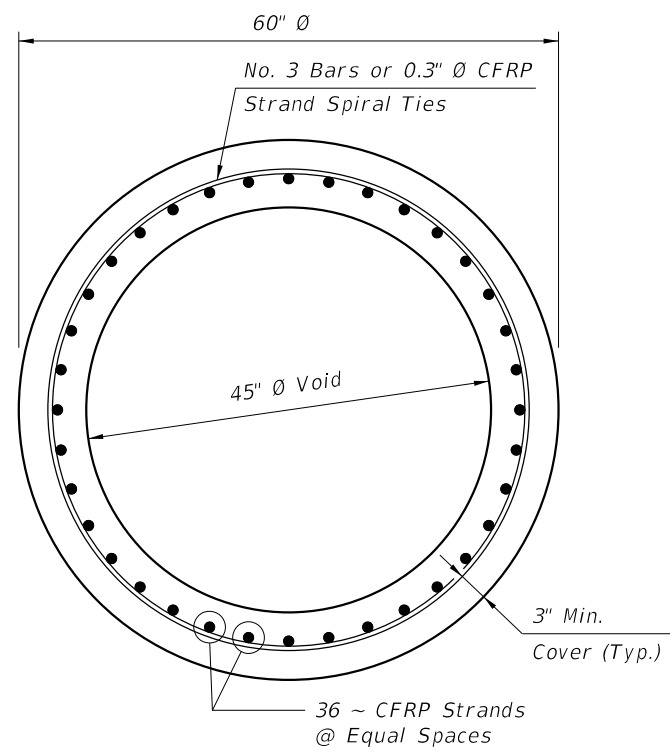


SECTION A-A

ALTERNATE STRAND PATTERNS

- 0.5" \emptyset , CFRP Single-Strand, at 39 kips
- 0.6" \emptyset , CFRP 7-Strand, at 40 kips

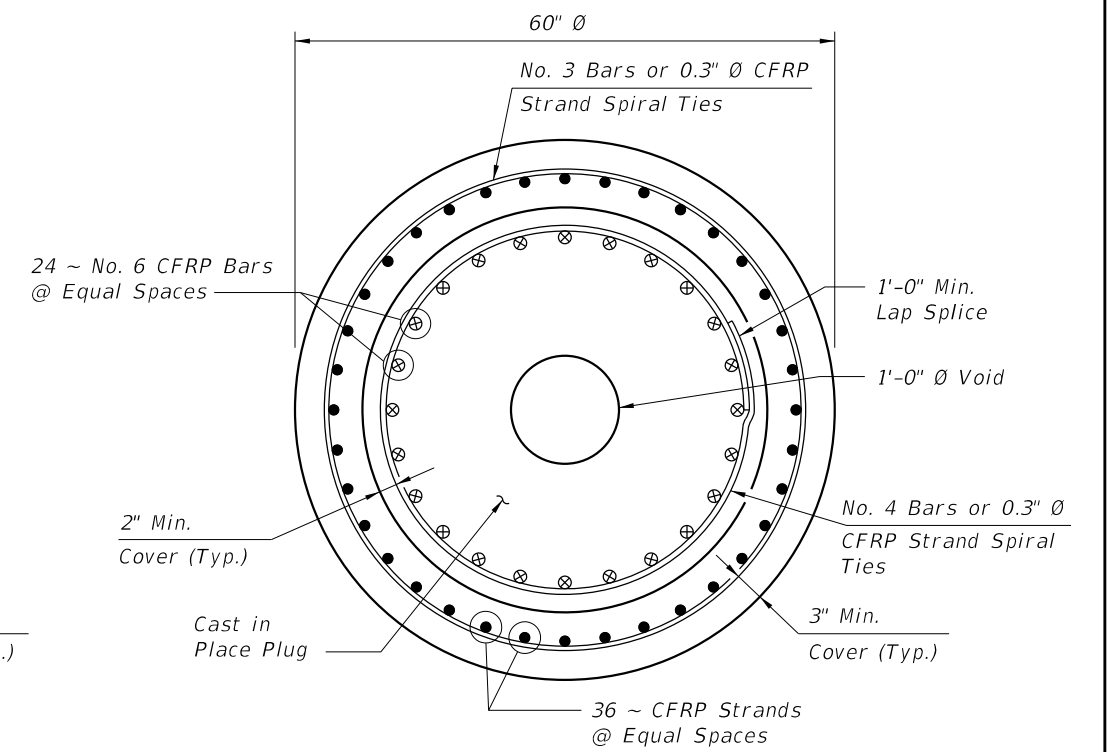

SECTION B-B

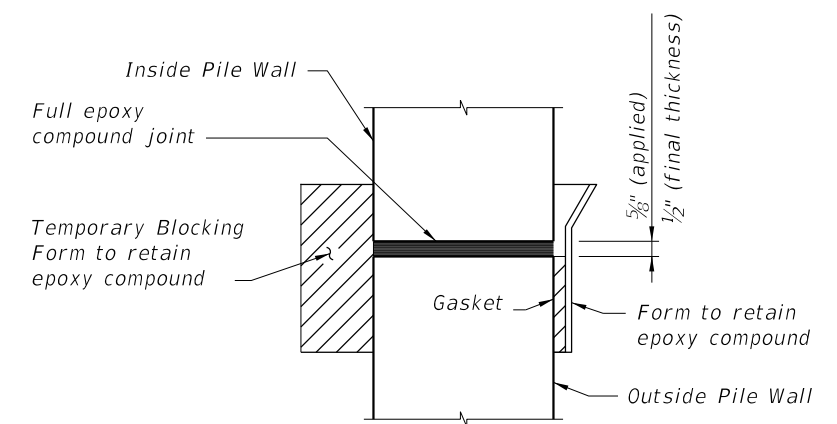

DETAIL "A"

10/29/2019 2:59:06 PM

LAST REVISION
01/01/16

DESCRIPTION:




FY 2020-21
STANDARD PLANS

60" PRESTRESSED CFRP & SS CONCRETE
CYLINDER PILE


INDEX
455-160

SHEET
2 of 3


CFRP PRESTRESSED PILE DETAILS

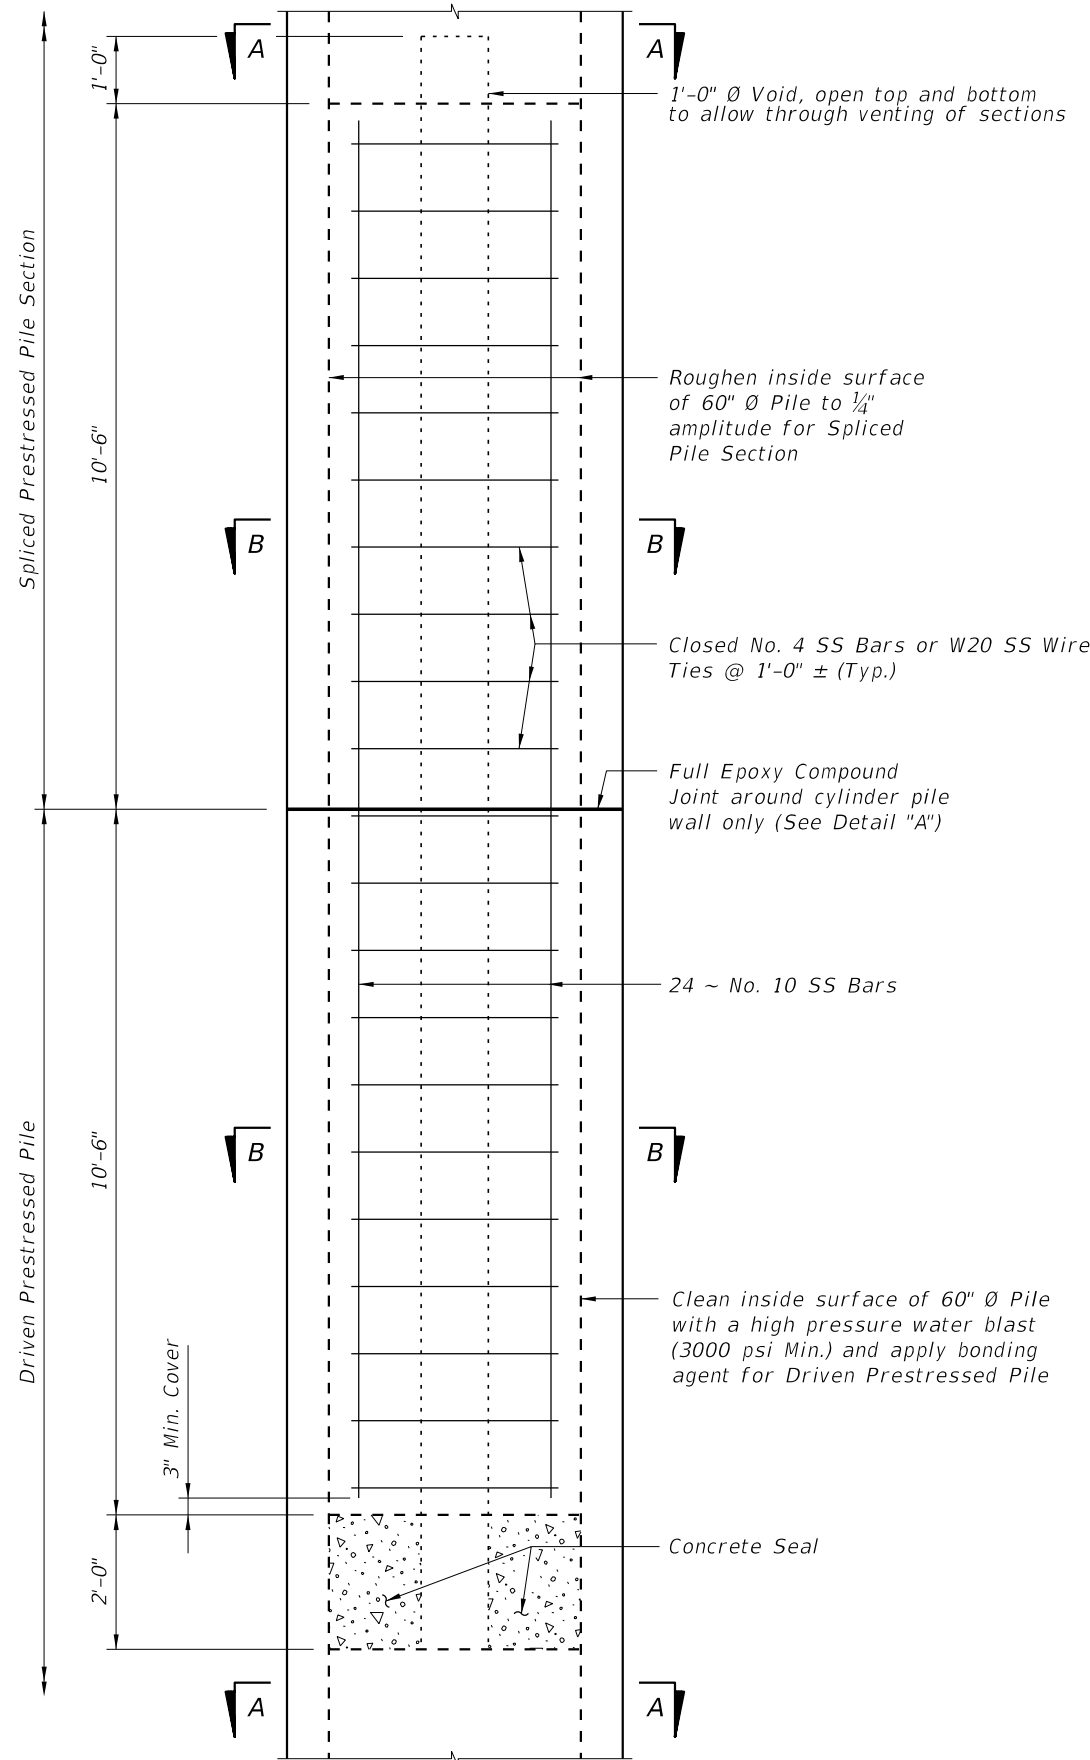

DRIVABLE UNFORESEEN FIELD SPLICE DETAIL
(Cast in Place Plug)

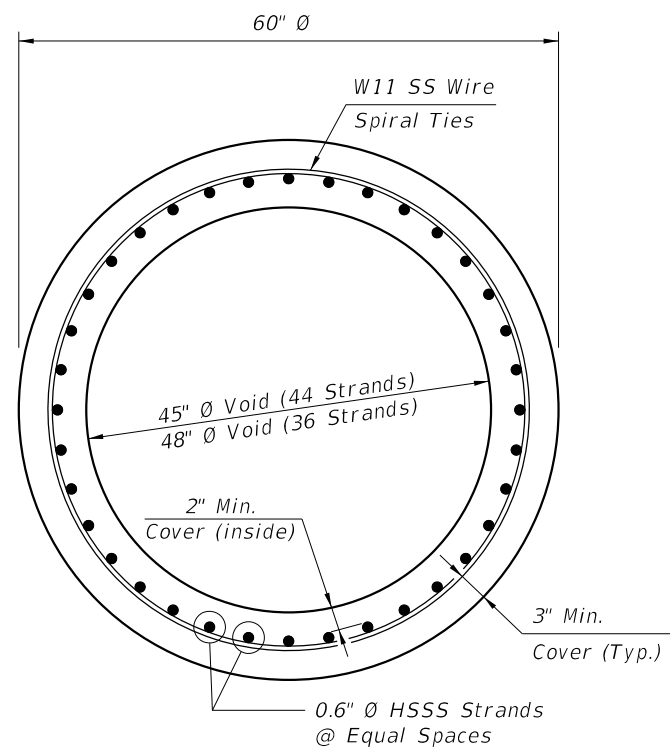


SECTION A-A

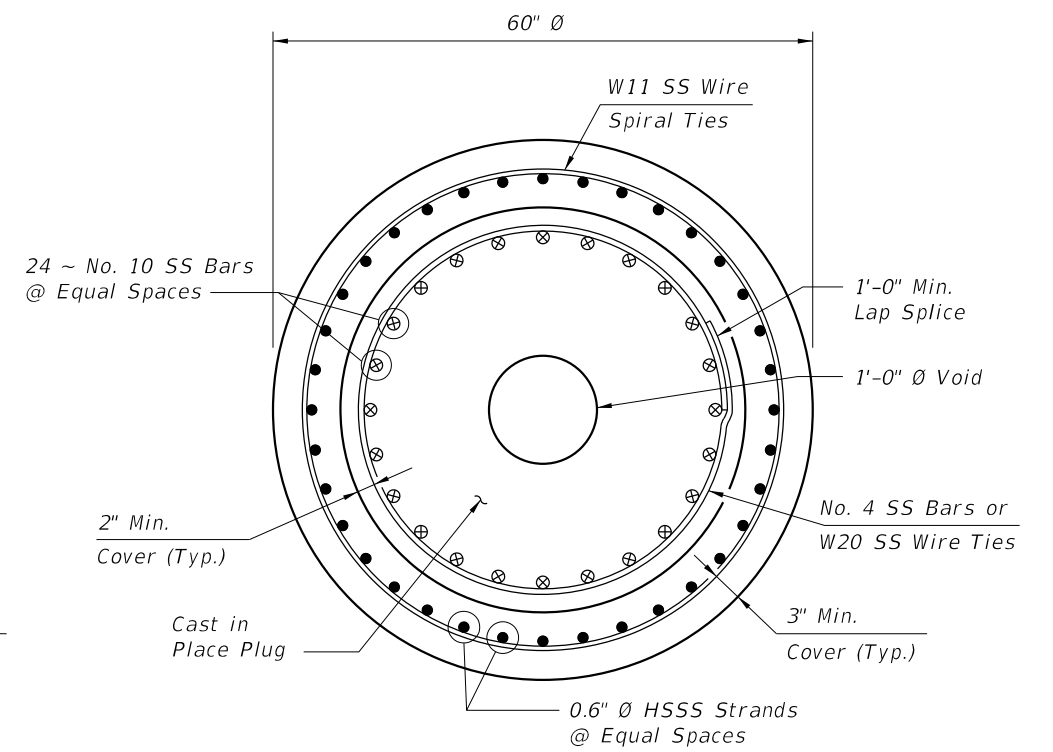

SECTION B-B

ALTERNATE STRAND PATTERNS

- 44 ~ 0.6" Ø, HSSS Strand, at 36 kips
- 36 ~ 0.6" Ø, HSSS Strand, at 36 kips

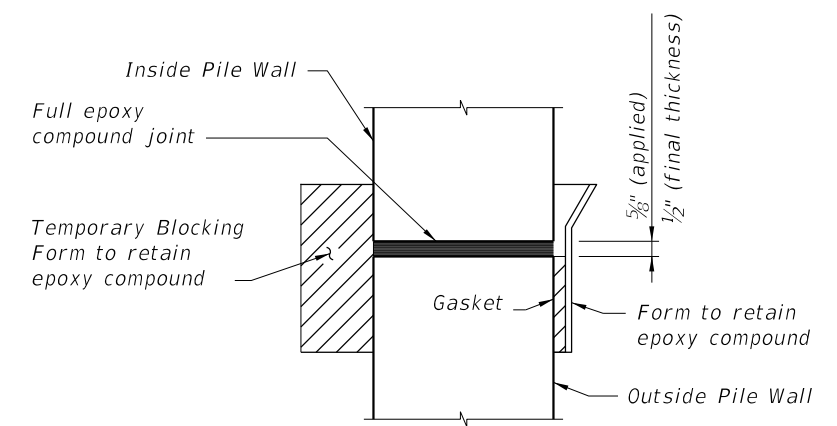

DETAIL "A"

SS PRESTRESSED PILE DETAILS

10/29/2019 2:59:07 PM

LAST REVISION	01/01/16	DESCRIPTION:
---------------	----------	--------------



FY 2020-21
STANDARD PLANS

60" PRESTRESSED CFRP & SS CONCRETE
CYLINDER PILE

INDEX
455-160

SHEET
3 of 3