

GENERAL NOTES:

1. Cross Slopes and Grades:

- A. Sidewalk, ramp, and landing slopes (i.e. 0.02, 0.05, and 1:12) shown in this Index are maximums. With approval of the Engineer, provide the minimum feasible slope where the requirements cannot be met.
- B. Landings must have cross-slopes less than or equal to 0.02 in any direction.
- C. Maintain a single longitudinal slope along each side of the curb ramp. Ramp slopes are not required to exceed 15 feet in length.
- D. Joints permitted at the location of Slope Breaks. Otherwise locate joints in accordance with Index 522-001. No joints are permitted within the ramp portion of the Curb Ramp.

2. Curb, Curb and Gutter and/or Sidewalk:

- A. Refer to Index 522-001 for concrete thickness and sidewalk details.
- B. Remove any existing curb, curb and gutter, or sidewalk to the nearest joint beyond the curb transition or to the extent that no remaining section is less than 5 feet long.

3. Curb Ramp Alpha-Identification:


- A. Sidewalk curb ramp alpha-identifications (e.g. CR-A) are provided for reference purposes in the Plans.
- B. Alpha-identifications CR-I and CR-J are intentionally omitted.

4. Detectable Warnings:

- A. Install detectable warnings in accordance with Specification 527.
- B. Place detectable warnings across the full width of the ramp or landing, to a minimum depth of 2 feet measured perpendicular to the curb line and no greater than 5 feet from the back of the curb or edge of pavement.
- C. If detectable warnings are shown in the Plans on slopes greater than 5%, align the truncated domes with the centerline of the ramp; otherwise, the truncated domes are not required to be aligned.

5. Detectable Warnings - Acceptance Criteria:


- A. Color and texture shall be complete and uniform.
- B. 90% of individual truncated domes shall be in accordance with the Americans with Disabilities Act Standards for Transportation Facilities, Section 705.
- C. There shall be no more than 4 non-compliant domes in any one square foot.
- D. Non-compliant domes shall not be adjacent to other non-compliant domes.
- E. Surfaces shall not deviate more than 0.10" from a true plane.

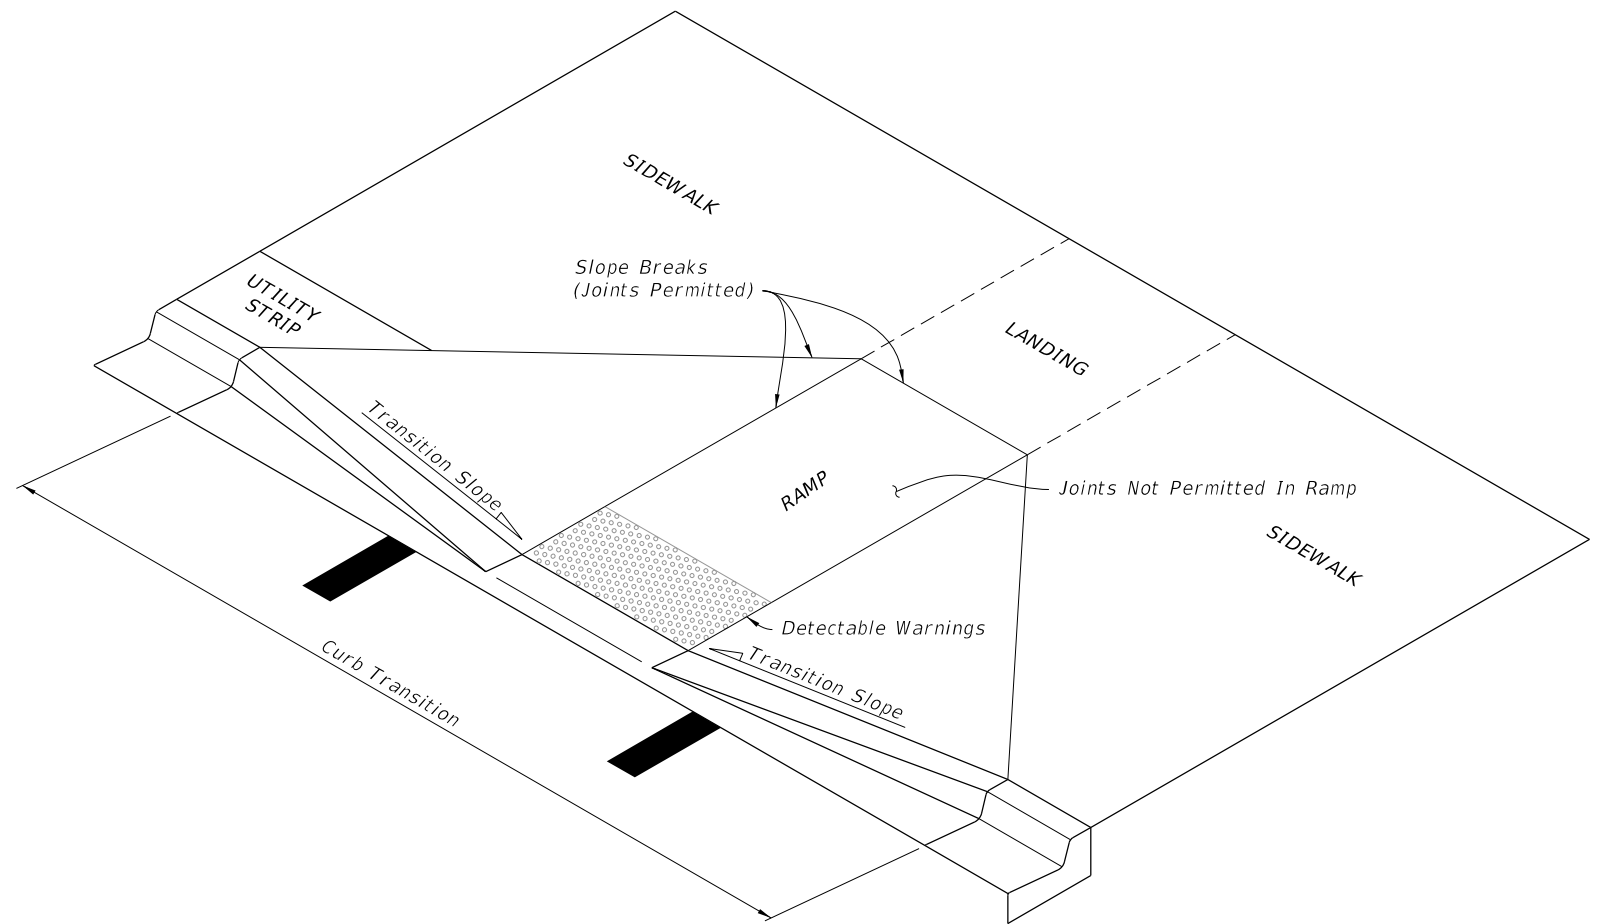


=====**CURB RAMP NOMENCLATURE**=====

7/20/2020 2:09:54 PM


LAST REVISION 11/01/19	REVISION	DESCRIPTION:	 FY 2020-21 STANDARD PLANS	DETECTABLE WARNINGS AND SIDEWALK CURB RAMPS	INDEX 522-002	SHEET 1 of 7
------------------------------	----------	--------------	---	--	-------------------------	------------------------

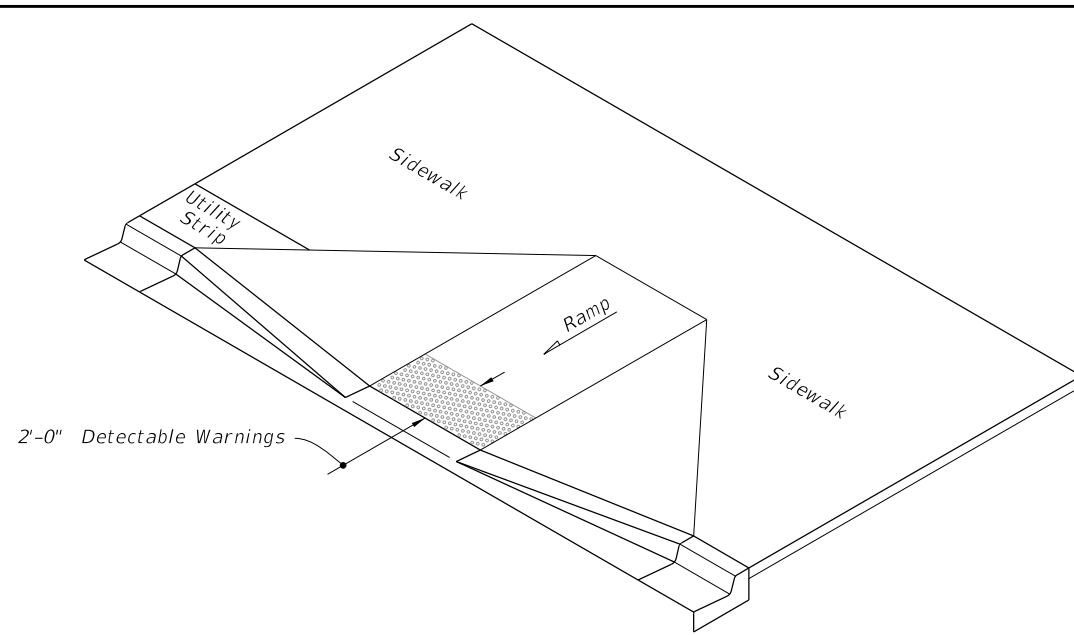

ISOMETRIC VIEW

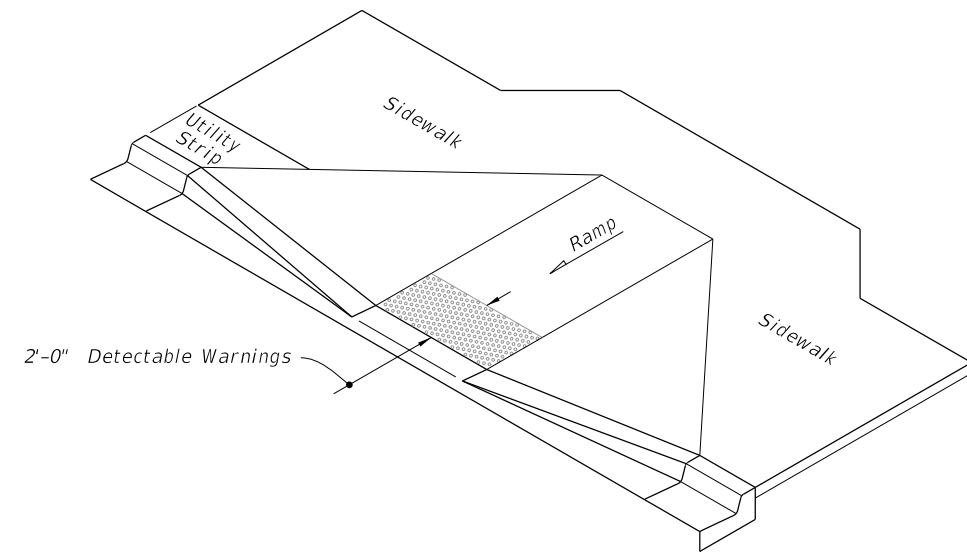


ISOMETRIC VIEW

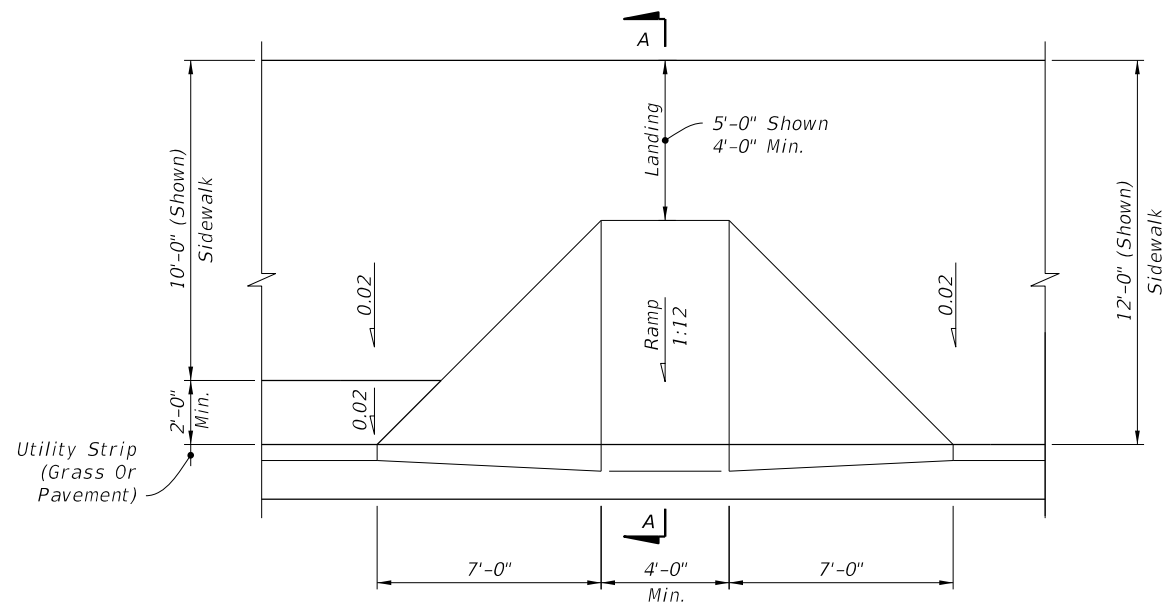

PLAN VIEW


NOTE: For Example of CR-A used in Radial Curb Returns, See Sheet 8.

CR-A

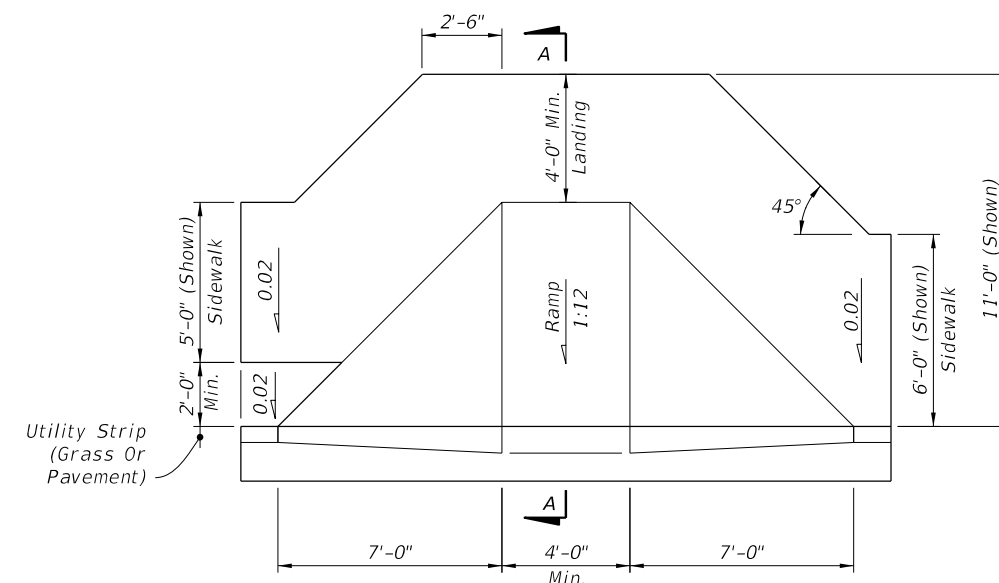

PLAN VIEW

CR-B

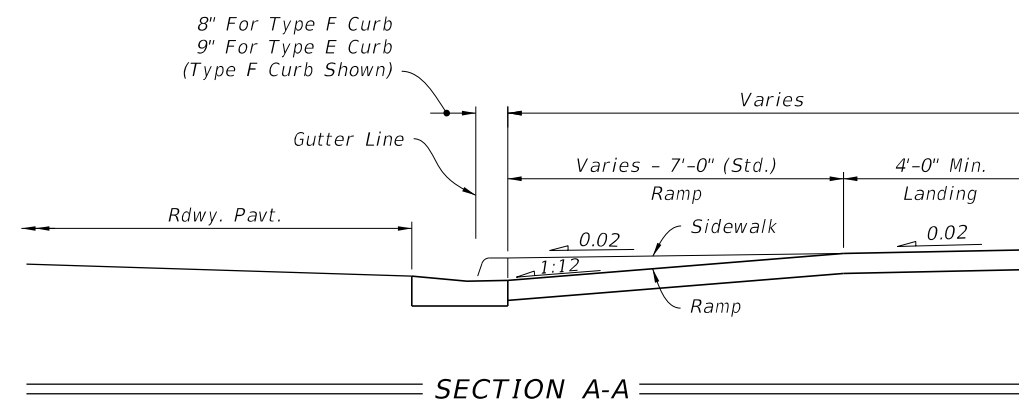

SECTION A-A

SIDEWALK CURB RAMPS CR-A AND CR-B

7/20/2020 2:09:58 PM

LAST REVISION 11/01/18	DESCRIPTION:
---------------------------	--------------




FY 2020-21
STANDARD PLANS



DETECTABLE WARNINGS AND SIDEWALK CURB RAMPS

INDEX
522-002



SHEET
2 of 7

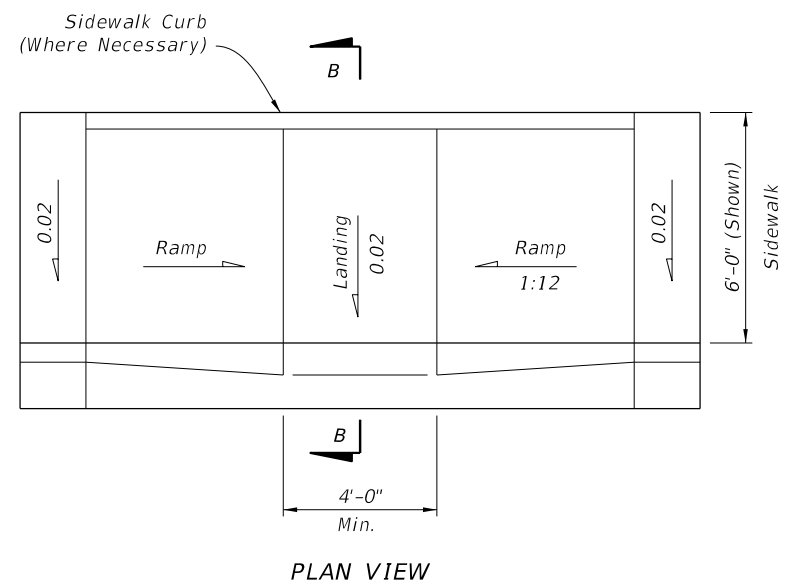

CR-C

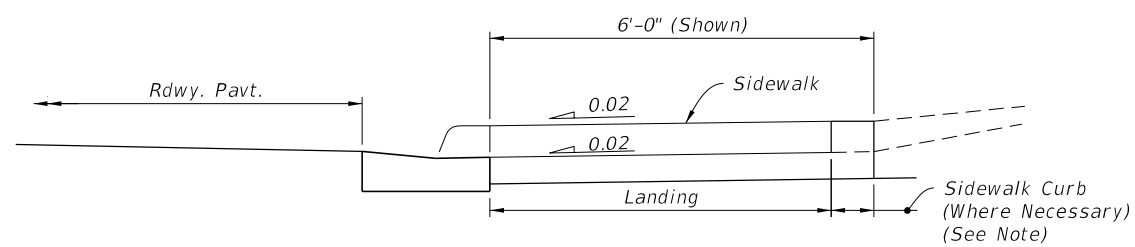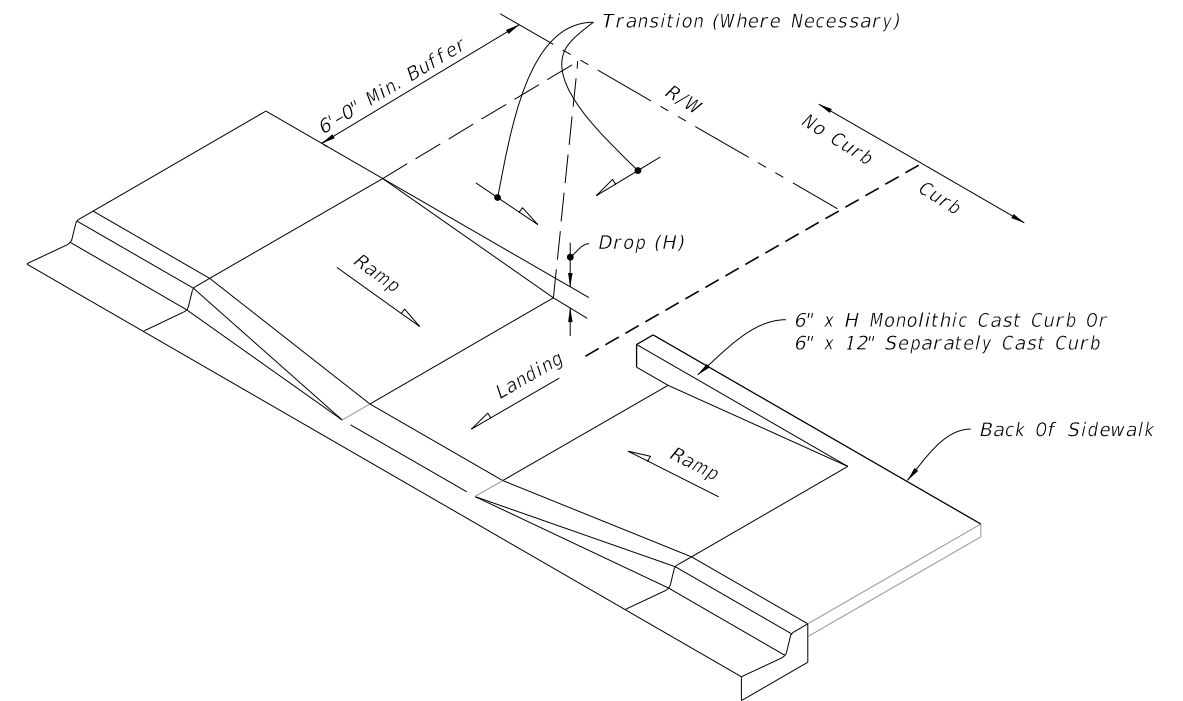

NOTE: For additional information on sidewalk curb construction, see SIDEWALK CURB OPTIONS details.

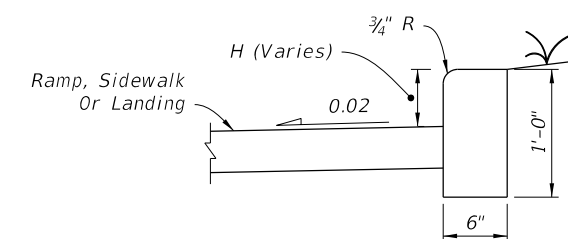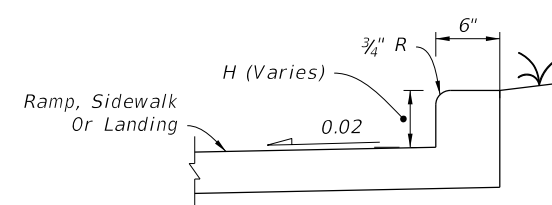

SIDEWALK CURB OPTIONS

SIDEWALK CURB RAMPS CR-C AND SIDEWALK CURB

7/20/2020 2:10:03 PM

LAST REVISION 11/01/18	DESCRIPTION:
---------------------------	--------------




FY 2020-21
STANDARD PLANS


DETECTABLE WARNINGS AND SIDEWALK CURB RAMPS

INDEX
522-002

SHEET
3 of 7

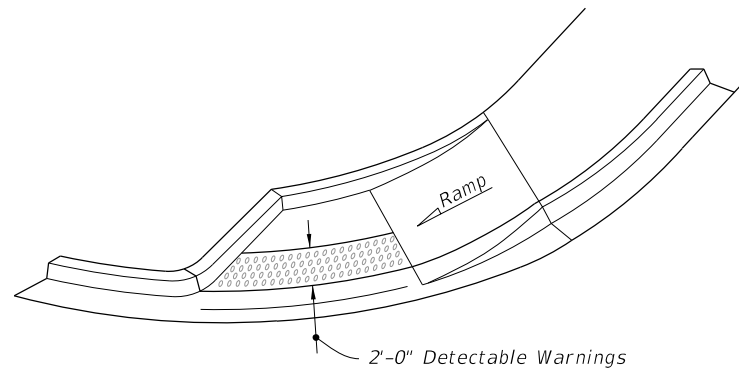


ISOMETRIC VIEW

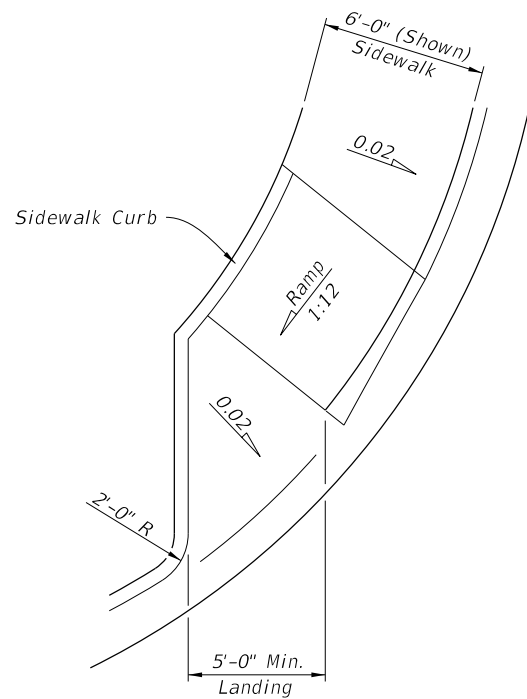


PLAN VIEW


CR-D

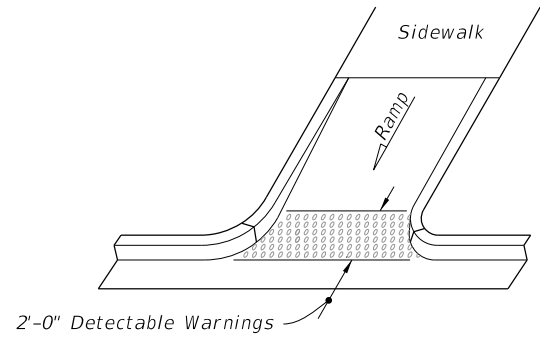

OPTION A

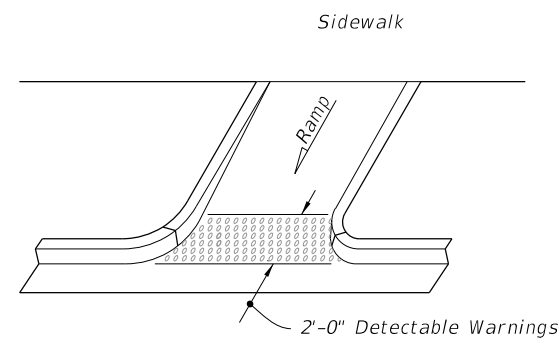


OPTION B
ISOMETRIC VIEW

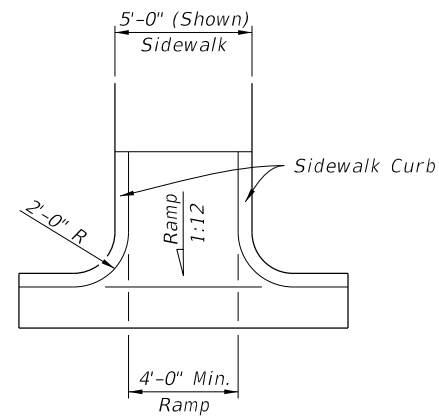


PLAN VIEW

CR-E

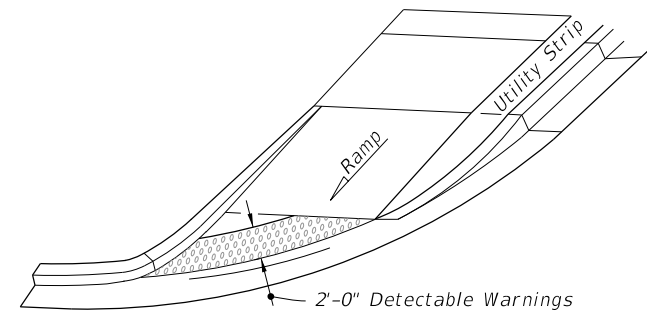


OPTION A

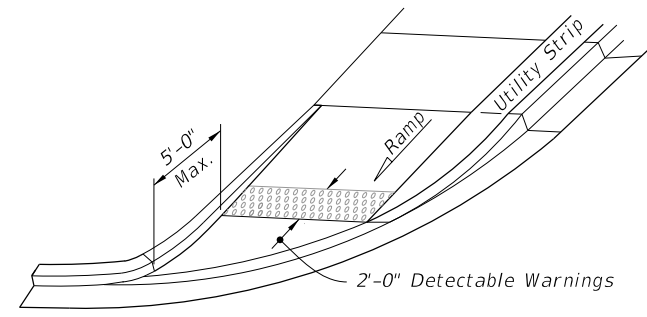


OPTION B

ISOMETRIC VIEW

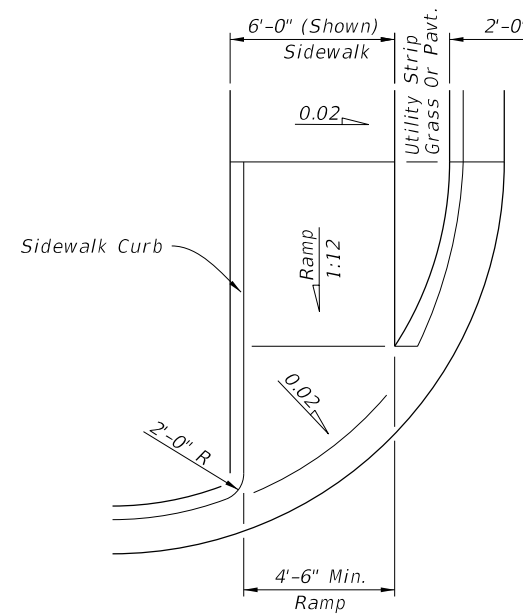


PLAN VIEW

CR-F

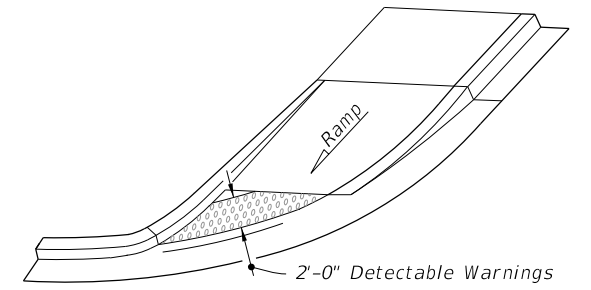


OPTION A

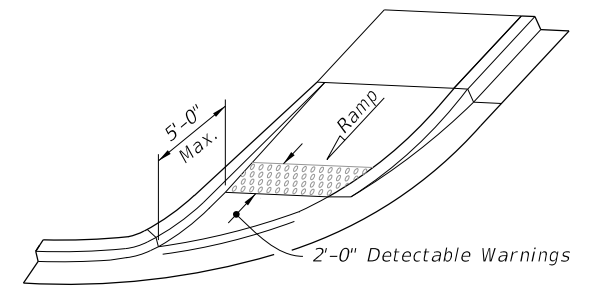

OPTION B

ISOMETRIC VIEW

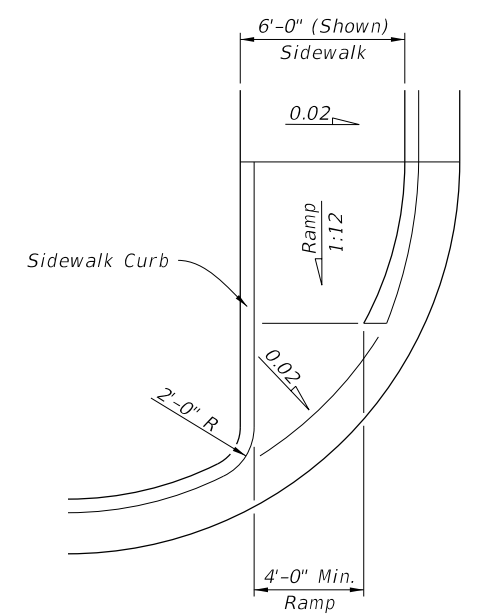

PLAN VIEW

CR-G

SIDEWALK CURB RAMPS CR-D, CR-E, CR-F & CR-G

7/20/2020 2:10:05 PM


LAST REVISION 11/01/18	DESCRIPTION:
---------------------------	--------------


**FY 2020-21
STANDARD PLANS**


DETECTABLE WARNINGS AND SIDEWALK CURB RAMPS

INDEX
522-002


SHEET
4 of 7

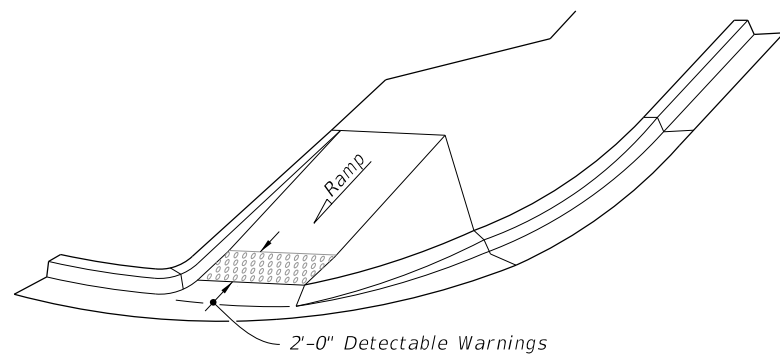


ISOMETRIC VIEW

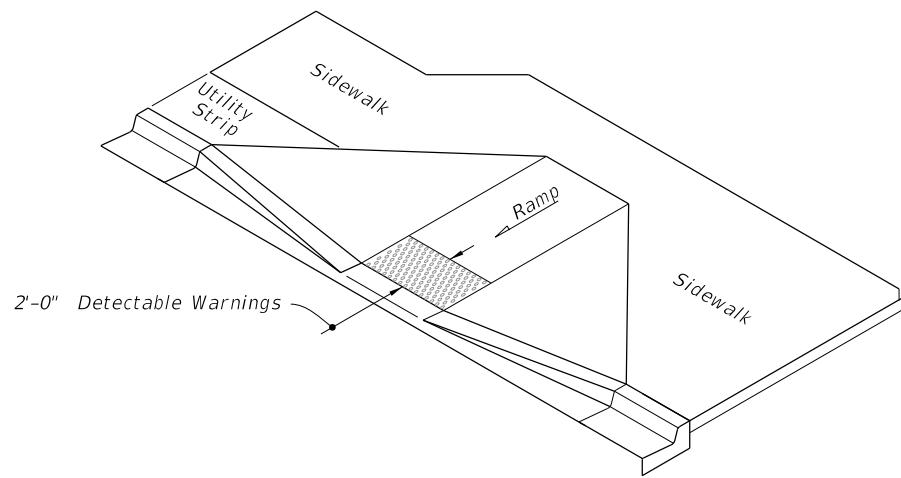


ISOMETRIC VIEW

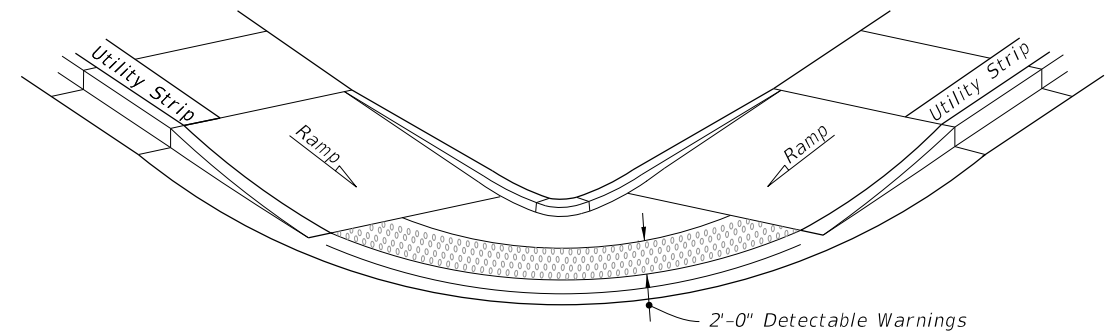

OPTION A

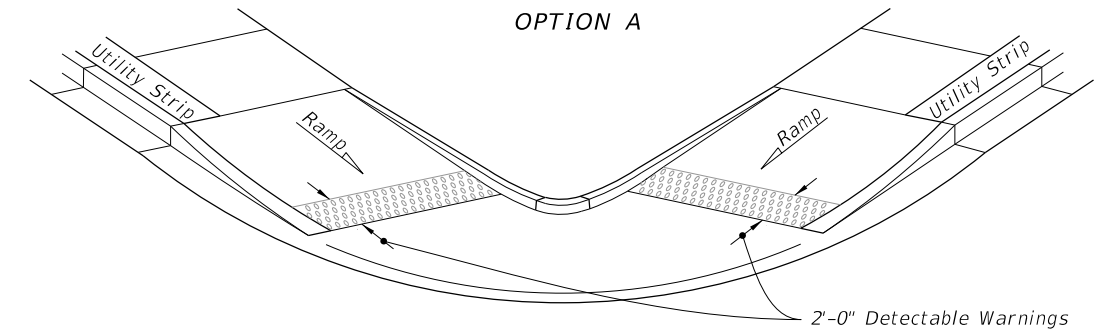


OPTION B

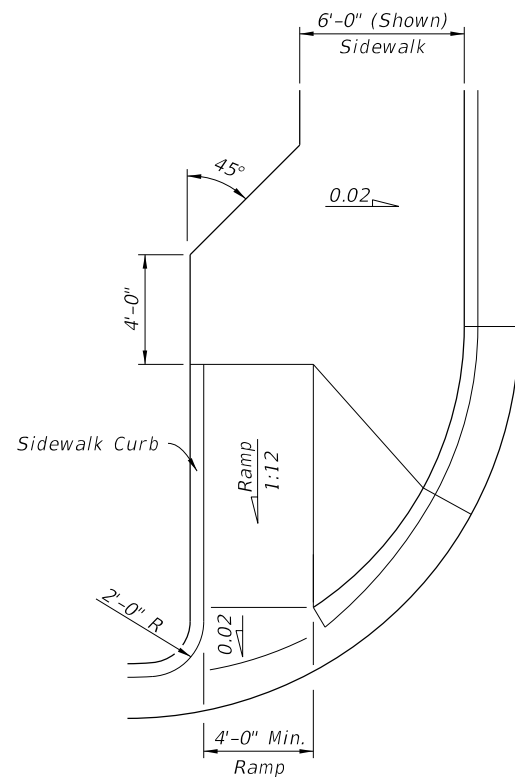


PLAN VIEW

CR-H

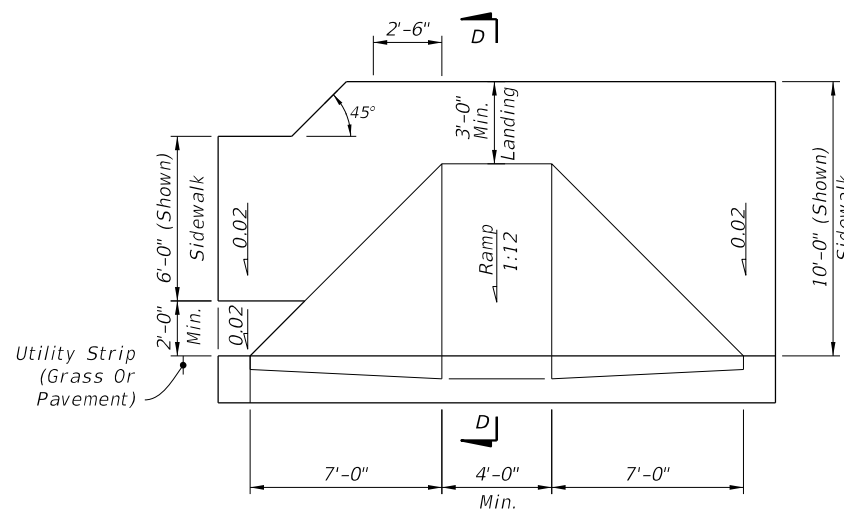

PLAN VIEW


CR-K

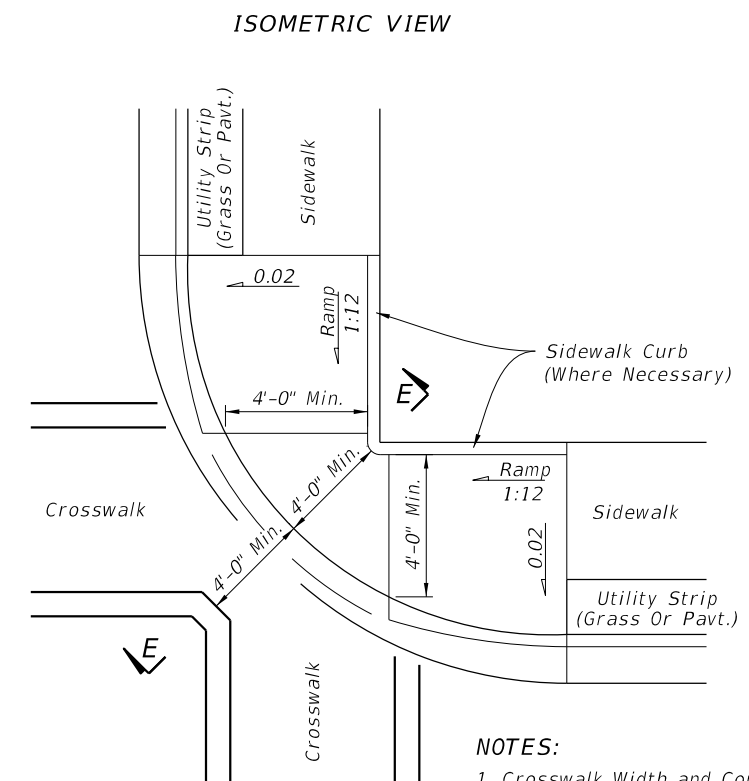


PLAN VIEW

CR-L

- NOTES:
1. Crosswalk Width and Configuration Vary; Must Conform to Index 711-001.
 2. 15' Radius Curve Shown for CR-L.
 3. For additional information on sidewalk curb construction, see SIDEWALK CURB OPTIONS details, on Sheet 3.

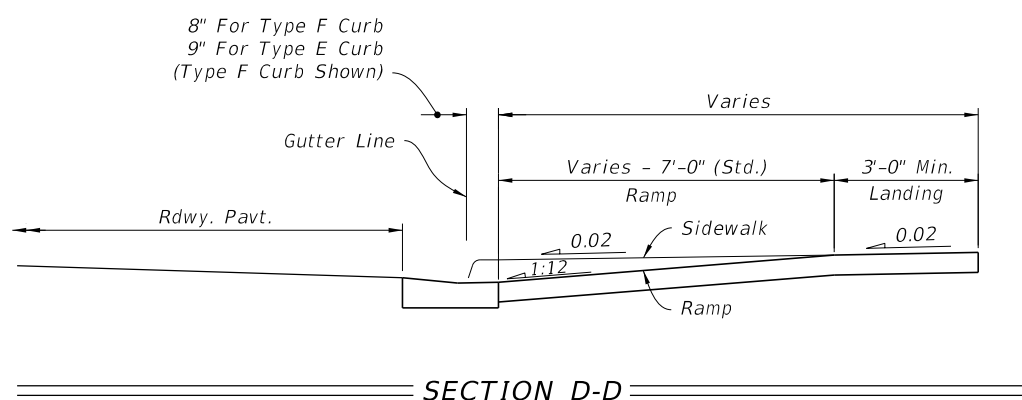

SECTION D-D

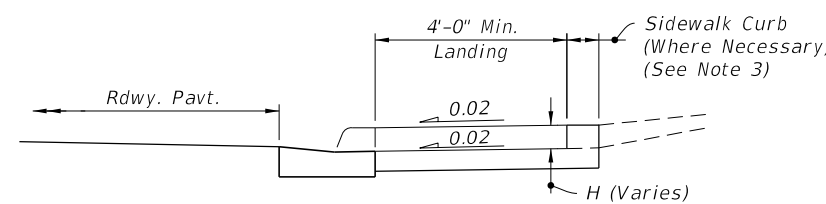

SECTION E-E

7/20/2020 2:10:08 PM

LAST REVISION 11/01/18	DESCRIPTION:
---------------------------	--------------






FY 2020-21
STANDARD PLANS

DETECTABLE WARNINGS AND SIDEWALK CURB RAMPS

INDEX
522-002


SHEET
5 of 7

SIDEWALK CURB RAMPS CR-H, CR-K & CR-L

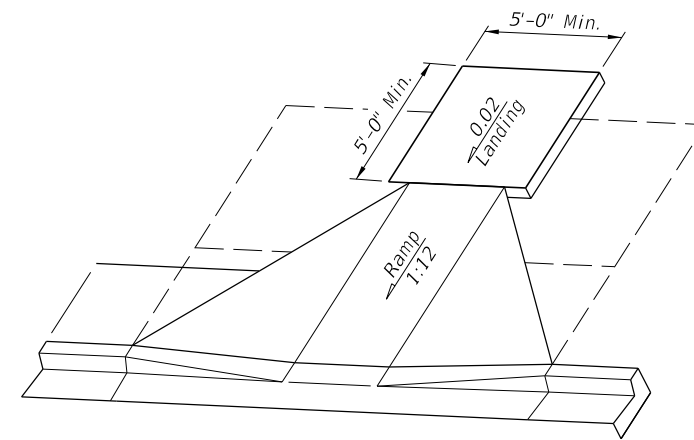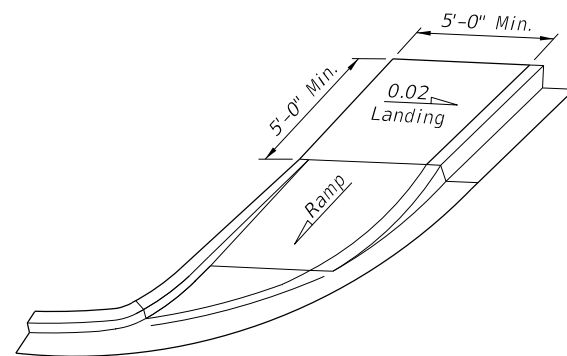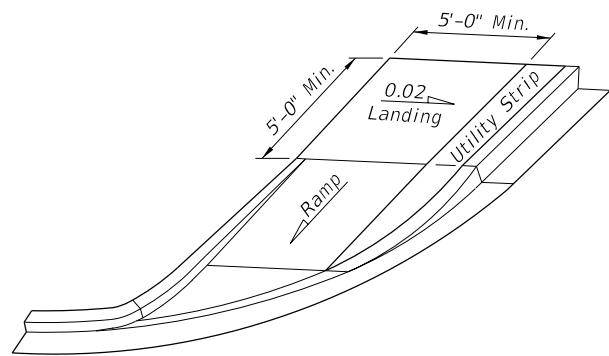


LANDINGS FOR CURB RAMPS WITHOUT SIDEWALKS

(See CR-F, CR-G & CR-K Respectively For Detectable Warning Details/Options)

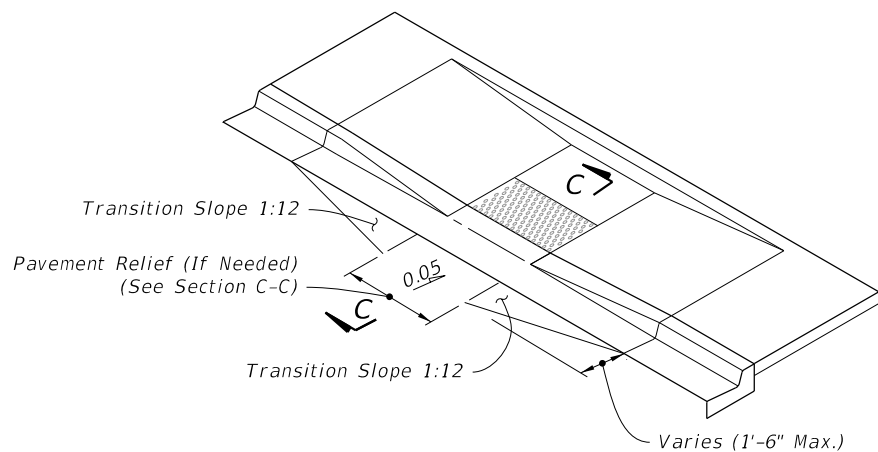


ISOMETRIC VIEW
(CR-C Shown, Other Similar)

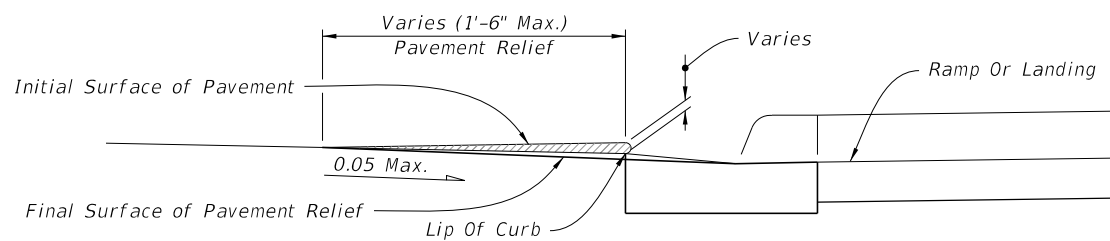


SECTION C-C

PAVEMENT RELIEF DETAILS

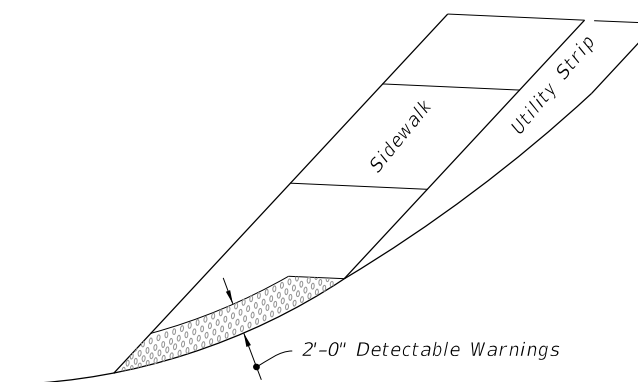

OPTION A

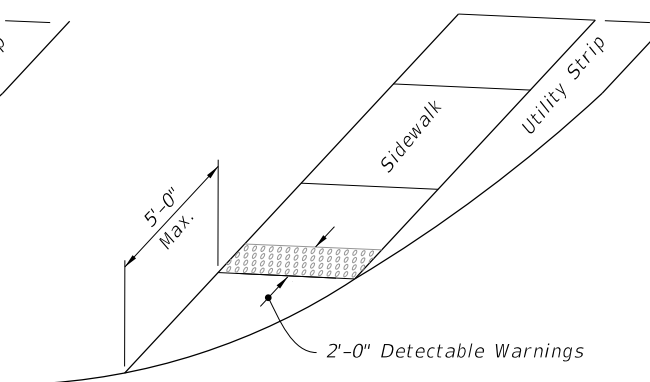

OPTION B

DETECTABLE WARNING ON FLUSH SHOULDER SIDEWALKS

CURB RAMPS WITHOUT SIDEWALKS AND FLUSH SHOULDER SIDEWALKS

7/20/2020 2:10:12 PM

LAST REVISION 11/01/18	DESCRIPTION:
---------------------------	--------------



FY 2020-21
STANDARD PLANS




DETECTABLE WARNINGS AND SIDEWALK CURB RAMPS

INDEX
522-002


SHEET
6 of 7

NOTES:

1. Where crosswalk markings are used, ramps must fall within the crosswalk limits. A clear space of 48" minimum is required at the bottom of the ramp within a marked crosswalk. If crosswalk markings are not present, a clear space of 48" minimum is required at the bottom of the ramp outside of active travel lanes.
2. Crosswalk widths and configurations vary; must conform to Index 711-001.
3. Flangeway Gap may be up to 3" for Freight-only Railways.

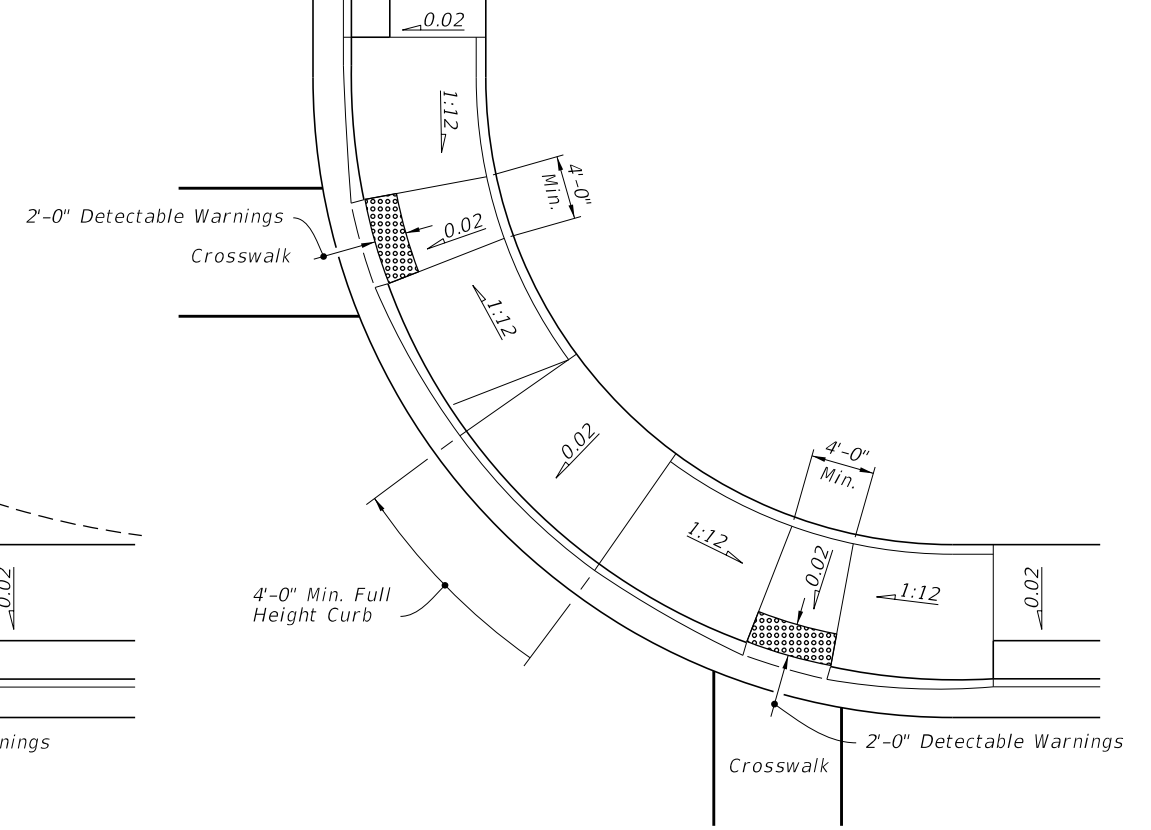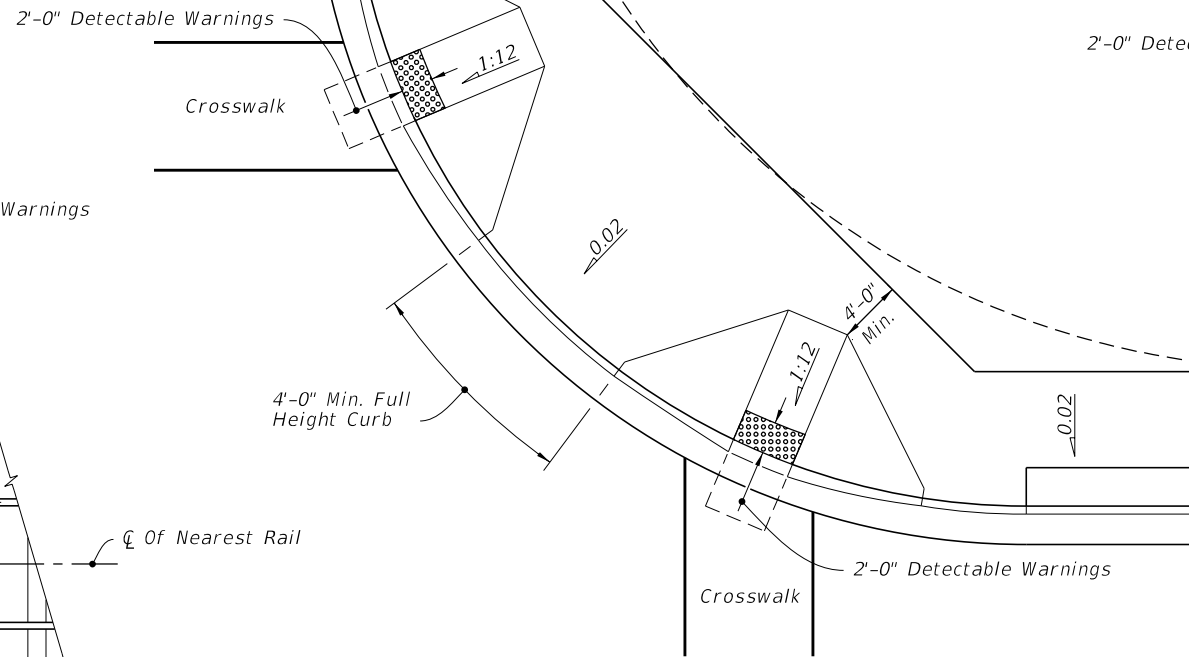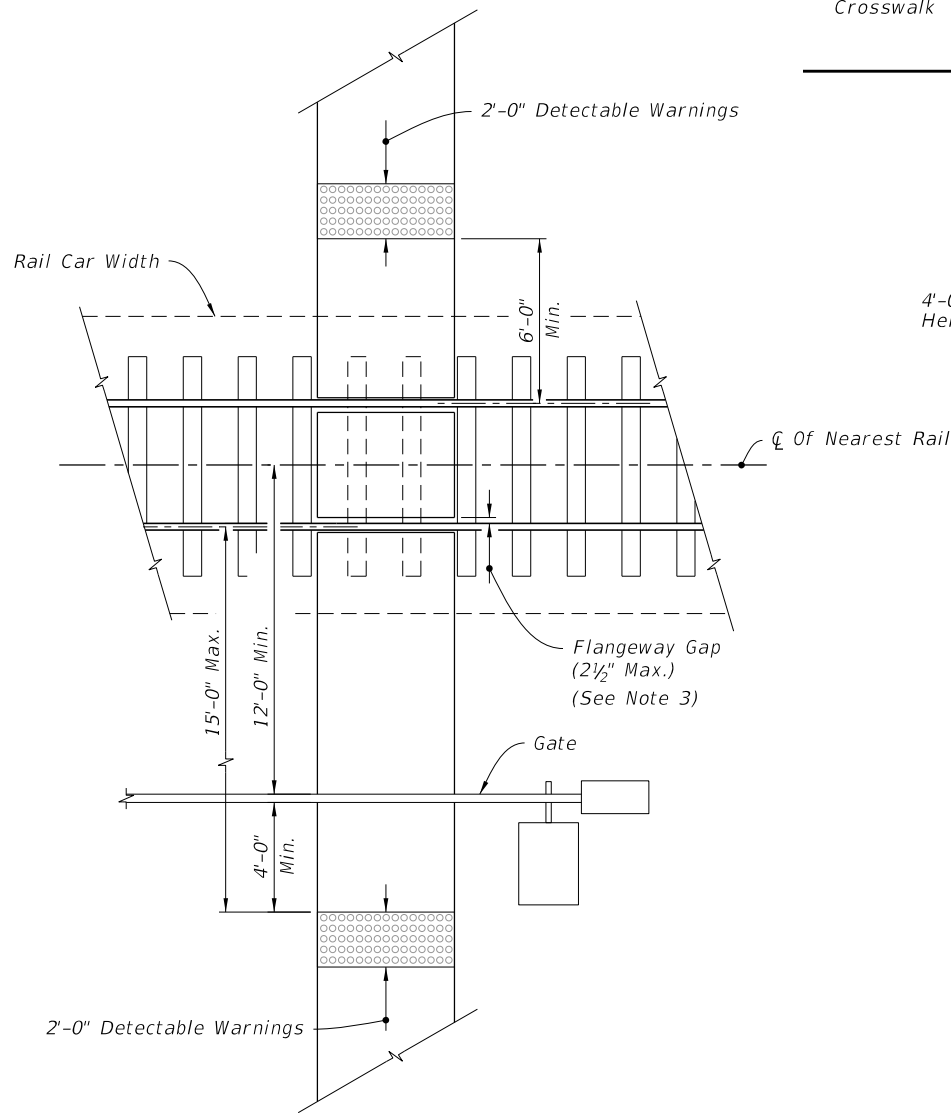

RADIAL SIDEWALK RAMPS

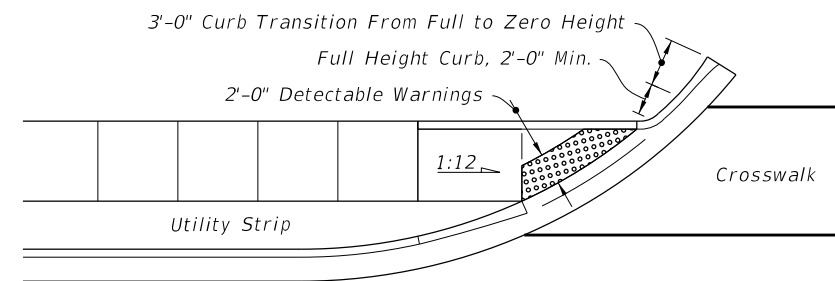


LINEAR SIDEWALK RAMPS

RAILROAD CROSSING

PLACEMENT OF SIDEWALK CURB RAMPS AT CURBED RETURNS (TYP.)

RAILROAD CROSSING AND CURB RAMPS AT CURBED RETURNS

7/20/2020 2:10:15 PM

LAST REVISION 11/01/17	DESCRIPTION:	 FY 2020-21 STANDARD PLANS	DETECTABLE WARNINGS AND SIDEWALK CURB RAMPS	INDEX 522-002	SHEET 7 of 7
---------------------------	--------------	--	---	------------------	-----------------