


12/3/2021 9:42:32 AM

GENERAL NOTES:


- 1. Work this Index with Index 425-001 and Index 425-010.
- 2. Chamfer all exposed edges and corners $\frac{3}{4}$ " chamfer or tooled to $\frac{1}{4}$ " radius.
- 3. All reinforcing is Grade 60 bars with 2" minimum cover unless otherwise noted. Cut or bend bars for $1\frac{1}{2}$ " clearance around pipe opening. Provide one additional #4 bar above and at each side of pipe opening.
- 4. Use Concrete Apron on inlets without slots and inlets with non-traversable slots only when called for in the Plans.
- 5. Quantities are for informational and estimating purposes only.

TABLE OF CONTENTS:	
Sheet	Description
1	General Notes and Contents
2	Type C - Dimensional, Reinforcing, and Grate Details
3	Type D - Dimensional, Reinforcing, and Grate Details
4	Type E - Dimensional, Reinforcing, and Grate Details
5	Type H (2 & 3 Grate) - Dimensional, Reinforcing, and Steel Grate Details
6	Type H (4 Grate) - Dimensional, Reinforcing, and Steel Grate Details
7	Cast Iron Grate Details
8	Non-Traversable Inlet Details
9	Traversable Inlet Without Slot Details
10	Traversable Inlet With Slot Details
11	Case 1 - Add Traversable Slots to Existing Inlets
12	Case 2 - Add Traversable Slots (Partial) to Existing Inlets
13	Case 3 - Add Traversable Slots (Partial) to Existing Inlets and Ditch Block
14	Alternate A Structure Bottom - Top Slab Details

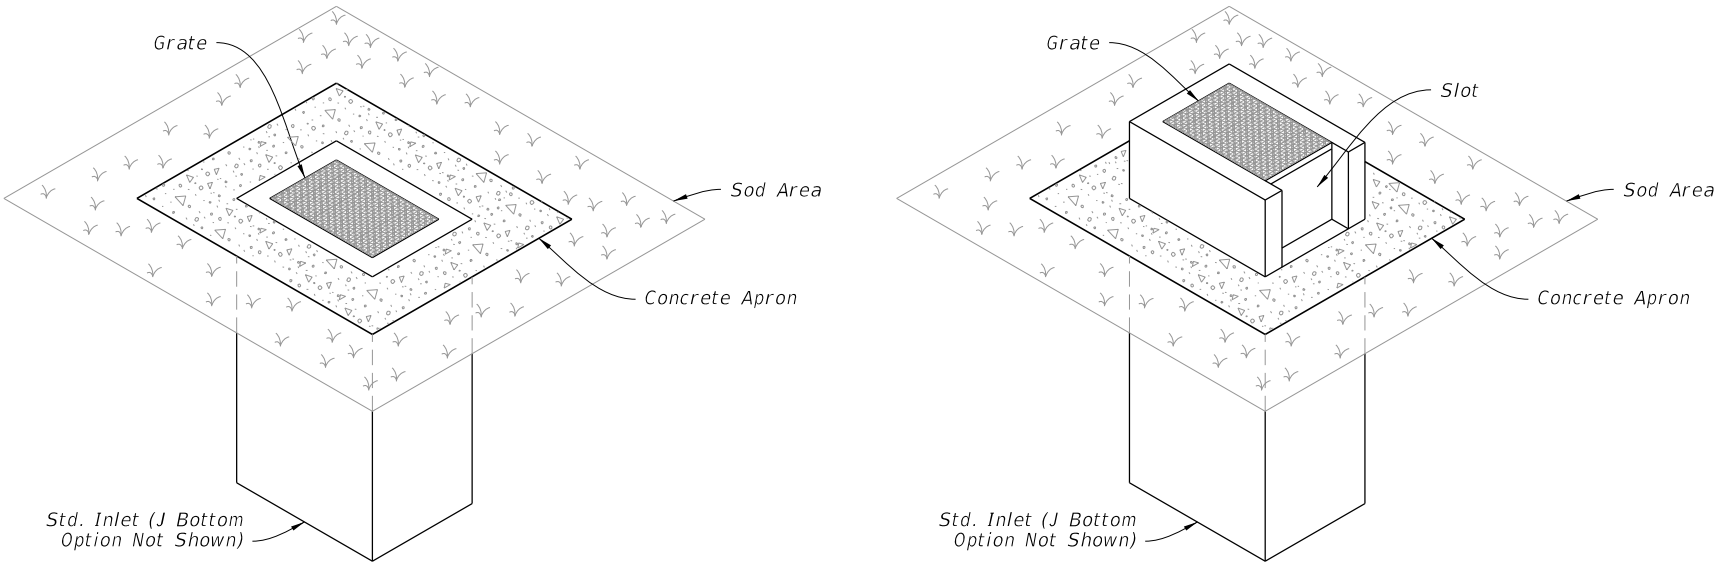

===== DITCH BOTTOM INLET TYPE C =====
TRAVERSABLE
(Without Slot - Type D, E, and H Similar, Pipe Connection Not Shown)

===== DITCH BOTTOM INLET TYPE C =====
NON-TRAVERSABLE
(Slot > 7" Shown - Type D, E, and H Similar, Pipe Connection Not Shown)

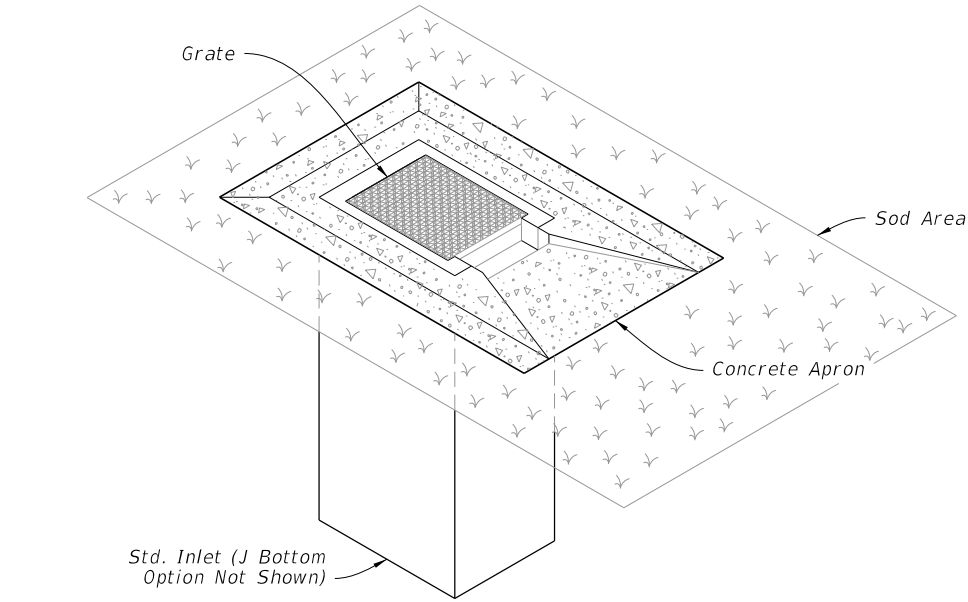

===== DITCH BOTTOM INLET TYPE C =====
TRAVERSABLE
(Single Slot < 7" Shown, Double Slot, Type D, and E Similar, Pipe Connection Not Shown)



FY 2021-22
STANDARD PLANS


DITCH BOTTOM INLET TYPE C, D, E, AND H

INDEX
425-052


SHEET
1 of 14

LAST
REVISION
11/01/20

REVISION DESCRIPTION:

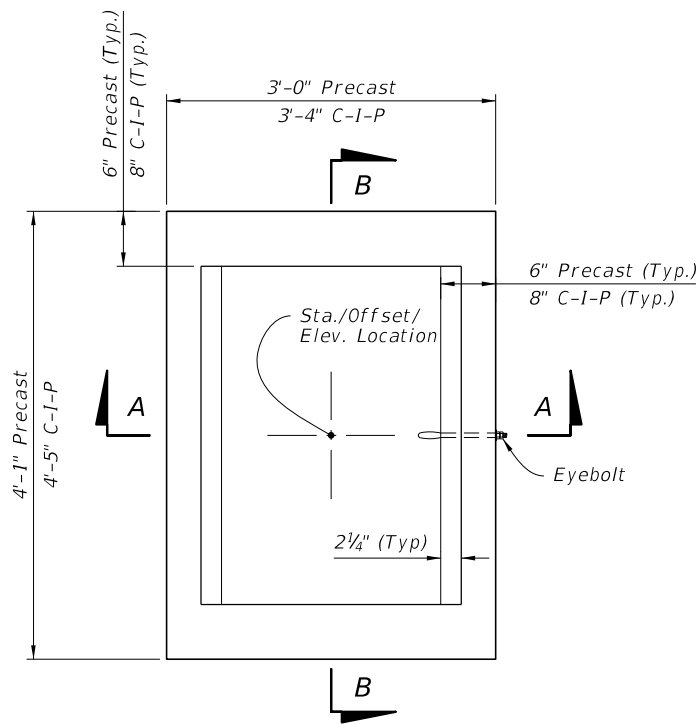



PLAN

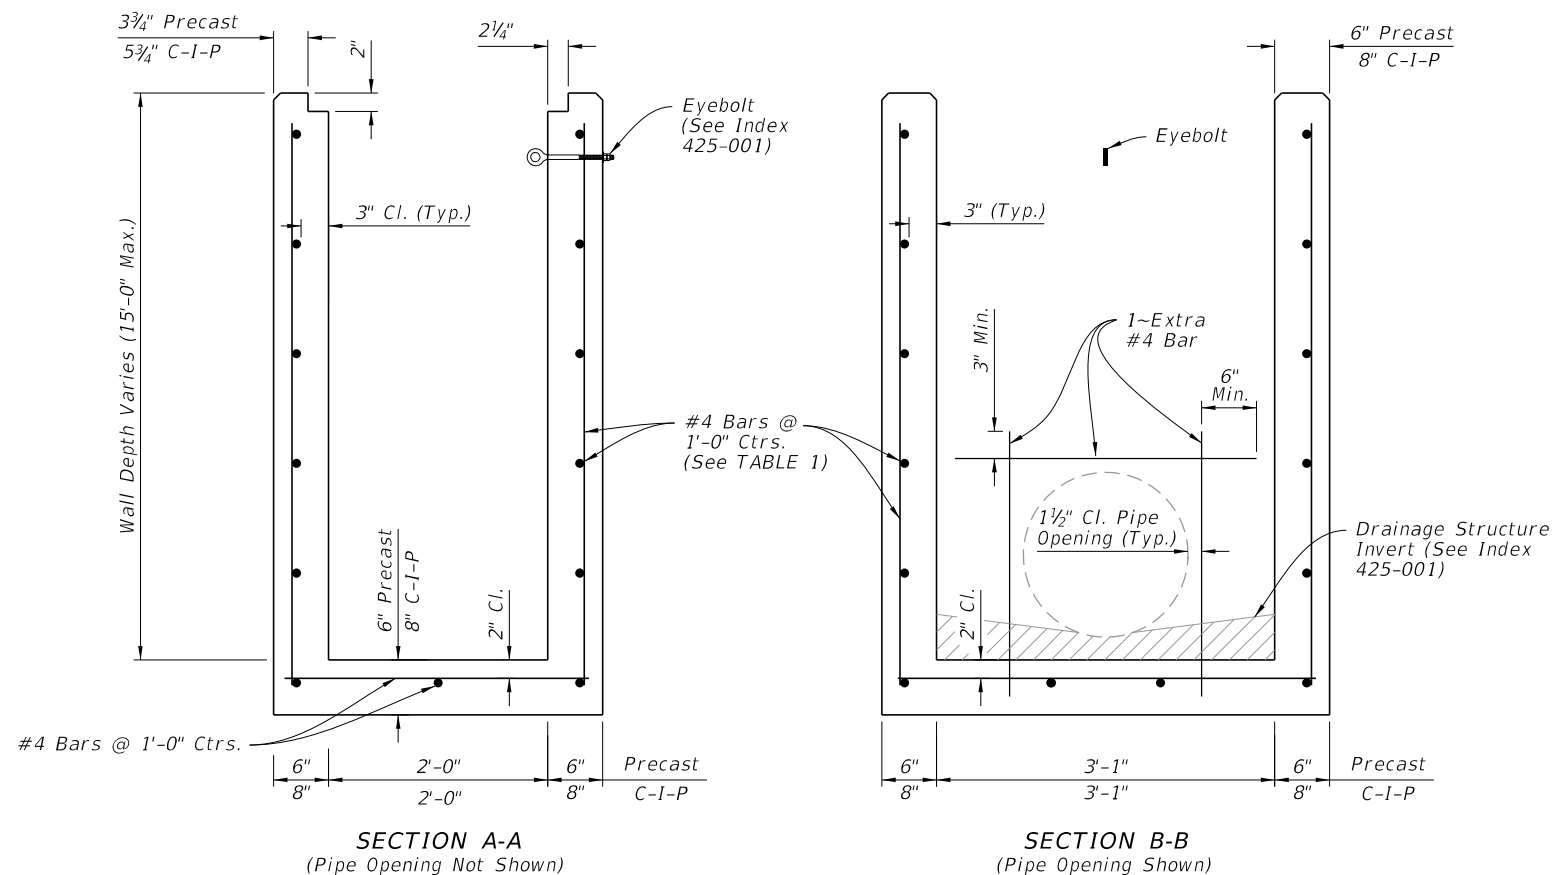


SECTION A-A
(Pipe Opening Not Shown)

SECTION B-B
(Pipe Opening Shown)

DIMENSIONAL AND REINFORCING DETAILS

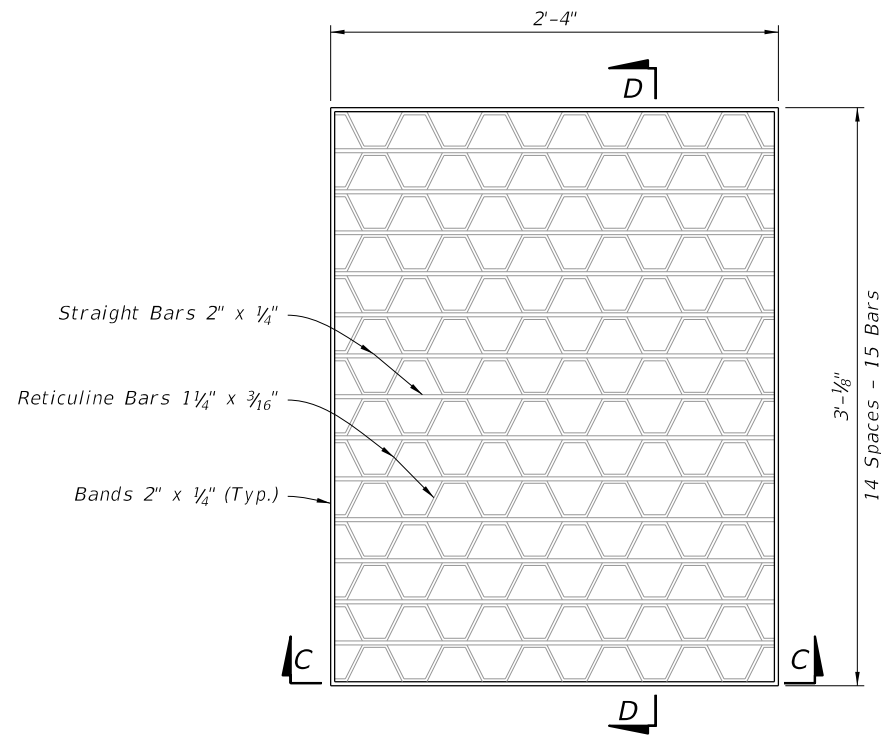

SECTION C-C

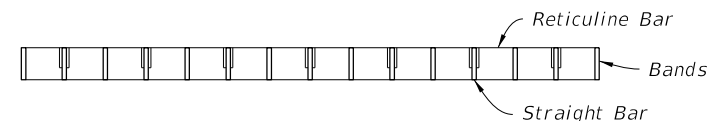

SECTION D-D

STEEL GRATE DETAIL

(Approx. 104 Lbs. - See Sheet 7 For Cast Iron Grates)






TABLE 1 HORIZONTAL WALL REINFORCING SCHEDULE				
WALL DEPTH	SCHEDULE	AREA (in. ² /ft.)	MAX. SPACING	
			BARS	WWF
0' - 15'	A12	0.20	12"	8"

NOTES:

1. Grate, Concrete Apron, and Sod not shown on structure detail.
2. See Sheet 8, 9, and 10 for Concrete Apron and Sodded Area details.

TYPE C - DIMENSIONAL, REINFORCING, AND STEEL GRATE DETAILS

LAST REVISION 11/01/20	REVISION	DESCRIPTION:	 FY 2021-22 STANDARD PLANS	DITCH BOTTOM INLET TYPE C, D, E, AND H	INDEX 425-052	SHEET 2 of 14
------------------------------	----------	--------------	--	--	------------------	------------------

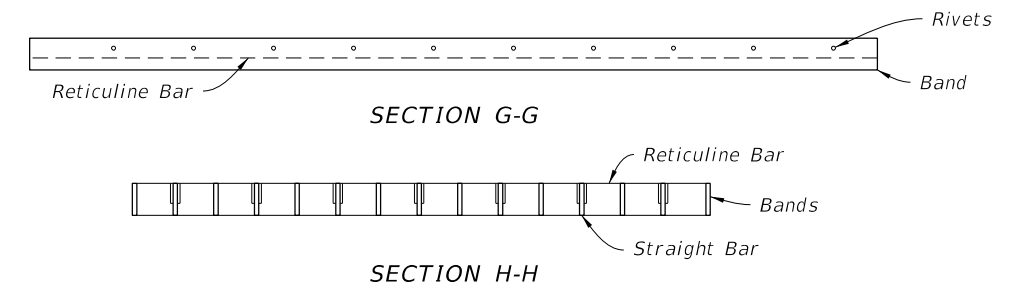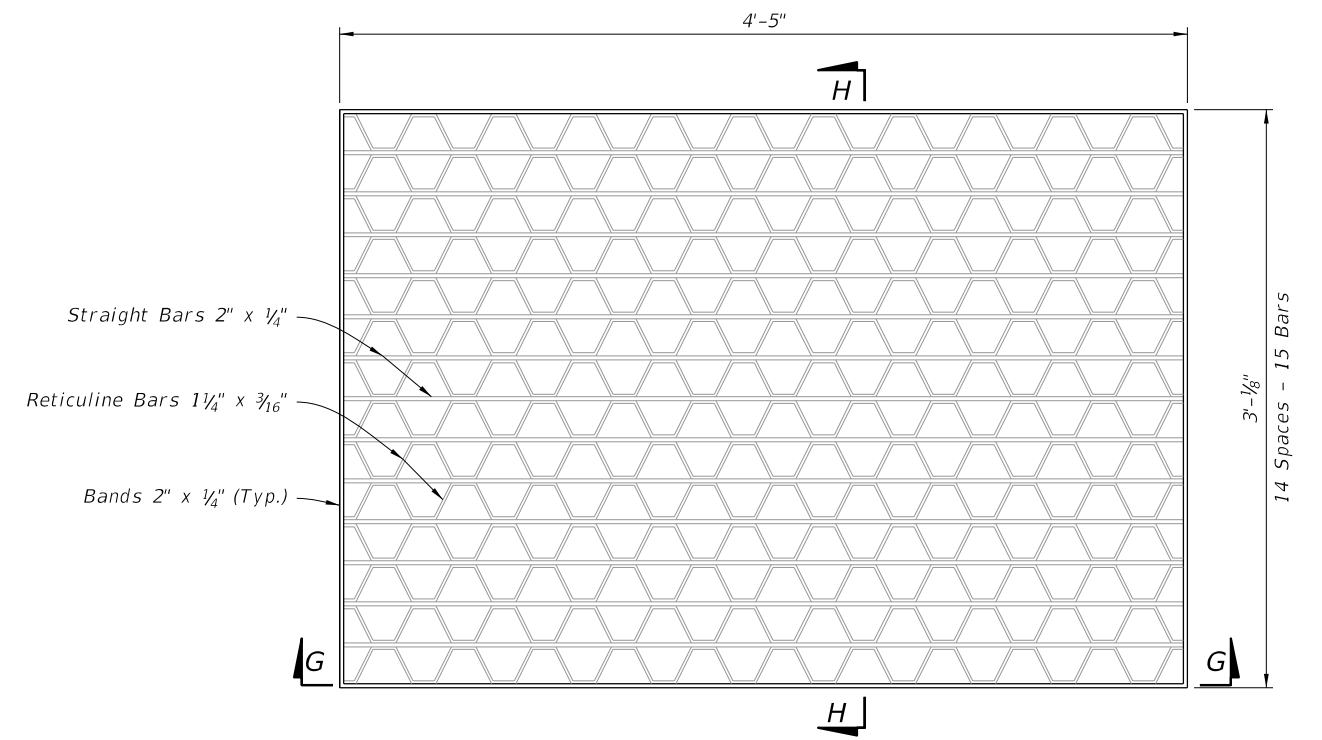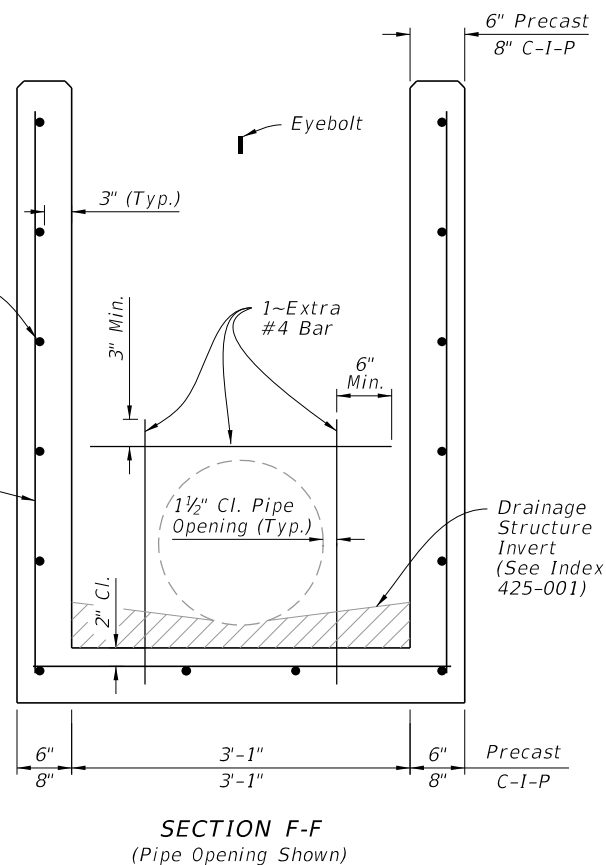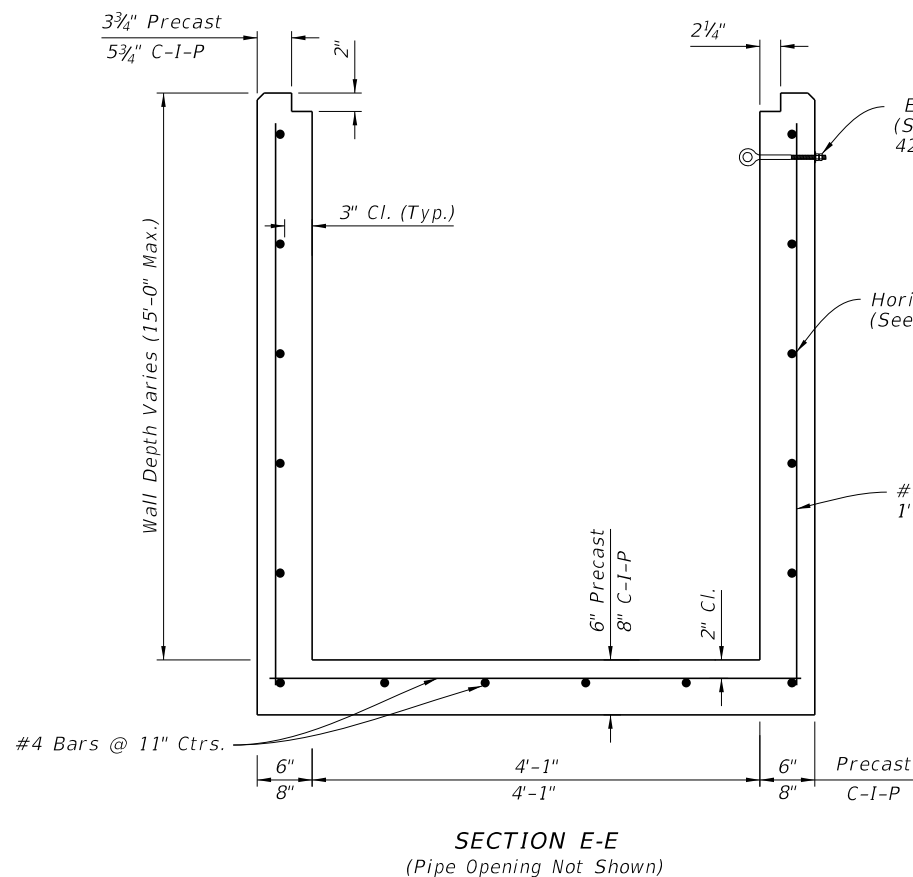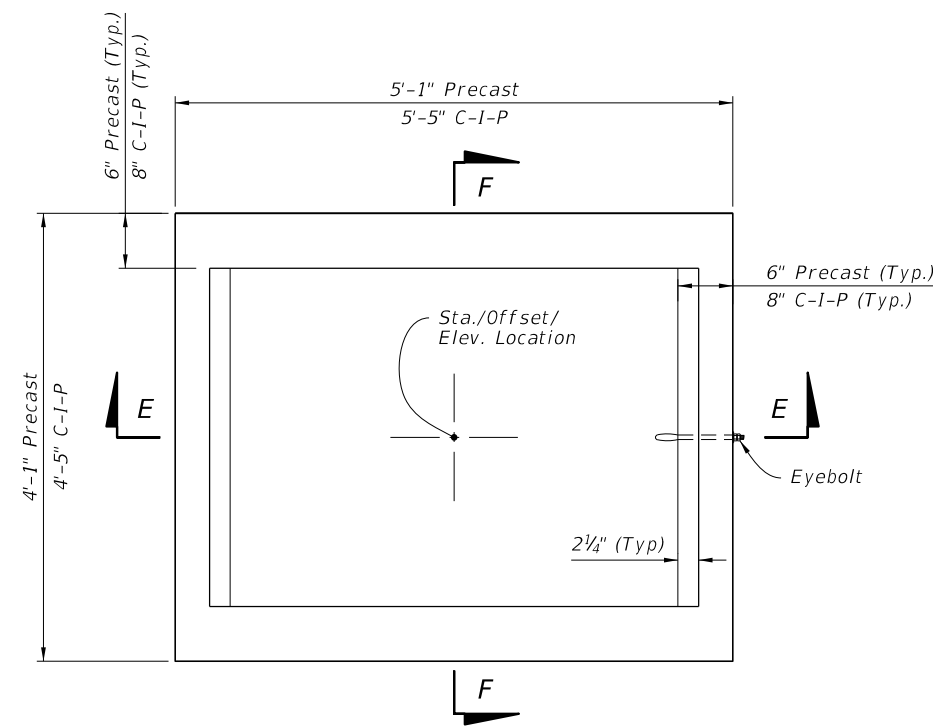

STEEL GRATE DETAIL
(Approx. 190 lbs. - See Sheet 7 For Cast Iron Grates)

TABLE 2 HORIZONTAL WALL REINFORCING SCHEDULE				
WALL DEPTH	SCHEDULE	AREA (in. ² /ft.)	MAX. SPACING	
			BARS	WWR
0' - 6'	A12	0.20	12"	8"
6' - 10'	A6	0.20	6"	5"
10' - 13'	A4	0.20	4"	3"
10' - 15'	B5.5	0.24	5 1/2"	5"

NOTES:

1. Grate, Concrete Apron, and Sod not shown on structure details.
2. See Sheet 8, 9, and 10 for Concrete Apron and Sodded Area details.
3. Cast Iron Grate is not permitted on inlet Type D.

DIMENSIONAL AND REINFORCING DETAILS

TYPE D - DIMENSIONAL, REINFORCING, AND STEEL GRATE DETAILS

10/12/2020 6:52:45 AM

LAST REVISION 11/01/20	REVISION	DESCRIPTION:	FDOT FY 2021-22 STANDARD PLANS	DITCH BOTTOM INLET TYPE C, D, E, AND H	INDEX 425-052	SHEET 3 of 14
------------------------------	----------	--------------	--------------------------------------	--	------------------	------------------

10/12/2020 6:52:48 AM

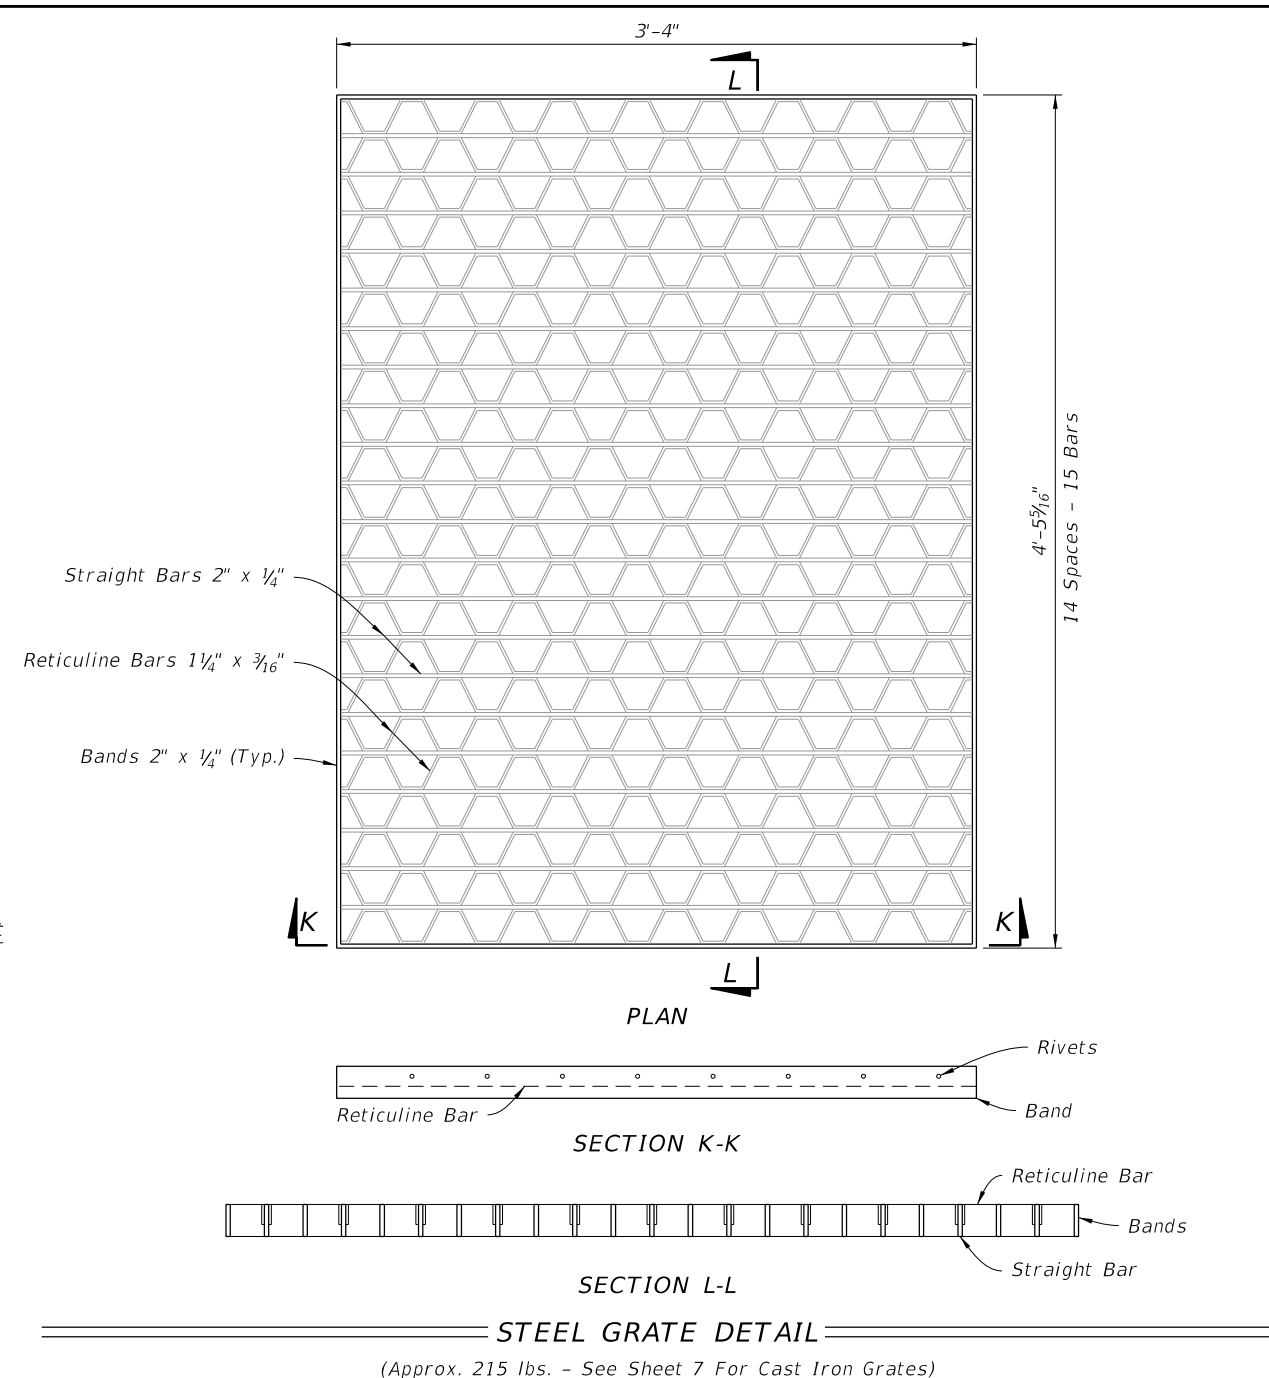
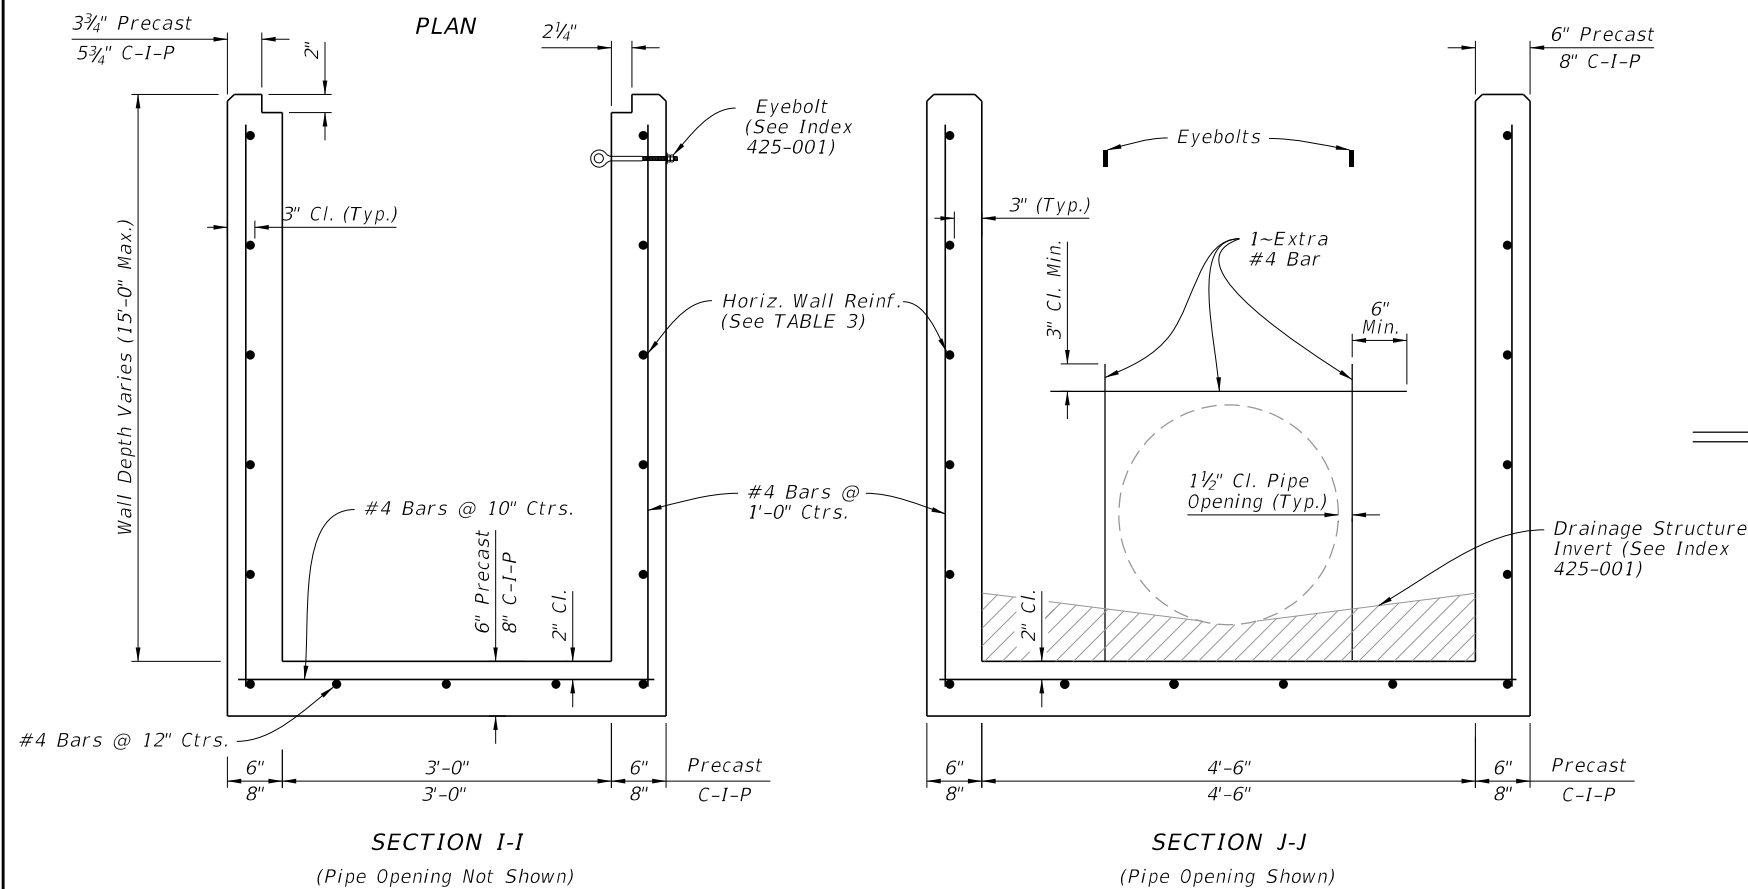
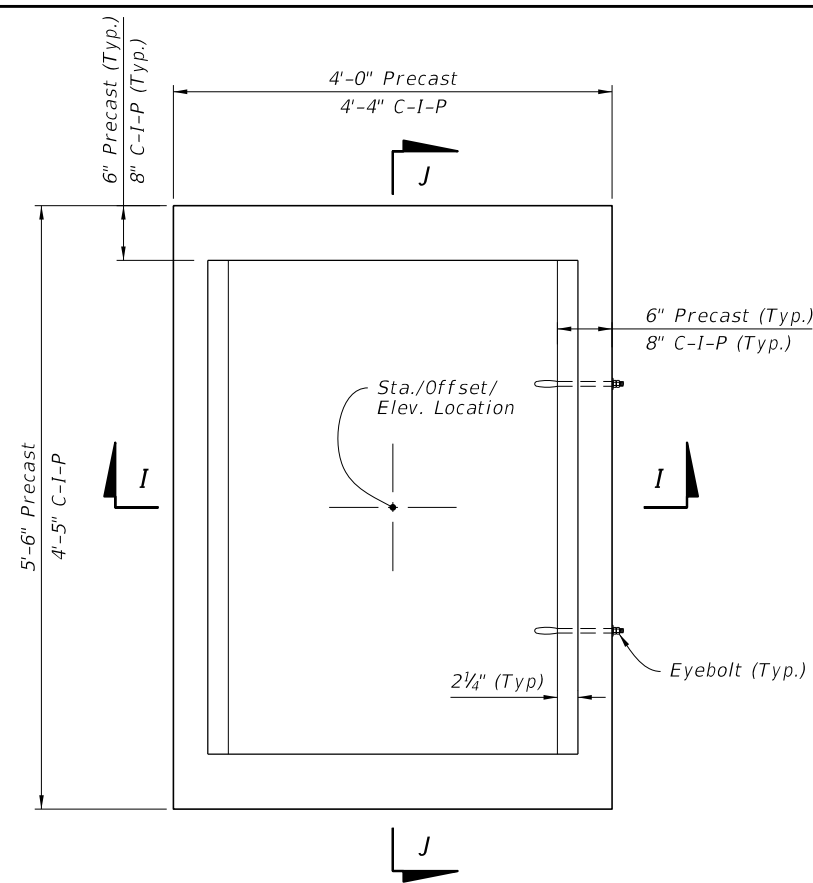






TABLE 3 HORIZONTAL WALL REINFORCING SCHEDULE				
WALL DEPTH	SCHEDULE	AREA (in. ² /ft.)	MAX. SPACING	
			BARs	WWR
0' - 5'	A12	0.20	12"	8"
0' - 7.5'	A6	0.20	6"	5"
7.5' - 10'	B5.5	0.24	5 1/2"	5"
10' - 15'	C6.5	0.37	6 1/2"	6"

- NOTES:**
- Grate, Concrete Apron, and Sod not shown on structure detail.
 - See Sheet 8, 9, and 10 for Concrete Apron and Sodded Area details.

DIMENSIONAL AND REINFORCING DETAILS

TYPE E - DIMENSIONAL, REINFORCING, AND STEEL GRATE DETAILS

LAST REVISION 11/01/20	REVISION	DESCRIPTION:	FDOT FY 2021-22 STANDARD PLANS	DITCH BOTTOM INLET TYPE C, D, E, AND H	INDEX 425-052	SHEET 4 of 14
------------------------------	----------	--------------	--------------------------------------	--	------------------	------------------

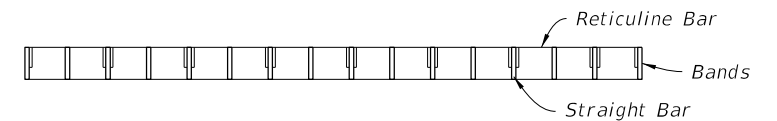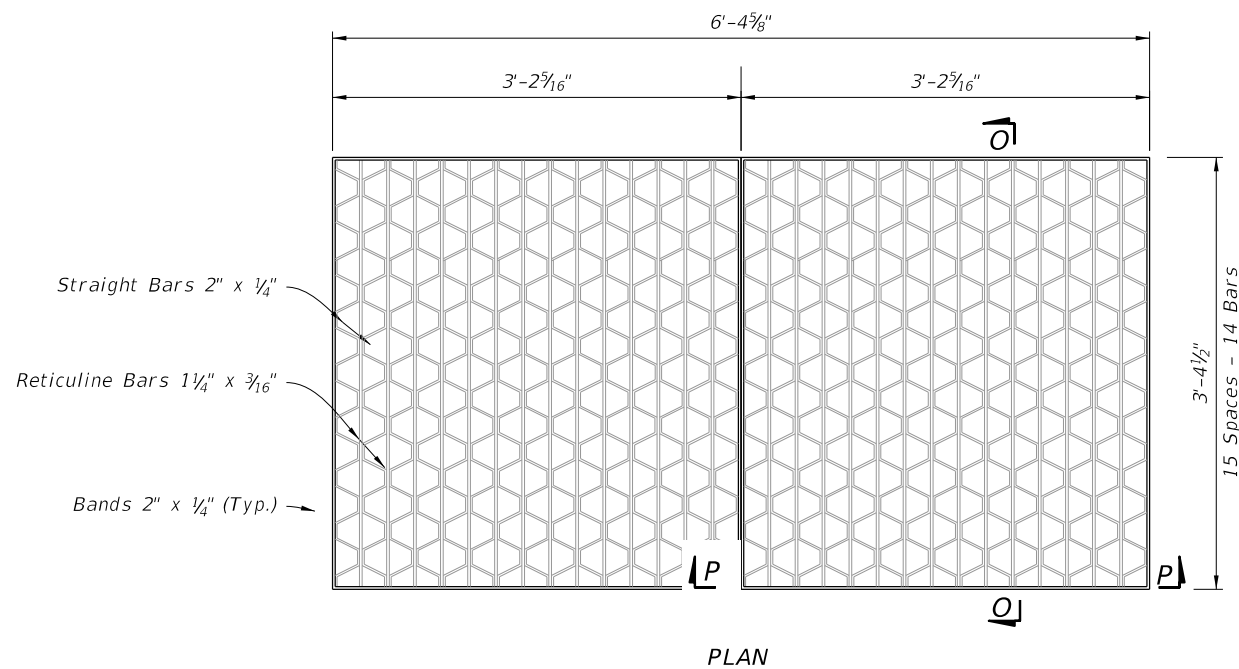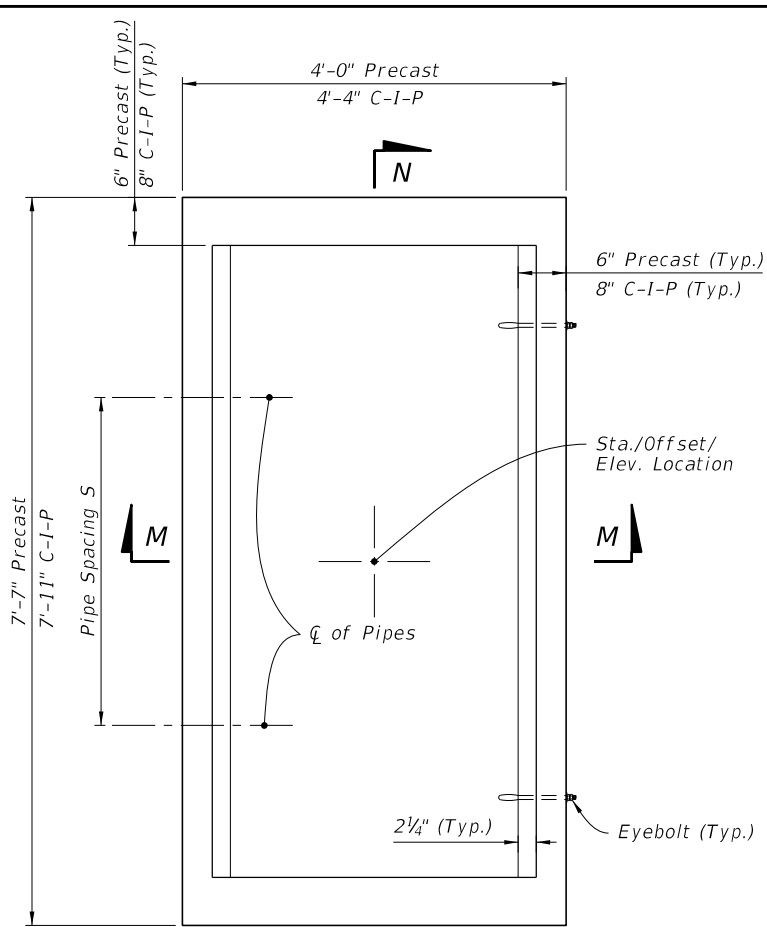

STEEL GRATE DETAIL

(2-Grates Shown, Approx. 310 lbs. - See Sheet 7 For Cast Iron, 3-Grates)

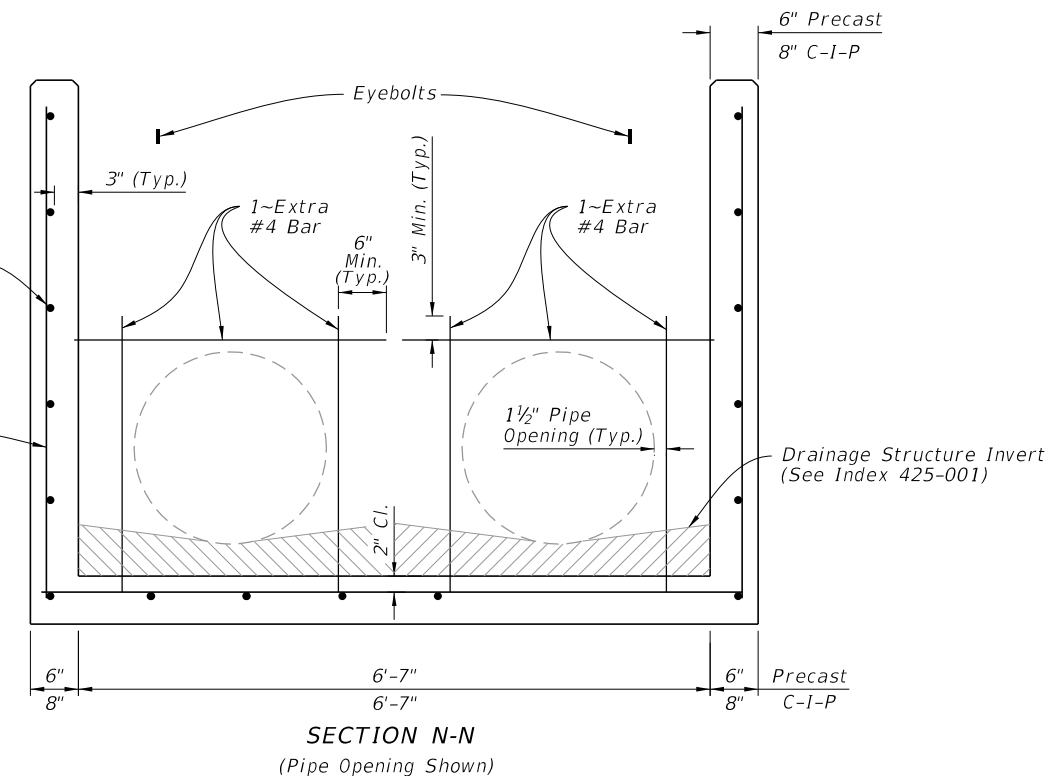
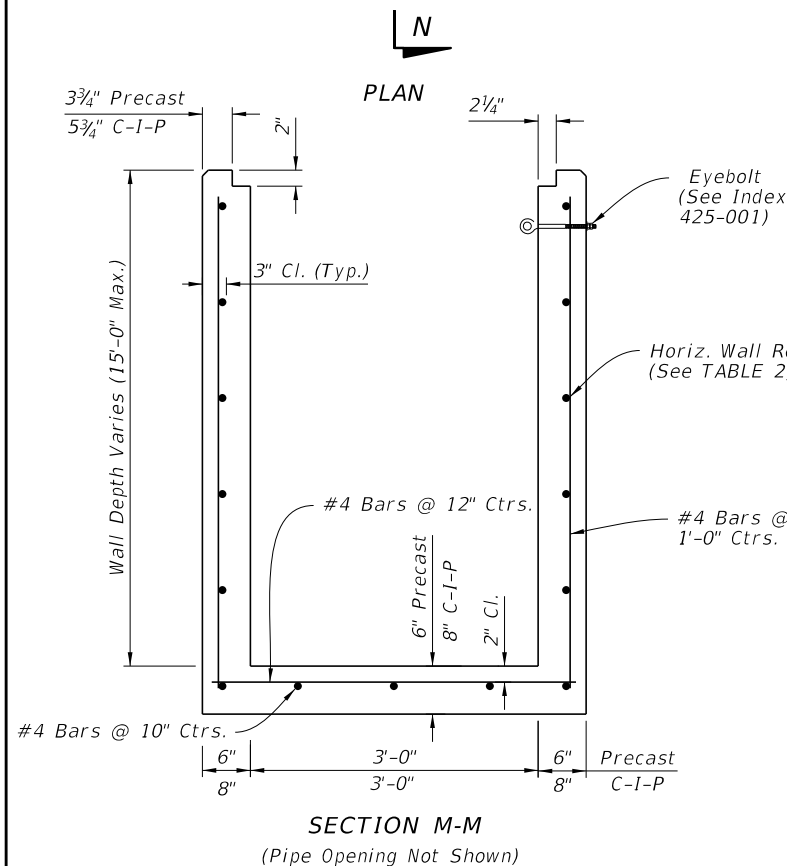


TABLE 4 HORIZONTAL WALL REINFORCING SCHEDULE				
WALL DEPTH	SCHEDULE	AREA (in. ² /ft.)	MAX. SPACING	
			BARS	WWR
0' - 5'	B5.5	0.24	5 1/2"	5"
5' - 7'	C6.5	0.37	6 1/2"	6"
7' - 15'	D4.5	0.53	4 1/2"	4"





NOTES:

1. Grate, Concrete Apron, and Sod not shown on structure details.
2. See Sheet 8, 9, and 10 for Concrete Apron and Sodded Area details.
3. Pipe Spacing S = 3'-5"

DIMENSIONAL AND REINFORCING DETAILS

TYPE H (2 & 3 GRATE) - DIMENSIONAL, REINFORCING, AND STEEL GRATE DETAILS

LAST REVISION 11/01/20	REVISION	DESCRIPTION:	FDOT FY 2021-22 STANDARD PLANS	DITCH BOTTOM INLET TYPE C, D, E, AND H	INDEX 425-052	SHEET 5 of 14
------------------------------	----------	--------------	--------------------------------------	--	------------------	------------------

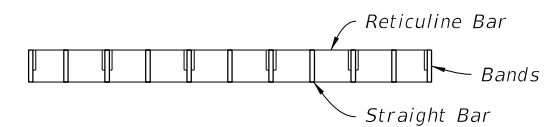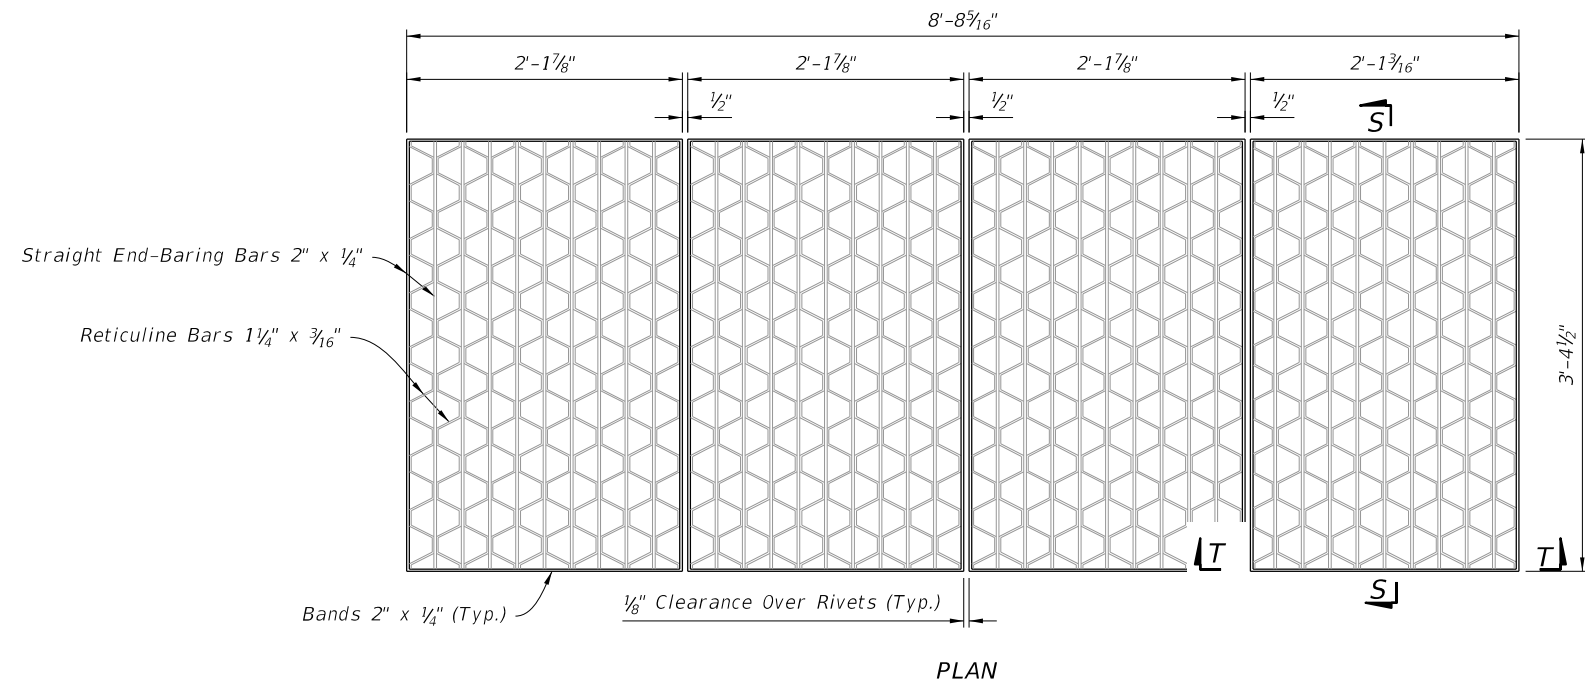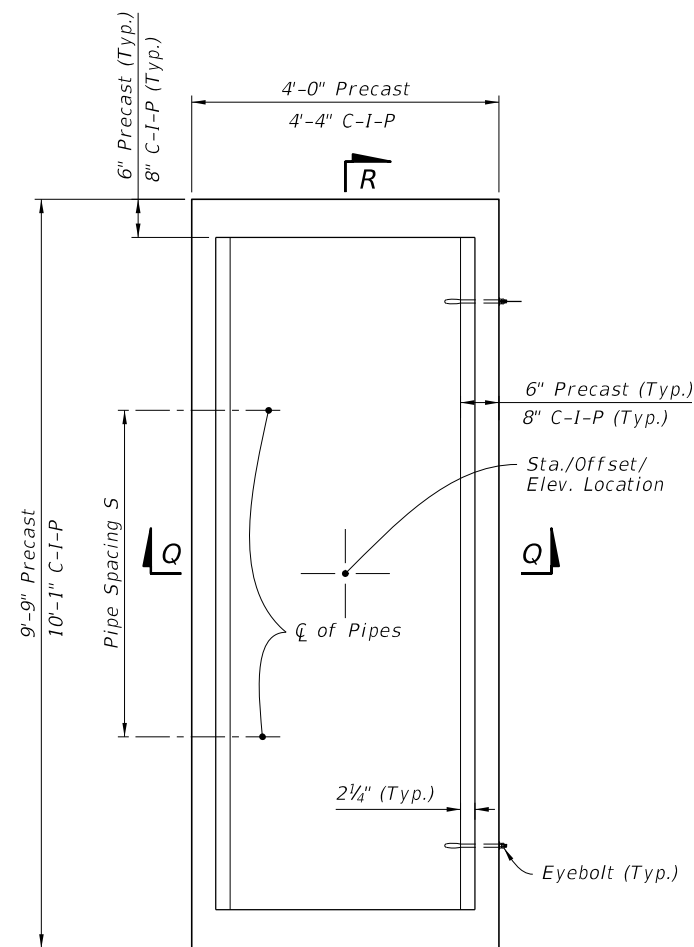

STEEL GRATE DETAIL

(Approx. 388 lbs. - See Sheet 7 For Cast Iron Grates)

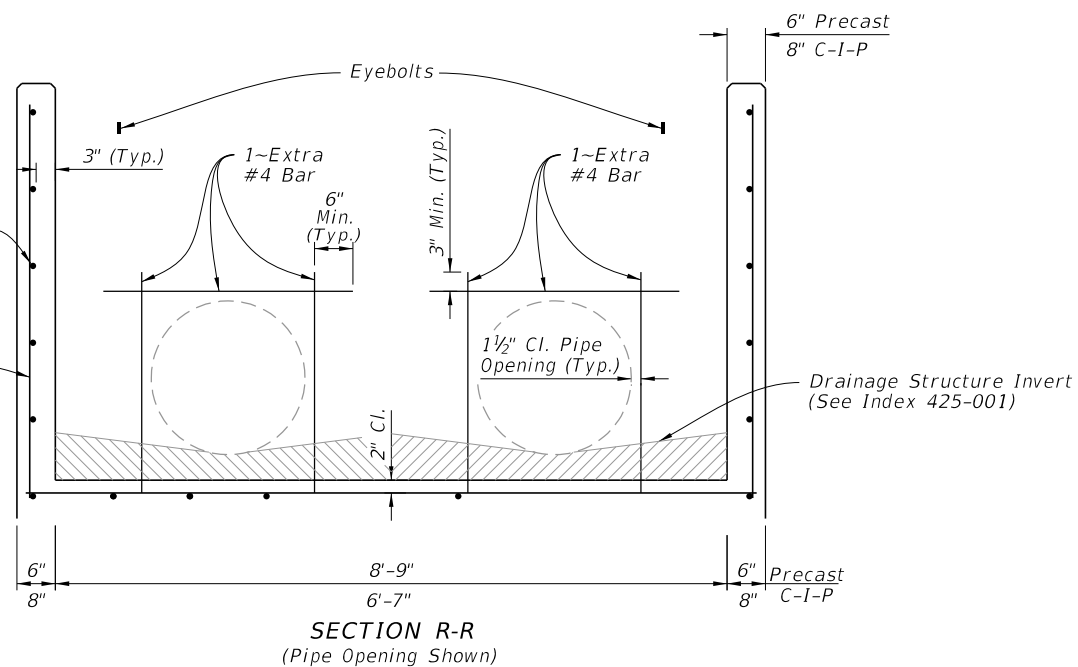
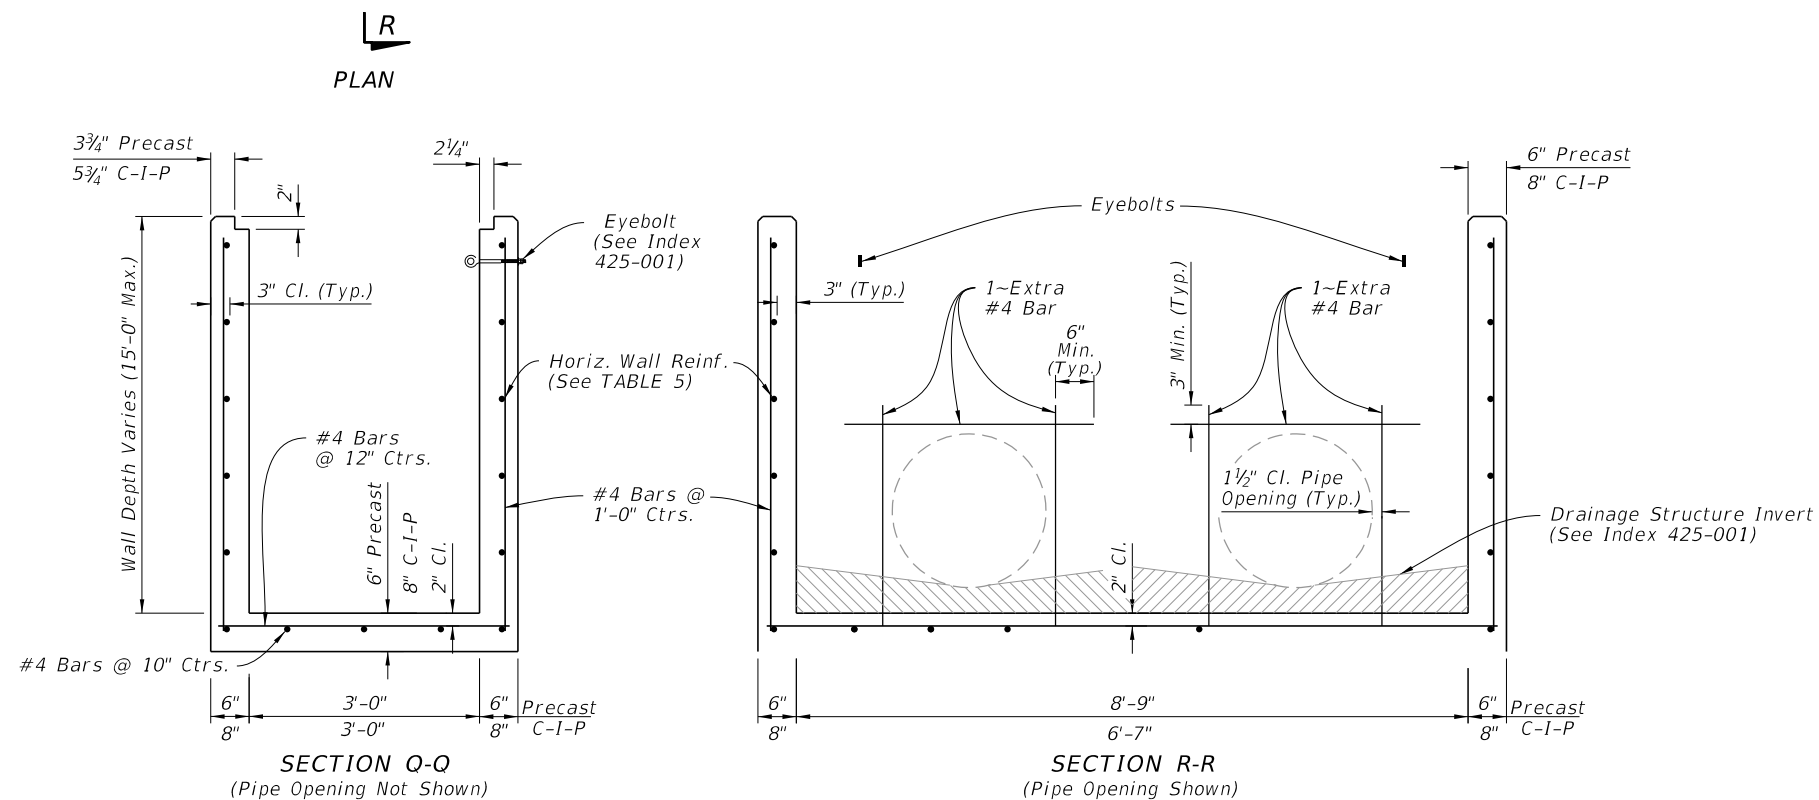


TABLE 5
HORIZONTAL WALL REINFORCING SCHEDULE

WALL DEPTH	SCHEDULE	AREA (in. ² /ft.)	MAX. SPACING	
			BARS	WWR
0' - 5'	C3.5	0.37	3½"	3"
5'-10'	D4.5	0.53	4½"	4"

NOTES:


1. Grate, Concrete Apron, and Sod not shown on structure details.
2. See Sheet 8, 9, and 10 for Concrete Apron and Sodded Area details.
3. Pipe Spacing $S = 4'-3"$

DIMENSIONAL AND REINFORCING DETAILS


TYPE H (4 GRATE) - DIMENSIONAL, REINFORCEMENT, AND STEEL GRATE DETAILS

NOTES:


- 1. Steel Grates are required on inlets with traversable slots and on Inlets where bicycle traffic is anticipated.
- 2. Cast Iron Grates are not permitted on Inlet Type D.

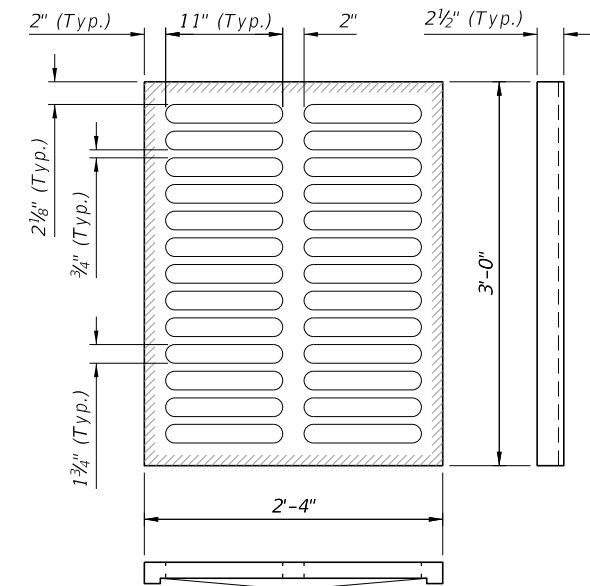


TYPE C
Approx. 235 lbs.

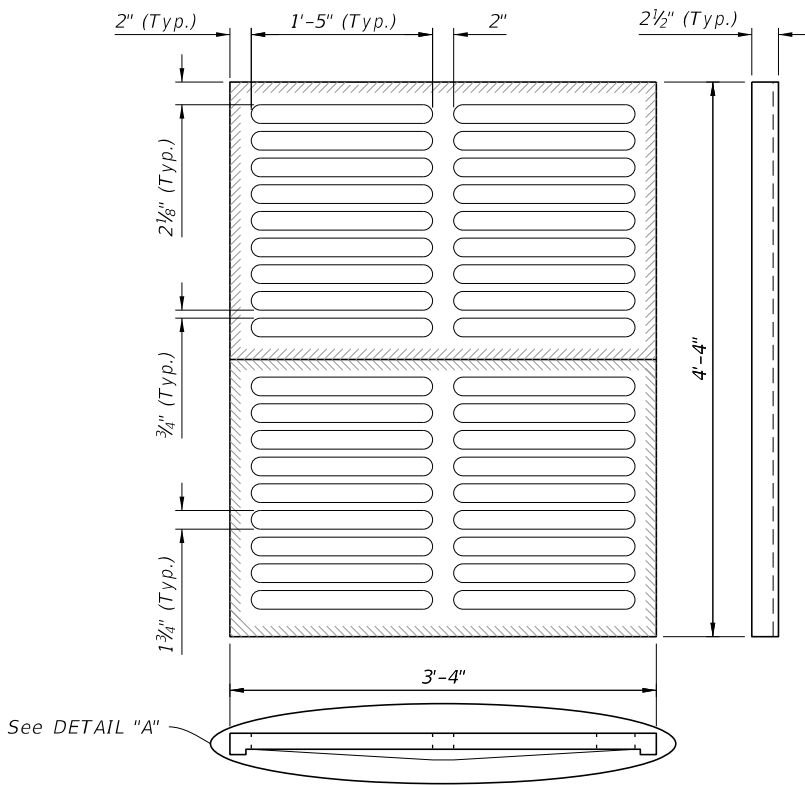


TYPE E
Approx. 465 lbs.

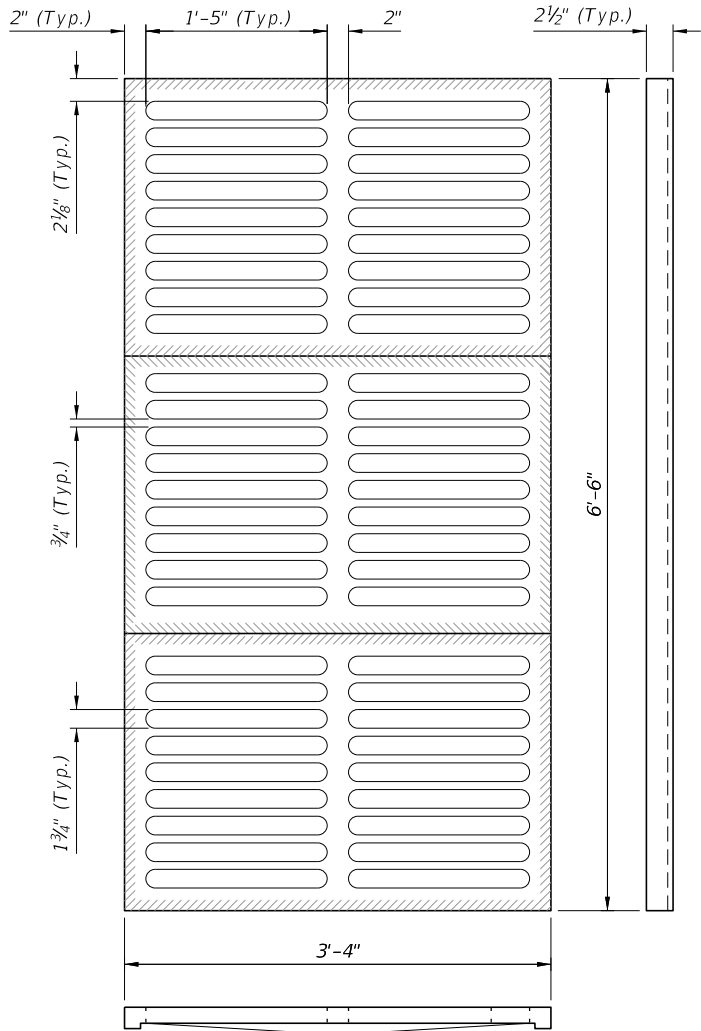

TYPE H
(3-Grate Inlet)
Approx. 725 lbs.

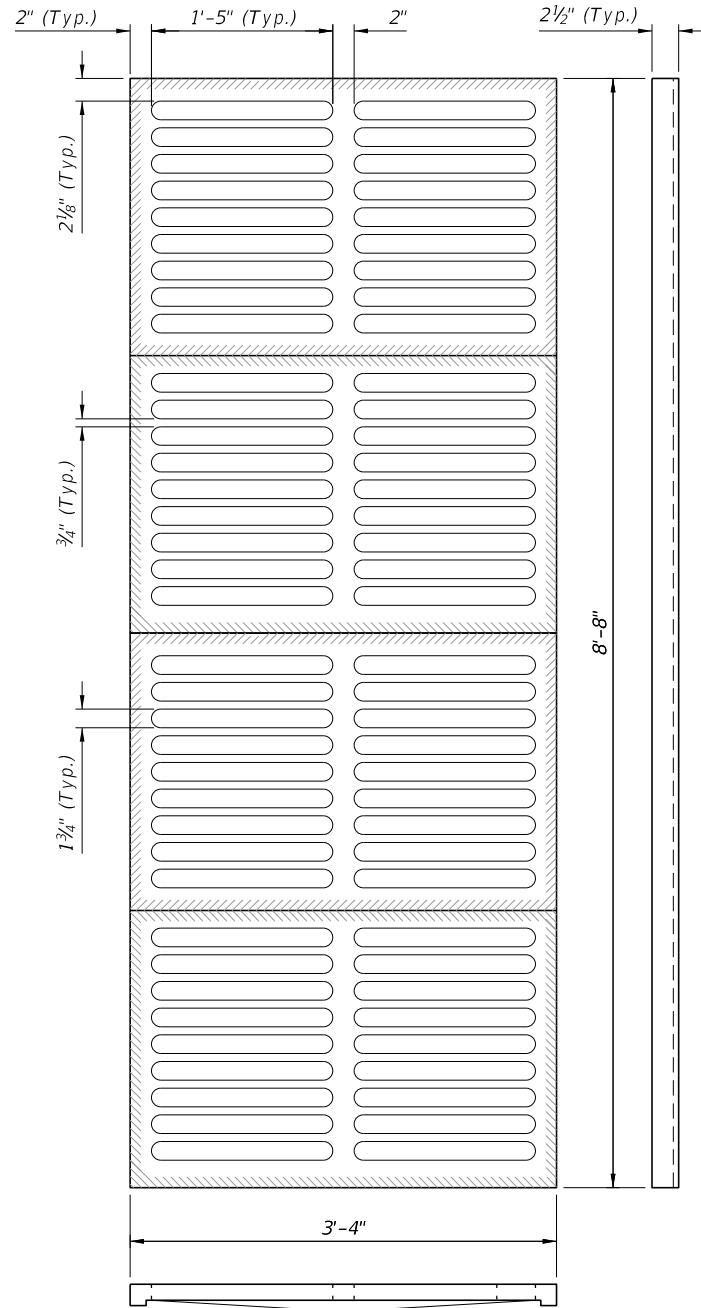

TYPE H
(4-Grate Inlet)
Approx. 967 lbs.

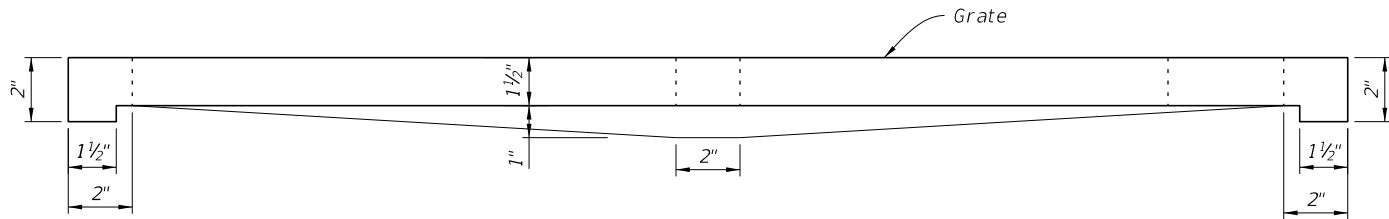

DETAIL "A"
(Typical Section)

CAST IRON GRATE DETAILS

LAST REVISION 11/01/120	DESCRIPTION:	 FY 2021-22 STANDARD PLANS	DITCH BOTTOM INLET TYPE C, D, E, AND H	INDEX 425-052	SHEET 7 of 14
-------------------------------	--------------	--	--	------------------	------------------

10/12/2020 6:53:04 AM




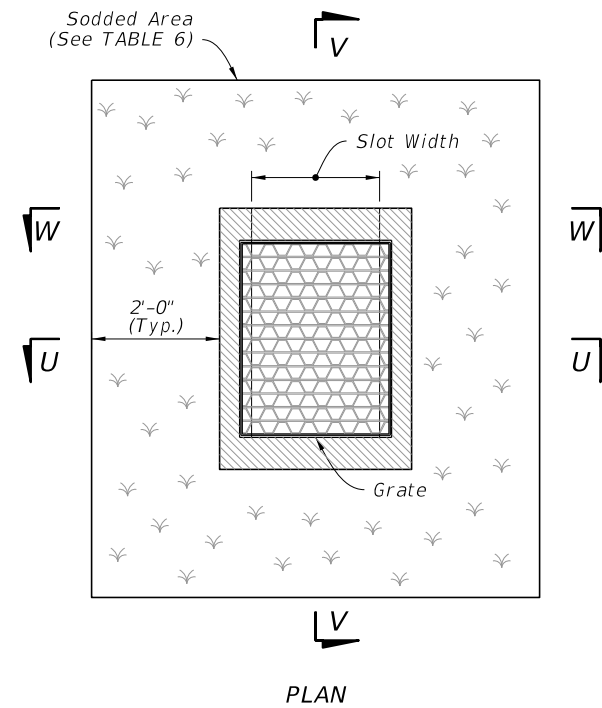


TABLE 6 SOD ONLY QUANTITIES	
Inlet Type	Sod SY
C	6
D	6
E	7
H	8

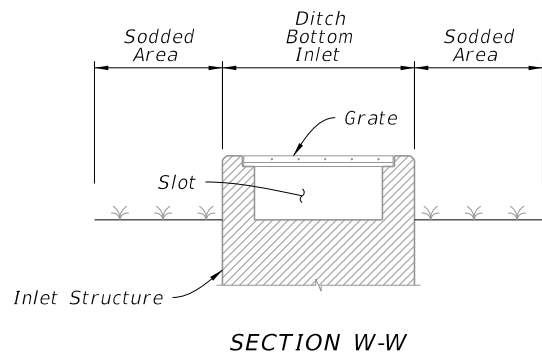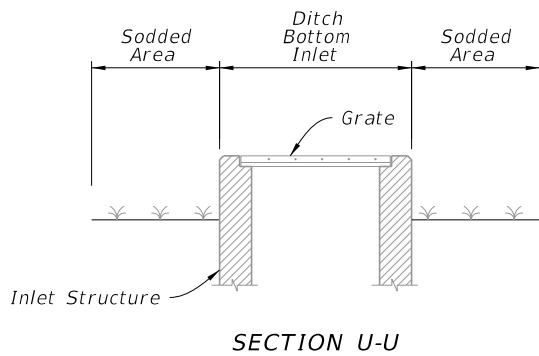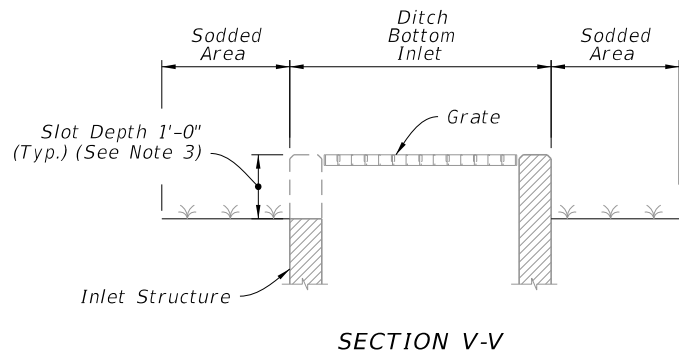

SODDING ONLY
(Slot Shown, Non-Slot Similar)




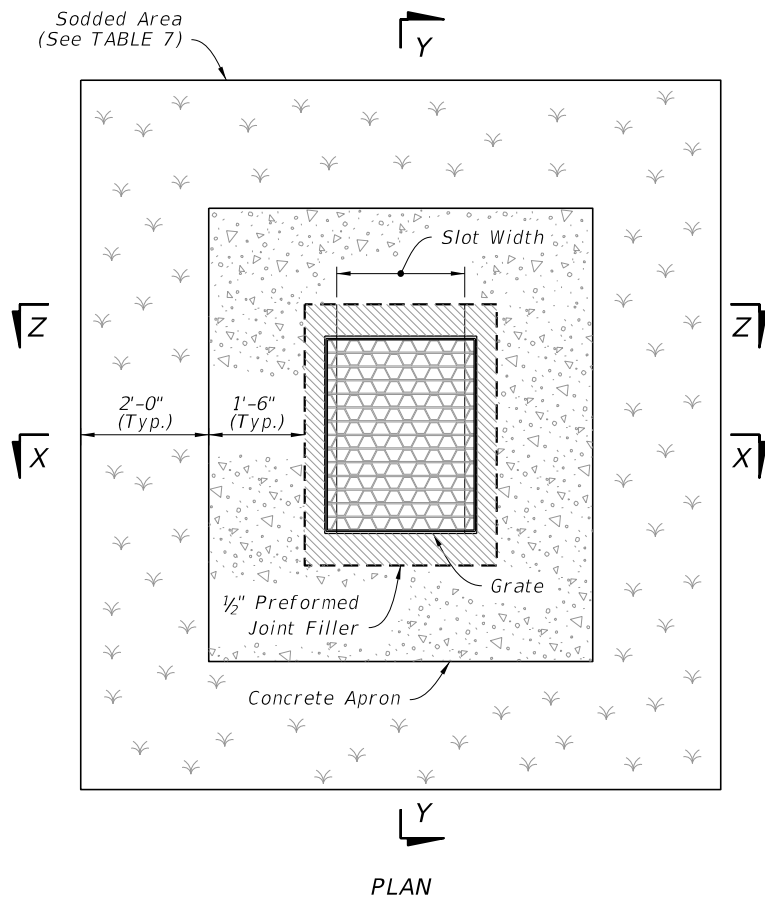


TABLE 7 SOD AND CONCRETE APRON QUANTITIES		
Inlet Type	Sod SY	Conc. CY
C	8	0.30
D	9	0.36
E	9	0.37
H	11	0.45

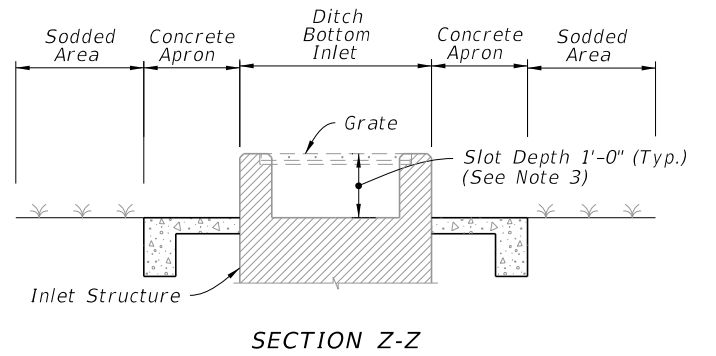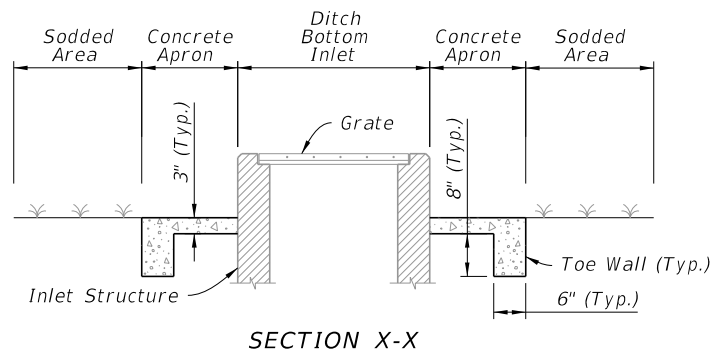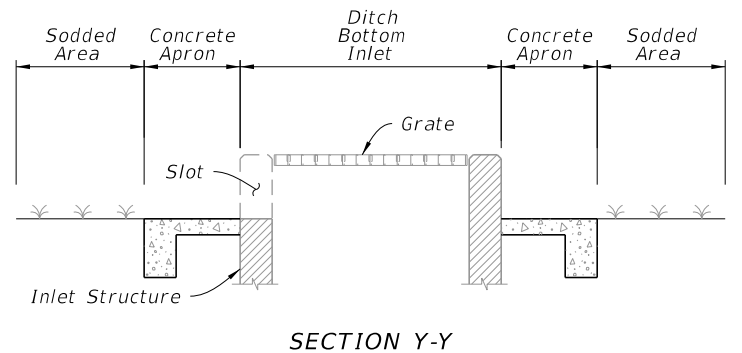

SODDING AND PAVEMENT
(Slot Shown, Non-Slot Similar)

NOTES:

1. Concrete Apron installed only where called for in the Plans.
2. Sod always required.
3. Slots are not permitted on sides with grate seats.

NON-TRAVERSABLE INLET DETAILS

LAST REVISION 11/01/20		DESCRIPTION:		FY 2021-22 STANDARD PLANS		DITCH BOTTOM INLET TYPE C, D, E, AND H		INDEX 425-052	SHEET 8 of 14
---------------------------	--	--------------	--	------------------------------	--	--	--	------------------	------------------

Sodded Area (See TABLE 8)



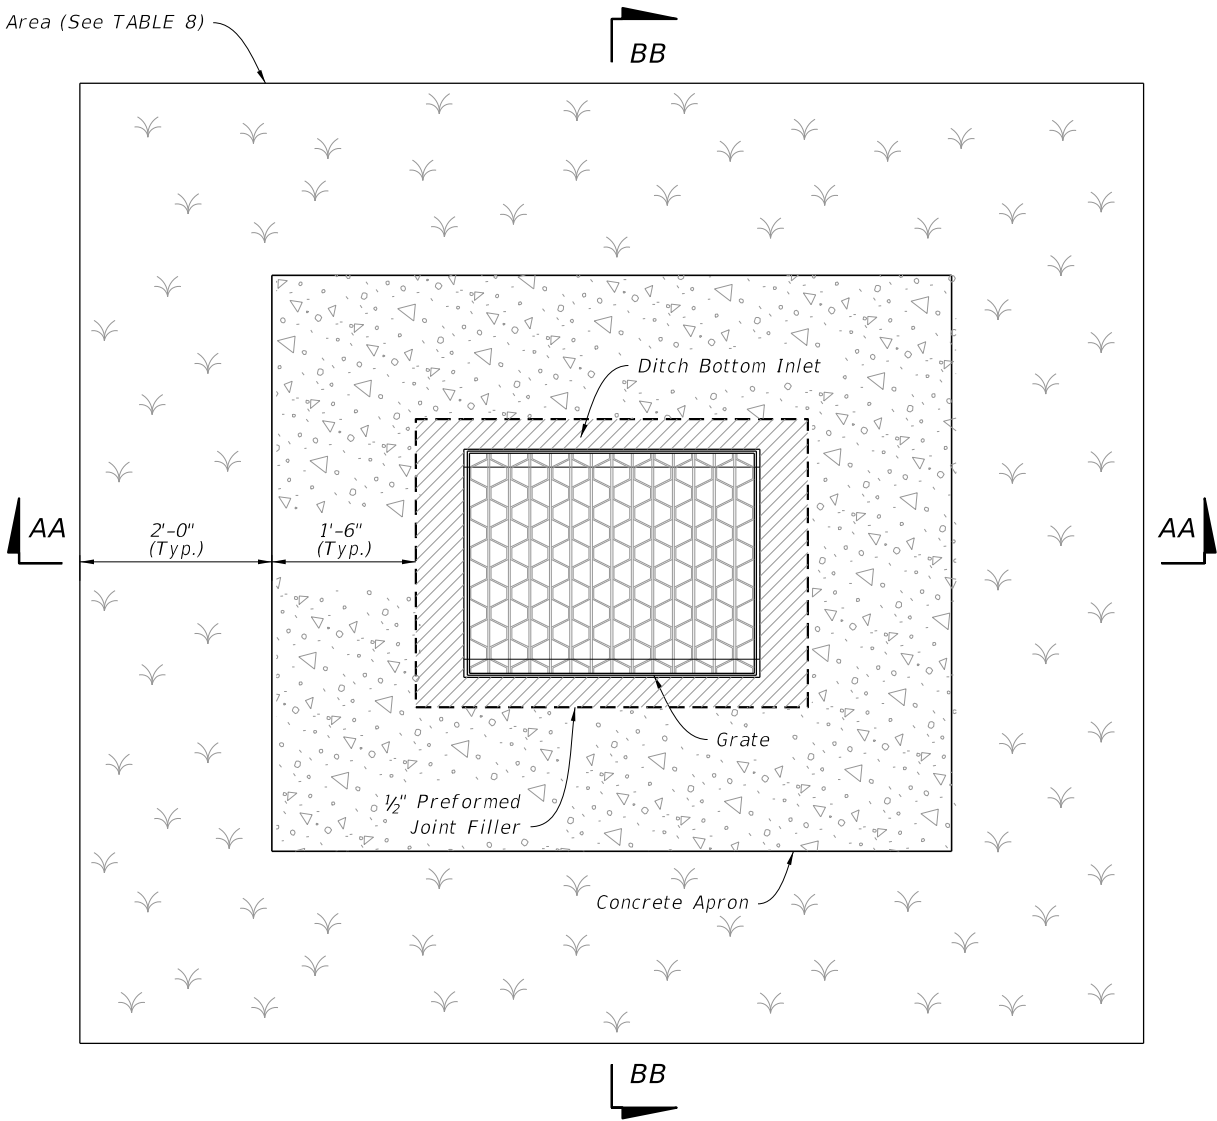


TABLE 8 CONCRETE APRON AND SOD QUANTITIES		
SOD AND PAVEMENT		
Inlet Type	Sod SY	Conc. CY
C	8	0.30
D	9	0.36
E	9	0.37
H	11	0.45

- NOTES:
- 1. Concrete Apron to be installed only where called for in the Plans.
 - 2. Sod always required.

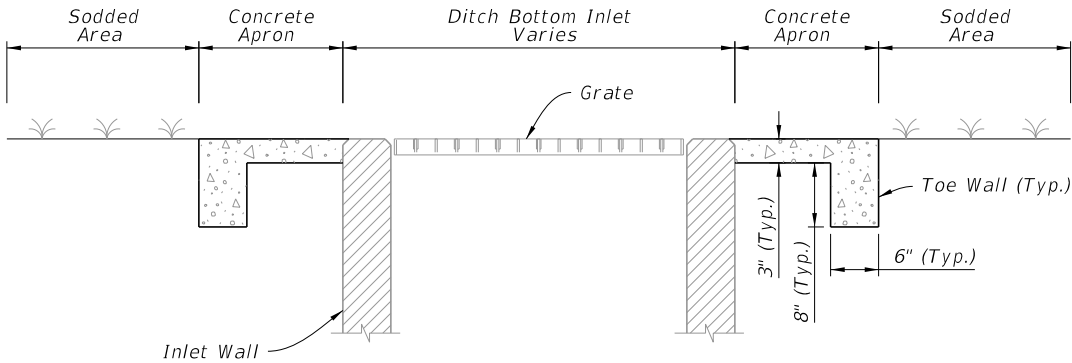

SECTION AA-AA

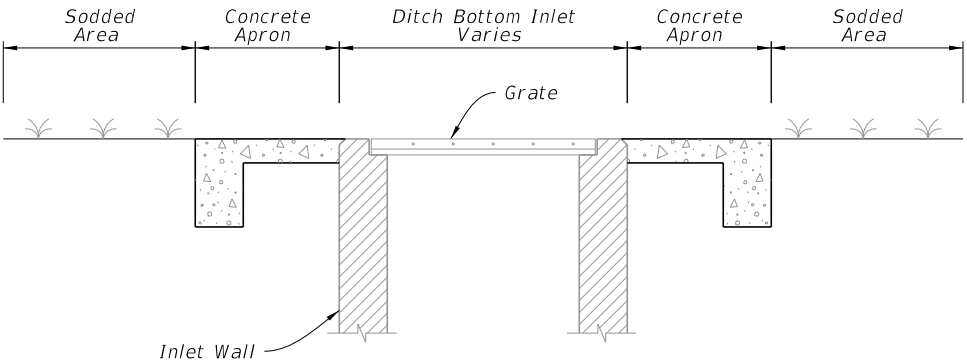

SECTION BB-BB

TRAVERSABLE INLET WITHOUT SLOT DETAILS

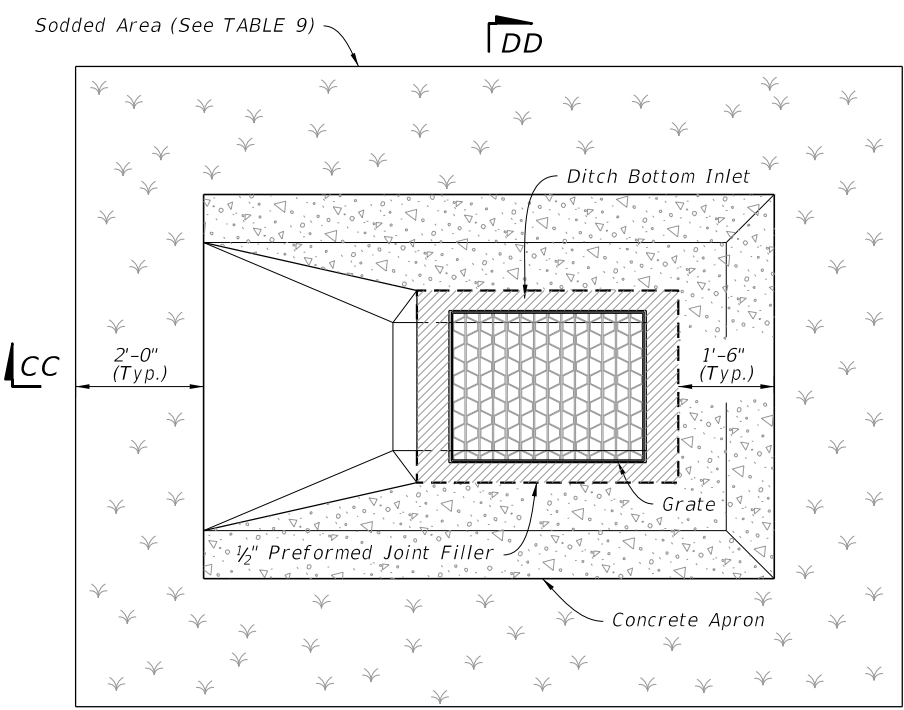


TABLE 9
CONCRETE APRON
AND
SOD QUANTITIES

SINGLE SLOT		
Inlet Type	Sod SY	Conc. CY
C	12	0.77
D	14	0.91
E	14	0.91
H	--	--



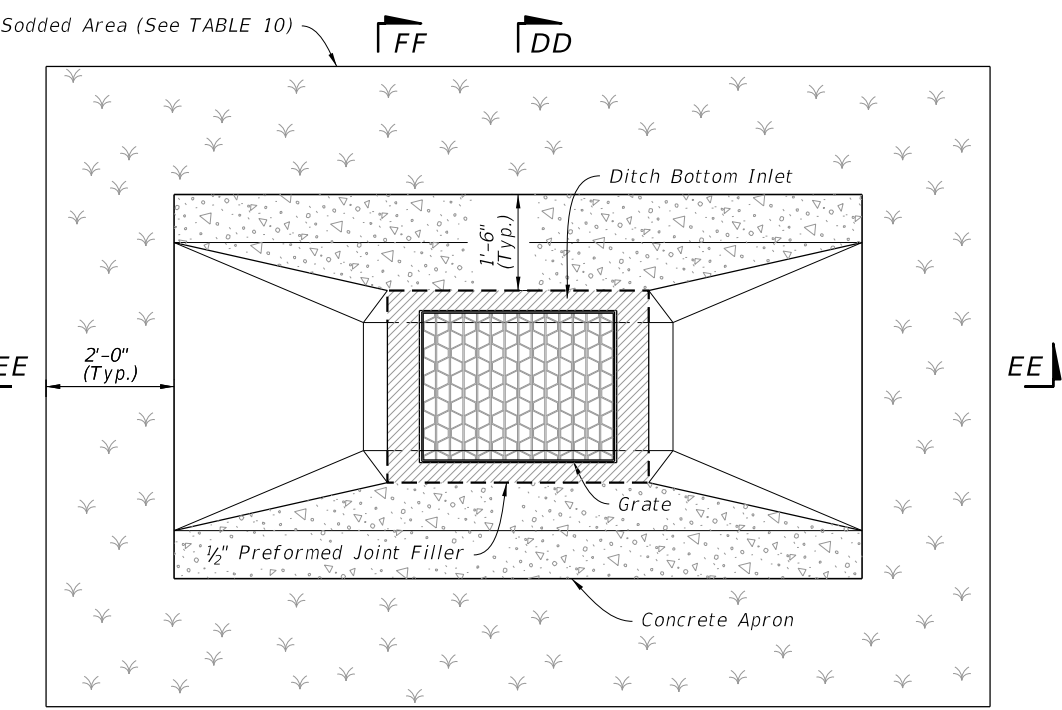


TABLE 10
CONCRETE APRON
AND
SOD QUANTITIES

DOUBLE SLOT		
Inlet Type	Sod SY	Conc. CY
C	16	0.93
D	19	1.10
E	18	1.08
H	--	--

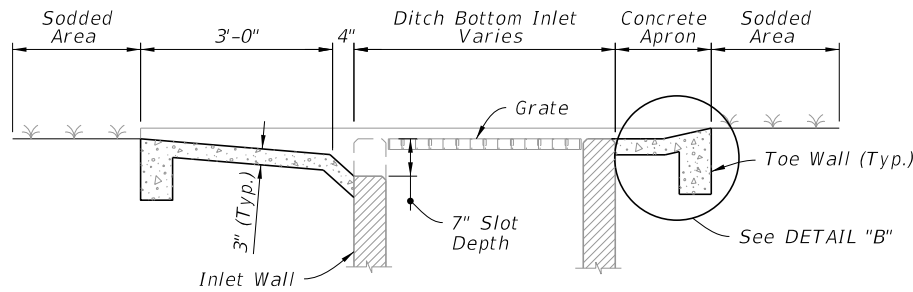


SECTION CC-CC

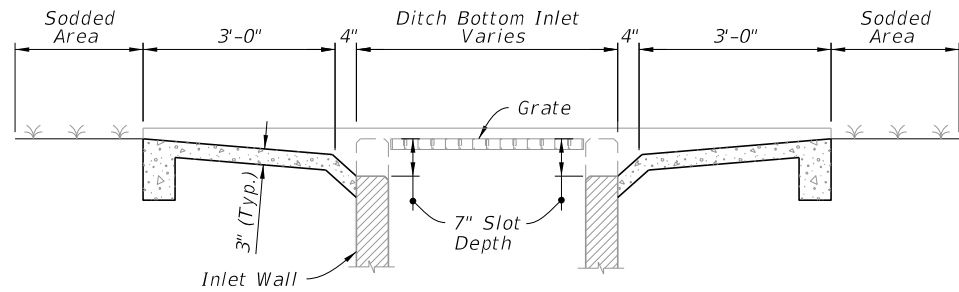


SECTION EE-EE

SINGLE SLOT


DOUBLE SLOT

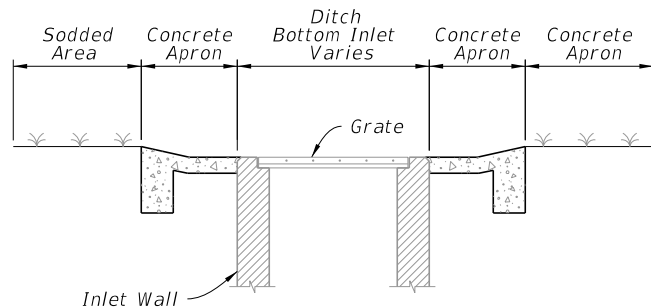

SECTION DD-DD

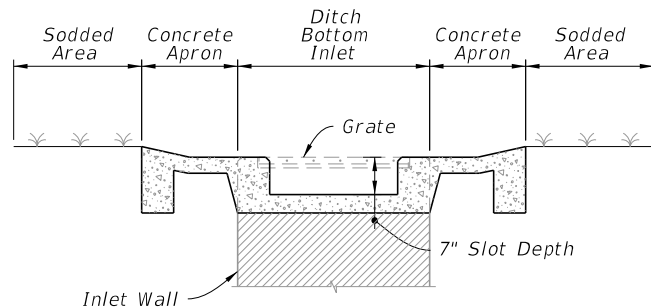

SECTION FF-FF

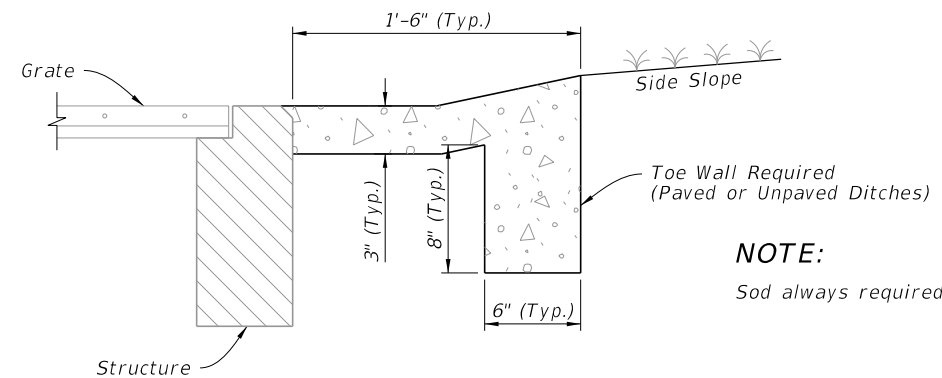


DETAIL "B"

NOTE:
Sod always required.


TRAVERSABLE INLET WITH SLOT DETAILS

12/10/2021 9:49:31 AM


LAST REVISION	DESCRIPTION:	FDOT	FY 2021-22 STANDARD PLANS	DITCH BOTTOM INLET TYPE C, D, E, AND H	INDEX	SHEET
11/01/20					425-052	10 of 14

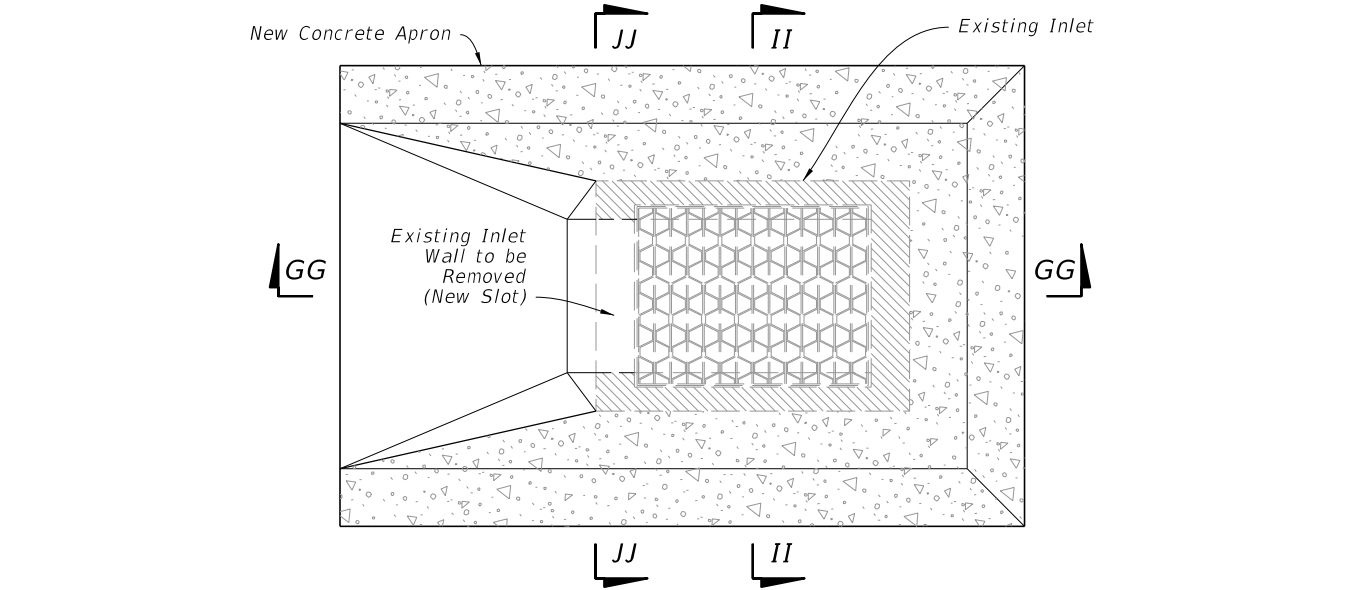


PLAN

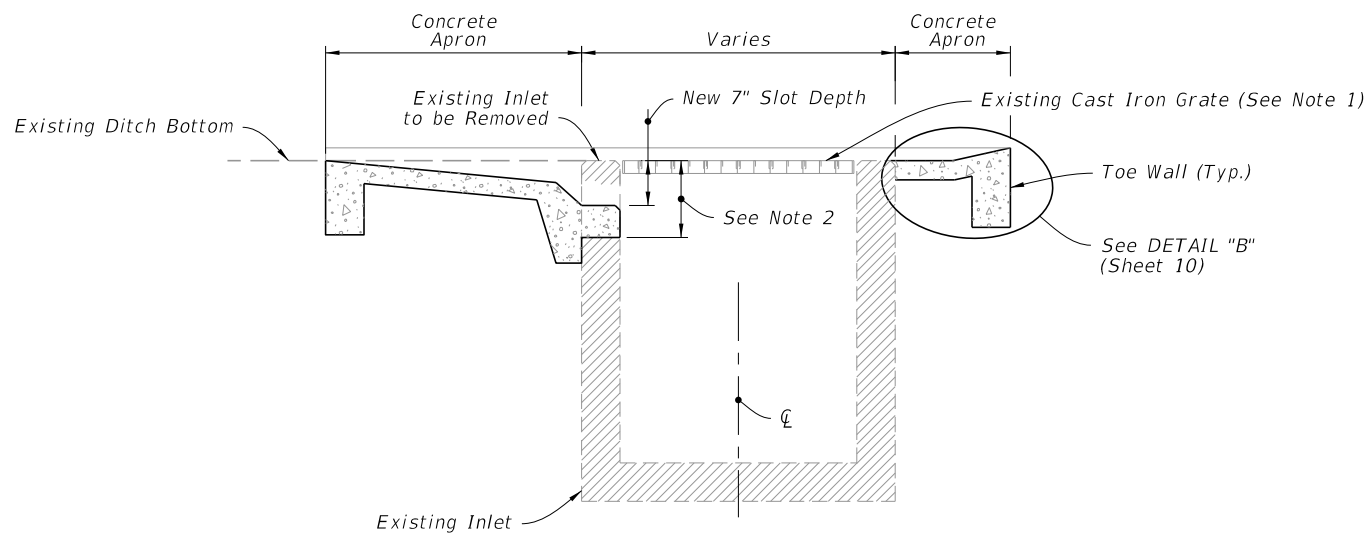

SECTION GG-GG

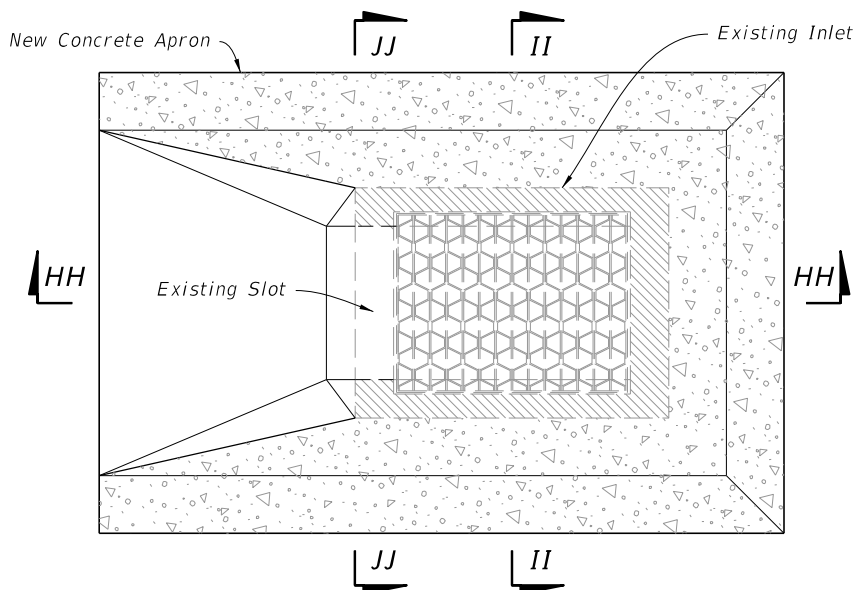


PLAN

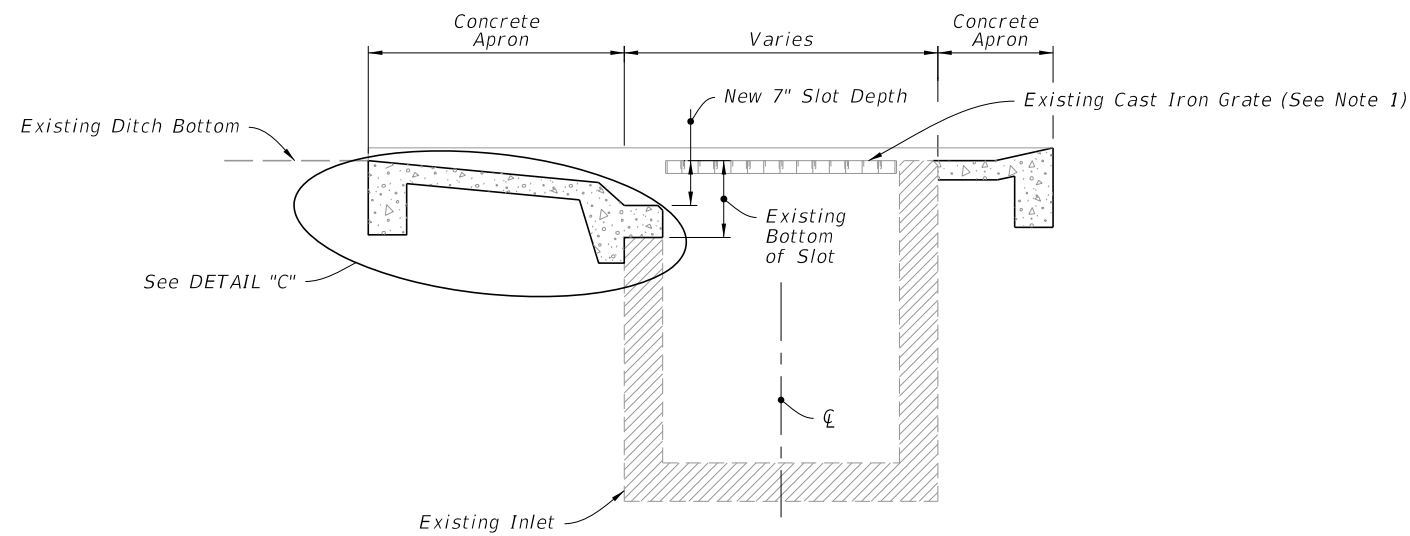


SECTION HH-HH

WITHOUT SLOT


WITH SLOT

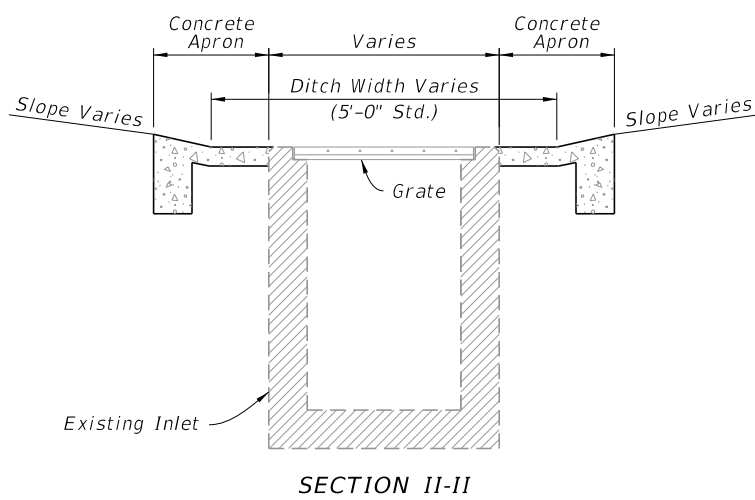

SECTION II-II

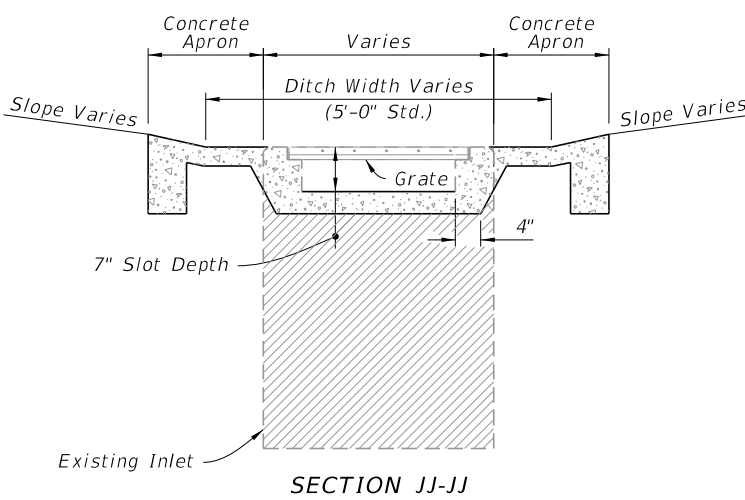

SECTION JJ-JJ

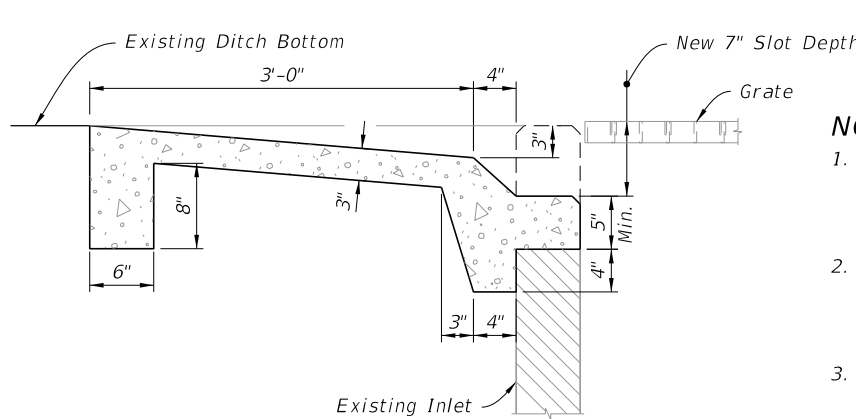


DETAIL "C"


- NOTES:**
1. Replace existing cast iron grate with steel grate. Replace existing steel grate when called for in the plans or as directed by the Engineer.
 2. Remove existing wall to this line (exposed rebar in pavement zone may be either removed or embedded)
 3. Single Slot shown, Double Slots symmetrical about the Inlet centerline.

CASE 1 - ADD TRAVERSABLE SLOTS TO EXISTING INLETS

LAST REVISION 11/01/20	REVISION	DESCRIPTION:	 FY 2021-22 STANDARD PLANS	DITCH BOTTOM INLET TYPE C, D, E, AND H	INDEX 425-052	SHEET 11 of 14
------------------------------	----------	--------------	--	--	------------------	-------------------

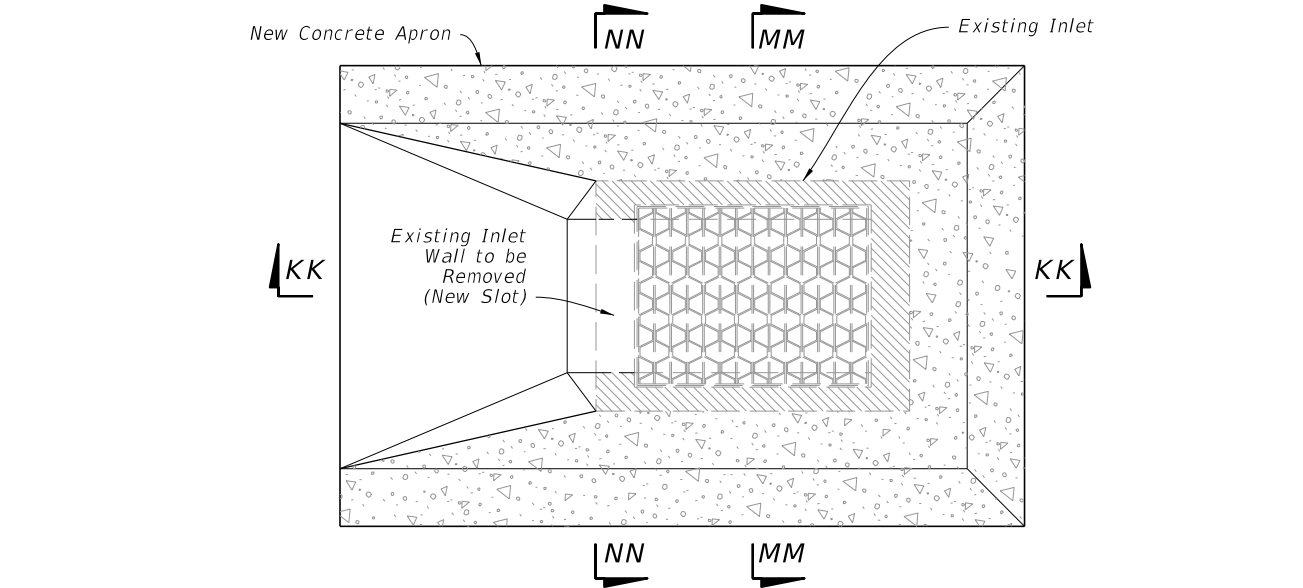


PLAN

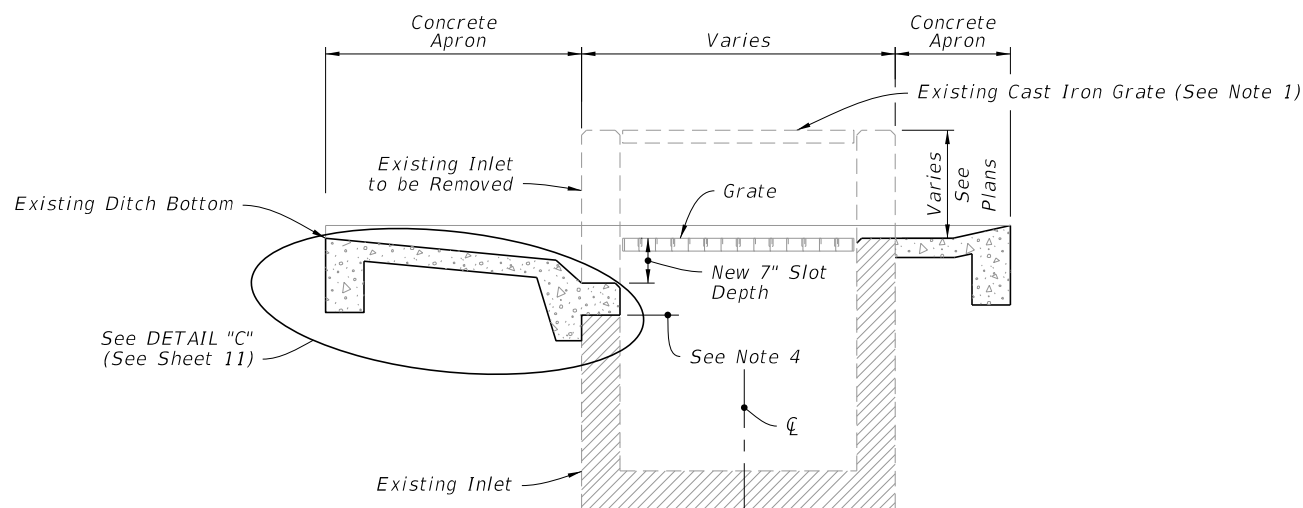


SECTION KK-KK

WITHOUT SLOT

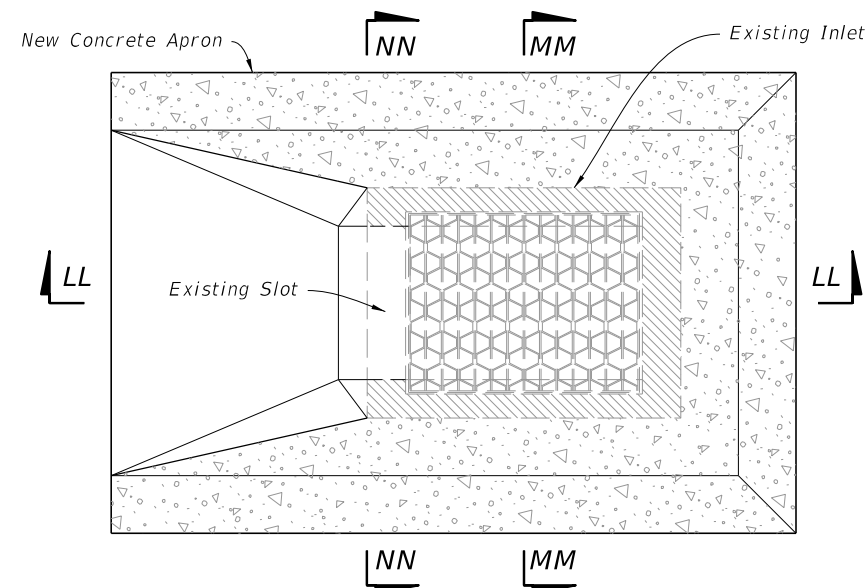


PLAN

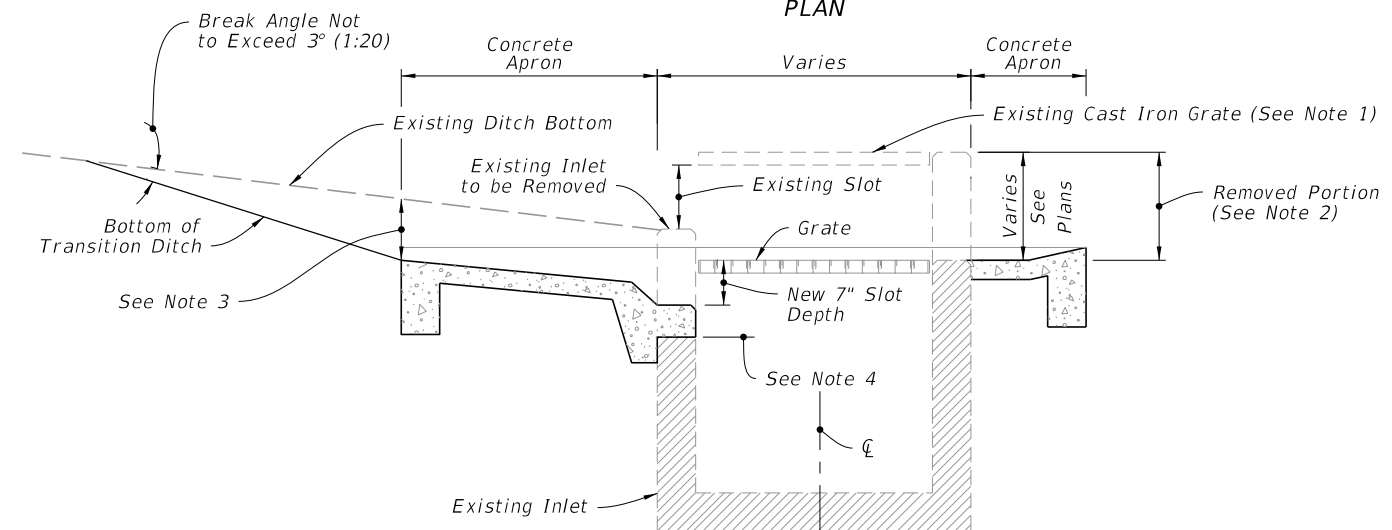


SECTION LL-LL

WITH SLOT

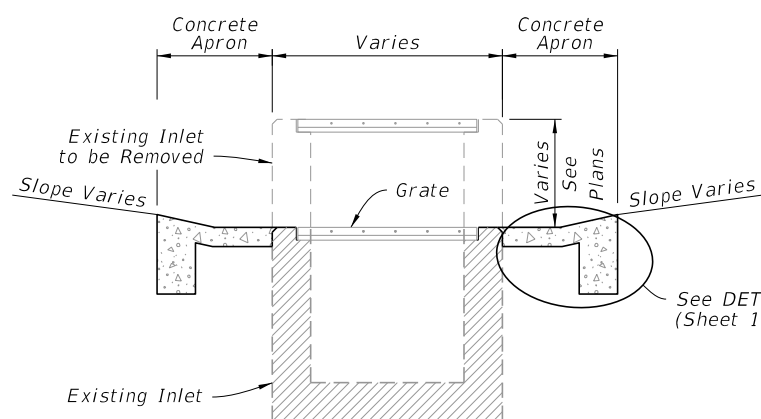

SECTION MM-MM

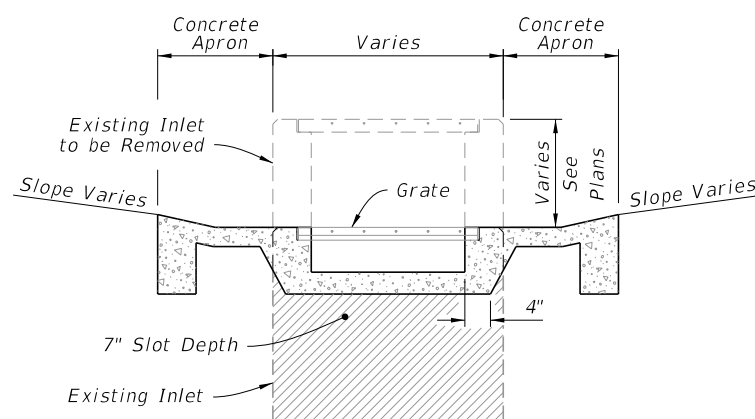

SECTION NN-NN


NOTES:

1. Existing cast iron grate to be replaced with steel grate. Existing steel reticulate grate to be replaced when called for in the Plans or as directed by the Engineer.
2. Remove this portion of box and construct new, concrete ditch pavement, seats and slot (s) (slots if required).
3. These points can be the same or nearly the same where ditch grades are flat.
4. Remove exist. wall to this line (exposed rebar in pavt. zone may be either removed or embedded).
5. Single Slot shown, Double Slots symmetrical about the Inlet centerline.


CASE 2 - ADD TRAVERSABLE SLOTS (PARTIAL) TO EXISTING INLETS

LAST REVISION 11/01/20	REVISION	DESCRIPTION:	FDOT FY 2021-22 STANDARD PLANS	DITCH BOTTOM INLET TYPE C, D, E, AND H	INDEX 425-052	SHEET 12 of 14
------------------------------	----------	--------------	--------------------------------------	--	------------------	-------------------

10/12/2020 6:53:23 AM

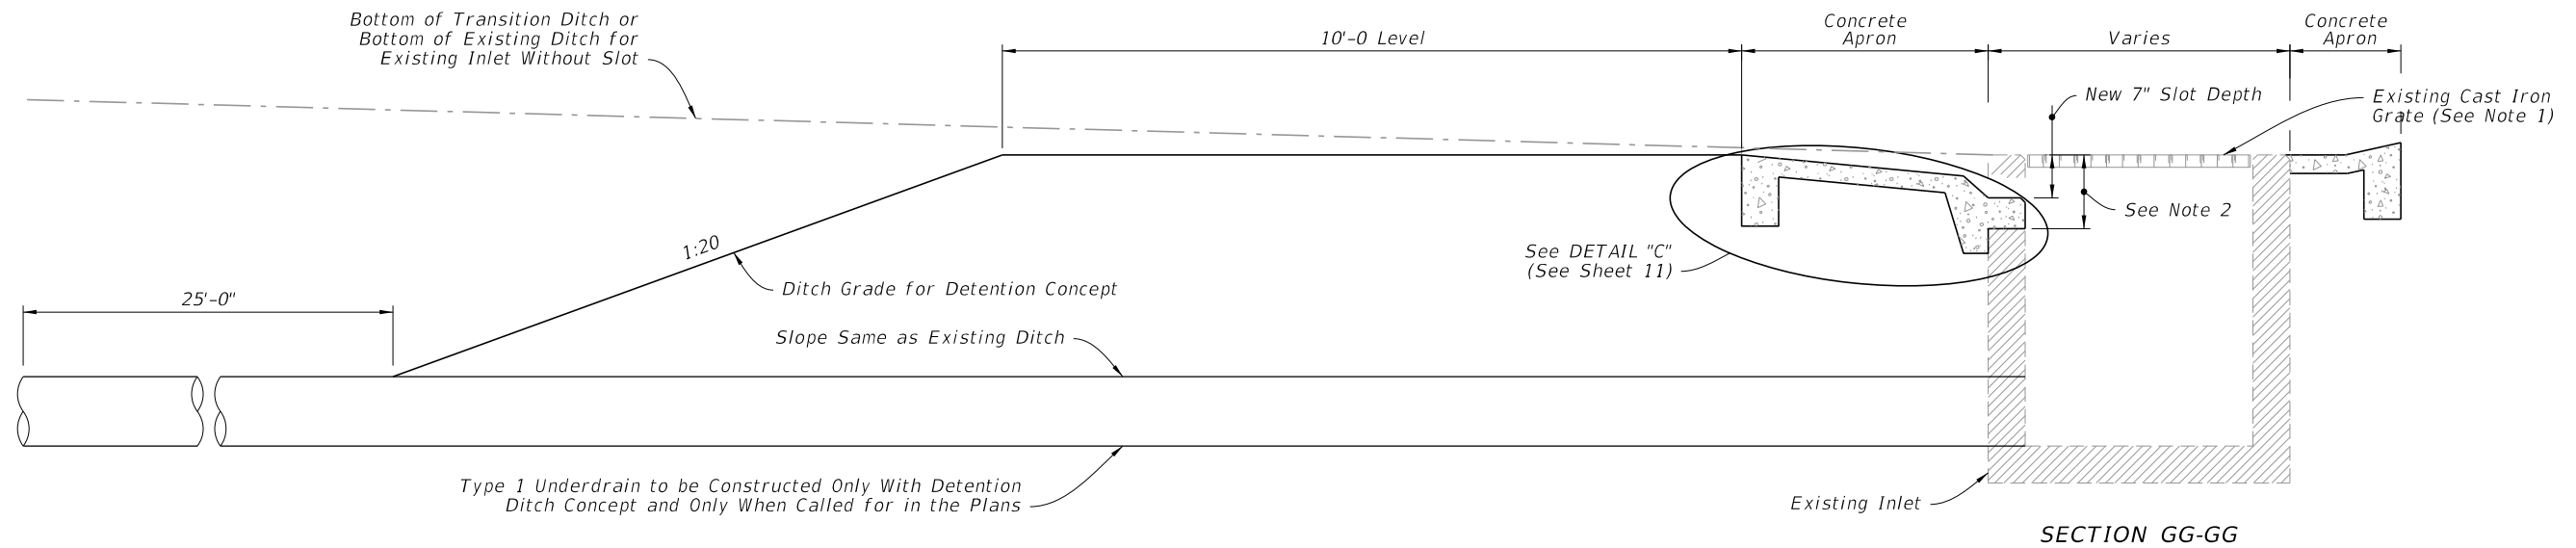


WITHOUT SLOT

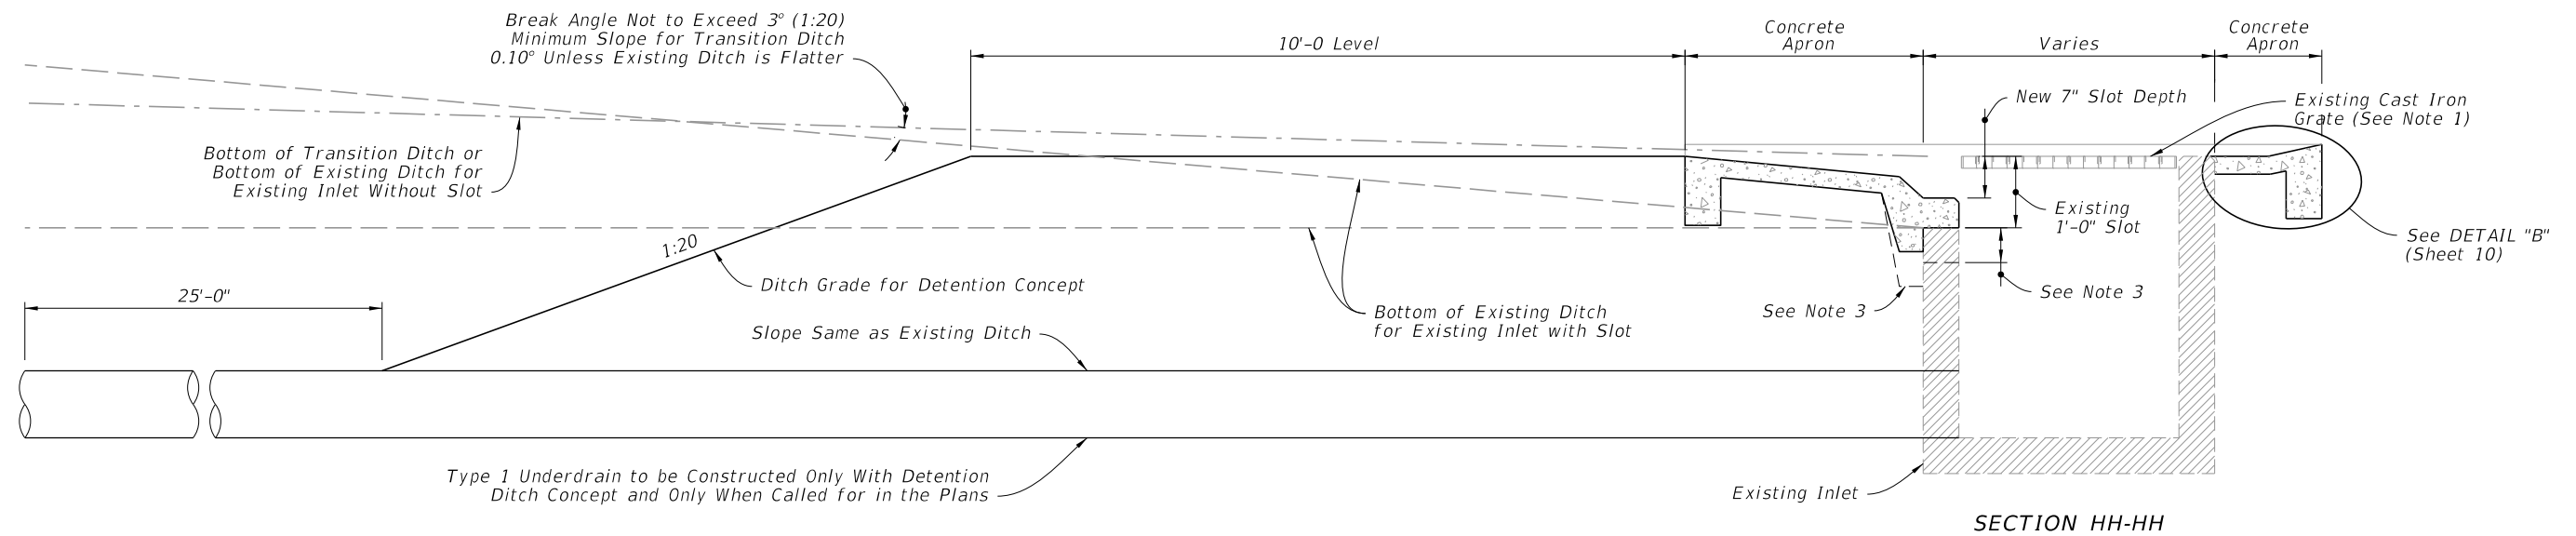

WITH SLOT

NOTES:

- Existing cast iron grate to be replaced with steel grate. Existing steel reticuline grate to be replaced when called for in the Plans or as directed by the Engineer.
- Remove existing wall to this line (exposed rebar in pavement zone may be either removed or embedded)
- Install extra apron when existing slot exceeds 12" in depth.
- Inlet details (With or Without Slots) similar to details on Sheet 11.

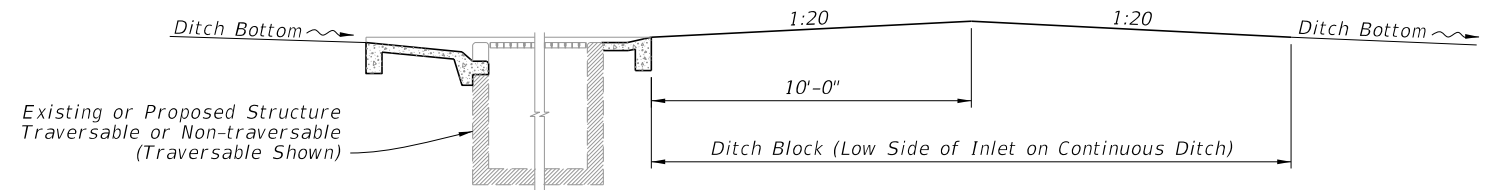

DITCH BLOCK FOR INLETS WITH OR WITHOUT SLOTS

CASE 3 - ADD TRAVERSABLE SLOTS (PARTIAL) TO EXISTING INLETS AND DITCH BLOCK

LAST REVISION	DESCRIPTION:	FDOT	FY 2021-22 STANDARD PLANS	DITCH BOTTOM INLET TYPE C, D, E, AND H	INDEX	SHEET
11/01/20					425-052	13 of 14

10/12/2020 6:53:25 AM

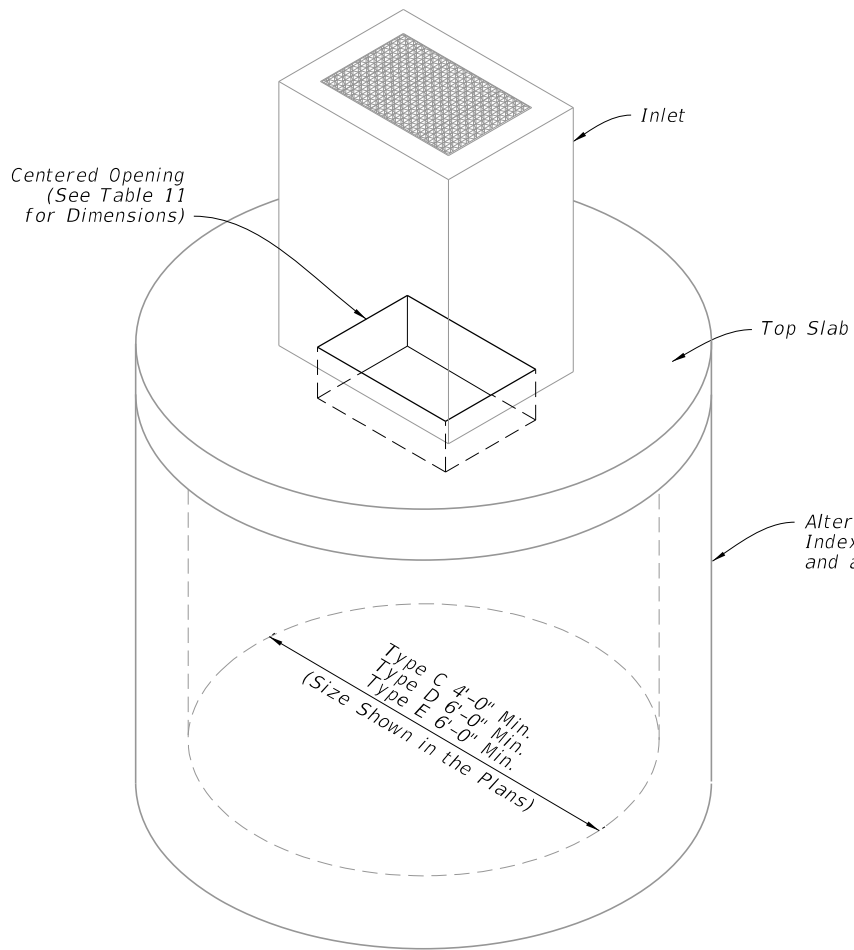


TABLE 11 TOP SLAB OPENINGS		
DIAMETER	OPENING SIZE	
	Min.	Max.
4'-0"	2'-0" x 3'-1"	2'-0" x 3'-1"
5'-0"	2'-0" x 3'-1"	3'-1" x 4'-1"
6'-0"	2'-0" x 3'-1"	3'-0" x 4'-6"
8'-0"	2'-0" x 3'-1"	3'-0" x 4'-6"

ISOMETRIC VIEW

2 Way Reinforcement
(See Tables 12 & 13)


#5 Hoop Bar
(Peripheral Reinforcement)

Centered Opening
(See Table 11
for Dimensions)

#4 Bar Each Corner
(2'-0" Min. Length)

#8 Bars

PLAN

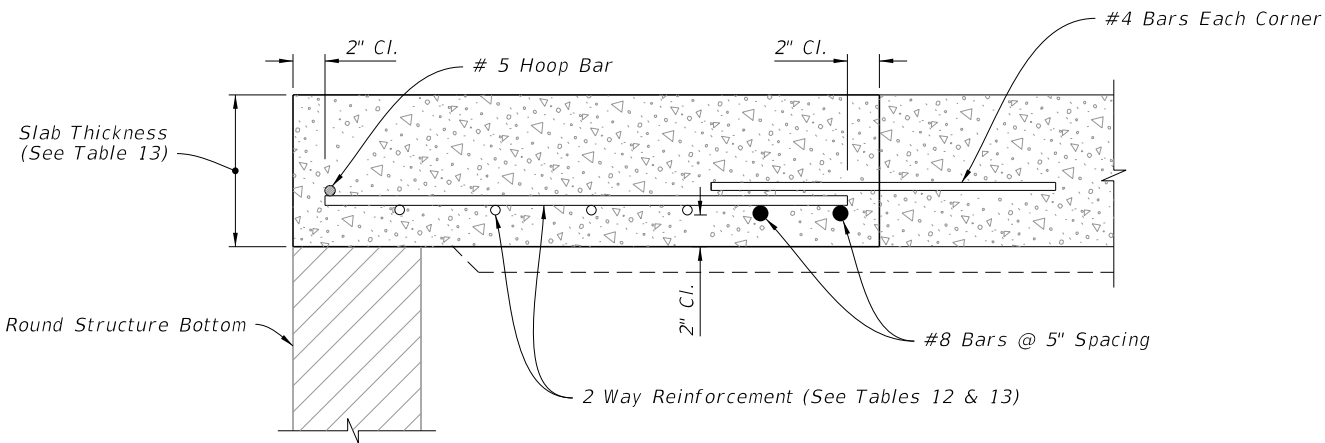

SECTION 00-00

TOP SLAB REINFORCEMENT DETAILS

TABLE 12 TOP SLAB REINFORCING SCHEDULE	
SCHEDULE	GRADE 60 (BAR) OR 65 KSI & 70 KSI (WIRE REINFORCING) In. ² /ft.
A	0.20
B	0.24
C	0.37
D	0.53
E	0.73
F	1.06
G	1.45

TABLE 13 TOP SLAB WITH CENTERED OPENING		
STRUCTURE DEPTH	SLAB THICKNESS	REINFORCING (2 WAY) SCHEDULE
SIZE: 4'-0"		
≥0.5'<40'	9½"	B
SIZE: 5'-0"		
≥0.5'<30'	9½"	C
30'-40'	9½"	D
SIZE: 6'-0"		
≥0.5'<8'	11½"	B
8'<18'	11½"	C
18'<30'	11½"	D
30'<37'	11½"	E
37'-40'	11½"	G
SIZE: 8'-0"		
≥0.5'<9'	11½"	C
9'<15'	11½"	D
15'<23'	11½"	E
23'<33'	11½"	E
33'-40'	11½"	G

ALTERNATE A STRUCTURE BOTTOM - TOP SLAB DETAILS



FY 2021-22
STANDARD PLANS

DITCH BOTTOM INLET TYPE C, D, E, AND H

INDEX
425-052

SHEET
14 of 14

LAST
REVISION
11/01/20

REVISION
DESCRIPTION: