GENERAL NOTES:

- 1. Work this Index with Specification 522.
- 2. Refer to Index 520-001 for drop curb details and Index 522-001 for joints between driveway, sidewalks, and curb.
- 3. Existing Curb and Gutter:

Remove existing curb and gutter to either the nearest joint beyond the flared point or to where no remaining section is less than 5 feet long.

- 4. Grades and cross slopes shown are maximums.
- 5. <u>Longitudinal Join</u>ts:

Construct V_B open joints placed at equal (20' max.) intervals for driveways over 20' wide. Match joints in curb and gutter to match joints in driveways.

6. Transverse Joints:

 $\overline{\text{Construct } \mathscr{V}''_8 \text{ open }}$ joints @ 10' Centers and $\mathscr{V}''_2 \text{ expansion joints with preformed joint filler every 5th joint.$

- 7. Construct driveways (6" thick concrete) to a uniform width (W) to the R/W line or the extent shown in the Plans.
- 8. Width of Sidewalk Thru Driveway is 4'-0" minimum. Match sidewalk width when shown in Plans or when utility strip width is equal to or greater than the depth of the Driveway Apron.
- 9. <u>Alpha-Nu</u>meric Identification:

Concrete Flared Driveway Alpha-Numeric Identifications (e.g. G4) are provided for reference purposes in the Plans.

LEGEND:


Sidewalk


Flared Driveway (6" Thick Concrete)

Sidewalk Thru Driveway (6" Thick Concrete)

Utility Strip

- G_A Grade of Apron
- G_D Grade of Driveway (Per Plans)

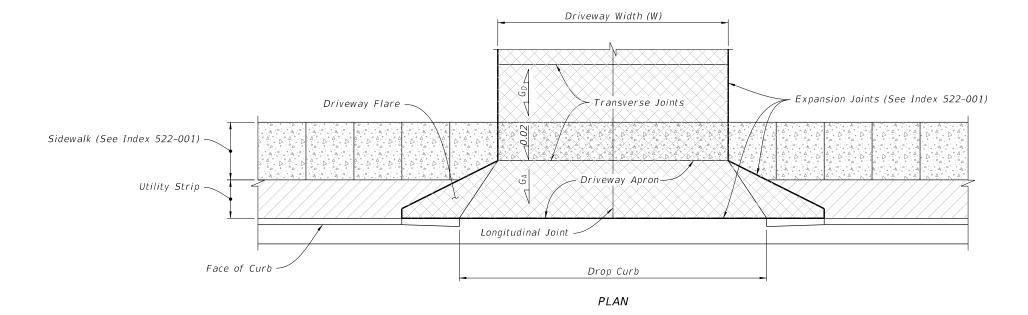


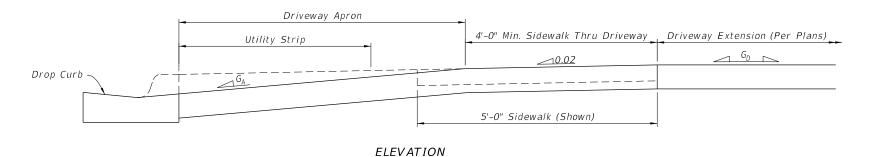


CONCRETE FLARED DRIVEWAY NOMENCLATURE =


LAST **REVISION** 11/01/18

DESCRIPTION:

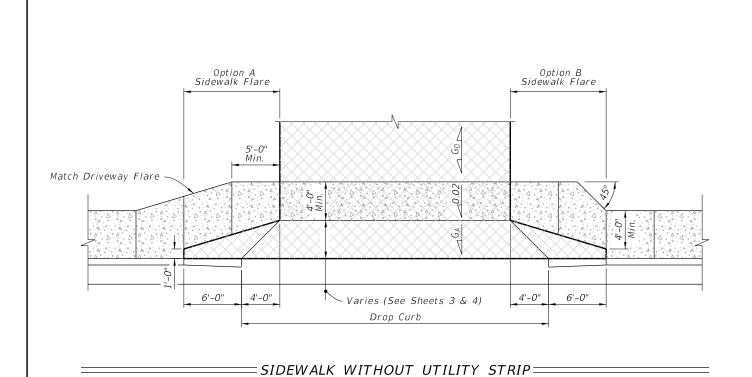

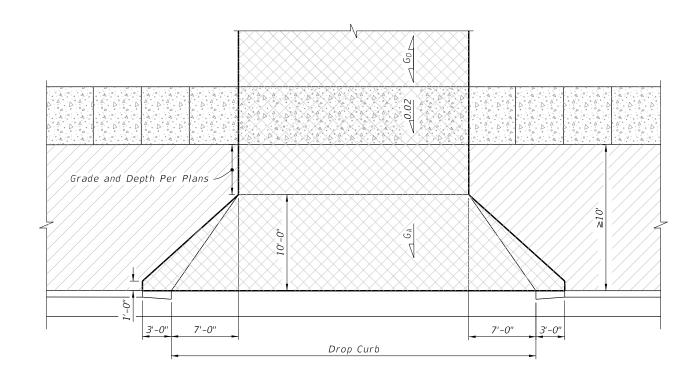

=WITHOUT SIDEWALK OR UTILITY STRIP ≥ 10' WIDE ===

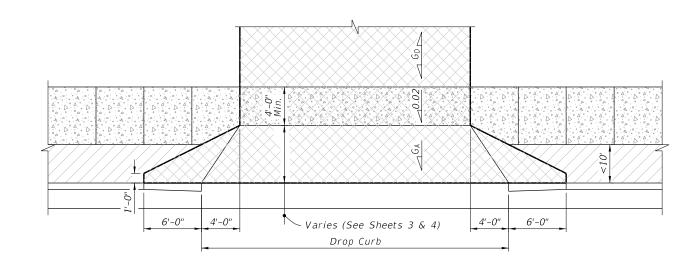

=UTILITY STRIP < 10' WIDE===

LEGEND:

Sidewalk

Flared Driveway (6" Thick Concrete)

Sidewalk Thru Driveway (6" Thick Concrete)

Utility Strip

REVISION 11/01/18

≥ DESCRIPTION:

FDOT

FY 2022-23 STANDARD PLANS

CONCRETE FLARED DRIVEWAYS

INDEX 522-003

SHEET 2 of 4

