NOTES:

- 1. Shop Drawings are required, refer to Specification 515.
- 2. <u>Materials:</u>
- A. Pan Head Set Screws: Stainless Steel (SS) Type 316 or 18-8 Alloy.
- B. Base Plates and Cap Plates: ASTM A36 or ASTM A709 Grade 36
- C. Pipe Rails and Posts: ASTM A53 Grade B for standard weight pipe and ASTM A500 Grade B, C or D or ASTM A501 for Structural Tube.


Handrail Support Bars: ASTM A36


RAILING MEMBER DIMENSIONS TABLE			
MEMBER	DESIGNATION	OUTSIDE DIMENSION	WALL THICKNESS
Posts	2" NPS (Sch. 40)	2.375"	0.154"
Rails	2" NPS (Sch. 40)	2.375"	0.154"
Rail Joint/Splice Sleeves	1½" NPS (Sch. 40)	1.900"	0.145"
Handrails Joint/Splice Sleeves	1" NPS (Sch. 40) HSS1.500x0.125	1.315" 1.500"	0.133" 0.125"
Handrails	1½" NPS (Sch. 40)	1.900"	0.145"
Handrail Support Bar	1" Ø Round Bar	1.000"	N/A


- D. Galvanized Steel Fasteners:
- a. Hex Head Bolts: ASTM A307 Type 1 or ASTM F1554 Grade 36
- b. Adhesive Anchors: ASTM F1554 Grade 36 fully threaded rods
- c. Hex Nuts: ASTM A563
- d. Flat Washers: ASTM F436
- E. Aluminum Shims: ASTM B209, Alloy 6061
- F. Bearing Pads: Plain, Fabric Reinforced, or Fabric Laminated meeting requirements of Specifications 515 and 932.
- 3. Fabrication:
- A. Place expansion joints at a maximum of 30'-0"spacing.
- B. Field splices are similar to the expansion joint detail and may be approved by the Engineer to facilitate handling; but top rail must be continuous across a minimum of two posts.


 C. Continuity field splice (Detail "E") only use to make the railing continuous for unforeseen field adjustments
- D. Corners and changes in tangential longitudinal alignment may be made continuous with a 9"bend radius or terminated at adjoining sections with a standard end hoop when handrails are not required.
- E. For curved longitudinal alignments, shop bend the top and bottom rails and handrails to match the alignment radius. F. For changes in tangential longitudinal alignment greater than 45° , positioned posts a maximum of 2'-0" each side of the corner, not at the corner apex.
- 4. Handrails are required and must be continuous at landings for:
- A. Grades Steeper than 5%,
- B. Three or more steps
- 5. Cutting of reinforcing steel is permitted for adhesive anchor bolt installations.


DESCRIPTION:

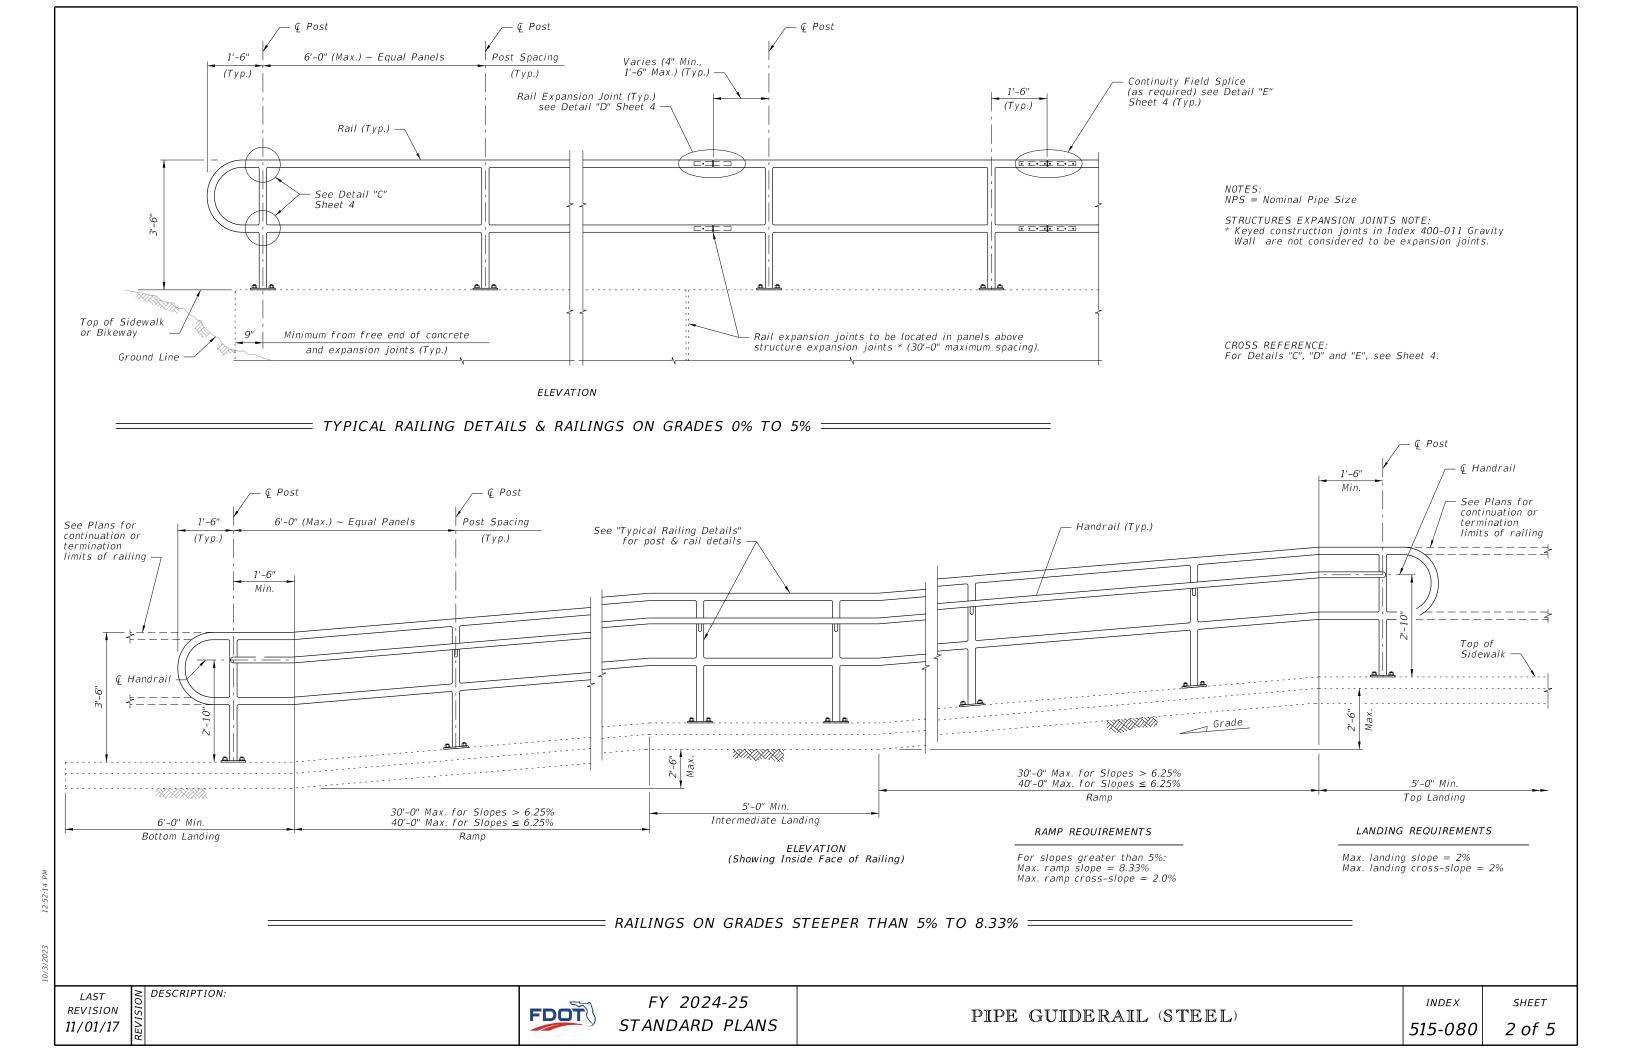

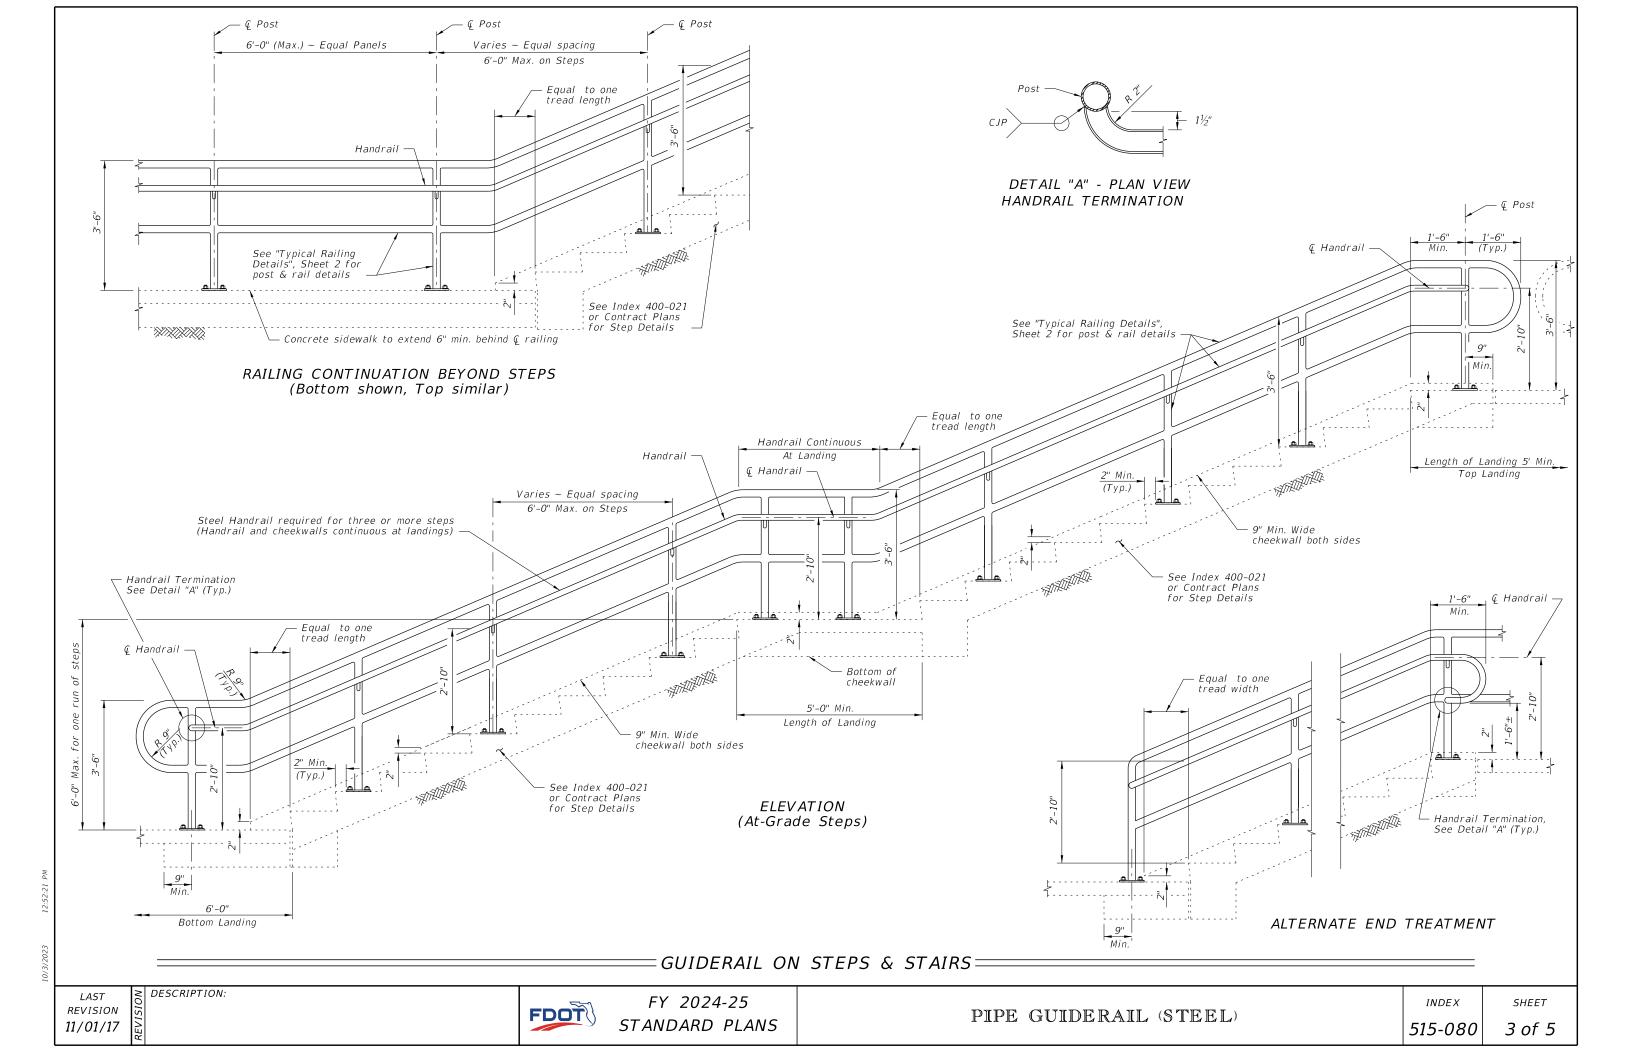

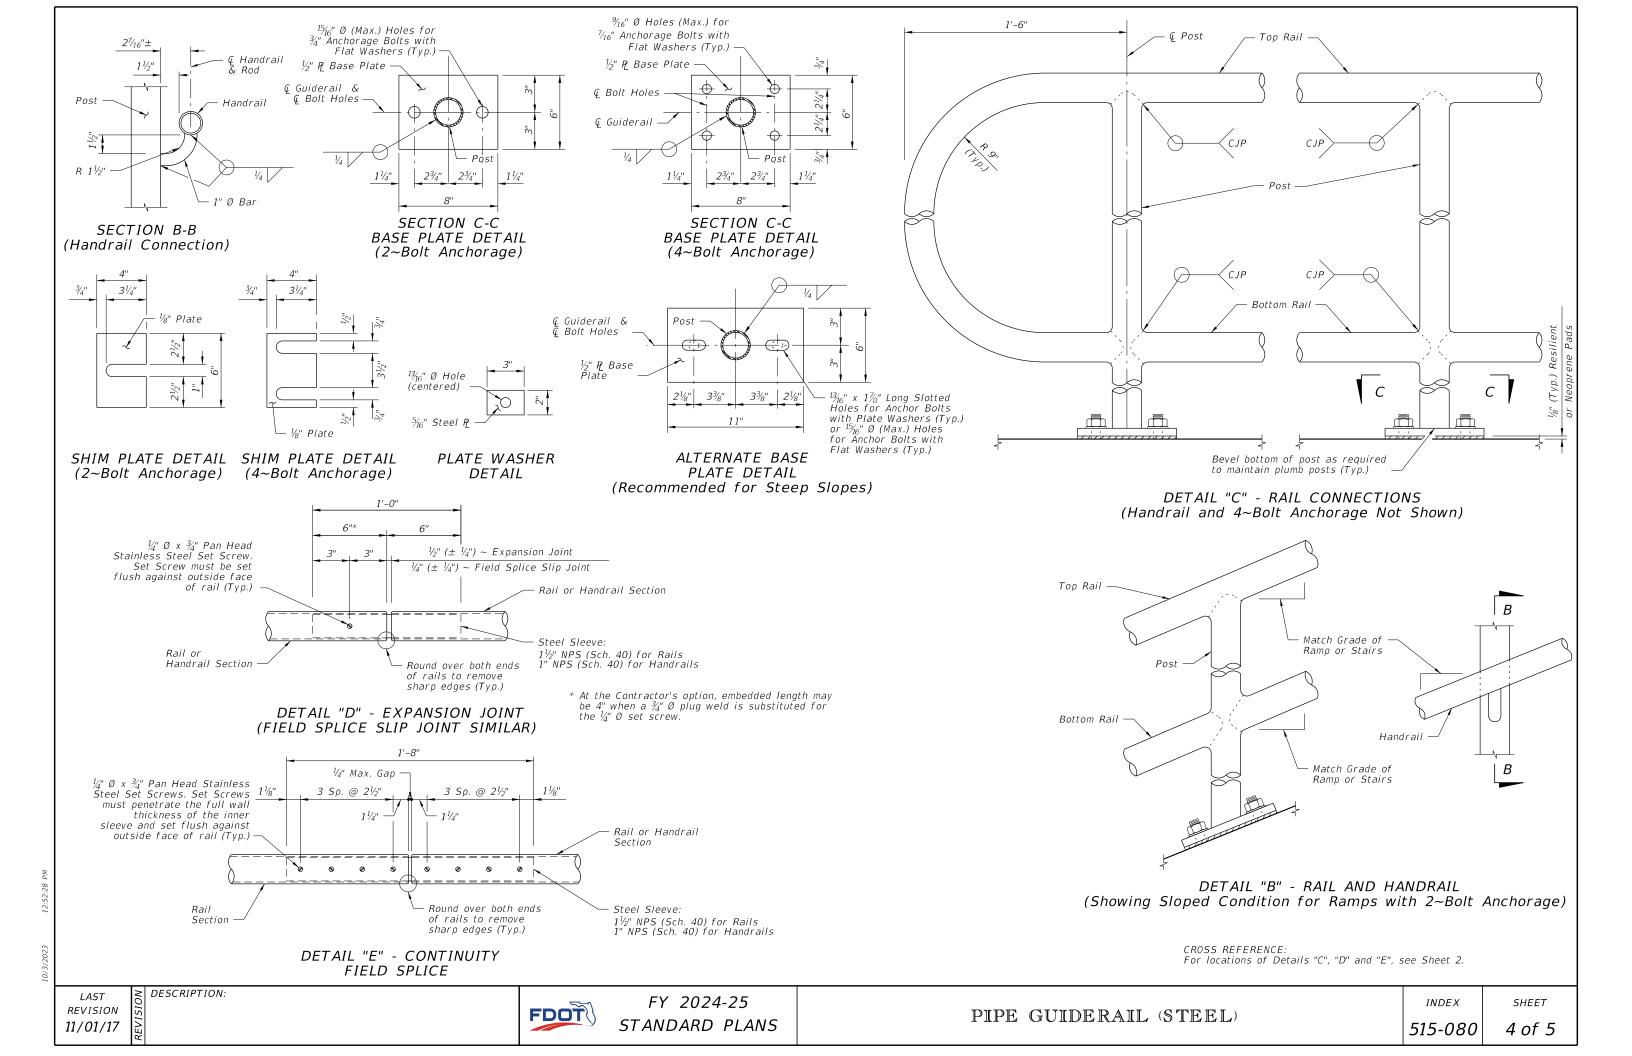

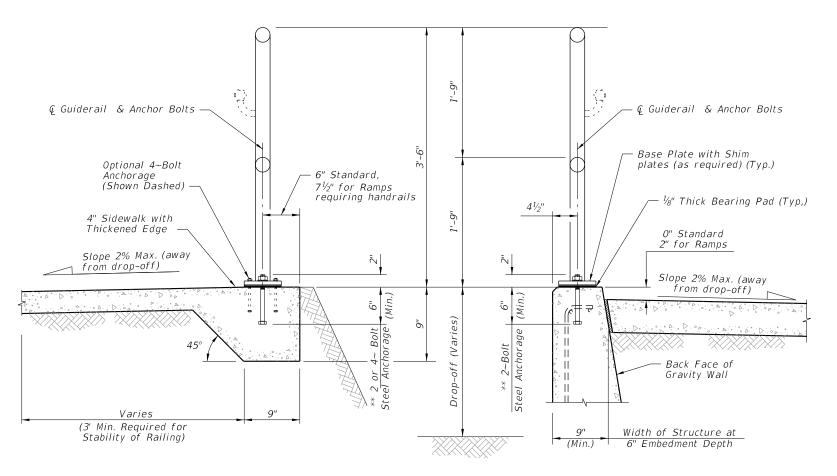

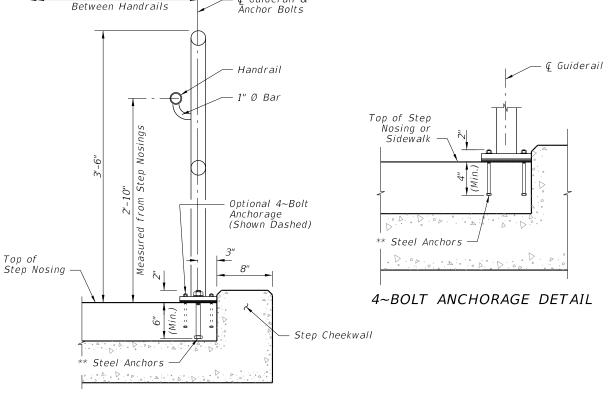


Guiderail &

TYPICAL SECTION ON CONCRETE SIDEWALK

TYPICAL SECTION ON GRAVITY WALL (Other Retaining Walls Similar)

TYPICAL SECTION ON STEPS & STAIRS

5'-0" Std. ~ 3'-0" Min. Clear_

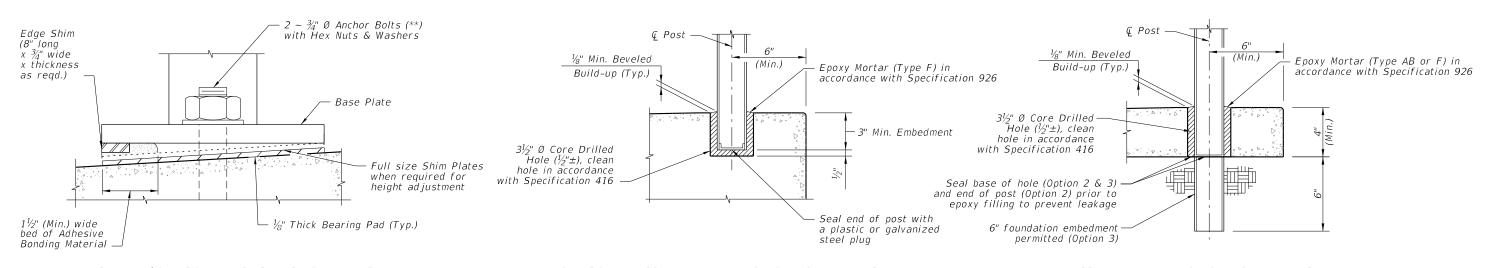

DETAIL "F" (OPTIONAL SHIMMING DETAIL FOR CROSS SLOPE CORRECTION) (Used in lieu of Beveled Shim Plates)

OPTIONAL SIDEWALK ANCHORAGE DETAIL

SIDEWALK ANCHORAGE DETAIL OPTION 2 & 3

 2 $\sim 34''$ Ø x 8" or 4 $\sim 7_{16}''$ Ø x 6" Steel Anchors: Galvanized Steel Bolts (As Shown) (C-I-P); Galvanized U-Bolts Permitted (C-I-P); Galvanized Adhesive Anchors Permitted (*); Expansion Anchors Not Permitted.

*** The minimum embedment for adhesive anchors is 6" for 2~Bolt Anchorage or 4" for 4~Bolt Anchorage.

REVISION 11/01/20

DESCRIPTION:

FDOT

FY 2024-25 STANDARD PLANS

INDEX

SHEET

515-080