

TABLE 1 SCHEDULE OF BELL REINFORCEMENT Classes II, III, IV, AND V; Wall A, B, AND C

Maximum

Reinforcement

Under Tolerance

in² per foot

0.010

0.010

0.010

0.010

0.010

0.010

0.011

0.012

0.0135

Design

Bell

Reinforcement

in² per foot

0.07

0.07

0.09

0.12

0.14

0.16

0.19

0.21

0.23

Nominal

Diameter

15"

18"

24"

30"

36"


42"

48"


54"

60"

Pipe

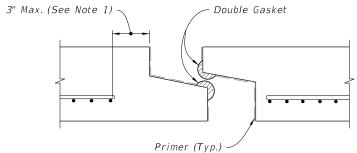

PREFORMED PLASTIC JOINT

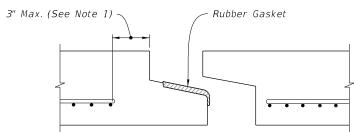

PROFILE RUBBER GASKET

NOTES:

- 2. Type D-3 Geotextile Jacket is required on both type of joints.
- 3. Details shown before joint is homed.

DESCRIPTION: LAST REVISION 11/01/23



FY 2025-26 STANDARD PLANS

MISCELLANEOUS DRAINAGE

66" 0.26 0.015 0.0165 72" 0.28

78"	0.30	0.018
84"	0.33	0.0195
90"	0.35	0.021
96"	0.37	0.0225
102"	0.40	0.024
108"	0.42	0.0255

## NOTES:

- 1. Locate the last full wrap of reinforcement within 3 inches of the spigot shoulder and meet ASTM C76 for round pipe.
- 2. All circumferential steel located above this line and within the 1.75 L is defined as bell reinforcement.


ROUND CONCRETE PIPE JOINT DETAIL=





1. Locate the last full wrap of reinforcement within 3 inches of the spigot shoulder and meet ASTM C507 for elliptical pipe.

=ELLIPTICAL CONCRETE PIPE JOINT DETAIL=

ROUND AND ELLIPTICAL CONC	RETE PI	PE JOINT
	INDEX	SHEET
DRAINAGE DETAILS	430-001	2 of 7

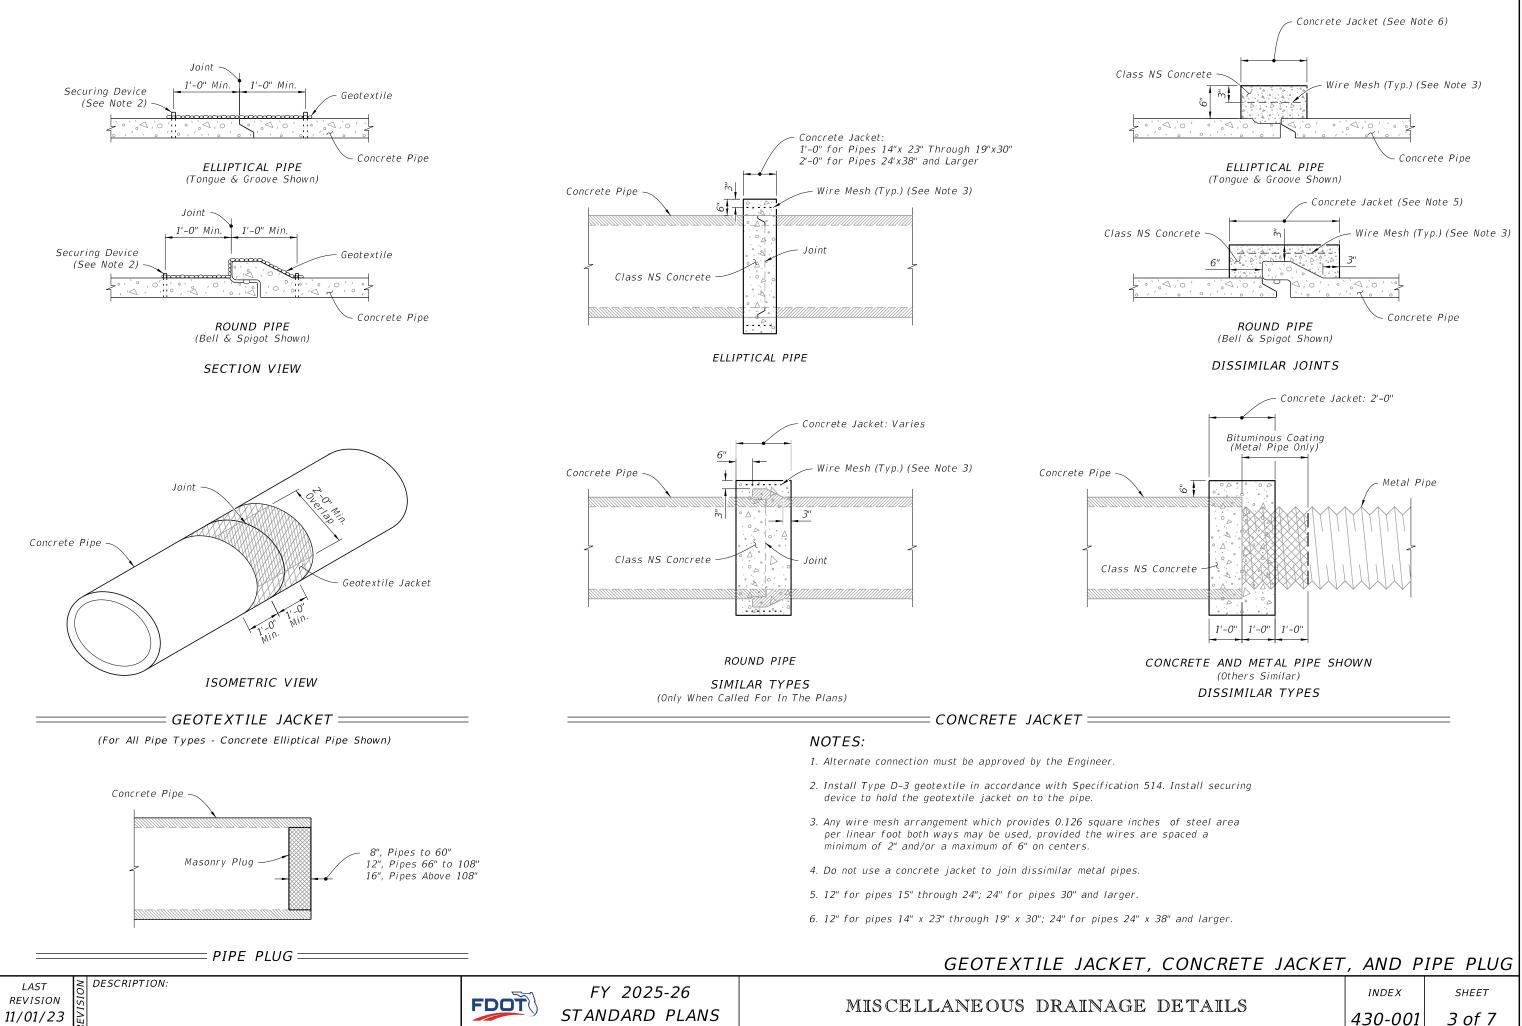



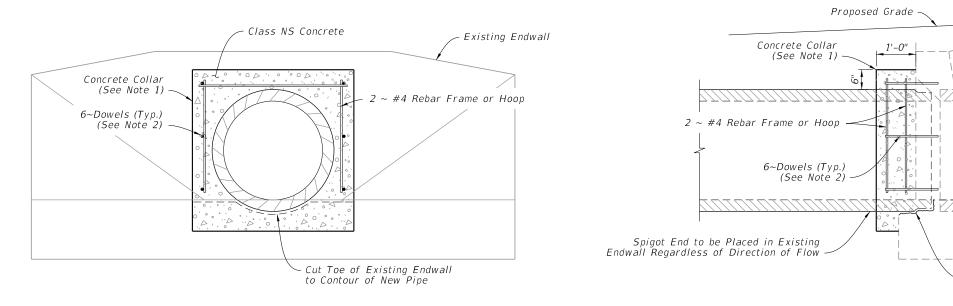

END ELEVATION

EXTENSION OF EXISTING PIPE CULVERTS =

## NOTES:


1. The collar may be formed by any method approved by the Engineer.

2. Install  $\gamma_2$ "x16" dowels in adhesive bond material.

LAST REVISION 11/01/20




MISCELLANEOUS DRAINAGE

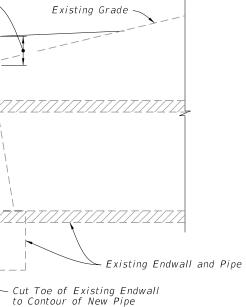

SIDE ELEVATION

С	ONCRETE	COLLARS
	INDEX	SHEET
DETAILS	430-001	4 of 7

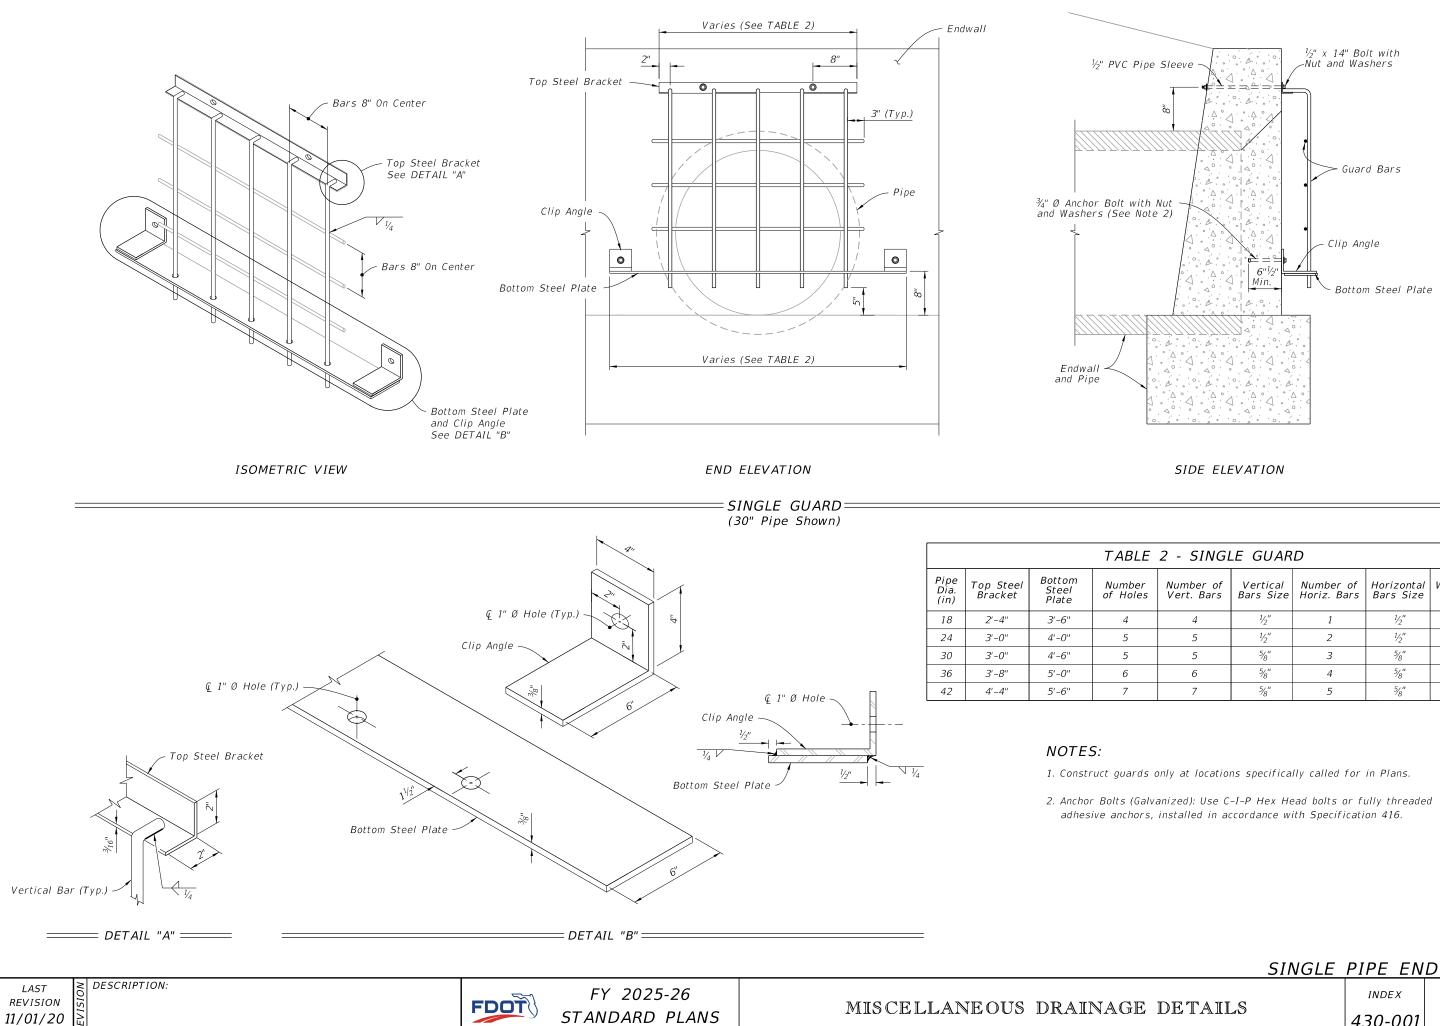

.E 2 - SINGLE GUARD									
er es	Number of Vertical Number of Horizontal Weig S Vert. Bars Bars Size Horiz. Bars Bars Size Ibs				Weight Ibs.				
	4	1/2"	1	1/2"	48				
	5	1/2"	2	1⁄2″	58				
	5	5/8"	3	5/8"	74				
	6	5/8"	4	<i>5</i> /8"	90				
	7	5/8"	5	5/8"	111				

	SINGLE	PIPE EN	D GUARD
		INDEX	SHEET
E DETAILS		430-001	5 of 7

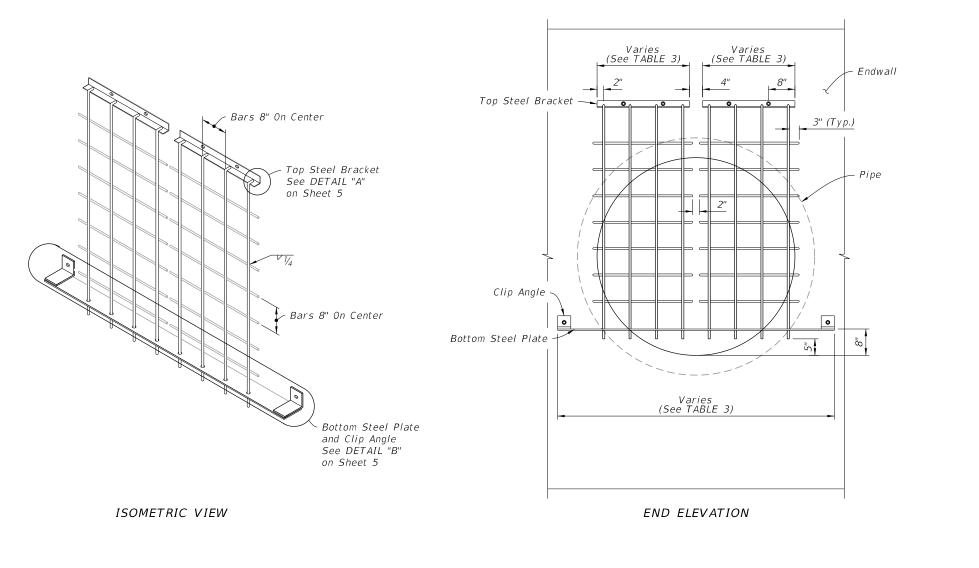




	TABLE 3 - DOUBLE GUARD									
Pipe Dia. (in)	Top Steel Bracket Grate 1	Top Steel Bracket Grate 2	Bottom Steel Plate	Number of Total Holes	Number of Vert. Bars Grate 1	Number of Vert. Bars Grate 2	Vertical Bars Size	Number of Horiz. Bars (each grate)	Horizontal Bars Size	Weight Ibs.
48	2'-4"	2'-4"	6'-0''	8	4	4	5/8"	5	<sup>5</sup> ⁄8″	127
54	2'-4"	2'-4"	6'-6"	8	4	4	3⁄4"	6	5/8"	157
60	2'-4"	2'-4"	7'-0"	8	4	4	3⁄4"	7	5/8''	172

LAST REVISION 11/01/20 NOISI/

NOTES:


1. Construct guards only at locations specifically called for in Plans.

2. Anchor Bolts (Galvanized): Use C-I-P Hex Head bolts or fully threaded adhesive anchors, installed in accordance with Specification 416.



FY 2025-26 STANDARD PLANS


## MISCELLANEOUS DRAINAGE

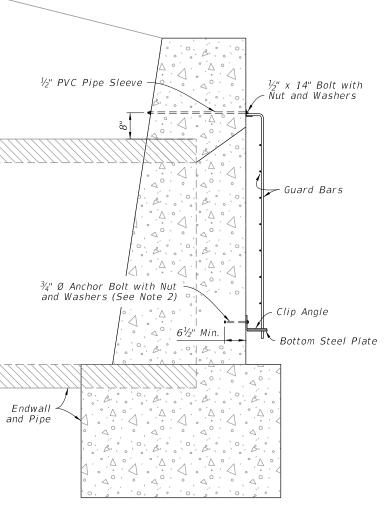

SIDE ELEVATION

DOUBLE	PIPF	FND	GUARD

	INDEX	SHEET
E DETAILS	430-001	6 of 7

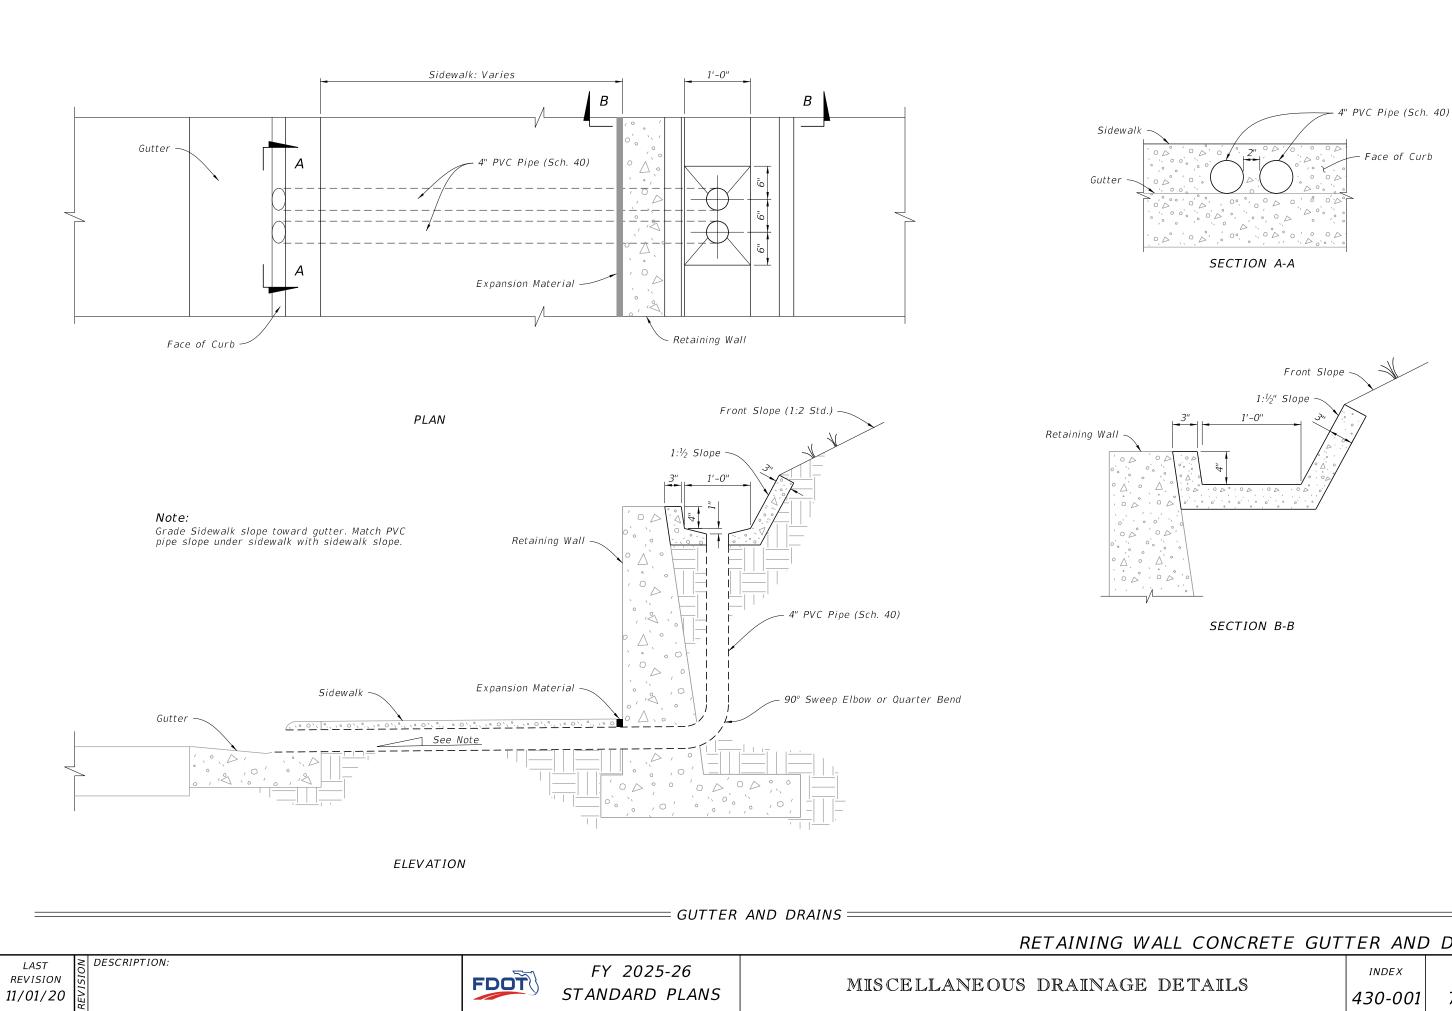

NALL CONCRETE GUT	TER AND	DRAINS
E DETAILS	INDEX	SHEET
E DETAILS	430-001	7 of 7