NOTES:

- 1. Shop Drawings are required.
- 2. Work with Specification 515.
- 3. Materials:
- A. Pan Head Set Screws: Aluminum Alloy 2024-74 or 7075-T73 or Stainless Steel (SS) Type 316 or 18-8 Alloy.
- B. Base Plates and Cap Plates: ASTM B209, Alloy 6061-T6
- C. Structural Pipe Tube and Bars: ASTM B221 or ASTM B429, Alloy 6061-T6

D. End Rails 90° bends and corner bends with a maximum 4 foot spacing: Alloy 6063-T5 is permitted.

RAILING MEMBER DIMENSIONS TABLE					
MEMBER	DESIGNATION	OUT SIDE DIMENSION	WALL THICKNESS		
Posts	2" NPS (Sch. 40)	2.375"	0.154"		
Rails	2" NPS (Sch. 40)	2.375"	0.154"		
Rail Joint/Splice Sleeves	1½" NPS (Sch. 40)	1.900"	0.145"		
Handrails Joint/Splice Sleeves	1" NPS (Sch. 40) 1.50 ODx0.125 Wall	1.315" 1.500"	0.133" 0.125"		
Handrails	1½" NPS (Sch. 40)	1.900"	0.145"		
Handrail Support Bar	1" Ø Round Bar	1.000"	N/A		

E. Galvanized Steel Fasteners:

- a. Hex Head Bolts: ASTM A 307 Type 1 or ASTM F1554 Grade 36
- b. Adhesive Anchors: ASTM F1554 Grade 36 fully threaded rods c. Hex Nuts: ASTM A563
- d. Flat Washers: ASTM F436
- F. Aluminum Shims: ASTM B209, Alloy 6061

G. Bearing Pads: Plain, Fabric Reinforced, or Fabric Laminated meeting requirements of Specifications 515 & 932.

4. Fabrication:

- A. Place expansion joints at a maximum of 30'-0"spacing
 B. Field splices are similar to the expansion joint detail and may be approved by the Engineer to facilitate handling; but top rail must be continuous across a minimum of two posts.
 C. Continuity field splice (Detail "E"); only use to make the railing continuous for unforeseen field adjustments
 D. Corners and changes in tangential longitudinal alignment may be made continuous with a 9" bend radius or terminated at adjoining sections with a standard end hoop when handrails are not required.
- E. For curved longitudinal alignments, shop bend top and bottom rails and handrails to match the alignment radius. F. For changes in tangential longitudinal alignment greater than 45°, position posts a maximum of 2'-0" each side of the corner, not at the corner apex.

5. Handrails are required and must be continuous at landings for:


- A. Grades Steeper than 5%
- B. Three or more steps


6. Cutting of reinforcing steel is permitted for post installed anchor bolts.







<i>И</i> Т Т Т Т Т И <i>Г</i>)	INDEX	SHEET	
AINUM)	515-070	1 of 5	

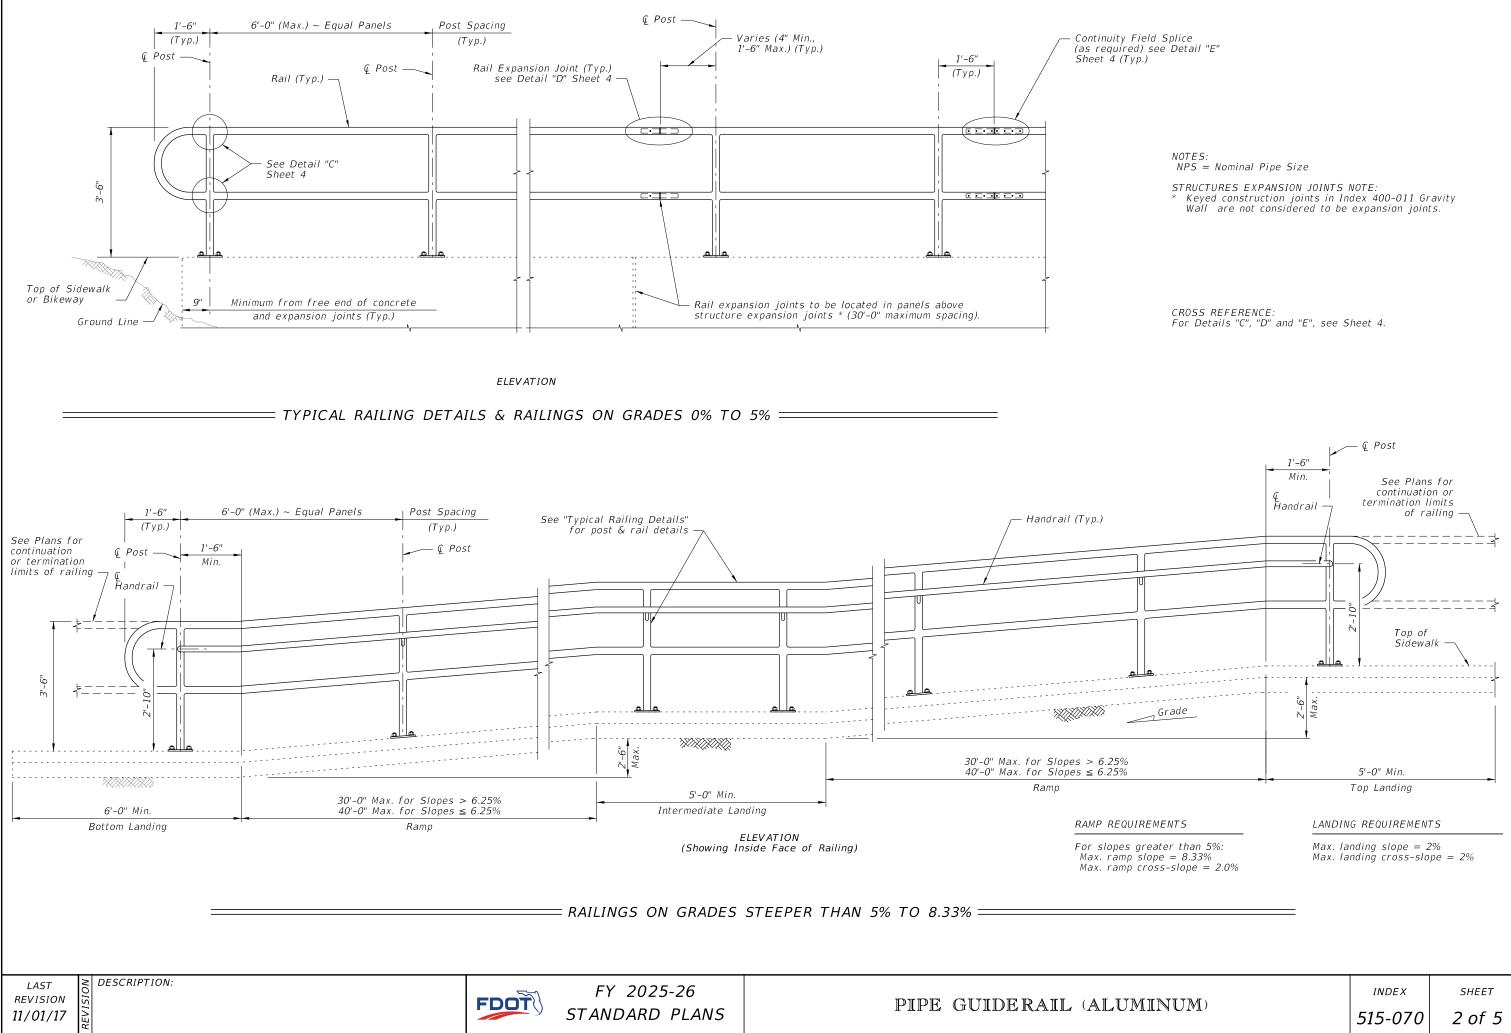

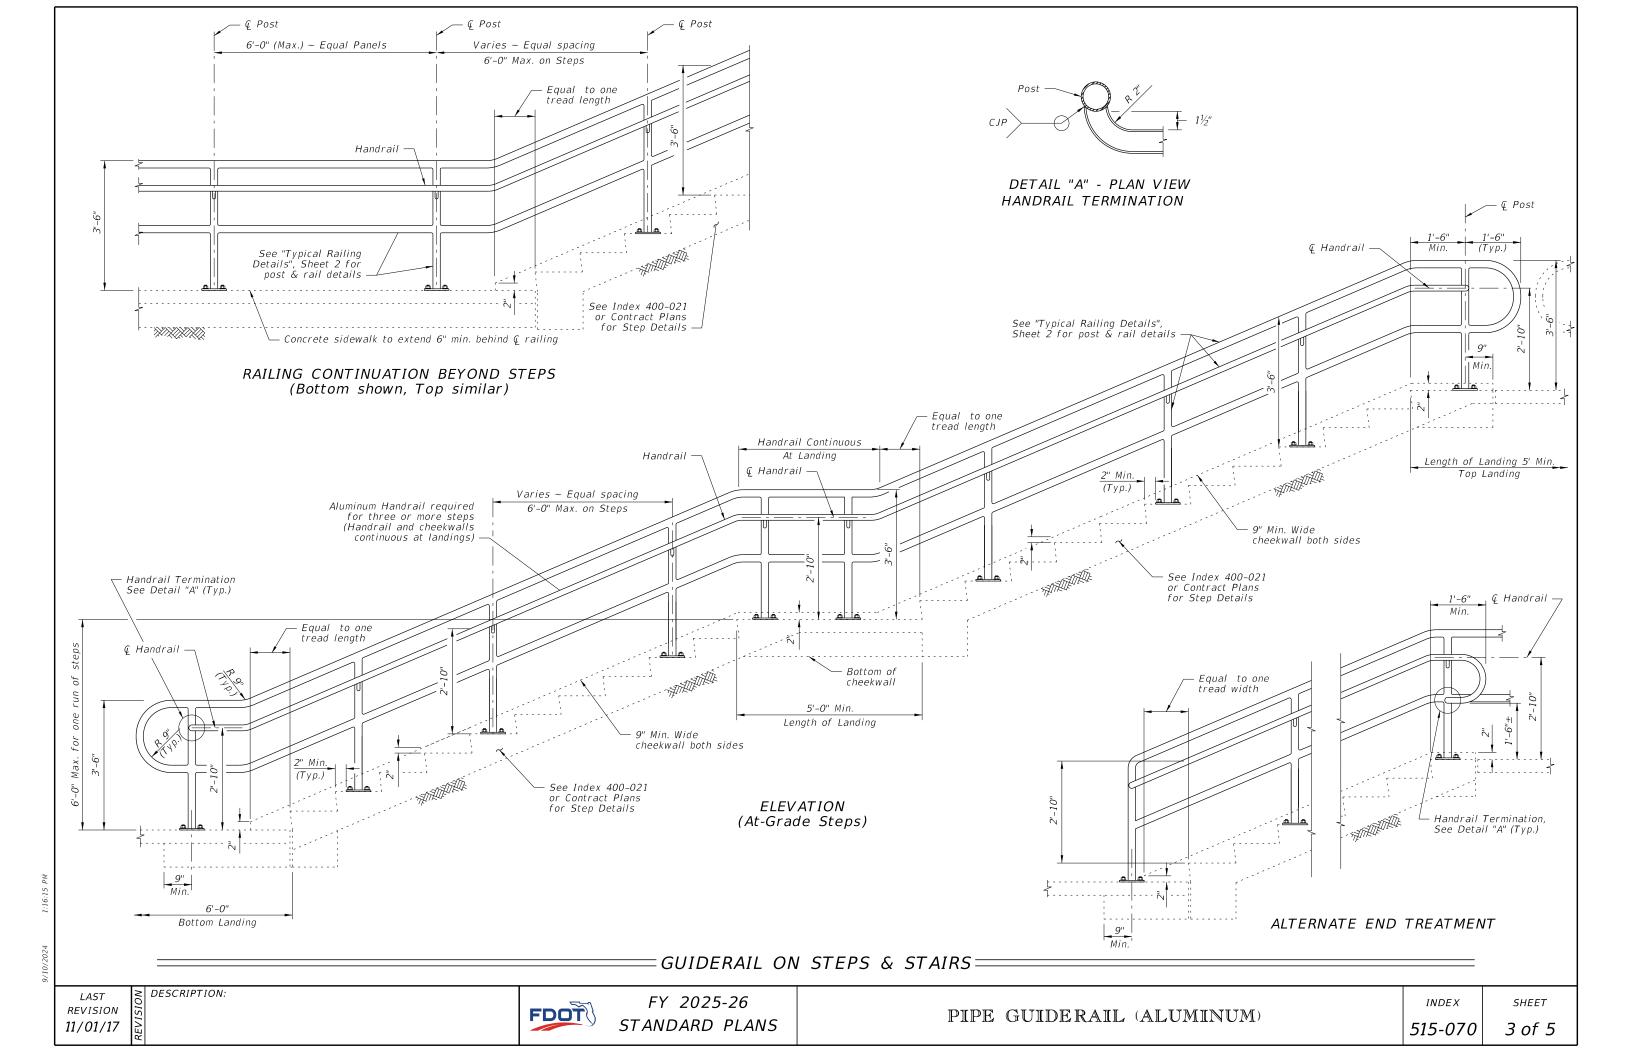

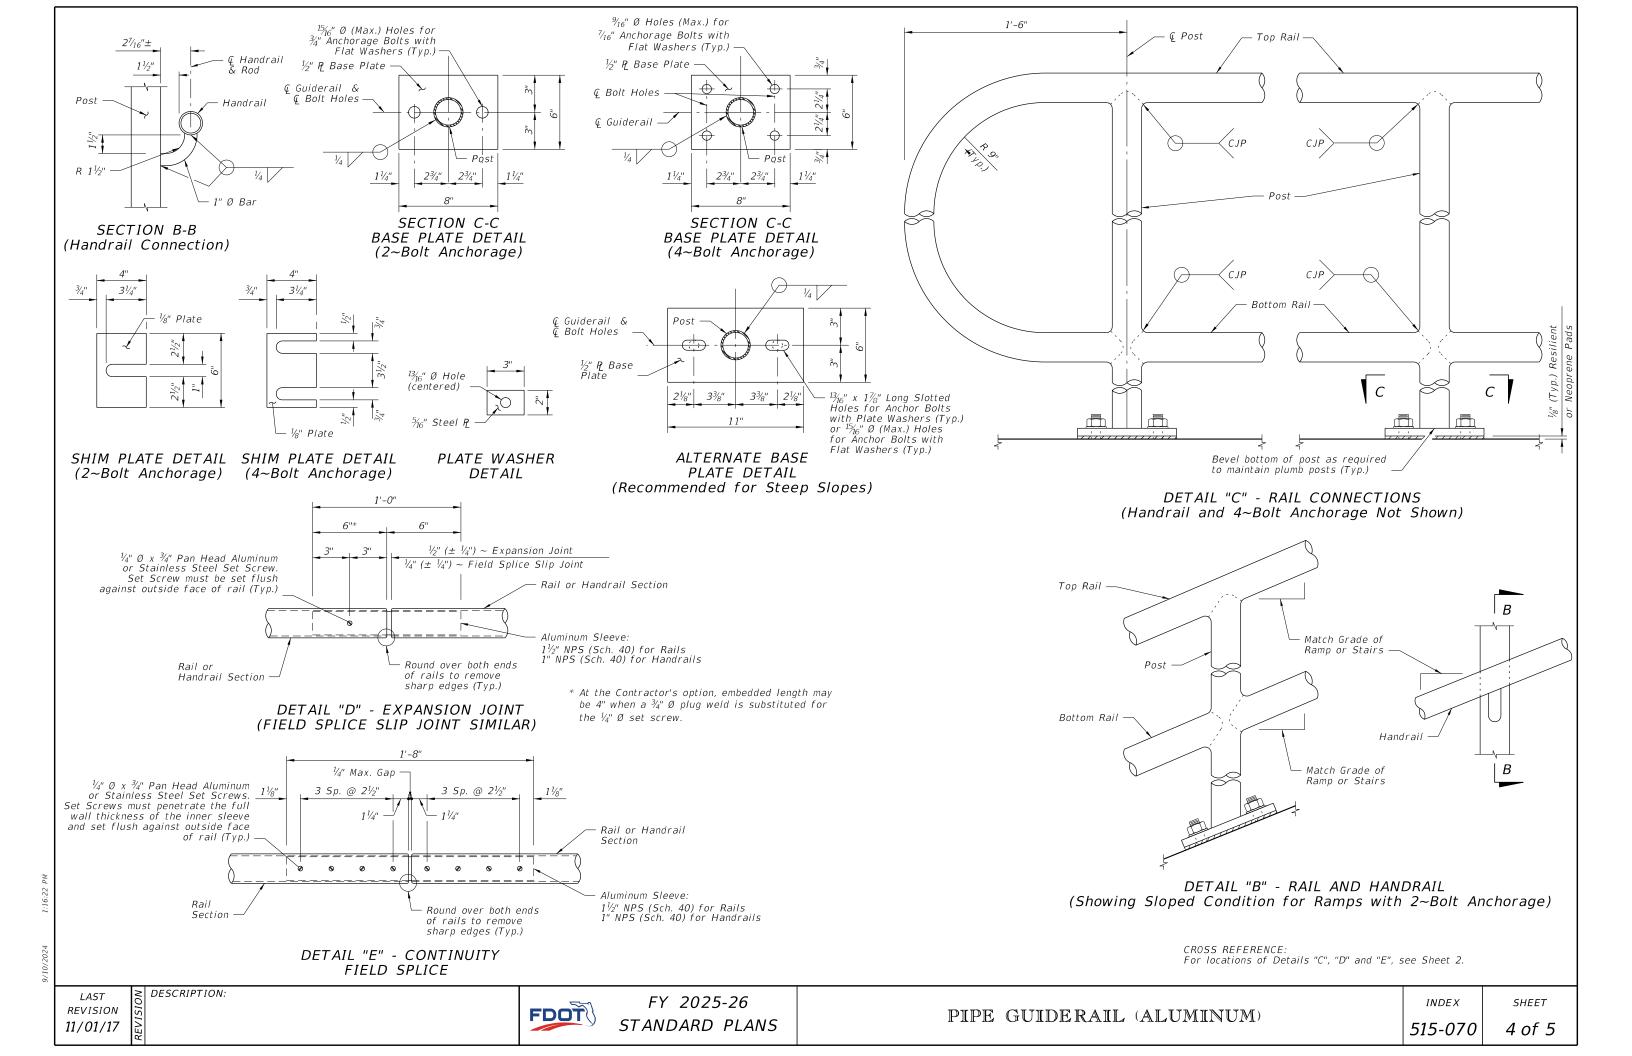

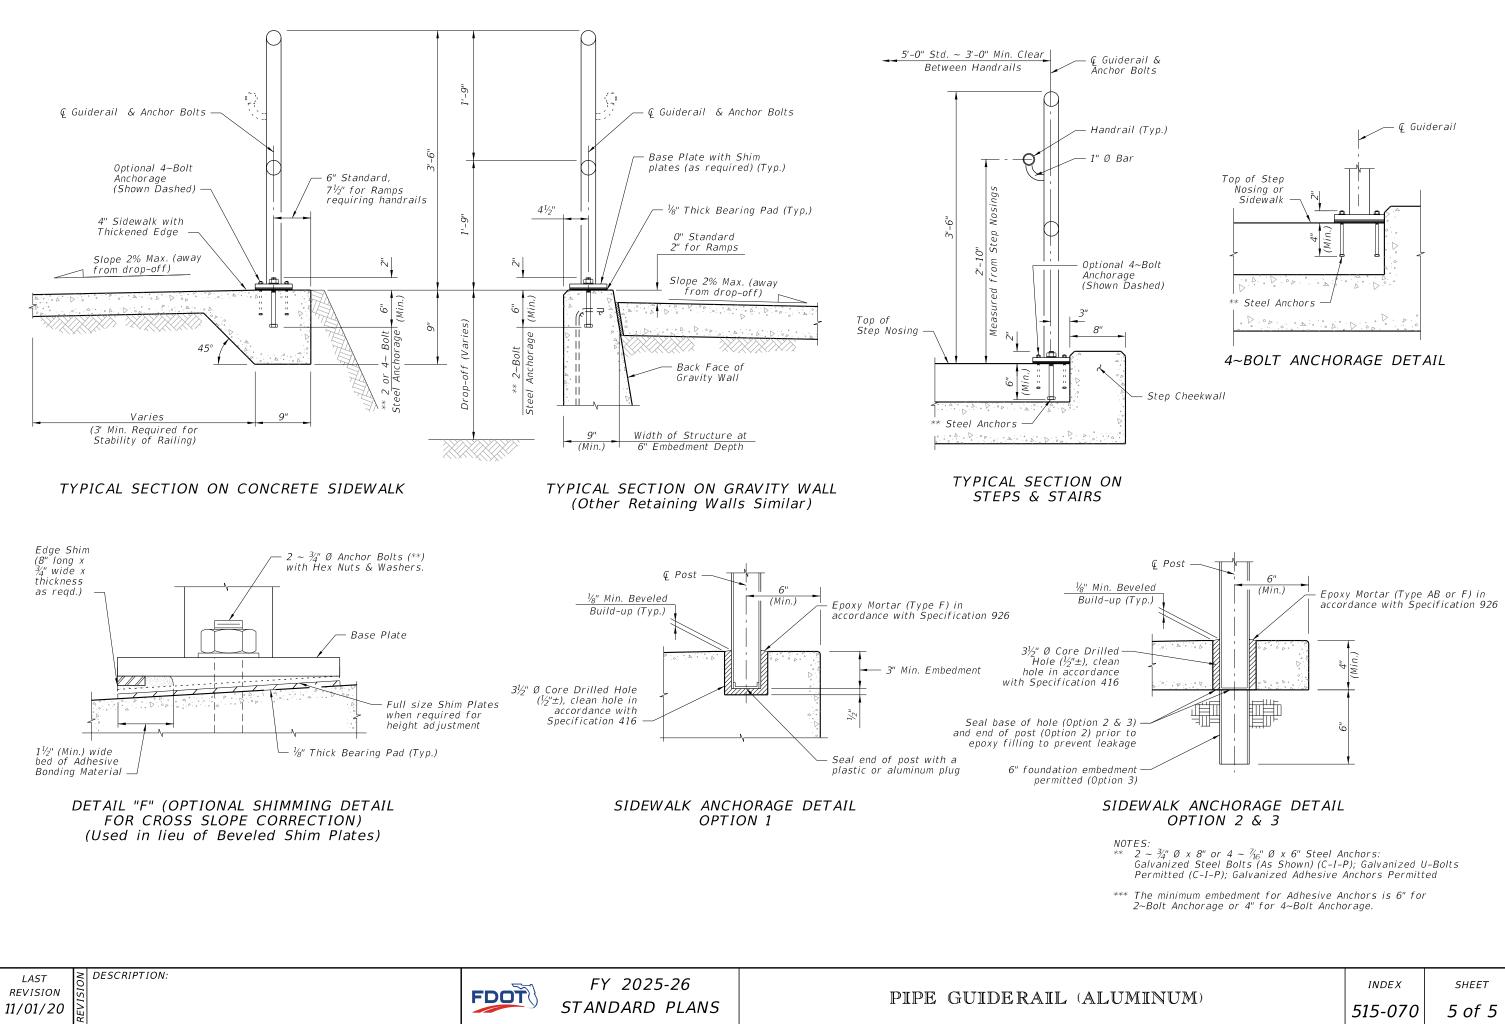

· T N T I T N <i>K</i> \	INDEX	SHEET
INUM)	515-070	5 of 5