

LAST

REVISION

11/01/23

PAYMENT:


DESCRIPTION:

Post Spacing (See Note 1)

© End Post

Post Cap (Typ.)

Post (Typ.)

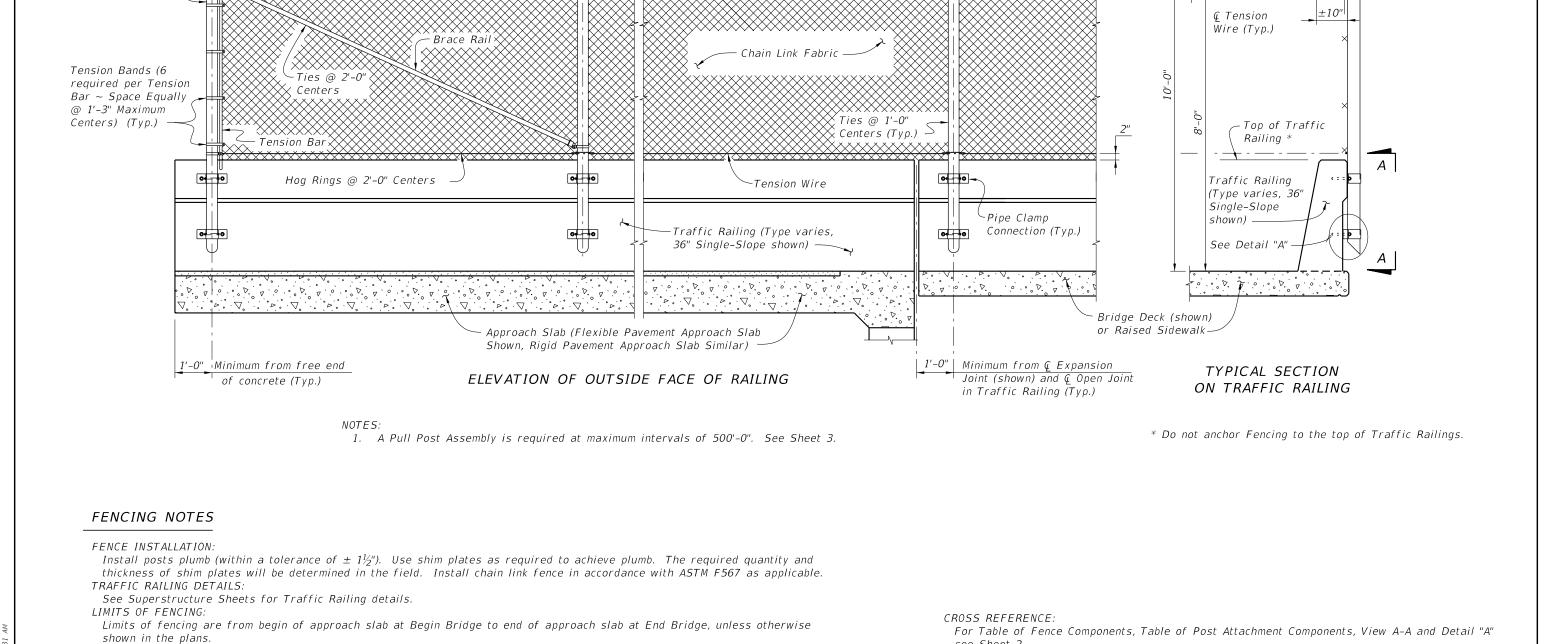

- Ç Line Post -

Tension Wire —

Hog Rings @

2'-0" Centers

– Hog Rings @

2'-0" Centers

 $5^{\circ}45'00'' \sim (3'' \pm along inside post)$

Post Cap (shown)

R = 2'-6''

or Loop Cap-

Outside Edge of Post

45°00'00" ~

inside post) -

INDEX

550-013

SHEET

1 of 3

 $(1'-11\frac{1}{2}'' \pm along)$

Tie tension wire to post with

9 gage zinc coated tie wire

ends of tie wire) (Typ.)

(triple wrap required at both

For Pull Post Assembly Detail for Traffic Railing see Sheet 3.

BRIDGE FENCING ON BARRIER (CURVED TOP)

Equal Spaces @ 10'-0" Max. (Posts may be shifted minimally to meet required clearances)

End Post Assembly

Payment will be made under Fencing, Type R. Payment includes all materials and labor required to complete installation of the fence.


FDOT

FY 2025-26

STANDARD PLANS

TABLE OF CHAIN LINK FENCE COMPONENTS				
COMPONENT	ASTM DESIGNATION	COMPONENT INFORMATION		
Posts	F1083	Galvanized Steel Pipe - $3\frac{1}{2}$ " NPS, Schedule 40 Regular Grade		
Chain Link Fabric (2" mesh with twisted top and knuckled bottom selvage)	A392	Zinc Coated Steel - 9 gage (coated wire diameter), Class 2 Coating		
	A491	Aluminum Coated Steel - 9 gage (coated wire diameter)		
	F668	Polyvinyl Chloride (PVC) Coated Steel - 9 gage Class 2b		
Tie Wires	F626	Zinc Coated Steel Wire - 9 gage		
Brace Bands	F626	12 Gage (Min. thickness) x $\frac{3}{4}$ " (Min. width) Steel Bands (Beveled or Heavy)		
Tension Bars	F626	$rac{3}{16}$ " (Min. thickness) x $rac{3}{4}$ " (Min. width) x 6'-10" (Min. height) Steel Bars		
Tension Bands	F626	14 Gage (Min. thickness) x $\frac{3}{4}$ " (Min. width) Steel Bands		
Miscellaneous Fence Components	F626	Zinc Coated Steel ~ (includes post or loop caps, horizontal and brace rail ends, combination rail ends, boulevard clamps and all other miscellaneous fittings & hardware,		
Tension Wire	A824 & A817	Type II (Zinc Coated Steel Wire) - 7 gage, Class 4 Coating		
		Type I (Aluminum Coated Steel Wire) - 7 gage		
Hog Rings	F626	Zinc Coated Steel Wire - 12 gage		
Brace Rails	F1083	Galvanized Steel Pipe - 1½" NPS, Schedule 40 Regular Grade		

	TAI	BLE OF POST ATTAC	CHMENT COMPONENTS
COMPONENT		ASTM DESIGNATION	COMPONENT INFORMATION
Pipe Clamps		A36 or A709 Grade 36	1/4" Steel PL
Base Plates		A36 or A709 Grade 36	¾" Steel P
Shim Plates		A36 or A709 Grade 36 or B209 Alloy 6061-T6 or B221 Alloy 6063-T5	Plate thicknesses as required. Holes in shim plates will be $\frac{3}{4}$ " Ø. For edge shims match the edge length of the base plate with a min. width of 3/4". Apply adhesive bonding material bed of 1-1/2" (Min.) wide
Spacers		-	Plate thickness varies based on traffic railing type (See Detail "A")
Pipe Clamp Connection	Adhesive Anchor Rods	F1554 Grade 36	Fully threaded Headless Anchor Rods $\sim \frac{5}{6}$ " Ø x 6" (no spacer) or $\frac{5}{6}$ " Ø x (6" + spacer thickness)
	C-I-P Anchor Rods	F1554 Grade 36	Hex Head Anchor Rods $\sim \frac{5}{8}$ " Ø x 6" (no spacer) or $\frac{5}{8}$ " Ø x (6" + spacer thickness)
Bolts		A307	¾" Ø x 4¾" Hex Head Bolts for Pipe Clamp Connections to Posts
Nuts		A563	Hex Nuts for Pipe Clamp Connections
Washers		F 436	Flat Washers for Pipe Clamp Connections
Bearing Pads (Plain Neoprene)		-	In accordance with Specification Section 932 for Ancillary Structures

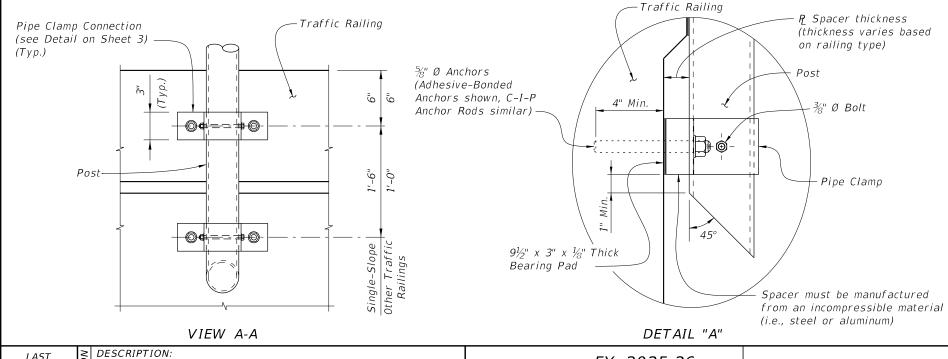

POST ATTACHMENT NOTES

ANCHOR RODS, NUTS AND WASHERS:

After the nuts have been tightened, distort the Anchor Rod threads to prevent removal of the nuts. Coat distorted threads and exposed trimmed ends of anchors with a galvanizing compound in accordance with Specification Section 562.

Hot-dip galvanize all Nuts, Washers, Bolts, C-I-P Anchor Rods, Adhesive Anchors and Fence Framework (Posts, Internal Sleeves, Shim Plates, Base Plates, Pipe Clamps and Spacers) in accordance with Specification Section 962. Hot-dip galvanize Fence Framework after fabrication.

ADHESIVE-BONDED ANCHORS AND DOWELS:

Adhesive Bonding Material Systems for Anchors and Dowels will comply with Specification Section 937 and be installed in accordance with Specification Section 416. Cutting of reinforcing steel is permitted for drilled hole installation.

WELDING:

All welding will be in accordance with the American Welding Society Structural Welding Code (Steel) ANSI/AWS D1.1 (current edition). Weld metal will be E60XX or E70XX. Nondestructive testing of welds is not required.

CROSS REFERENCE:

For location of View A-A and Detail "A" see Sheet 1.

11/01/24

FDOT

FY 2025-26 STANDARD PLANS 550-013

INDEX 2 of 3

SHEET

