GENERAL NOTES:

1. Meet the requirements of Specification 700.

2. Shop Drawings are required:

   A. Provide length as shown in the Plans
   B. Design in accordance with AISC, AASHTO, and OSHA requirements
   B. Do not start fabrication until the shop drawings are approved

3. Catwalk hangers must be positioned to avoid conflicts with the sign structure truss and gusset plates. Place walkway close to the sign with a maximum open distance from walkway grate to DMS sign of ½".

4. Maximum spacing of Catwalk hanger supports is 5'–0". Cantilever ends of grating is 8".

5. Galvanized steel catwalk grating meeting the requirements of Specification 504–2.3. Must Support a 90 psf load and have a 3½" minimum toe kick. Attach grating in accordance with the manufacturer's instructions using stainless steel or galvanized fasteners.

6. Supply and install an OSHA 1910 compliant, self closing, hot dip galvanized safety gate. Install per manufactures instructions.

7. Chain link fabric options (2" mesh with knuckled selvage top and bottom for all options):

   A. AASHTO M181 Type I – Zinc Coated Steel, No. 9 gage (coated wire diameter), coated at the rate of 1.8 oz/ft². (M181 Class D 2.0 oz./ft². modified to 1.8 oz./ft².).
   B. AASHTO M181 Type II – Aluminum Coated Steel, No. 9 gage (coated wire diameter), coated at the rate of 0.40 oz./ft².

8. Install 2" NPS (Sch. 40) guiderail and posts: ASTM A53 Grade B for standard weight pipe.

9. Materials:

   A. Steel plates ASTM A 36 or A709 Grade 36.
   B. W–Sections: ASTM A572 Grade 36 or 50.

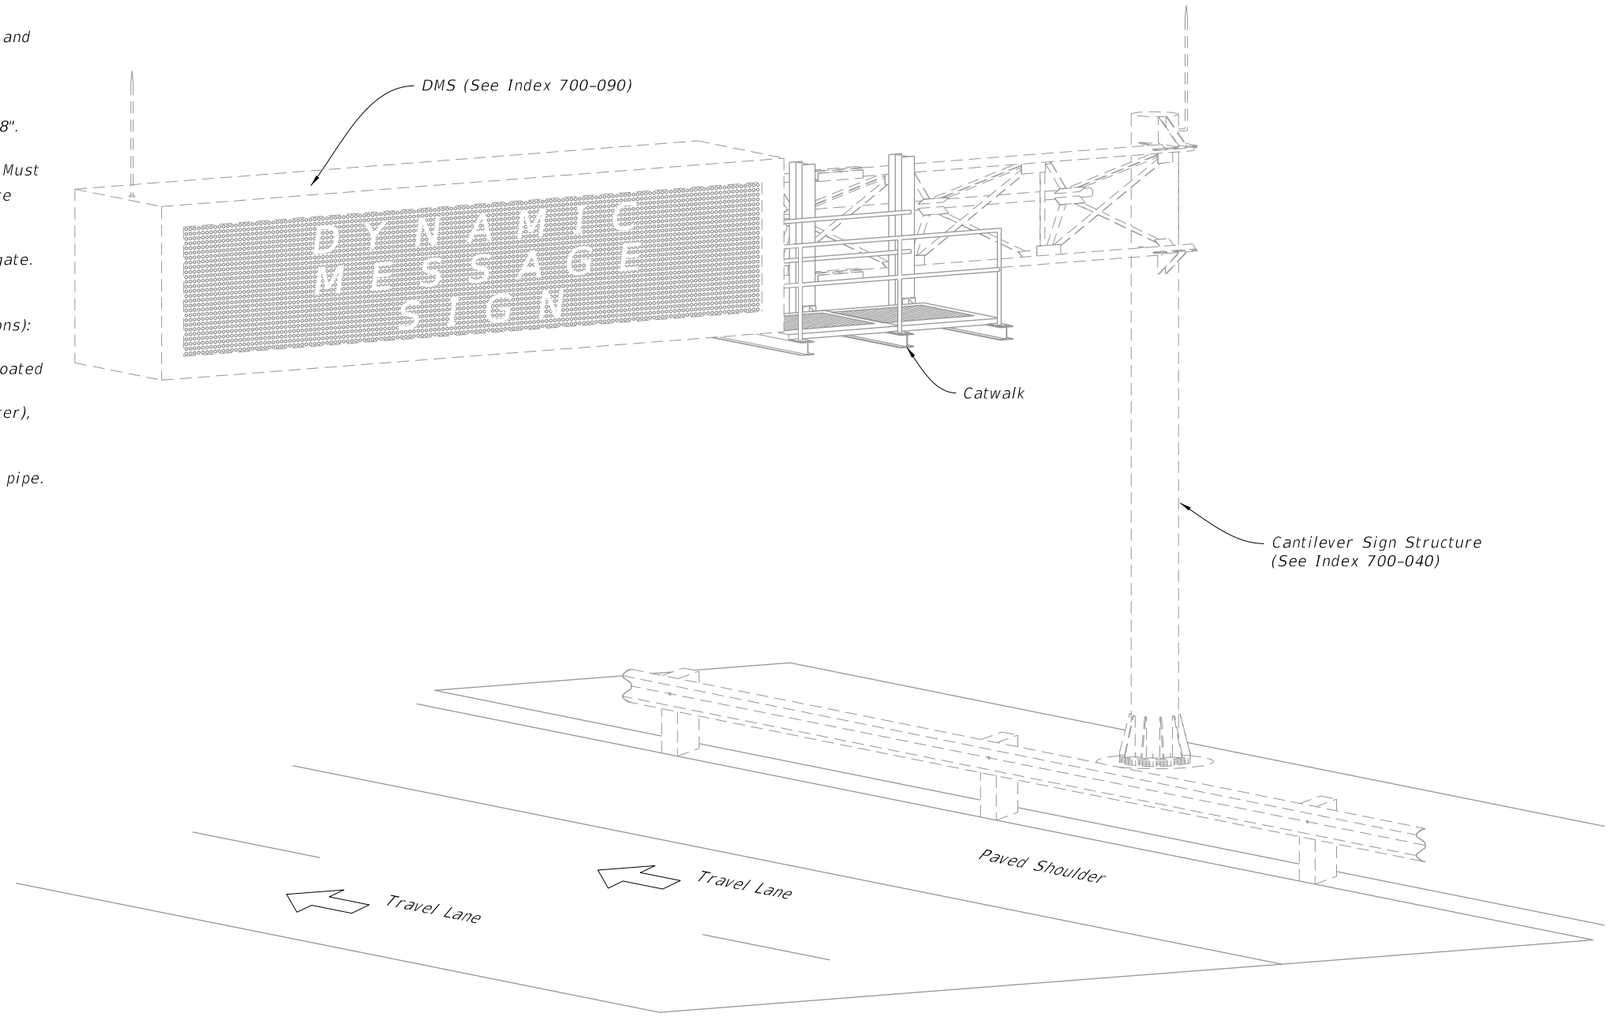

CATWALK ASSEMBLY
(Cantilever Shown, Span Similar)

TABLE OF CONTENTS:

Sheet	Description
1	General Notes and Content
2	General Assembly and Fixed Base Details
3	Walkway Support Details

9/10/2024 2:48:26 PM

LAST REVISION	REVISION	DESCRIPTION:	FDOT	FY 2025-26 STANDARD PLANS	CATWALK DETAILS	INDEX	SHEET
11/01/22						700-091	1 of 3

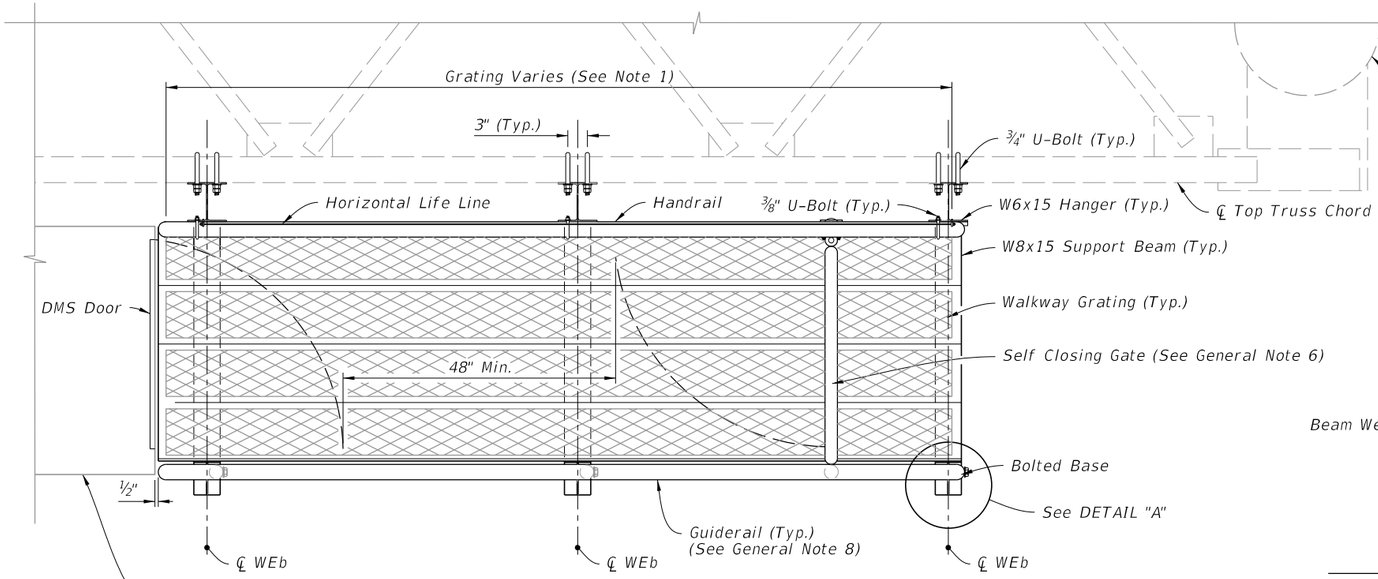

PLAN

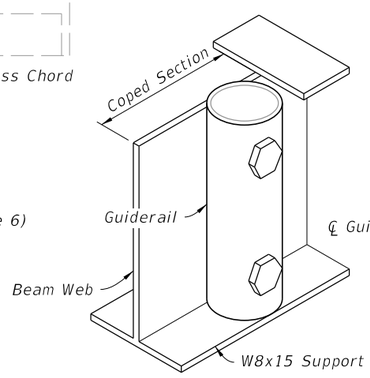

ISOMETRIC VIEW

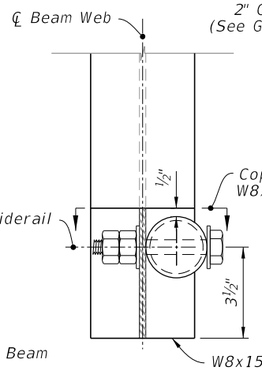

DETAIL "A"

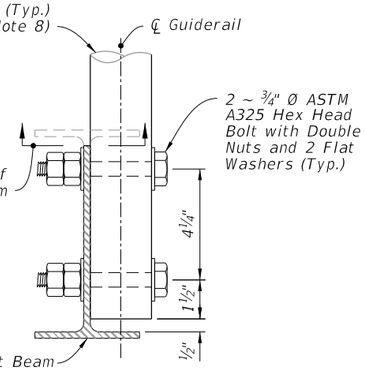

DETAIL "B"

BOLTED BASE DETAILS

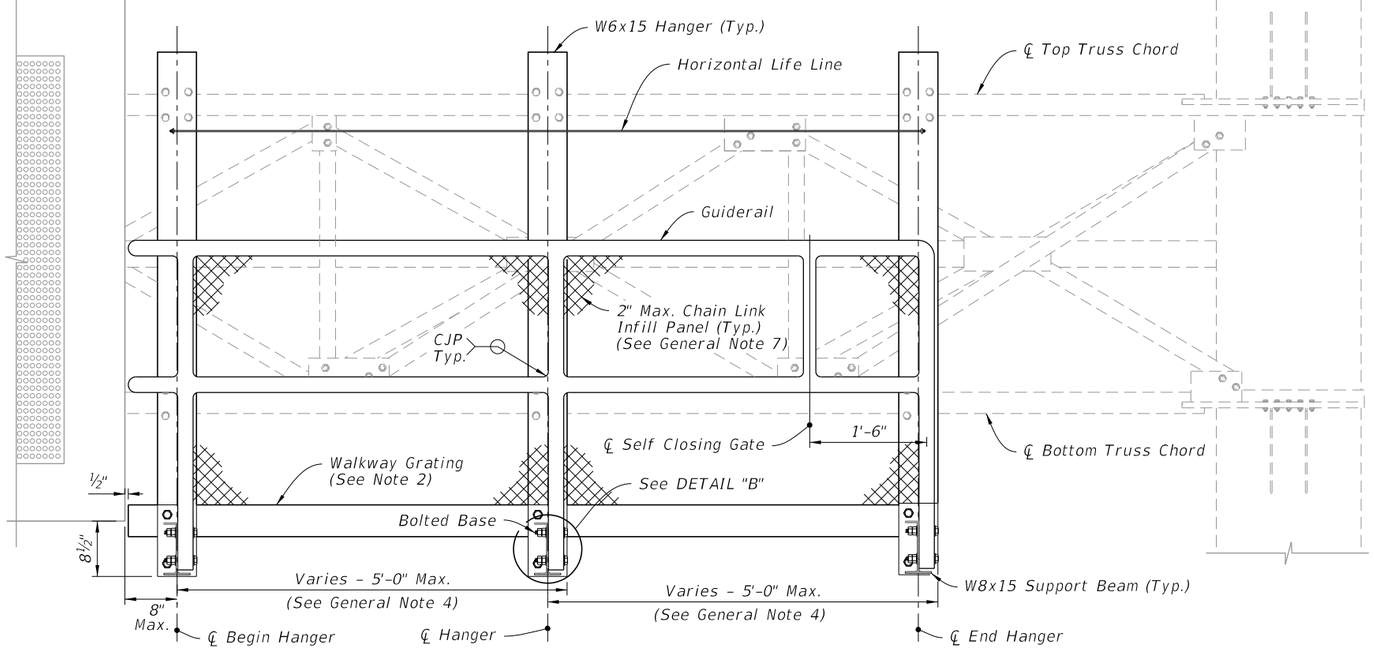

FRONT ELEVATION

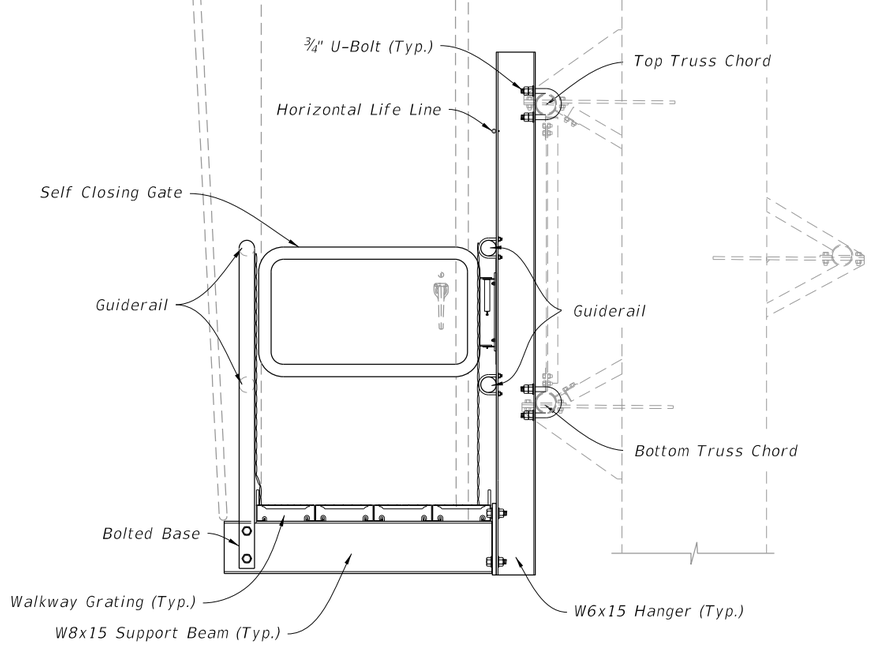

SIDE ELEVATION

GENERAL ASSEMBLY

NOTES:

1. See manufacturer details for walkway planks and bolting criteria.
2. Fasten securely. See grating manufactures details.

GENERAL ASSEMBLY AND FIXED BASE DETAILS

LAST REVISION	REVISION	DESCRIPTION:			INDEX	SHEET
11/01/19			FY 2025-26 STANDARD PLANS	CATWALK DETAILS	700-091	2 of 3

9/10/2024 2:48:34 PM

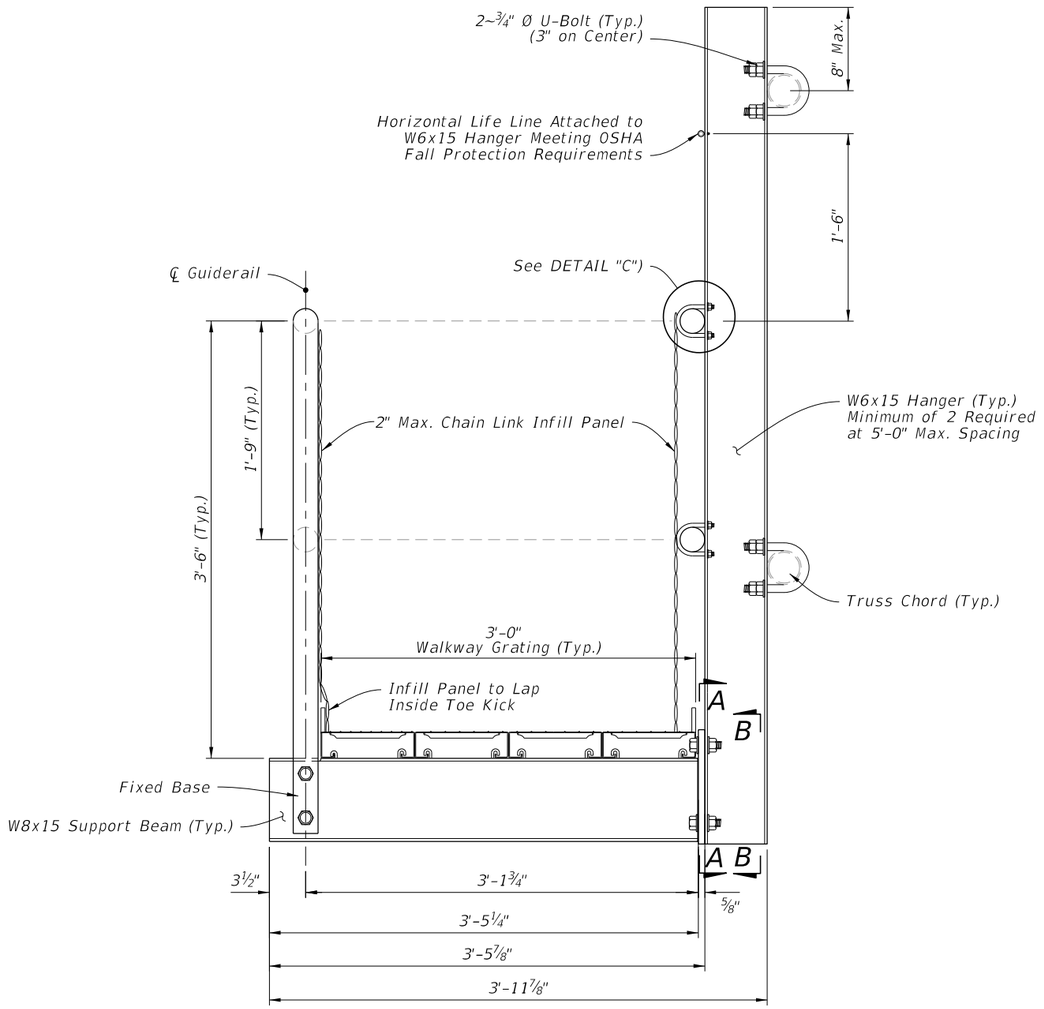

WALKWAY SUPPORT DETAILS

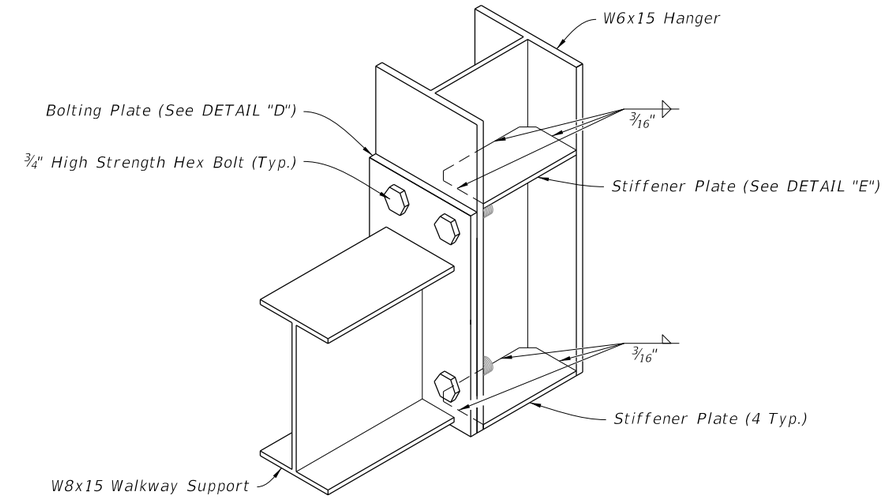

ISOMETRIC VIEW

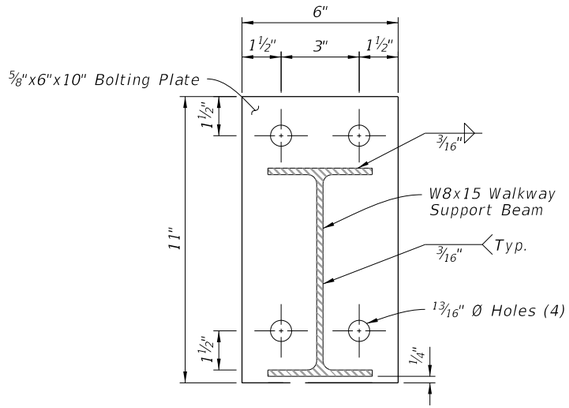

SECTION A-A

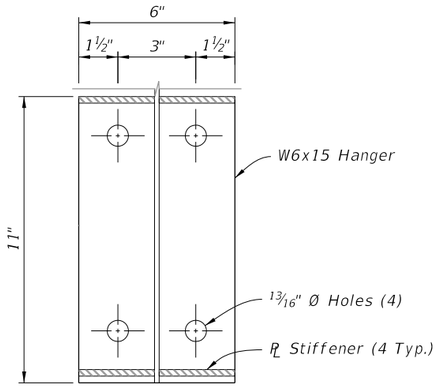

SECTION B-B

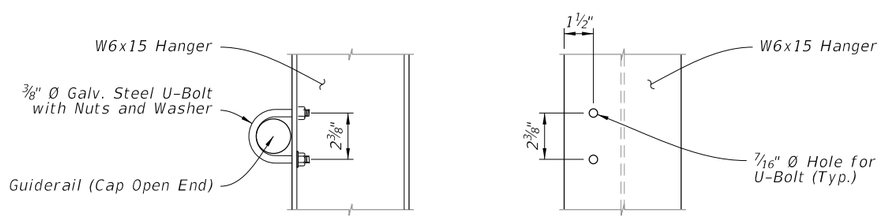

SIDE ELEVATION

FRONT ELEVATION

DETAIL "C"
(Guiderail Attachment)

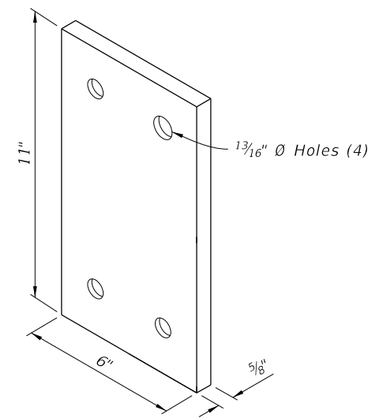

DETAIL "D"
(Bolting Plate)



DETAIL "E"
(Stiffener Plate)

WALKWAY SUPPORT DETAILS

9/10/2024 2:48:41 PM

LAST REVISION	REVISION	DESCRIPTION:			INDEX	SHEET
11/01/19			FY 2025-26 STANDARD PLANS	CATWALK DETAILS	700-091	3 of 3