
GENERAL NOTES:

- 1. Work this Index with Index 425-001 and Index 425-010.
- 2. Use Grade 60 reinforcing bars with 2" minimum cover unless otherwise shown. See Index 425-001 for equivalent area of welded wire fabric. Cut or bend bars out of way of pipe when necessary. Bars to clear pipe by $1\frac{1}{2}$ ".
- 3. Recommended maximum pipe sizes are 24" longitudinal and 30" transverse. For larger pipe, inlets with Alt. B bottoms, Index 425-010 is recommended.
- 4. All dimensions are for both precast and cast-in-place inlets unless otherwise shown.

| TABLE OF CONTENTS: | |
|--------------------|-------------------------------------|
| Sheet | Description |
| 1 | General Notes and Contents |
| 2 | Dimensional and Reinforcing Details |

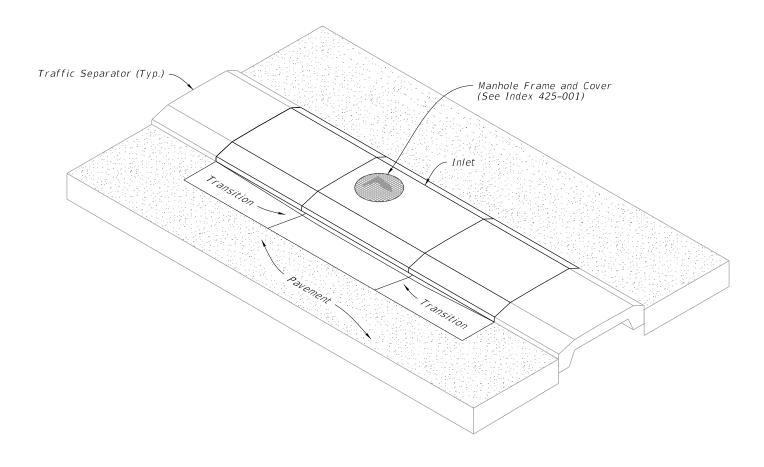

= CURB INLET TYPE 7 =(Bottom Not Shown)

DESCRIPTION:

