


GENERAL NOTES:

- 1. Work this Index with Index 425-001 and Index 425-010.
- 2. When called for in the Plans, use this inlet in conjunction with median or shoulder barrier per Index 521-001 or a barrier with junction slab and wall coping per Index 521-610.
- 3. Reinforce the upper 2'-3" of the inlet in accordance with sections CC, DD, and EE regardless of construction method.
- 4. Chamfer exposed edges and corners to 3/4" or tool to 1/4" radius.
- 5. Do not field install roller bars when Alt. G grates are specified in the Plans in accordance with Specification 425. Adjust tolerance during fabrication or casting, or match grate to structure prior to galvanizing.
- 6. Use Grade 60, #4 bars for reinforcing steel. See Index 425-001 for equivalent area of welded wire fabric.
- 7. Dimensions are for both precast and cast-in-place inlets unless otherwise noted.
- 8. Anchor bolts: Use either ASTM A307 hex head bolts cast-in-place, or ASTM A36 or F1554 (Grade 36) galvanized fully threaded rod, adhesive bonded anchors installed in accordance with Specification 416. Rods must be a minimum of 6" long with 4" minimum embedment with one ASTM 194 or A563 heavy hex head nut and one ASTM F436 flat washer each. Hot-dip galvanize anchor bolts, nuts, and washers.
- 9. Reduce Cross Slope: Use a flatter cross slope as required to match adjacent grading per the Plans. Reduce vertical dimensions and bar spacing as needed to maintain concrete cover as shown.

TABLE OF CONTENTS:

Sheet	Description
1	General Notes and Contents
2	Dimensional, Reinforcing, and Steel Grate Details
3	Inlet Collar Dimensional, Reinforcing, and Backwall Plate Details
4	Shoulder Pavement Wrap, Barrier Type Examples, and Structure Bottoms

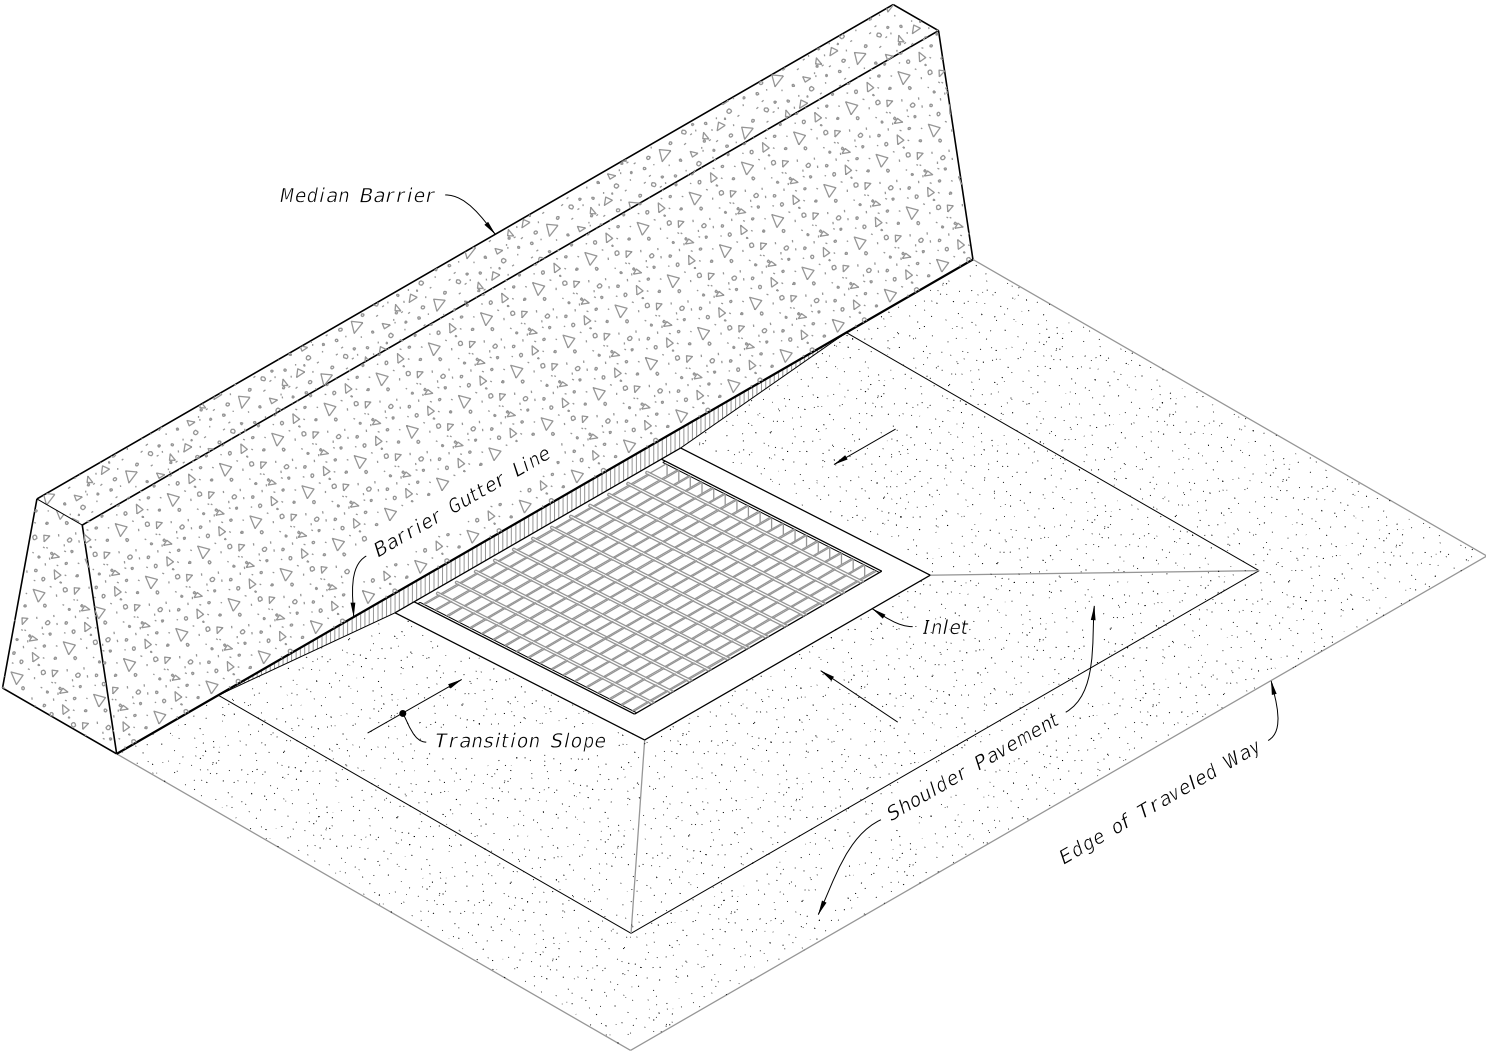


ADJACENT BARRIER INLET
(Shoulder Barrier Similar)


9/26/2025 11:52:33 AM

LAST REVISION 11/01/25	REVISION	DESCRIPTION:	 FY 2026-27 STANDARD PLANS	ADJACENT BARRIER INLET	INDEX 425-031	SHEET 1 of 4
------------------------------	----------	--------------	--	------------------------	------------------	-----------------

9/26/2025 11:52:41 AM

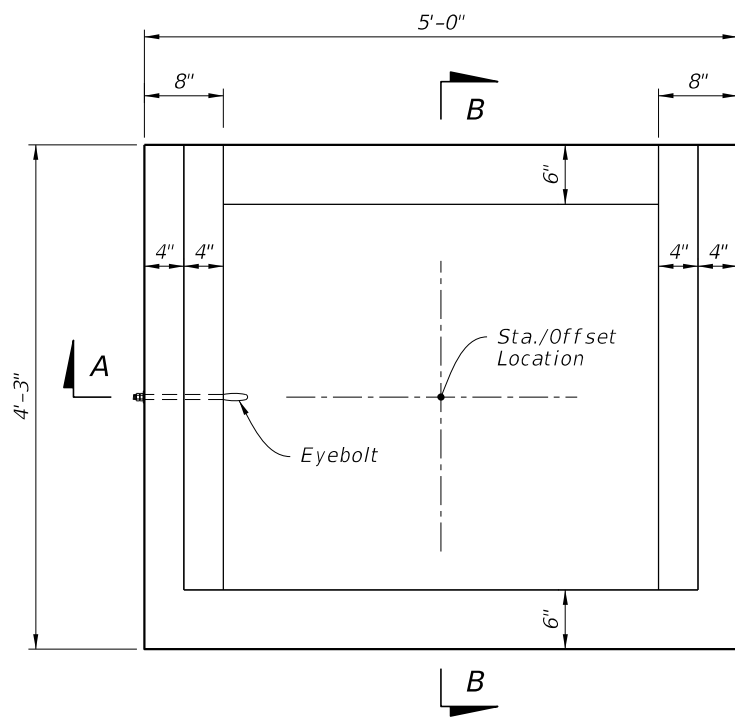


PLAN

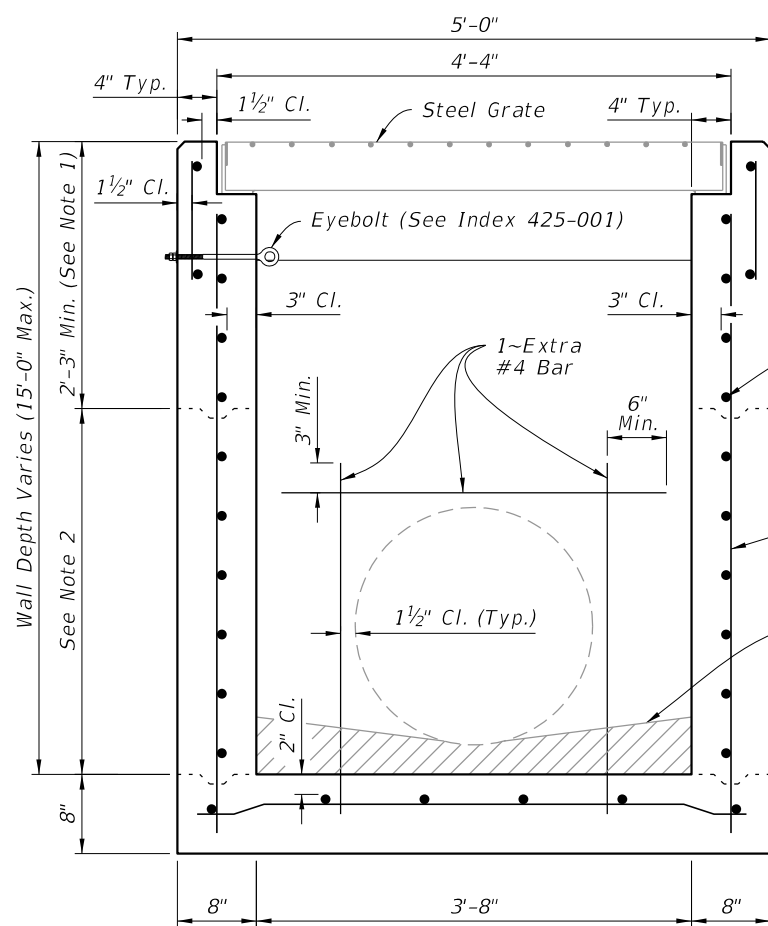


SECTION A-A
(Pipe Opening Shown)

- NOTES:**
- See Sections E-E, F-F, and G-G on Sheet 3 for reinforcing details.
 - Construction joints permitted between these limits. See Index 425-001 for minimum dimensions.
 - Field Installation: When clearance (C) exceeds $\frac{5}{8}$ " weld a one-piece round bar (roller bar) to the end of the cross bars and end band angles to reduce the clearance (C) to $\frac{5}{8}$ " or less. After welding the bar, clean bar and damaged grate coating and coat with a coal tar pitch varnish.

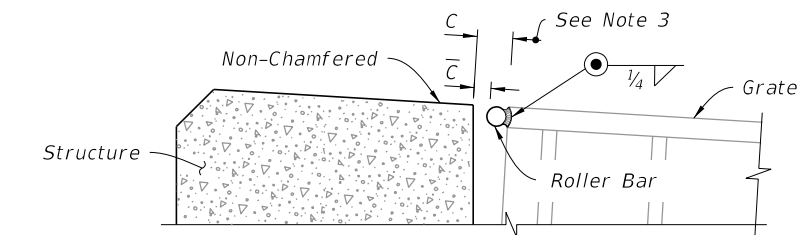


DETAIL "A"

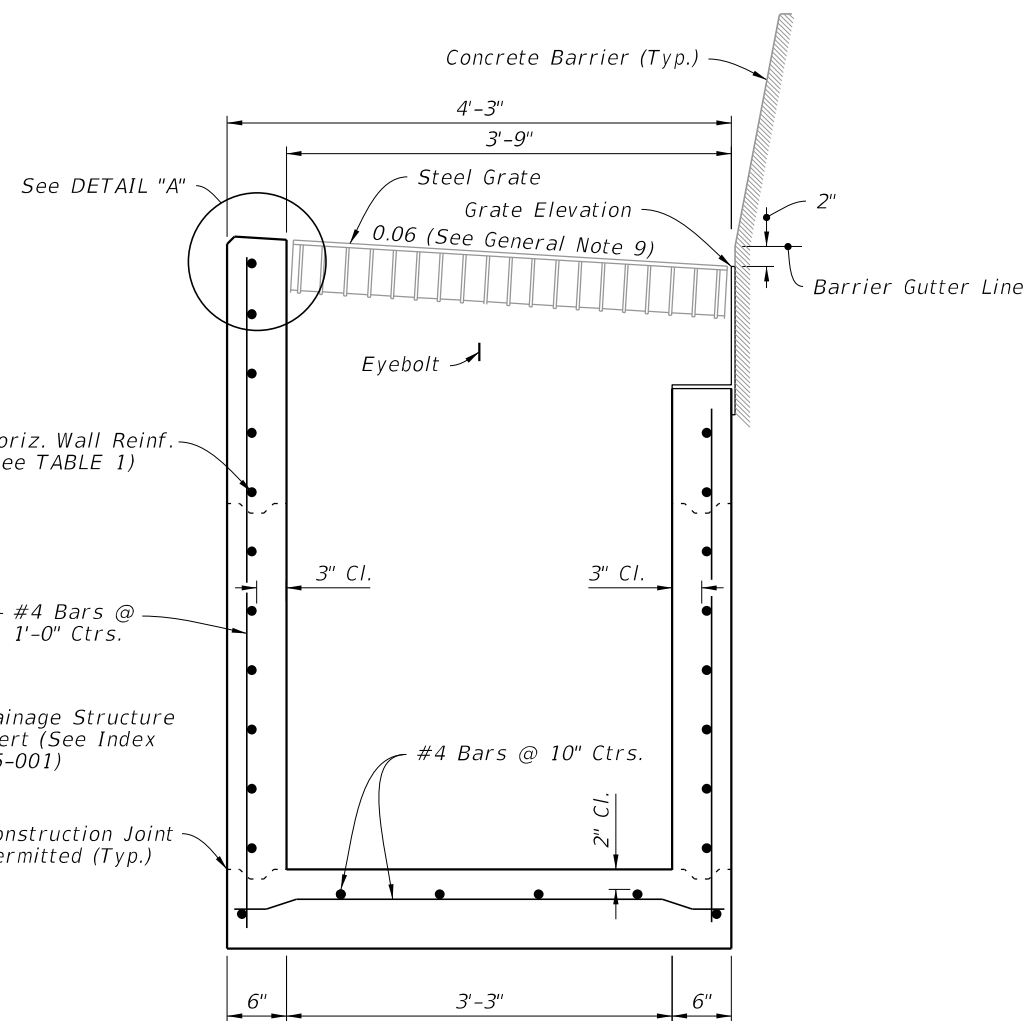


SECTION B-B
(Pipe Opening Not Shown)

DIMENSIONAL AND REINFORCEMENT

TABLE 1: HORIZONTAL WALL REINFORCING SCHEDULE				
WALL DEPTH	SCHEDULE	AREA (in. ² /ft.)	MAX. SPACING	
			BARS	WWR
0'-5'	A12	0.20	12"	8"
5'-10'	A6	0.20	6"	5"
10'-15'	A4	0.20	4"	3"
10'-15'	B5.5	0.24	5 1/2"	5"

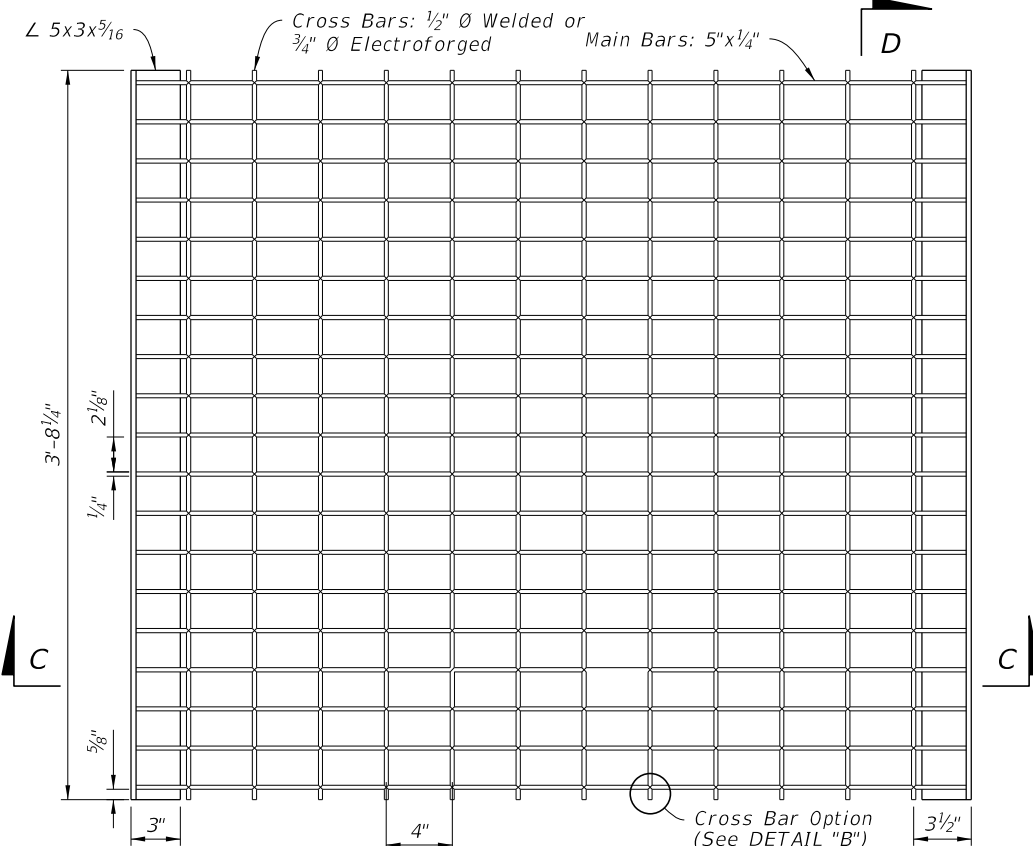


PLAN

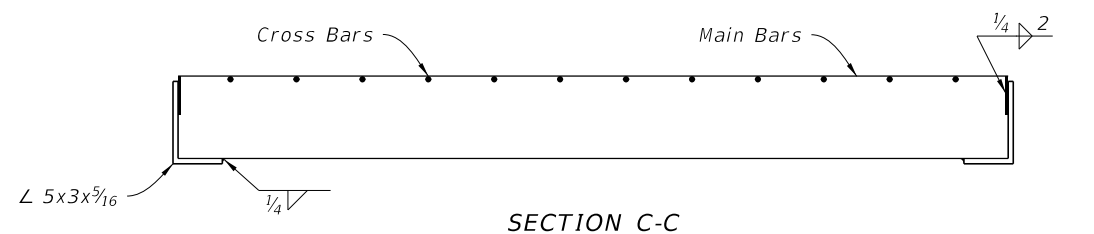

SECTION C-C



SECTION D-D

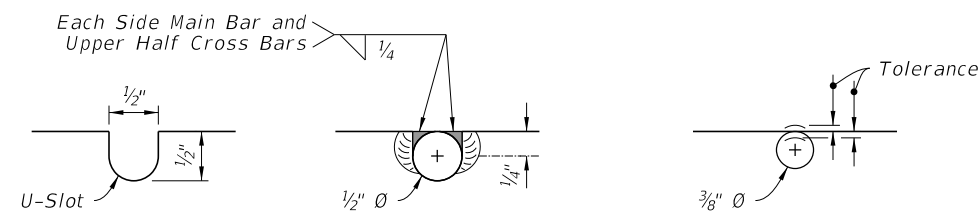

WELDED


ELECTROFORGED

DETAIL "B"


STEEL GRATE

DIMENSIONAL, REINFORCING, AND STEEL GRATE DETAILS


LAST REVISION	DESCRIPTION:	FY 2026-27 STANDARD PLANS	ADJACENT BARRIER INLET	INDEX	SHEET
11/01/25				425-031	2 of 4

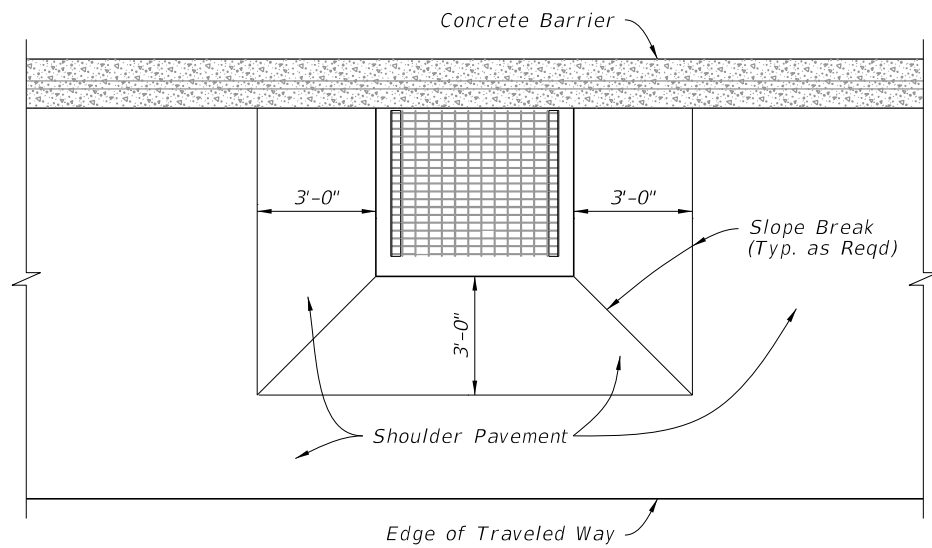


STANDARD LOCATON

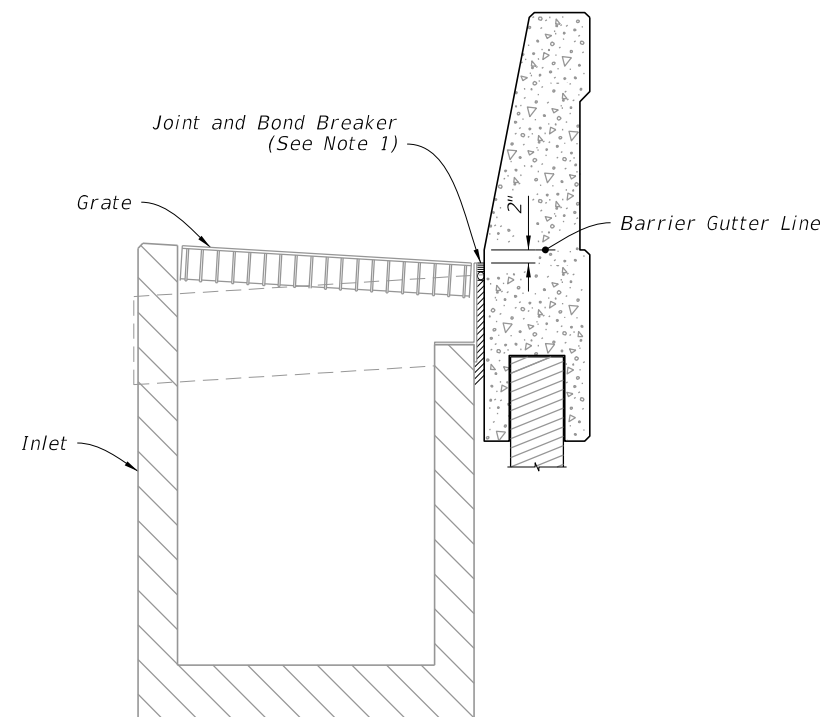


JUNCTION SLAB AND WALL COPING

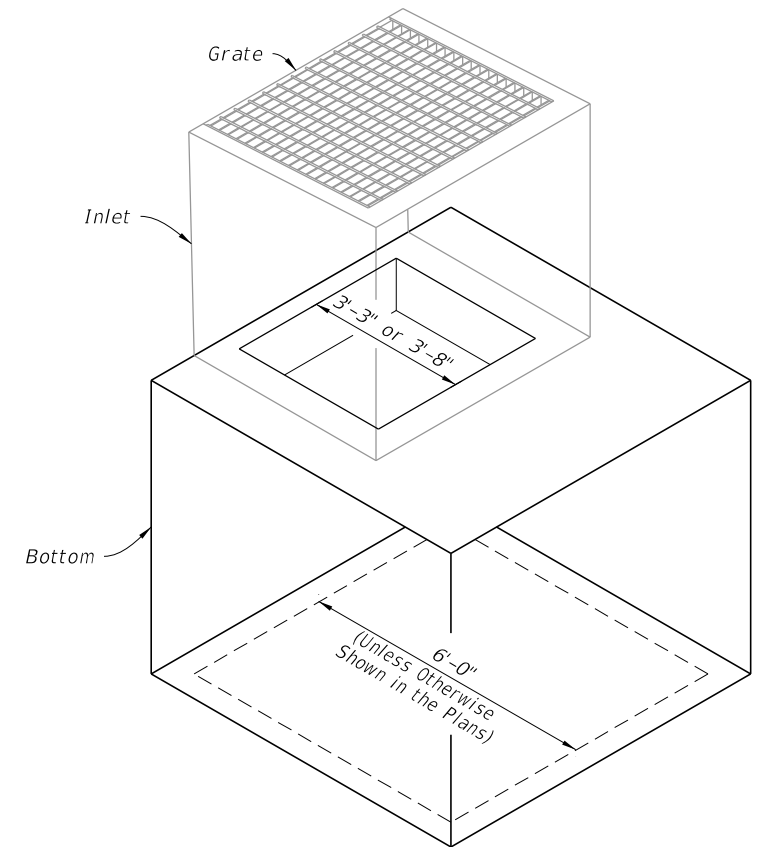


ALTERNATE B STRUCTURE BOTTOM

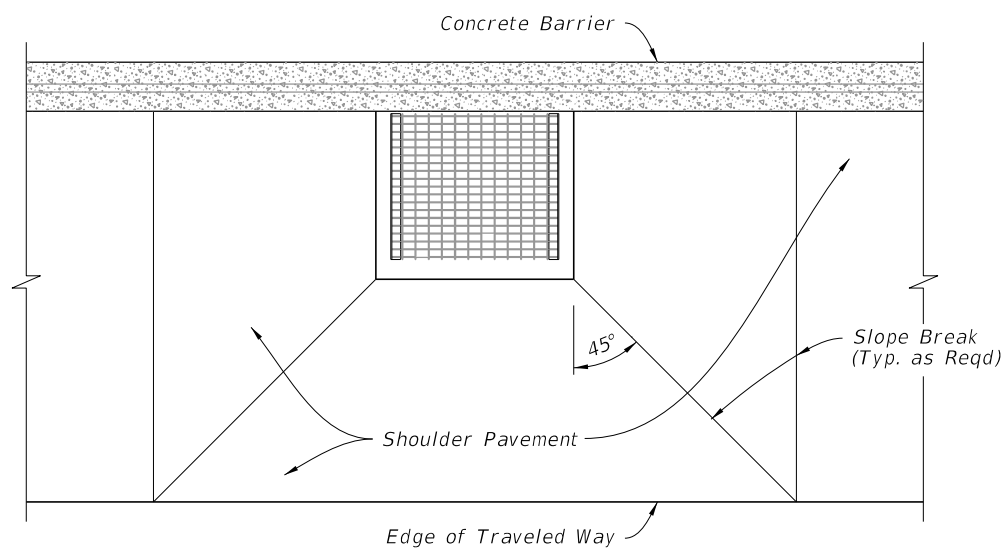

SUPERELEVATION - HIGH SIDE LOCATION

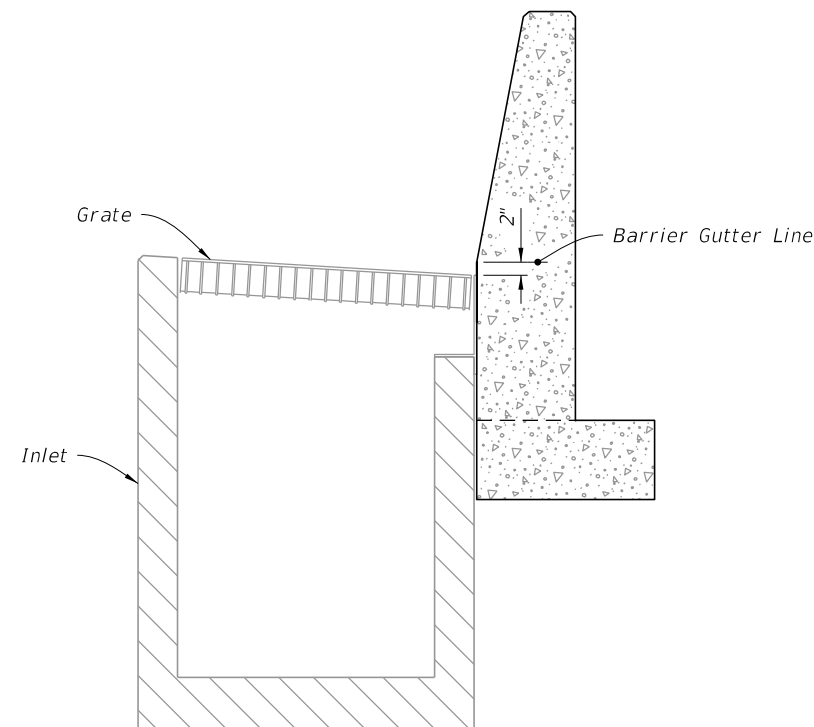

STEM AND FOOTING

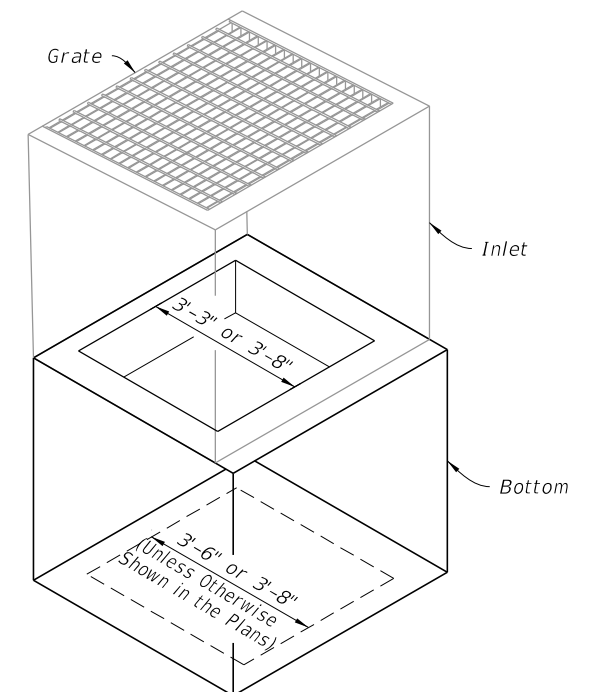

ALTERNATE B STRUCTURE BOTTOM

NOTE: Alt. B Structure Bottom Only. See Index 425-010

SHOULDER PAVEMENT TRANSITIONS

BARRIER TYPE EXAMPLES

INLET WITH STRUCTURE BOTTOM

SHOULDER PAVEMENT WRAP, BARRIER TYPE EXAMPLES, AND STRUCTURE BOTTOMS

LAST REVISION 11/01/25	REVISION	DESCRIPTION:		FY 2026-27 STANDARD PLANS	ADJACENT BARRIER INLET	INDEX 425-031	SHEET 4 of 4
------------------------------	----------	--------------	---	------------------------------	------------------------	------------------	-----------------