




9/26/2025 12:53:08 PM

GENERAL NOTES:


- 1. Work this Index with Index 425-052.
- 2. Quantities are for informational and estimating purposes only.

TABLE OF CONTENTS:	
Sheet	Description
1	General Notes and Contents
2	Inlet Type C (Modified)
3	Special Concrete Endwall
4	Shallow Ditches and Yard Drains

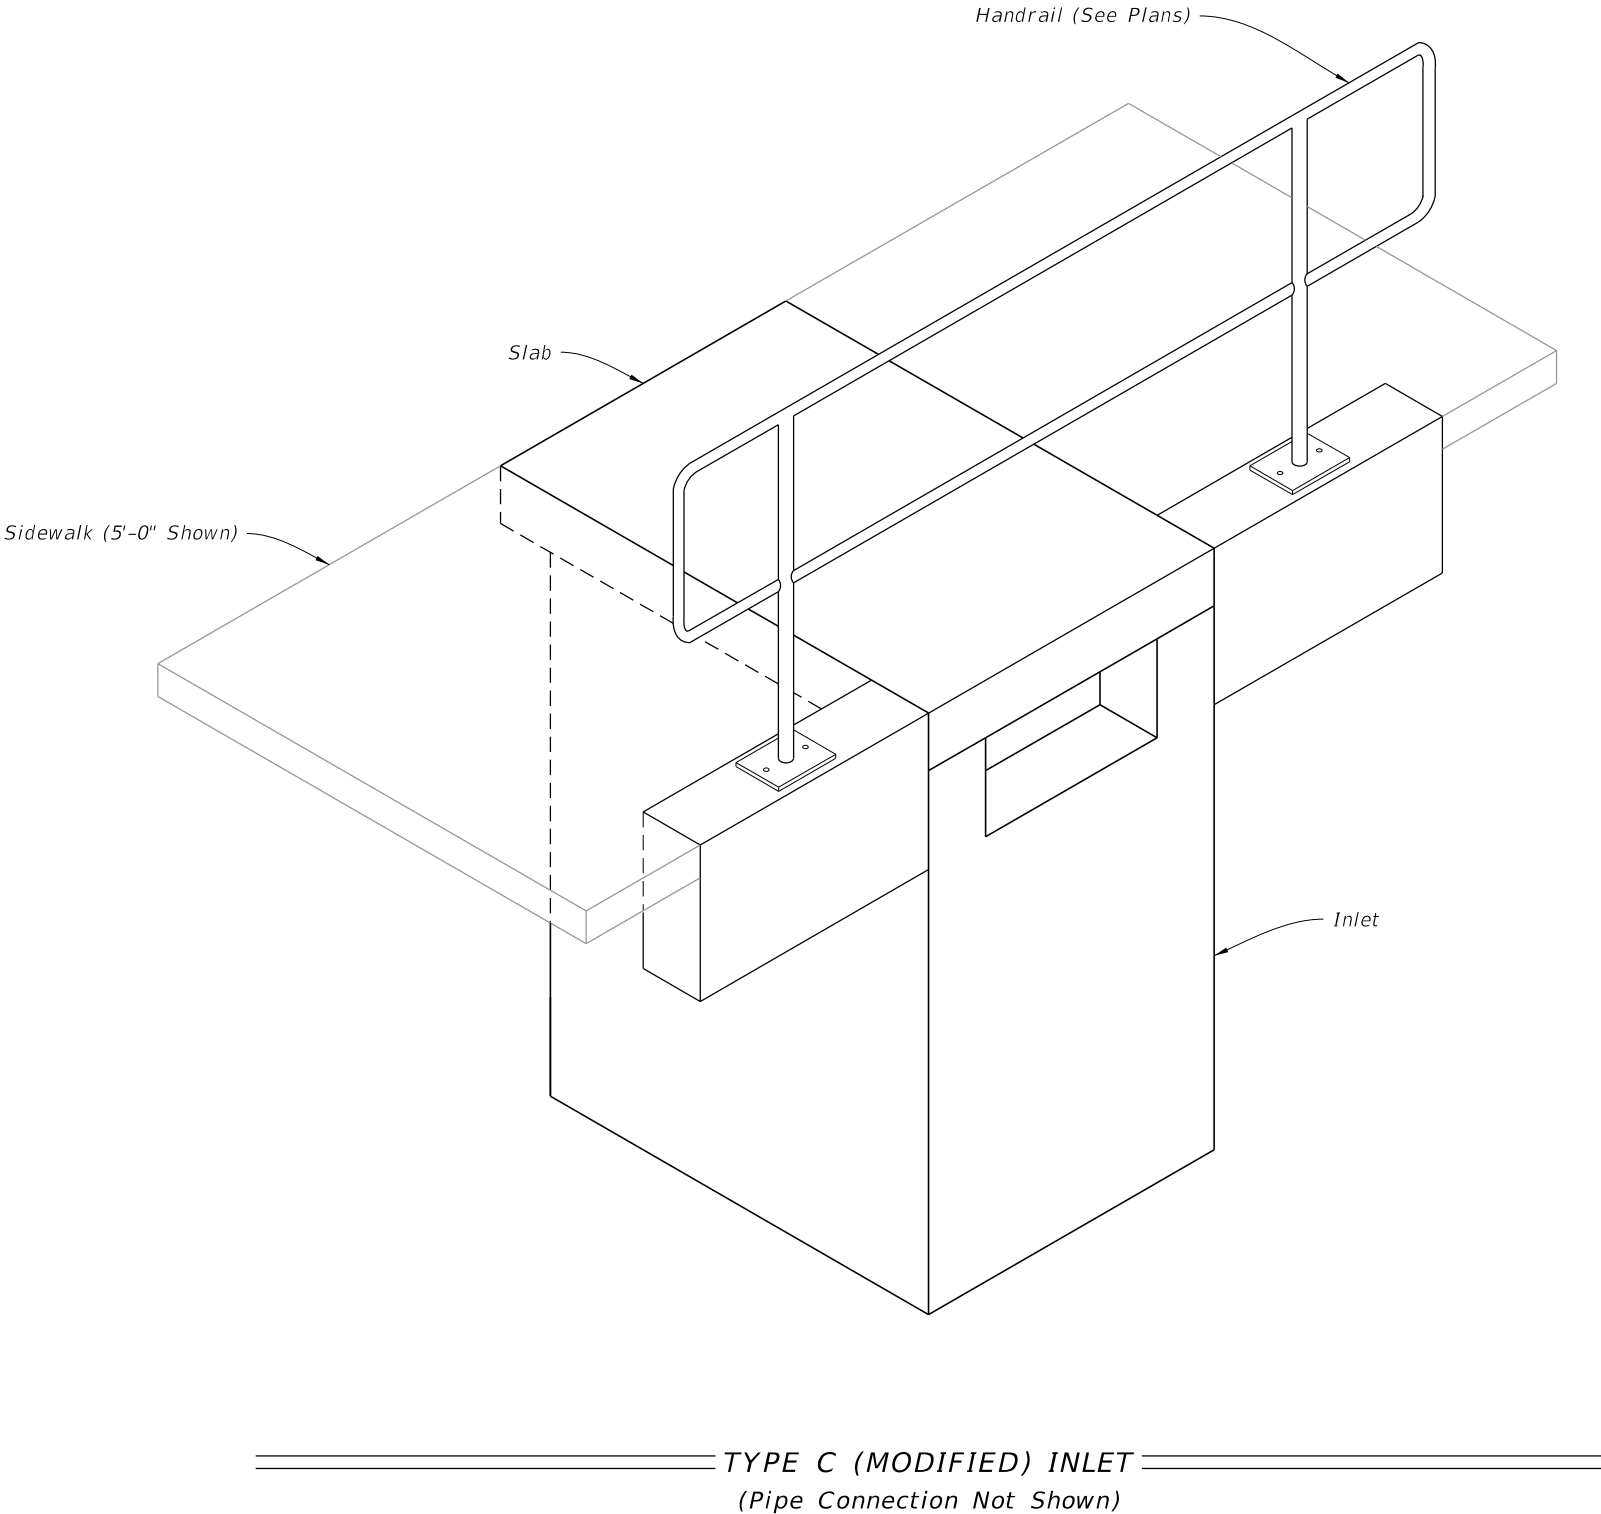


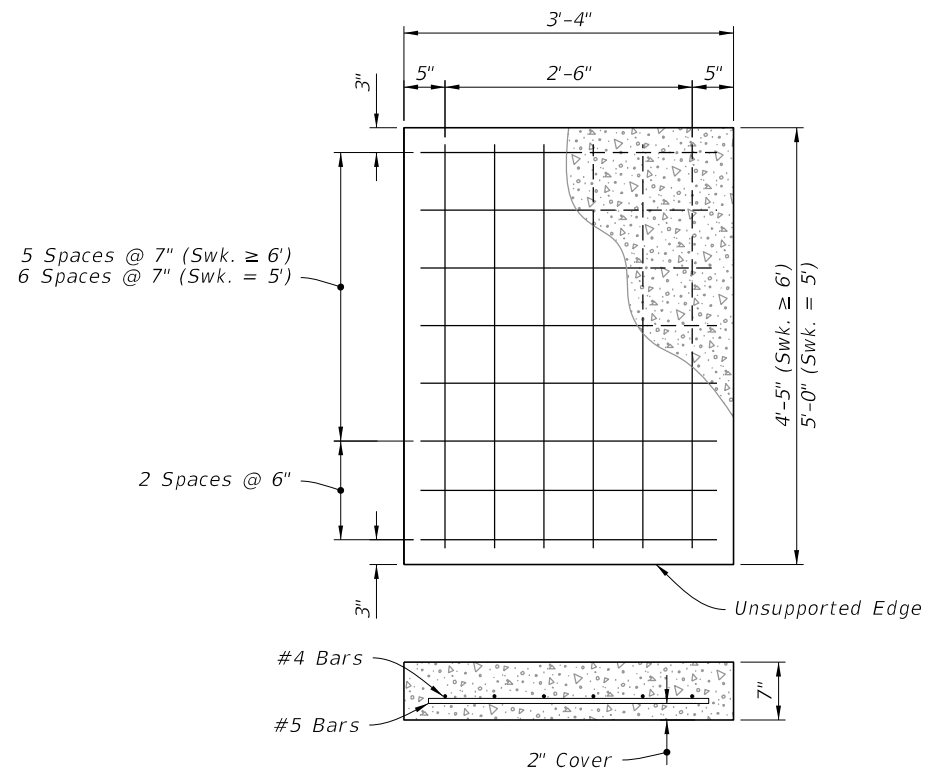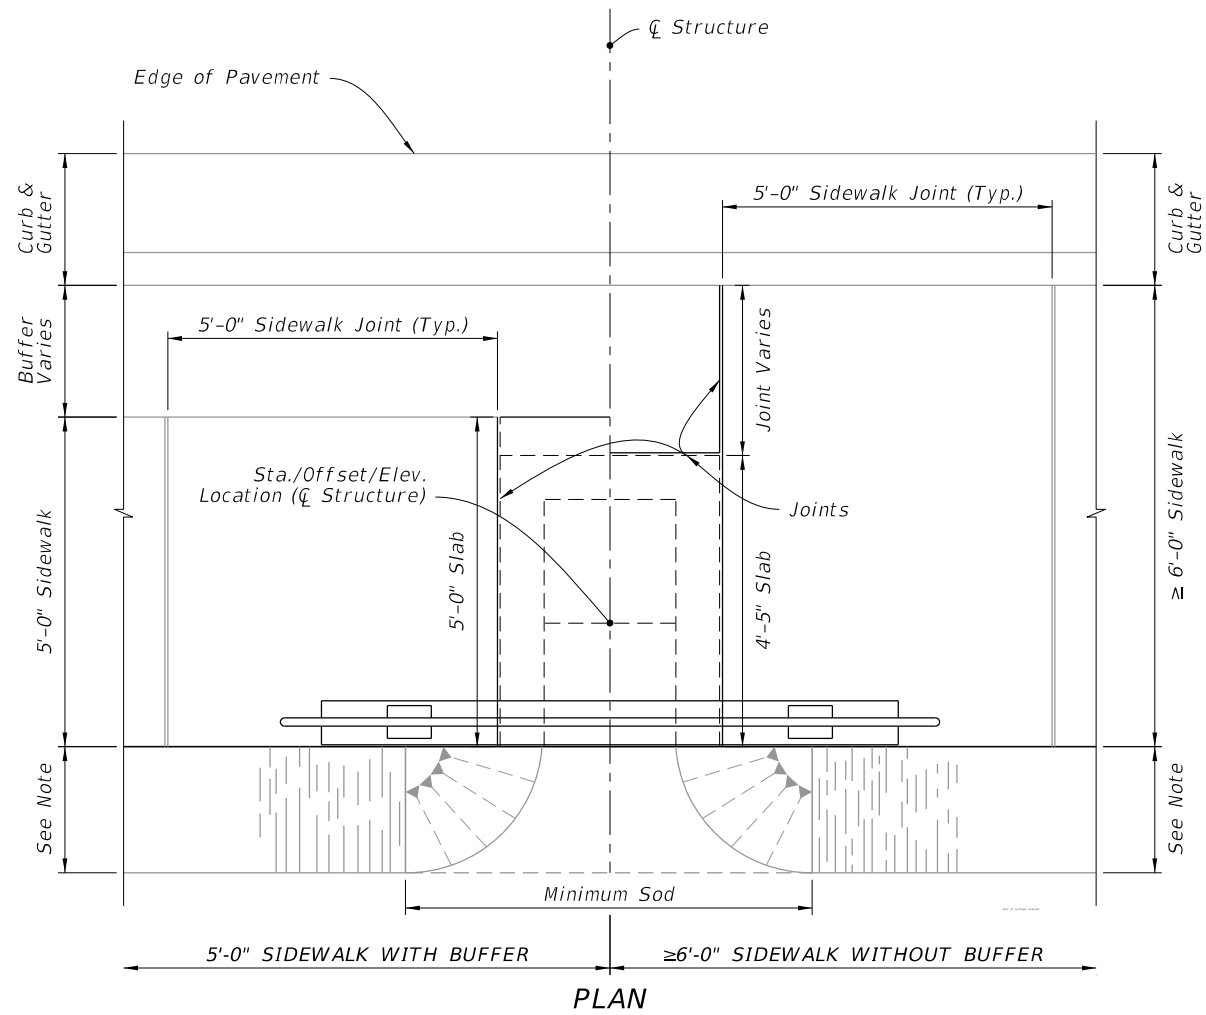

SLAB REINFORCEMENT


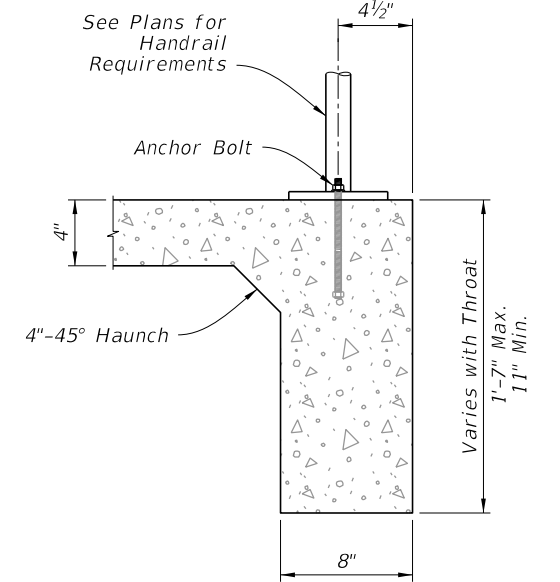


SECTION B-B

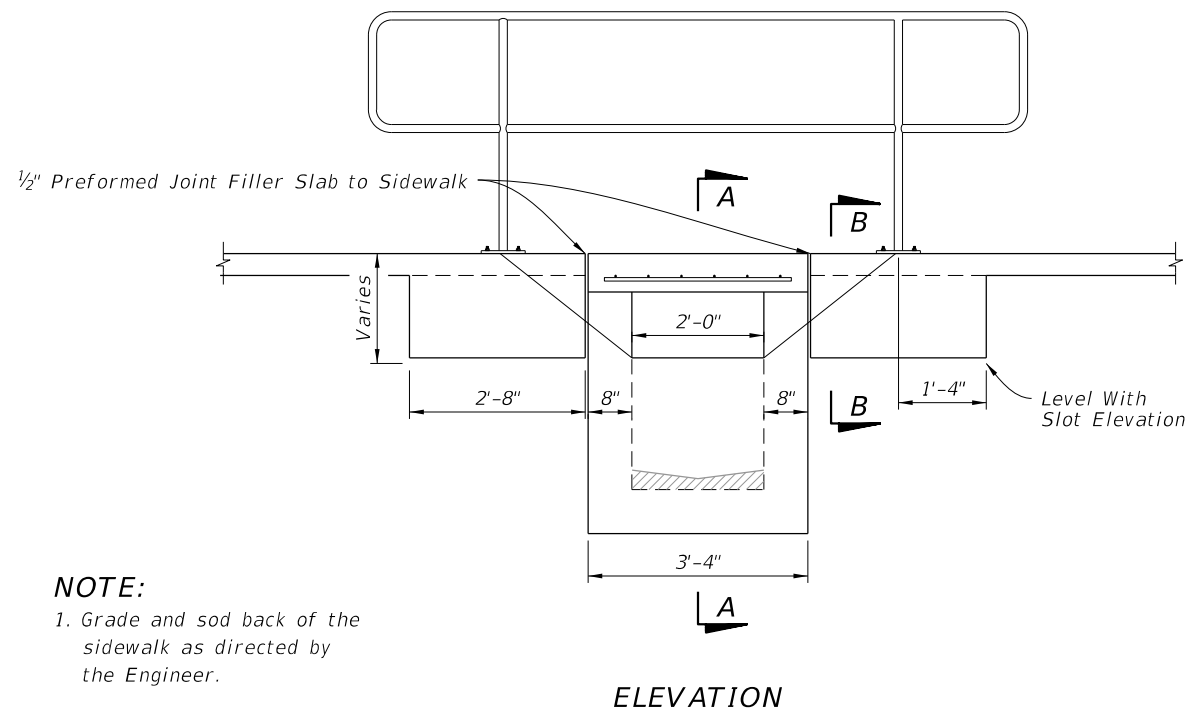

NOTE:


1. Grade and sod back of the sidewalk as directed by the Engineer.
2. Pipe connection not shown.

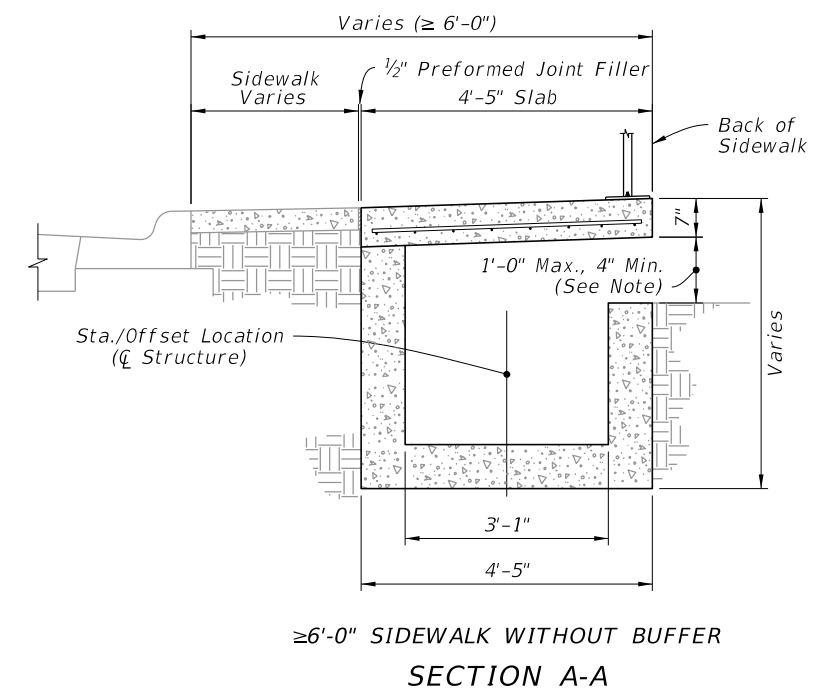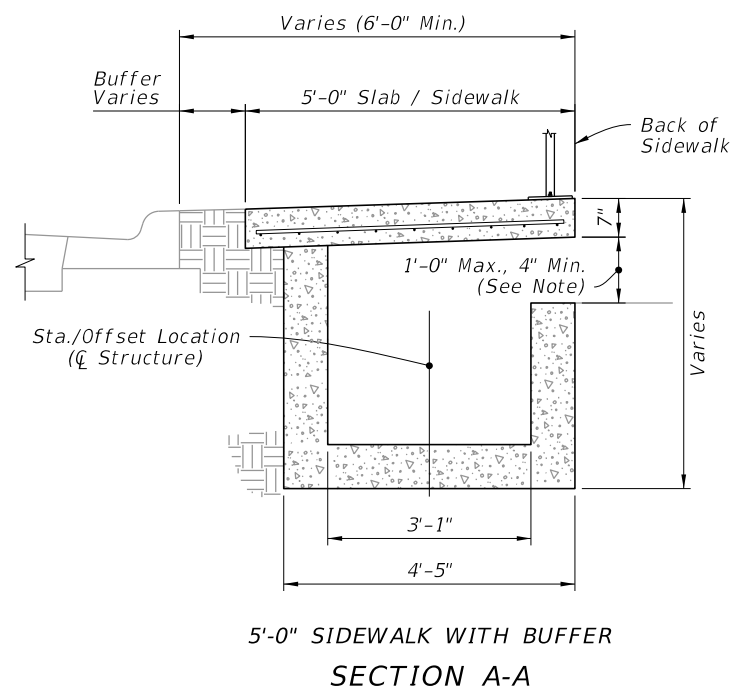


TYPE C INLET (MODIFIED)

9/26/2025 12:53:14 PM


LAST REVISION	DESCRIPTION:	FDOT	FY 2026-27 STANDARD PLANS	BACK OF SIDEWALK DRAINAGE	INDEX	SHEET
11/01/20					425-060	2 of 4

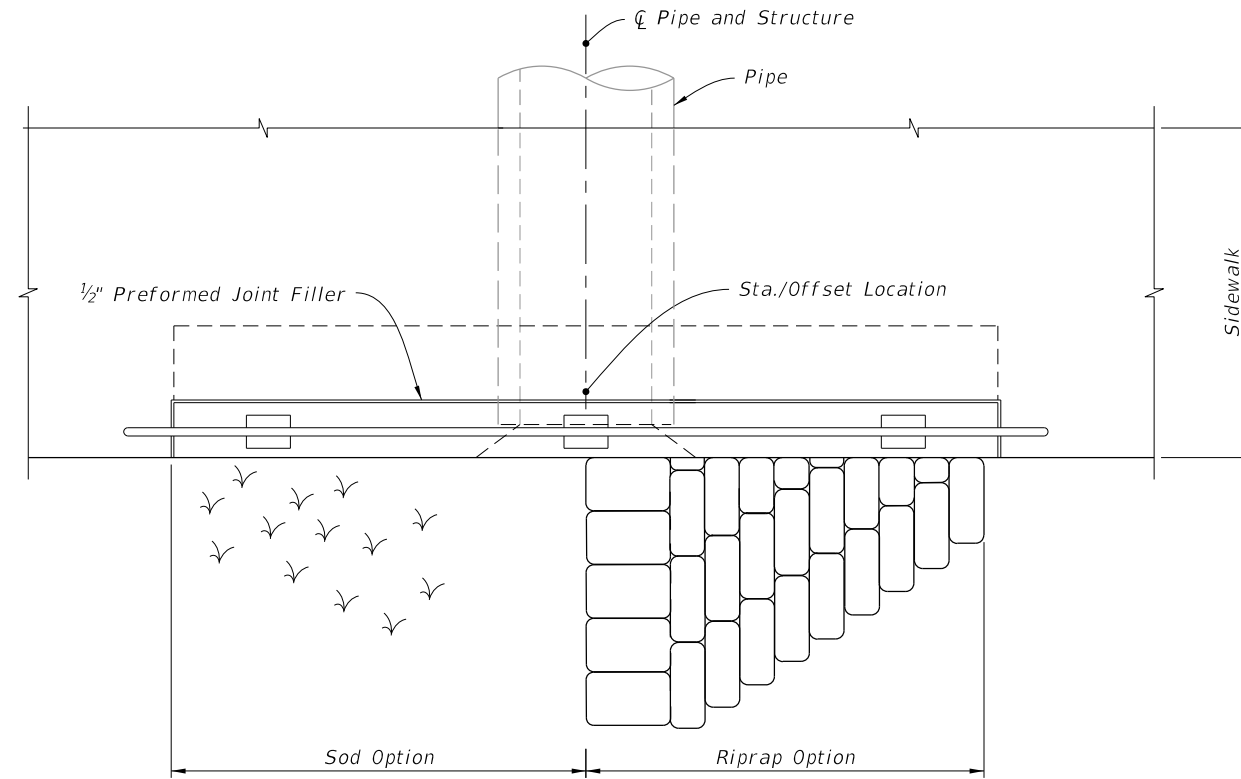


PLAN

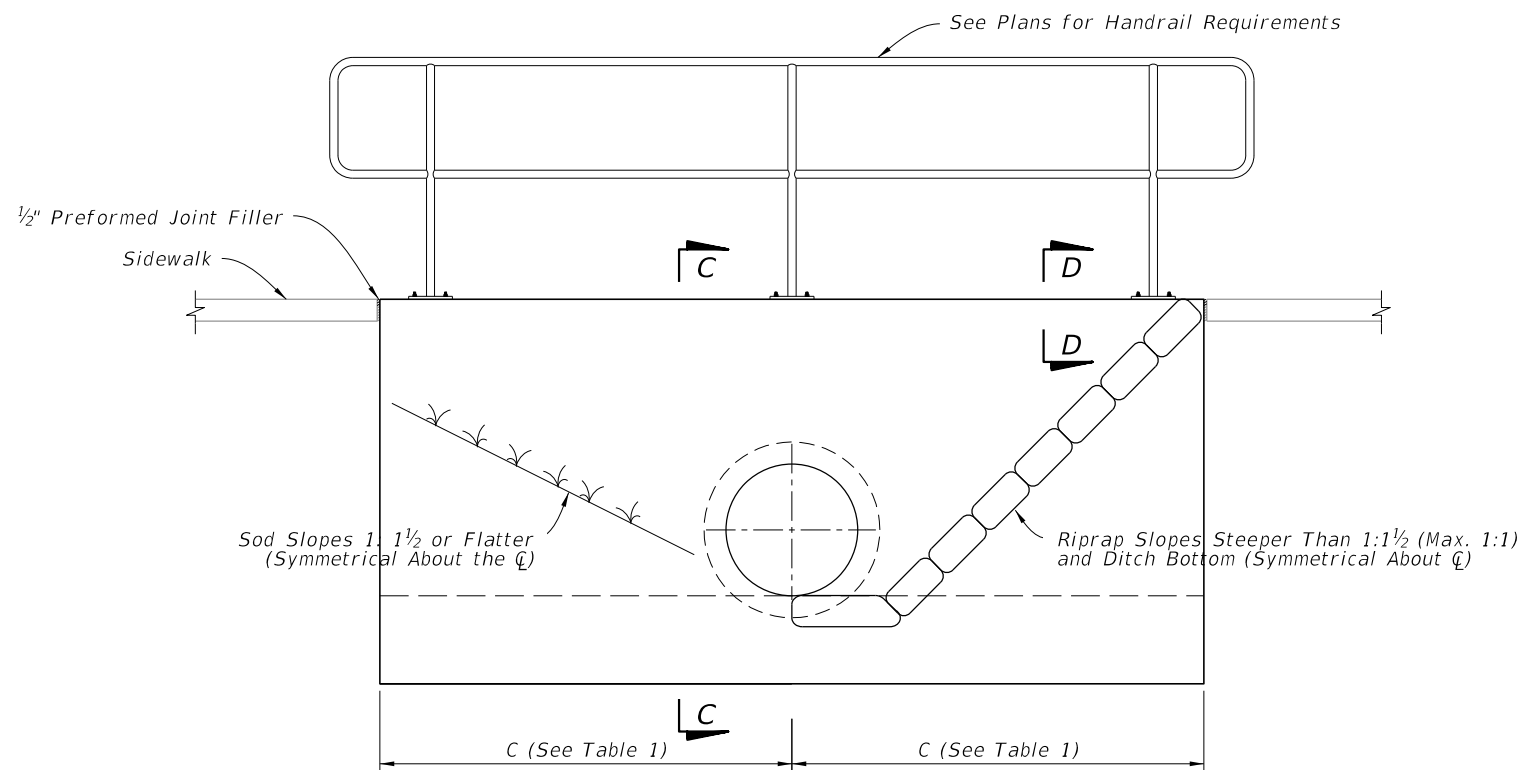

ELEVATION

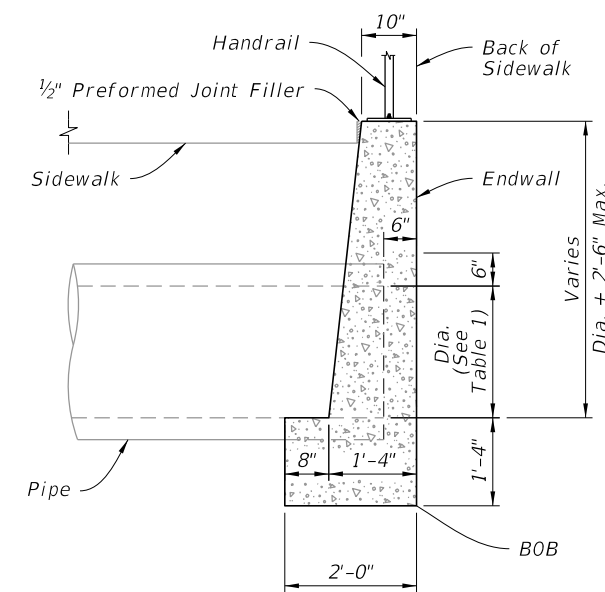

SECTION C-C

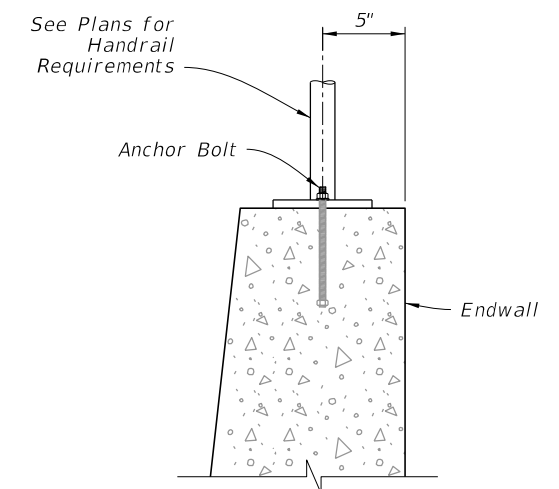

SECTION D-D

NOTES:

1. Grading back of sidewalk as directed in the Plans.
2. Concrete quantities shown are for maximum wall heights and for information only.
3. Riprap quantities are for informational and estimating purposes only.


TABLE - 1

Pipe Size Dia. (in)	C	Concrete Class II (CY)	Sand-Cement Riprap (CY)
15	4'-9"	2.3	1.1
18	5'-3"	2.6	1.3
24	6'-3"	3.3	1.8

SPECIAL CONCRETE ENDWALL

NOTES:


- 1. Construct at locations as directed by the Engineer.
- 2. Use either cast iron pipe or PVC rigid conduit, U.L. listed for direct sunlight exposure, Schedule 40.

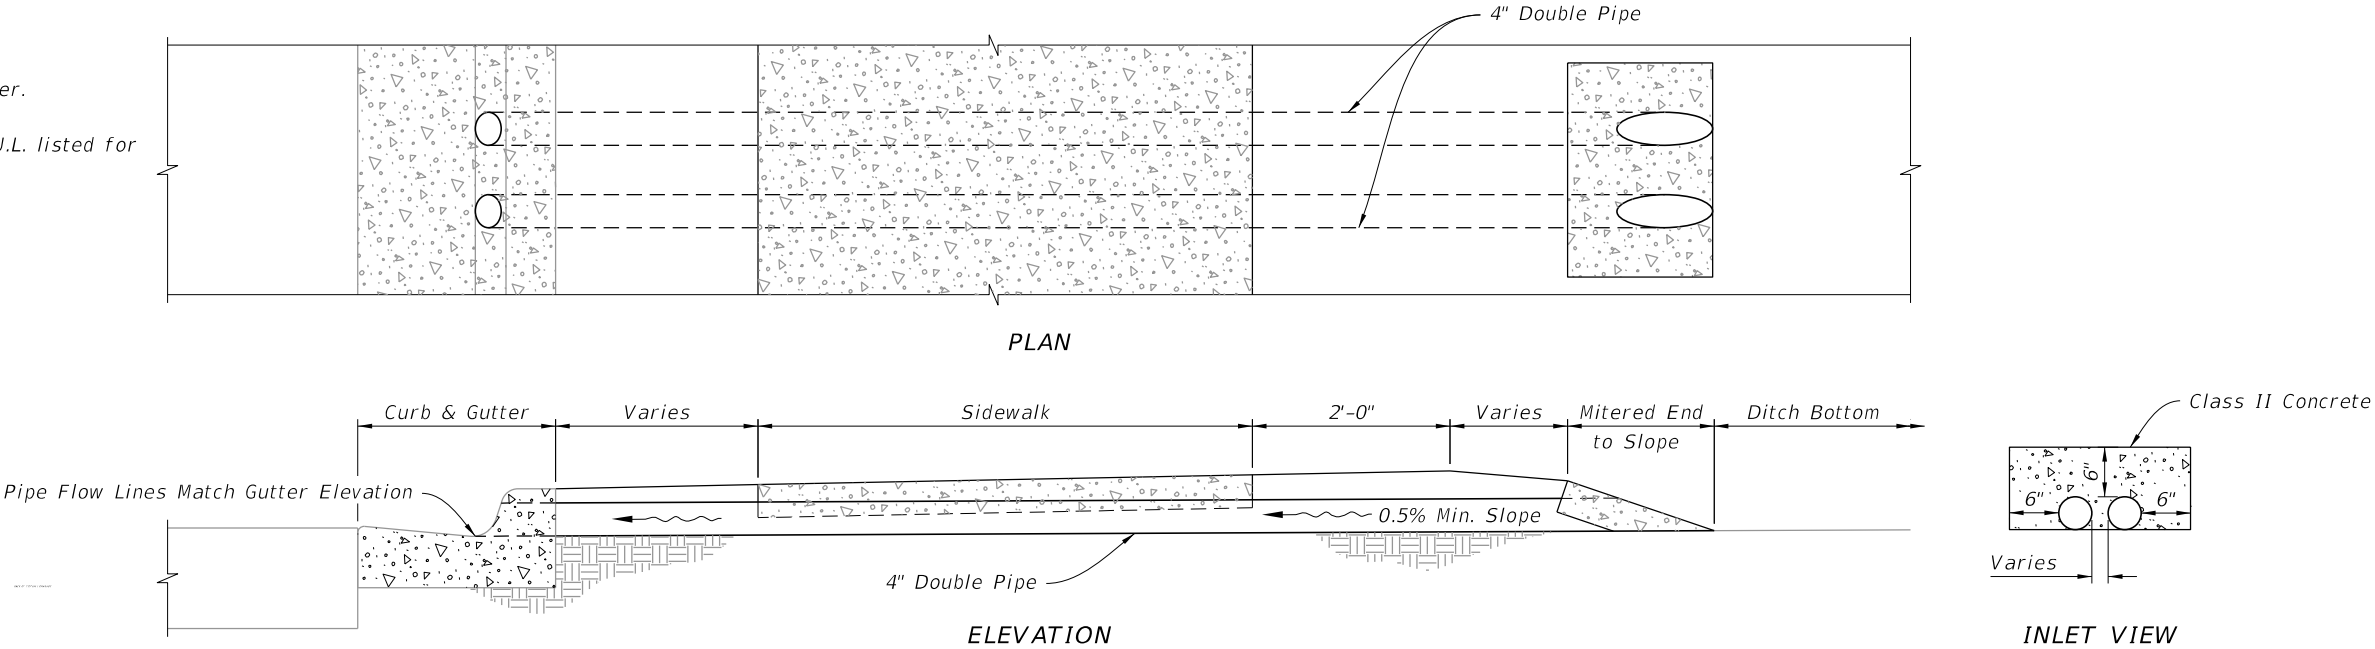

SHALLOW DITCHES

NOTES:

- 1. Tee will be either concrete or PVC, 15"x15"x12".
- 2. Grate will have diameter of 14 1/4", 2 1/2" thick, minimum 45 square inches flow area, and be light duty cast iron in accordance Specification 962.

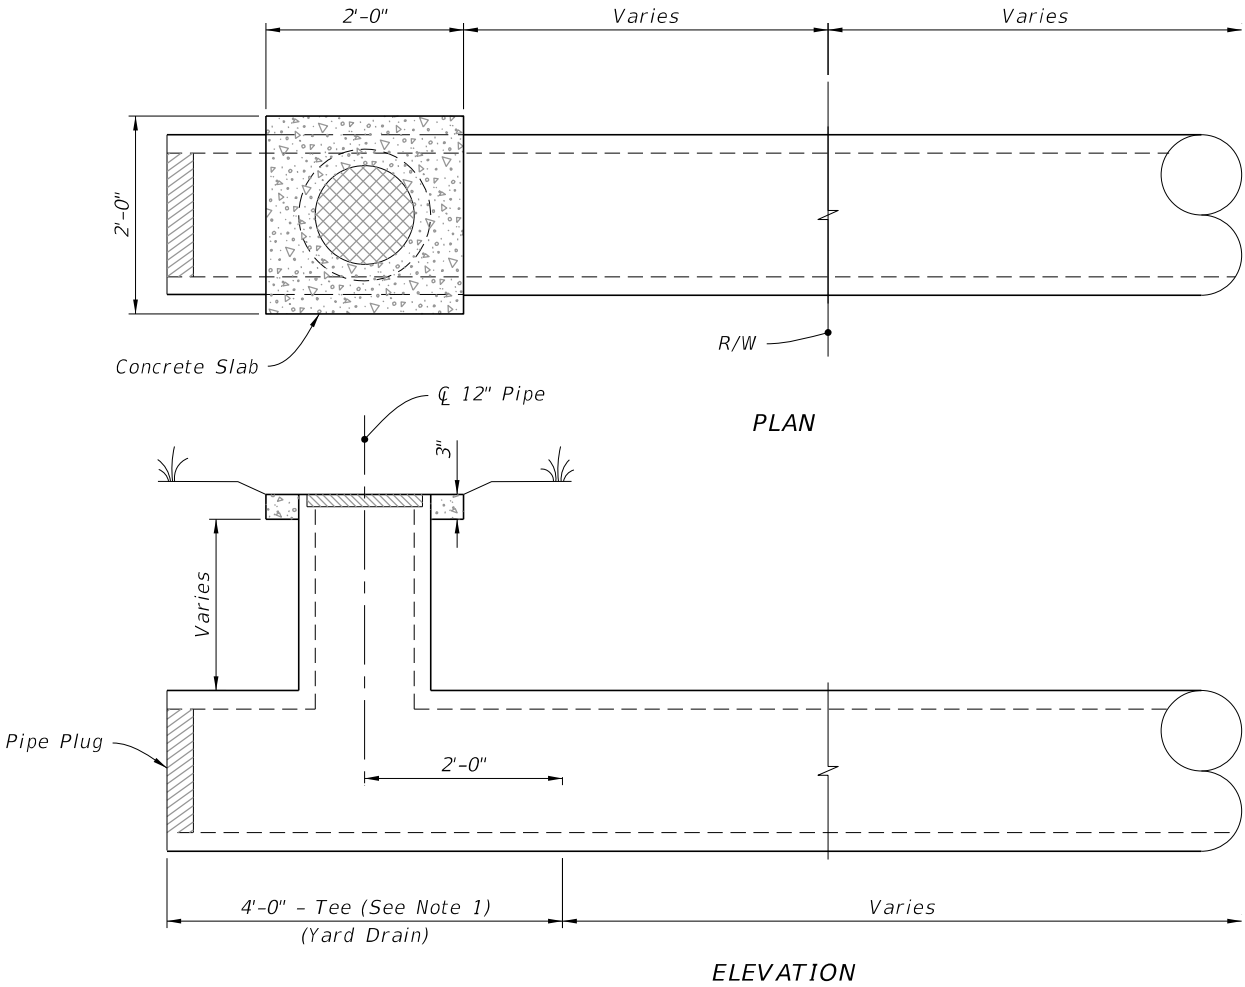

YARD DRAINS

SHALLOW DITCHES AND YARD DRAINS

LAST REVISION 11/01/21	REVISION	DESCRIPTION:	 FY 2026-27 STANDARD PLANS	BACK OF SIDEWALK DRAINAGE	INDEX 425-060	SHEET 4 of 4
------------------------------	----------	--------------	--	----------------------------------	------------------	-----------------