


- 2. Construct lip at the end of ditch pavement downstream of DPI or on flatter grades where there is a decrease in ditch velocity.
- 3. Use toewalls with all ditch paving, except adjacent to drainage structures.
- 4. Construct sides of paving with 1' minimum height for junction of R/W ditch spillway and lateral ditch.
- 5. Select and install appropriate geotextile type in accordance with Specification 514 under all ditch pavement except for miscellaneous asphalt.
- 6. Install ditch pavement requiring reinforcement as detailed in Plans.

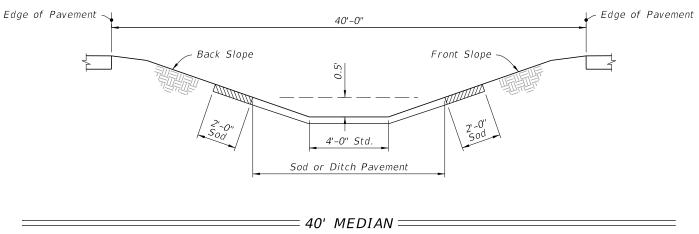

REVISION 11/01/25


DESCRIPTION:

FDOT

FY 2026-27 STANDARD PLANS DITCH PAVEMENT AND SODDING

INDEX SHEET

*A* 

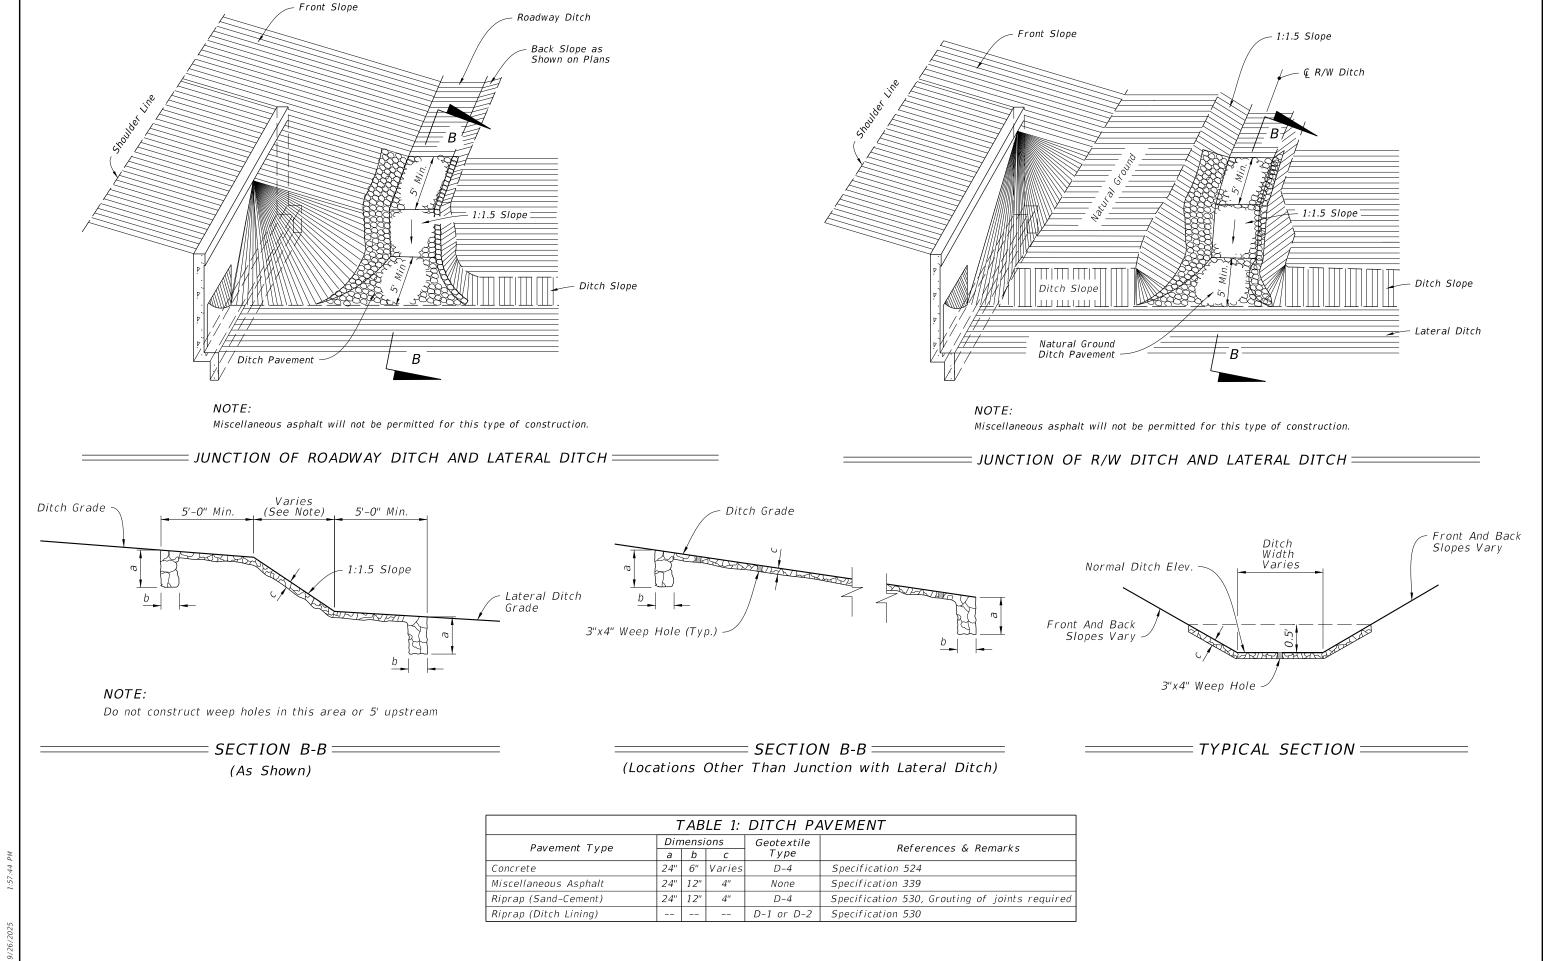

REVISION 11/01/25 DESCRIPTION:

FDOT

Matting

SECTION C-C

Matting Side Slope 6" Overlap (Min.)

SECTION D-D

= MATTING FOR DITCH ==


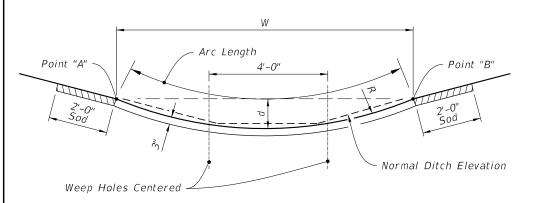


TABLE 2: ALTERNATE DITCH PAVEMENT					
TO REPLACE:	W	d	R	Rows Of Weep Holes	Arc Length
6' Median Swale	6'	0.24'	19'	0	6.0'
1:6 Front Slopes; 1:4 Back Slope					
5' Ditch Bottom Width	10'	0.67'	19'	2	10.1'
4' Ditch Bottom Width	9'	0.54'	19'	2	9.1'
1:4 Front Slopes & Back Slope					
5' Ditch Bottom Width	9'	0.74'	14'	2	9.2'
4' Ditch Bottom Width	8'	0.58'	14'	1 (in center)	8.1'

## NOTE:

For use only where side slopes are 1:4 or flatter. Point "A" and "B" are at the same elevation and should be used to locate the paved section.

= ALTERNATE DITCH PAVEMENT ==

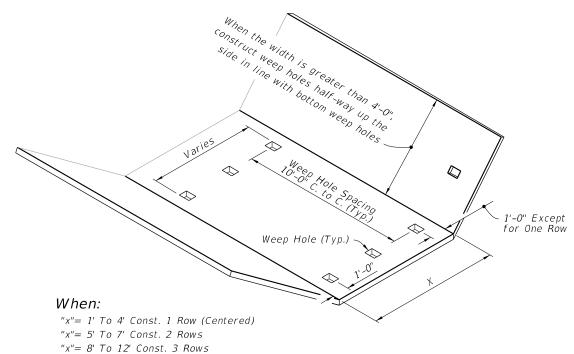

## NOTES:

"x"= 13' To 17' Const. 4 Rows

"x"= 18' To 22' Const. 5 Rows

(Typical)

- 1. Construct all weep holes 3"x4" rectangle or 4" or 5" diameter circle hole. Place  $\frac{1}{2}$  cu. ft. (12" x 12" x 6") of No. 57 aggregate under each hole with 1 sq. ft. of galvanized wire mesh (  $\frac{1}{4}$ " openings) placed between the aggregate and the ditch pavement.
- 2. Rectangle weep holes shown, round weep holes similar.
- 3. Weep hole spacing may be reduced to 5' minimum when directed by the Engineer.

= WEEP HOLE ARRANGEMENT =

Sand-Cement or Rubble Riprap 6" Fold Min. No Adhesive Above Here Geotextile 12" Bituminous Coating of Face of Concrete

BONDED OPTION

Sand-Cement or Rubble Riprap 6" Fold Min. Geotextile 1"x2" Pressure Treated Timber Nailed to Surface

NAILED OPTION

## NOTE:

Either option may be used, unless called for in the plans.

=  ${\it GEOTEXTILE}$   ${\it PLACEMENT}$  ==AT CONCRETE STRUCTURE

DESCRIPTION:



FY 2026-27 STANDARD PLANS

INDEX

SHEET