


## ELEVATION OF INSIDE FACE OF TRAFFIC RAILING WITH PEDESTRIAN/BICYCLE BULLET RAILING

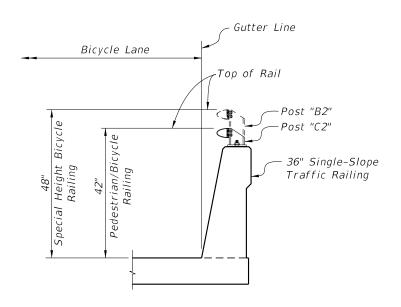

SECTION A-A TYPICAL SECTION THRU BRIDGE DECK (APPROACH SLAB SIMILAR)


#### NOTES:


- 1. A Bullet Railing Tapered-End Transition is required for all approach ends of Bullet Railings on Traffic Railings. When Guardrail Connection is required terminate the Bullet Railing Tapered-End Transition at beginning of the Traffic Railing End Transition.
- 2. Where Bullet Railing continues on retaining wall mounted Traffic Railings or Barriers, provide a Bullet Railing Tapered End Transition at the terminus of the Bullet Railing.

## CROSS REFERENCES:

Work in conjunction with Index 515-022.

For Traffic Railing Details, Reinforcement and Notes see Index 521-427.

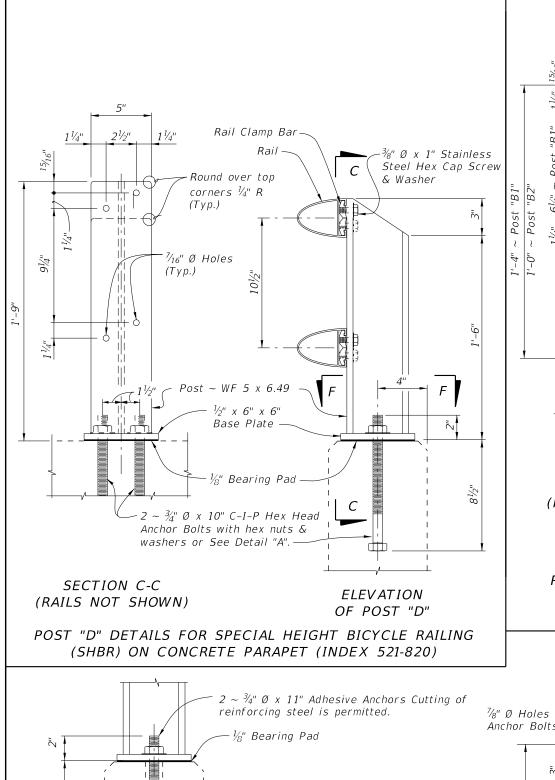


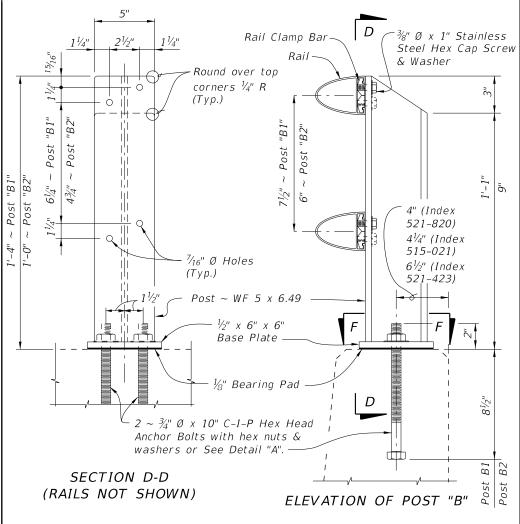

POST "B1" DETAILS FOR SHBR ON TRAFFIC RAILING (INDEX 521-423) AND FOR PEDESTRIAN/BICYCLE RAILING (PBR) ON CONCRETE PARAPETS (INDEX 521-820) POST "B2" DETAILS FOR SHBR ON TRAFFIC RAILING (INDEX 521-427 AND 515-021)

4½" (Index 515-021) 6½" (Index 521-423) Ε 11/4" Rail Clamp Bar ¾" Ø x 1" Stainless Steel Hex Cap Screw 7∕<sub>16</sub>" Ø Holes & Washer (Typ.)Round over top corners 1/4" R (Typ.)Post ~ WF 5 x 6.49 ½" x 6" x 6" Base Plate Post Post  $rac{1}{8}$ " Bearing Pad Ε  $2 \sim \frac{3}{4}$ " Ø x 10" C-I-P Hex Head Anchor Bolts with hex nuts & washers or See Detail "A". \_ Face of Traffic Railing SECTION E-E **ELEVATION** OF POST "C" (RAIL NOT SHOWN)

POST "C1" DETAILS FOR PEDESTRIAN/BICYCLE RAILING (PBR) ON TRAFFIC RAILINGS (INDEX 521-423) POST "C2" DETAILS FOR PBR ON TRAFFIC RAILING (INDEX 521-427 & 515-021)

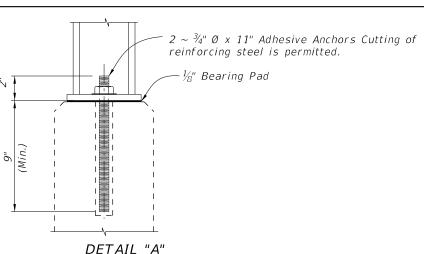

ALTERNATE ANCHOR BOLT

(Concrete Parapet Shown, Traffic Railings Similar)

DESCRIPTION:

6" <sup>7</sup>⁄<sub>8</sub>" Ø Holes for Anchor Bolts (Typ.) H-Beam Post ~ WF 5 x 6.49

SECTION F-F

BASE PLATE DETAIL

Rail Clamp Bars-Rail ¾" Ø x 1" Stainless Steel Hex Cap Screws and Washers

RAIL TO POST CONNECTION DETAIL

#### CROSS REFERENCES:

For post spacing on Concrete Parapets see Index 521-820.

For post spacing on Traffic Railings see Index 515-021.

For Rail Details see Sheet 2.

For Railing Notes and Tapered End Transition Details see Sheet 3.

FDOT


FY 2026-27 STANDARD PLANS


PEDESTRIAN/BICYCLE BULLET RAILING DETAILS

INDEX 515-022

SHEET

REVISION 11/01/17

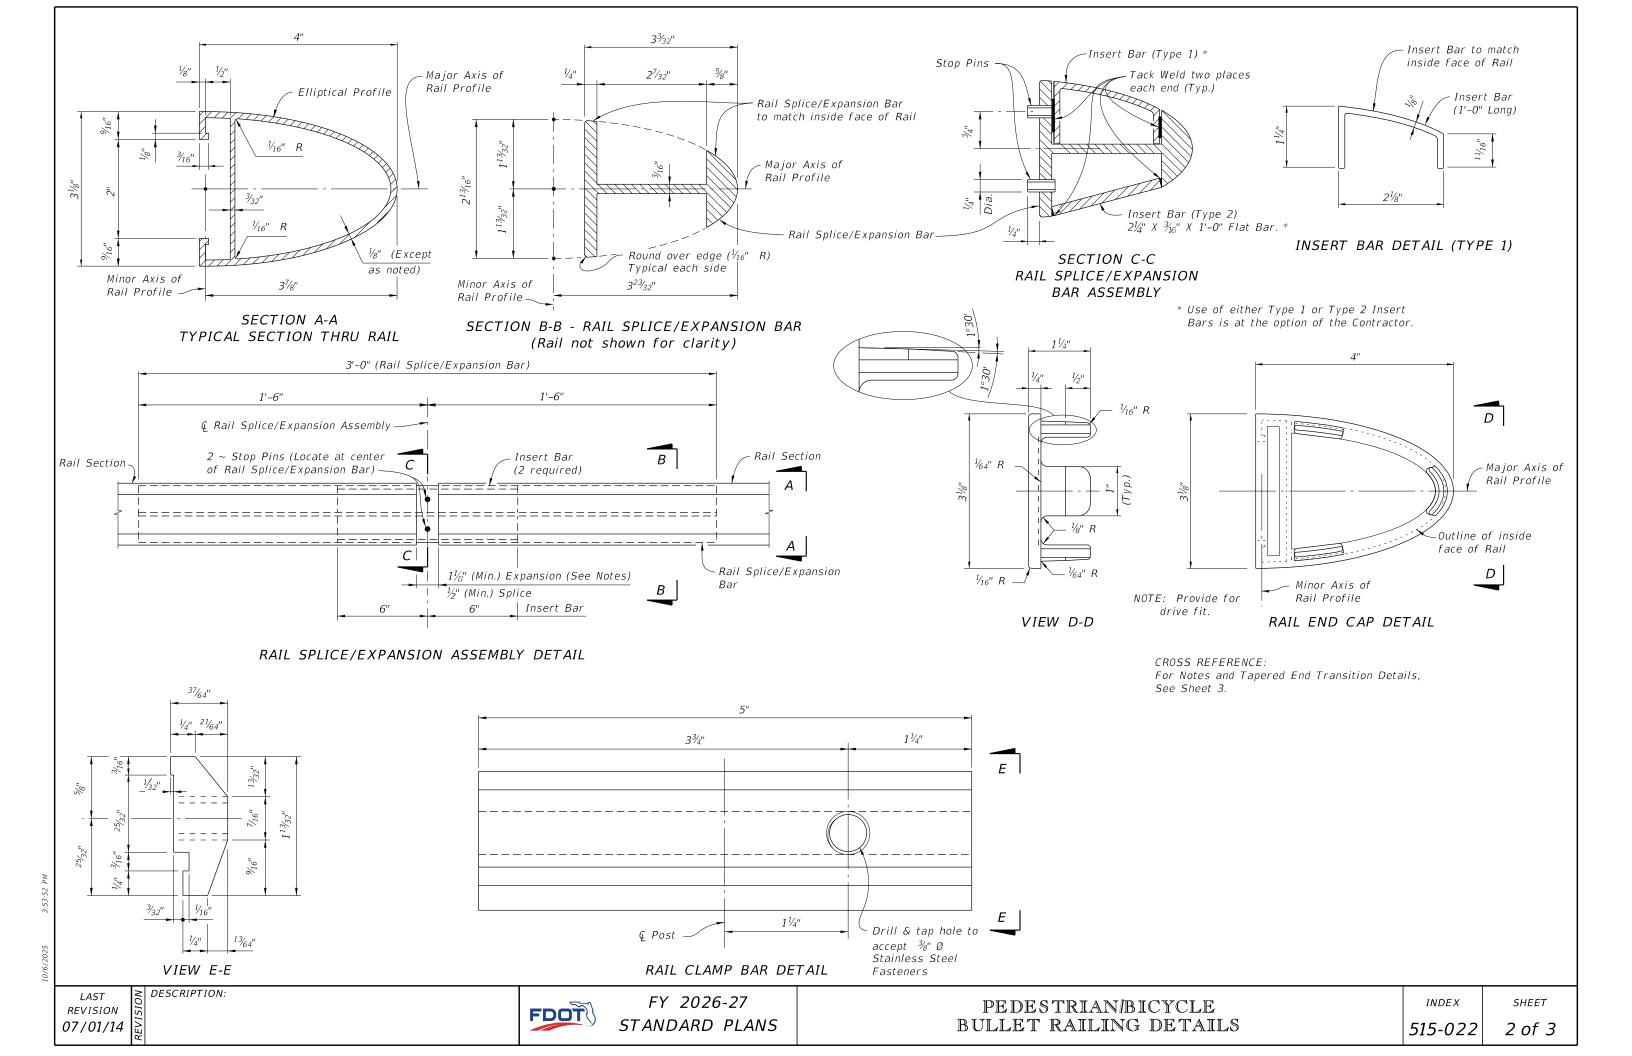

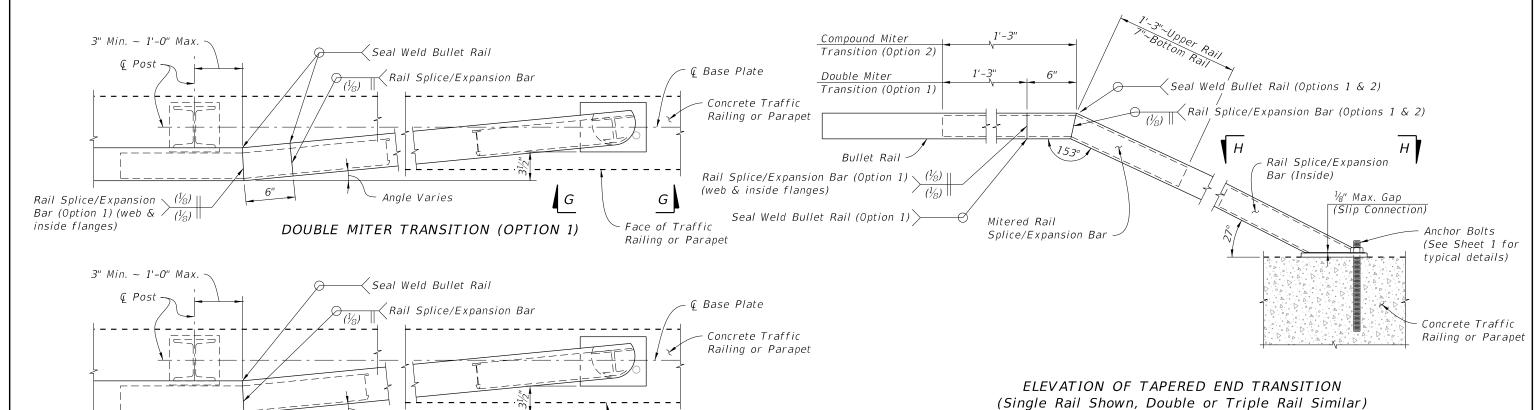

## PARTIAL PLAN OF TAPERED END TRANSITIONS

Angle Varies


G

Face of Traffic


Railing or Parapet

(Single Rail Shown, Double or Triple Rail Similar)

COMPOUND MITER TRANSITION (OPTION 2)



## VIEW G-G TRANSITION BASE PLATE (Bullet Rail not shown for Clarity)

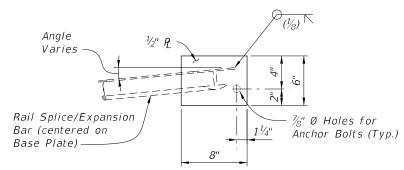

VIEW H-H TRANSITION BASE PLATE (Bullet Rail not shown for Clarity)

#### RAILING NOTES:

- Work this Index with Index 521-423, 521-427, 521-428, 521-820 and 515-021 and Specification Section 515.
- Shop Drawings: Submit shop drawings prior to fabrication. A. Include post and rail splice/expansion assembly location for curved alignments with radii < 40 feet and for all end terminations.
- - A. Supply Aluminum materials In accordance with Specification Section 965 and the following: Wrought Aluminum Post: ASTM B221, Alloy 6061-T6 or 6351-T5 Rail End Cap: ASTM B26 sand cast aluminum alloy 356.0-F Plate and Bars: ASTM B209 Alloy 6061-T6 Rails: ASTM B221 Alloy 6061-T6 or 6351-T5. Stop Pins: Press-fit aluminum or stainless steel pins or tubes
  - B. Stainless Steel Fasteners: ASTM F-593, Alloy Group 2 (316).
  - C. Bearing Pads: Plain or Fiber Reinforced meeting Specification Section 932 for Ancillary Structures.
  - D. Anchor Bolts: Galvanized ASTM A307 Grade 36 Hex Head. Galvanized ASTM 1554 Grade 55 Threaded rods for Adhesive Anchors.
- 4. Layout.
  - A. Posts shall be uniformly spaced with reasonable consistency.
  - B. Tapered End Transitions are required at the terminus of the approach ends of Bullet Railing mounted on a Traffic Railing. Bullet Railings on concrete parapets shielded by a traffic railing do not require Tapered End Transitions unless noted otherwise in the Plans.
  - C. Adjust post spacing's to avoid parapet obstacles, such as armor expansion plates, by 9 inches minimum.
  - D. Rails shall be continuous over a minimum of 3 posts, except that lengths less than 12 feet need only be continuous over 2 posts.
  - E. Space splices at 40 feet maximum. Splice all rails in a given railing section at about the same center line.
  - F. Provide rail expansion assemblies in panels between posts on either side of a bridge expansion joint. Rail expansion assemblies are similar to the rail splice assemblies with increased space at the expansion assembly to allow for movement equal to 1.5 times the bridge joint opening or 1" greater than the expected joint movement.
- - A. Set rails near bridge expansion joints to allow for expected movement.
  - B. Cutting of reinforcing steel is permitted for post installed anchors.
- 6. Payment: Includes the full cost of installed bullet railing. Cost of the Concrete Parapet or Traffic Railing is separate.

REVISION 11/01/22

DESCRIPTION:


FDOT

FY 2026-27 STANDARD PLANS

PEDESTRIAN/BICYCLE BULLET RAILING DETAILS INDEX

SHEET

515-022 3 of 3

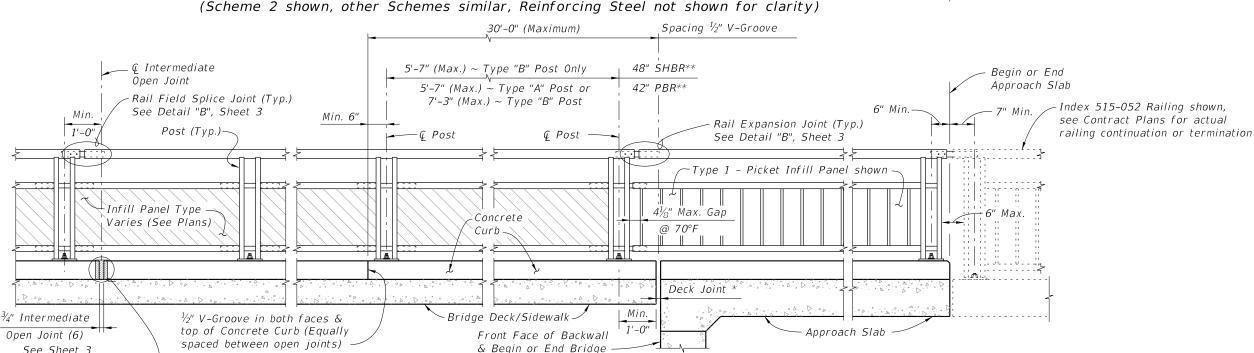

ELEVATION OF INSIDE FACE OF RAILING (Scheme 2 shown with Post "A", other Schemes similar, Reinforcing Steel not shown for clarity)

See Sheet 3 for Pre-cured

Silicone Sealant


- 1. Shop Drawings are required.
- 2. Work this Index with Index 515-052 Bicycle/Pedestrian Railing Details (Steel) and Specification Section 515. Refer to the SPI for Design Criteria and Limits of Use.
- 3. Materials:
  - A. Steel: Galvanized after fabrication
    - a. Fasteners: Hex Head Bolt ASTM A307, Hex Nuts ASTM A563, Washers ASTM F436
    - b. Support Bracket (Scheme 3) L-shape and Stiffener Plate: ASTM A36
    - c. Bottle-guard (Schemes 1 & 3) L-shape: ASTM A36
  - B. Concrete: Same as bridge deck
  - C. Pre-cured Silicone Sealant: Specification Section 932
  - D. Bearing Pads: Provide \( \frac{1}{18} \)" Plain, Fabric Reinforced or Fabric Laminated bearing pads that meet the requirements of Specification Section 932 for Ancillary Structures.
- 4. See Structures Plans, Superstructure Sheets for bridge information including concrete type, deck expansion joint locations and orientations, and thermal movement.
- 5. Railings:
  - A. For thermal movement greater than 4" (up to a maximum of 5"), clear opening between adjacent pickets, or panels at Rail Expansion Joints above Deck Joints must be reduced to  $3\frac{1}{3}$ ".
  - B. For treatment of railings on skewed bridges see Index 521-427.
- 6. Curbs:
  - A. Match open curb joints at Deck Expansion Joint locations to the deck joint dimension.
  - B. Construct Concrete Curb (Scheme 2) vertical with the top surface finished level transversely. See Concrete Curb Details Sheet 3.
  - C. Provide  $\frac{3}{4}$ " Intermediate open joints in curbs coinciding with the  $\frac{3}{4}$ " joints in the traffic railing.
- 7. Payment: Support bracket (Scheme 3) is incidental to the cost of railing. Curb concrete and reinforcing steel (Scheme 2) are included in the bridge deck quantities.

\* Deck Joint at Begin Bridge or End Bridge shown; Deck Joint at Q Pier or Intermediate Bent similar.

\*\* SHBR~Special Height Bicvcle Rail PBR~Pedestrian/Bicycle Rail

REVISION 11/01/17



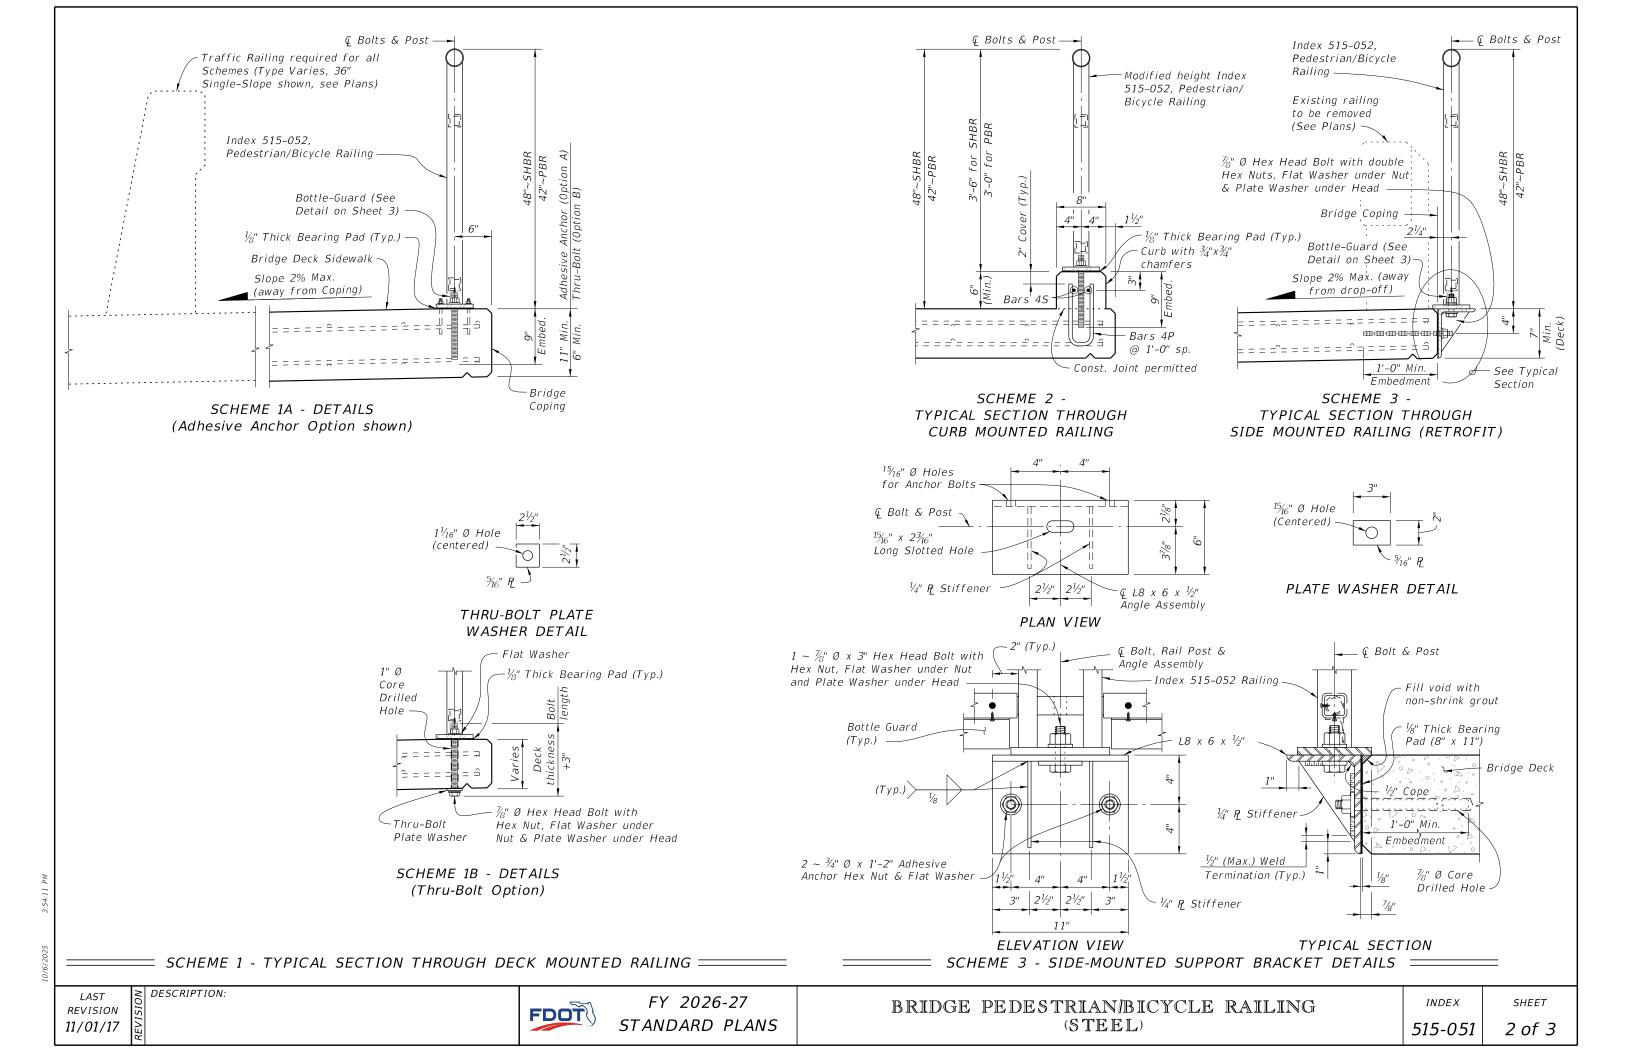


## ROUND RAILS - TOP RAIL OR HANDRAIL

- \*  $\frac{1}{4}$ " Ø x  $\frac{3}{4}$ " Pan Head Stainless Steel (Type 316 or 18–8 Alloy) Set Screws along outside face of railing. Set screws must be set flush against the rail surface. A  $\frac{3}{4}$  Ø plug weld may be substituted for the two set screws at expansion joints.
- \*\* Embedded length may be 4" for plug welded connection.
- \*\*\* Increase handrail sleeve embedment to 8" for Expansion Joint openings greater than 2".

sharp edges (Typ.)


\*\*\*\* Expansion Joint opening shall match the clear opening in the deck joint but not greater than 3".

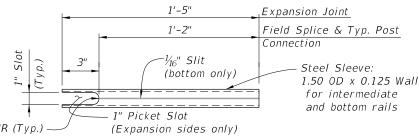


INTERMEDIATE OR BOTTOM RAIL - STEEL SLEEVE DETAIL (Bottom Side Shown)

CONVENTIONAL REINFORCING


## == DETAIL "B" EXPANSION JOINT (FIELD SPLICE SIMILAR) =

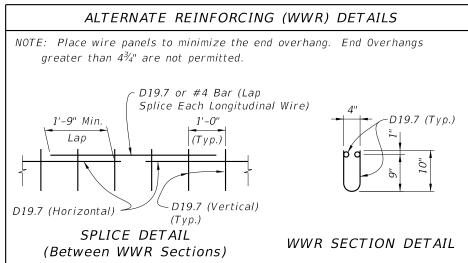



#### CURB REINFORCING STEEL NOTES:

- 1. All bar dimensions in the bending diagrams are out to out.
- 2. The reinforcement for the curb on a retaining wall shall be the same as detailed for an 8" deck.
- 3. All reinforcing steel at the open joints shall have a 2" minimum cover.
- 4. Bars 4S may be continuous or spliced at the construction joints. Bar splices for Bars 4S shall be a minimum of 1'-8"
- 5. Deformed Welded Wire Reinforcement (WWR) meeting the requirements of Specification Section 931 may be used in lieu of all Bars 4P and 4S.

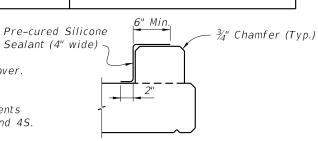

# ESTIMATED CONCRETE CURB


QUANTITIES (SCHEME 2)				
ITEM UNIT QUANTITY				
Concrete	CY/LF	0.0124		
Reinforcing Steel LB/LF 4.01				

## DETAIL "A" - SECTION AT INTERMEDIATE OPEN JOINT

#### INTERMEDIATE JOINT SEAL NOTE:

At Intermediate Open Joints, seal the lower 6" portion of the open joint with Pre-cured Silicone Sealant. Apply sealant prior to any Class V finish coating and remove all curing compound and loose material from the surface prior to application of bonding agent.

#### SCHEME 2 - CONCRETE CURB DETAILS

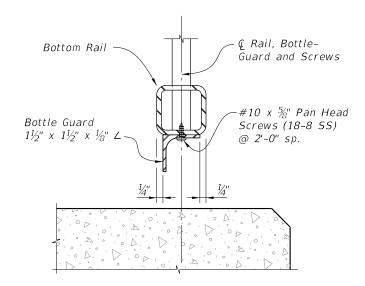


TYPICAL SECTION THROUGH BOTTOM RAIL (Post Not Shown for Clarity)

== SCHEME 1 - BOTTLE GUARD DETAIL ====

#### CROSS REFERENCE:

See Sheet 1 for Bridge Railing Notes.

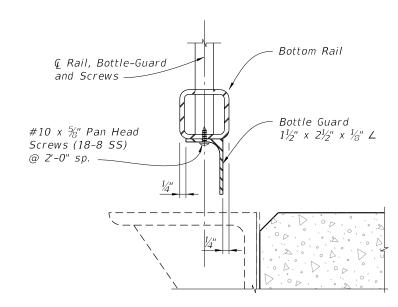

TYPICAL SECTION THROUGH BOTTOM RAIL (Post Not Shown for Clarity)

= SCHEME 3 - BOTTLE GUARD DETAIL =

REVISION 11/01/16

DESCRIPTION:

FDOT


FY 2026-27 STANDARD PLANS

BRIDGE PEDESTRIAN/BICYCLE RAILING (STEEL)

INDEX

SHEET

515-051 3 of 3 (Scheme 2 shown, other Schemes similar, Reinforcing Steel not shown for clarity)

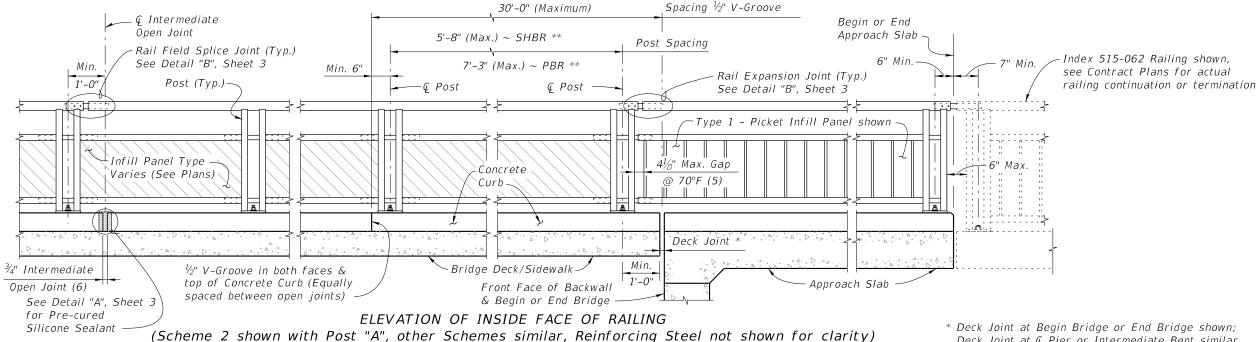


NOTES:

- Deck Joint at & Pier or Intermediate Bent similar.
- \*\* SHBR ~ Special Height Bicycle Railing PBR ~ Pedestrian/Bicycle Railing

- 1. Shop Drawings are required.
- 2. Work this Index with Index 515-062 Aluminum Bicycle/Pedestrian Railing Details and Specification Section 515. Refer to the IDS for Design Criteria and Limits of Use.
- 3. Materials:
  - A. Galvanized Steel Fasteners: Hex Head Bolt ASTM A307, Hex Nuts ASTM A563, Washers ASTM F436
  - B. Aluminum:
    - a. Support Bracket (Scheme 3) L-shape and Stiffener Plate: ASTM B209, Alloy 6061-T6
    - b. Bottle-guard (Schemes 1 & 3) L-shape: ASTM B209, Alloy 6061-T6 or 6063-T5
  - C. Concrete: Same as bridge deck
  - D. Pre-cured Silicone Sealant: Specification Section 932
  - E. Bearing Pads: Provide 1/8" thick Plain, Fabric Reinforced or Fabric Laminated pads meeting the requirements of Specification Section 932 for Ancillary Structures.
- 4. See Structures Plans, Superstructure Sheets for bridge information including concrete type, deck expansion joint locations and orientations, and thermal movement.
- 5. Railings:
  - A. For thermal movement greater than 4" (up to a maximum of 5"), clear opening between adjacent pickets, or panels at Rail Expansion Joints above Deck Joints must be reduced to  $3\frac{1}{2}$ ".
  - B. For treatment of railings on skewed bridges see Index 521-427.
- 6. Curbs:
  - A. Match open curb joints at Deck Expansion Joint locations to the deck joint dimension.
  - B. Construct Concrete Curb (Scheme 2) vertical with the top surface finished level transversely. See Concrete Curb Details Sheet 3.
- C. Provide  $\frac{3}{4}$ " Intermediate open joints in curbs coinciding with the  $\frac{3}{4}$ " joints in the traffic railing.
- 7. Payment: Support bracket (Scheme 3) is incidental to the cost of railing. Curb concrete and reinforcing steel (Scheme 2) are included in the bridge deck quantities.

REVISION 11/01/17

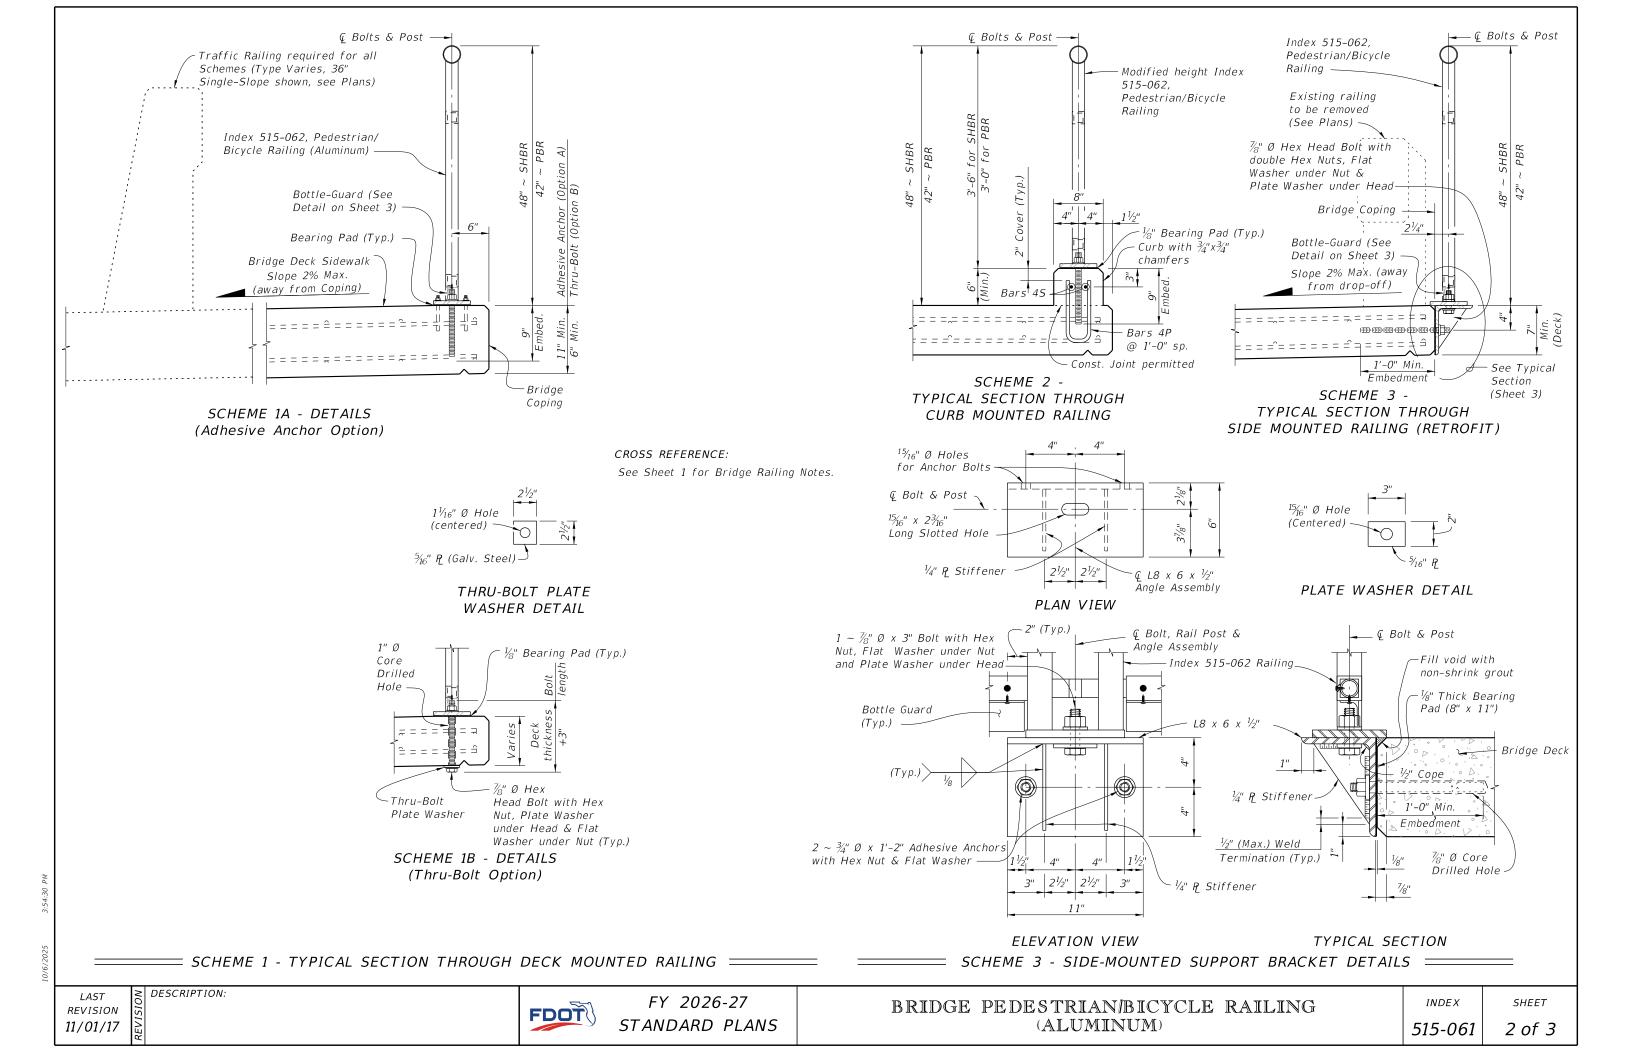


#### ROUND RAILS - TOP RAIL OR HANDRAIL

\*  $\frac{1}{4}$ " Ø x  $\frac{3}{4}$ " Pan Head Aluminum (Alloy 7075-T73) or Stainless Steel (Type 316 or 18-8 Alloy) Set Screws along outside face of railing. Set screws must be set flush against the rail surface. A 3/4" Ø plug weld may be substituted for the two set screws at expansion joints.

sharp edges (Typ.)

- \*\* Embedded length may be 4" for plug welded connection.
- \*\*\* Increase handrail sleeve embedment to 8" for Expansion Joint openings greater than 2".
- \*\*\*\* Expansion Joint opening shall match the clear opening in the deck joint but not greater than 3".

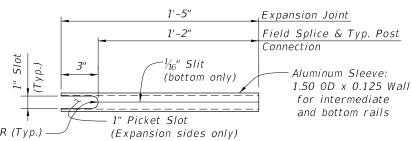

INTERMEDIATE OR BOTTOM RAIL - ALUMINUM SLEEVE DETAIL (Bottom Side Shown)

**LENGTH** 


2'-0"

As Regd.

As Regd.

BAR 4S

## DETAIL "B" EXPANSION JOINT (FIELD SPLICE SIMILAR) =

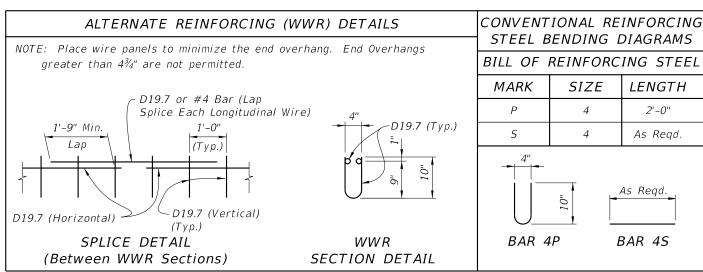

#### CURB REINFORCING STEEL NOTES:

ESTIMATED CONCRETE CURB

UNIT

CY/LF

LB/LF

ITEM

Reinforcing Steel

Concrete


- 1. All bar dimensions in the bending diagrams are out to out.
- 2. The reinforcement for the curb on a retaining wall shall be the same as detailed for an 8" deck.
- 3. All reinforcing steel at the open joints shall have a 2" minimum cover.
- 4. Bars 4S may be continuous or spliced at the construction joints. Bar splices for Bars 4S shall be a minimum of 1'-8".

QUANTITY

0.0124

4.01

5. Deformed WWR meeting the requirements of Specifications Section 931 may be used in lieu of all Bars 4P and 4S.

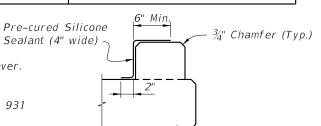

## DETAIL "A" - SECTION AT INTERMEDIATE OPEN JOINT

#### QUANTITIES (SCHEME 2) INTERMEDIATE JOINT SEAL NOTE:

At Intermediate Open Joints, seal the lower 6" portion of the open joint with Pre-cured Silicone Sealant. Apply sealant prior to any Class V finish coating and remove all curing compound and loose material from the surface prior to application of bonding agent.

## SCHEME 2 - CONCRETE CURB DETAILS =

DESCRIPTION:



FY 2026-27 STANDARD PLANS

BRIDGE PEDESTRIAN/BICYCLE RAILING (ALUMINUM)


INDEX

SHEET

î Rail, Bottle-Bottom Rail Guard and Screws #10 x 5/4" Pan Head Bottle Guard Screws (18-8 SS) 1½" x 1½" x ⅓" ∠ @ 2'-0" sp.

TYPICAL SECTION THROUGH BOTTOM RAIL (Post Not Shown for Clarity)

= SCHEME1 - BOTTLE GUARD DETAIL =

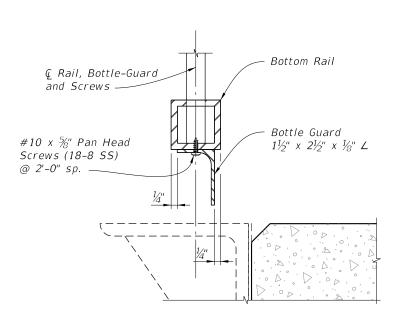

TYPICAL SECTION THROUGH BOTTOM RAIL (Post Not Shown for Clarity)

= SCHEME 3 - BOTTLE GUARD DETAIL =

REVISION 11/01/16

ADHESIVE-BONDED DOWELS: Adhesive Bonding Material Systems for Dowels shall comply with Specification Section 937 and be installed in accordance with Specification Section 416. The field testing proof loads required by Specification Section 416 shall be 23,800 lbs. for Dowel Bars 6D on the inside face (traffic side) of the railing (1'-0" embedment) and 18,500 lbs for Dowel Bars 6D along the outside face of the traffic railing (5" min. embedment).


BRIDGES ON CURVED ALIGNMENTS: The details presented in this Standard are shown for bridges on tangent alignments. Details for bridges on horizontally curved alignments are similar.

BARRIER DELINEATORS: Barrier Delineators shall meet Specification Section 993. Install Barrier Delineators on top of the Traffic Railing along the entire length of the bridge 2" from the face on the traffic side in accordance with Specification Section 705. Barrier Delineator color (white or yellow) shall match the color of the near edgeline.

GUARDRAIL: See Index 536-001 for guardrail component details, geometric layouts and associated notes not fully detailed


BRIDGE NAME PLATE: If a portion of the existing Traffic Railing is to be removed that carries the bridge name, number and or date, or if the installation of the Traffic Railing (Thrie Beam Retrofit) will obscure the bridge name, number and or date, then replace the information that has been removed or obscured, with 3" tall black lettering on white nonreflective sheeting applied to the top of the adjacent quardrail. The information must be clearly visible from the right side of the approaching travel lane. The sheeting and adhesive backing shall comply with Specification Section 994 and may comprise individual decals of letters and numbers.


PAYMENT: Concrete Traffic Railing-Bridge Retrofit - Post & Beam Railing (EA) includes all material and labor required to demolish a portion of the existing structure where required and to construct the concrete portion of the retrofit railing, Guardrail Approach Transition to rigid Barriers (EA) includes transition block, and necessary hardware to complete the Guardrail transitions shown.

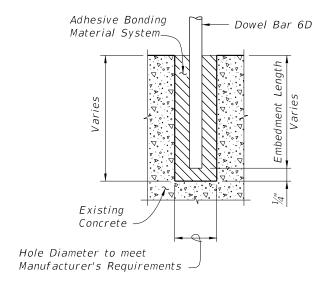



#### DOWEL DETAIL


Note: Shift dowel holes to clear if the existing reinforcement is encountered.

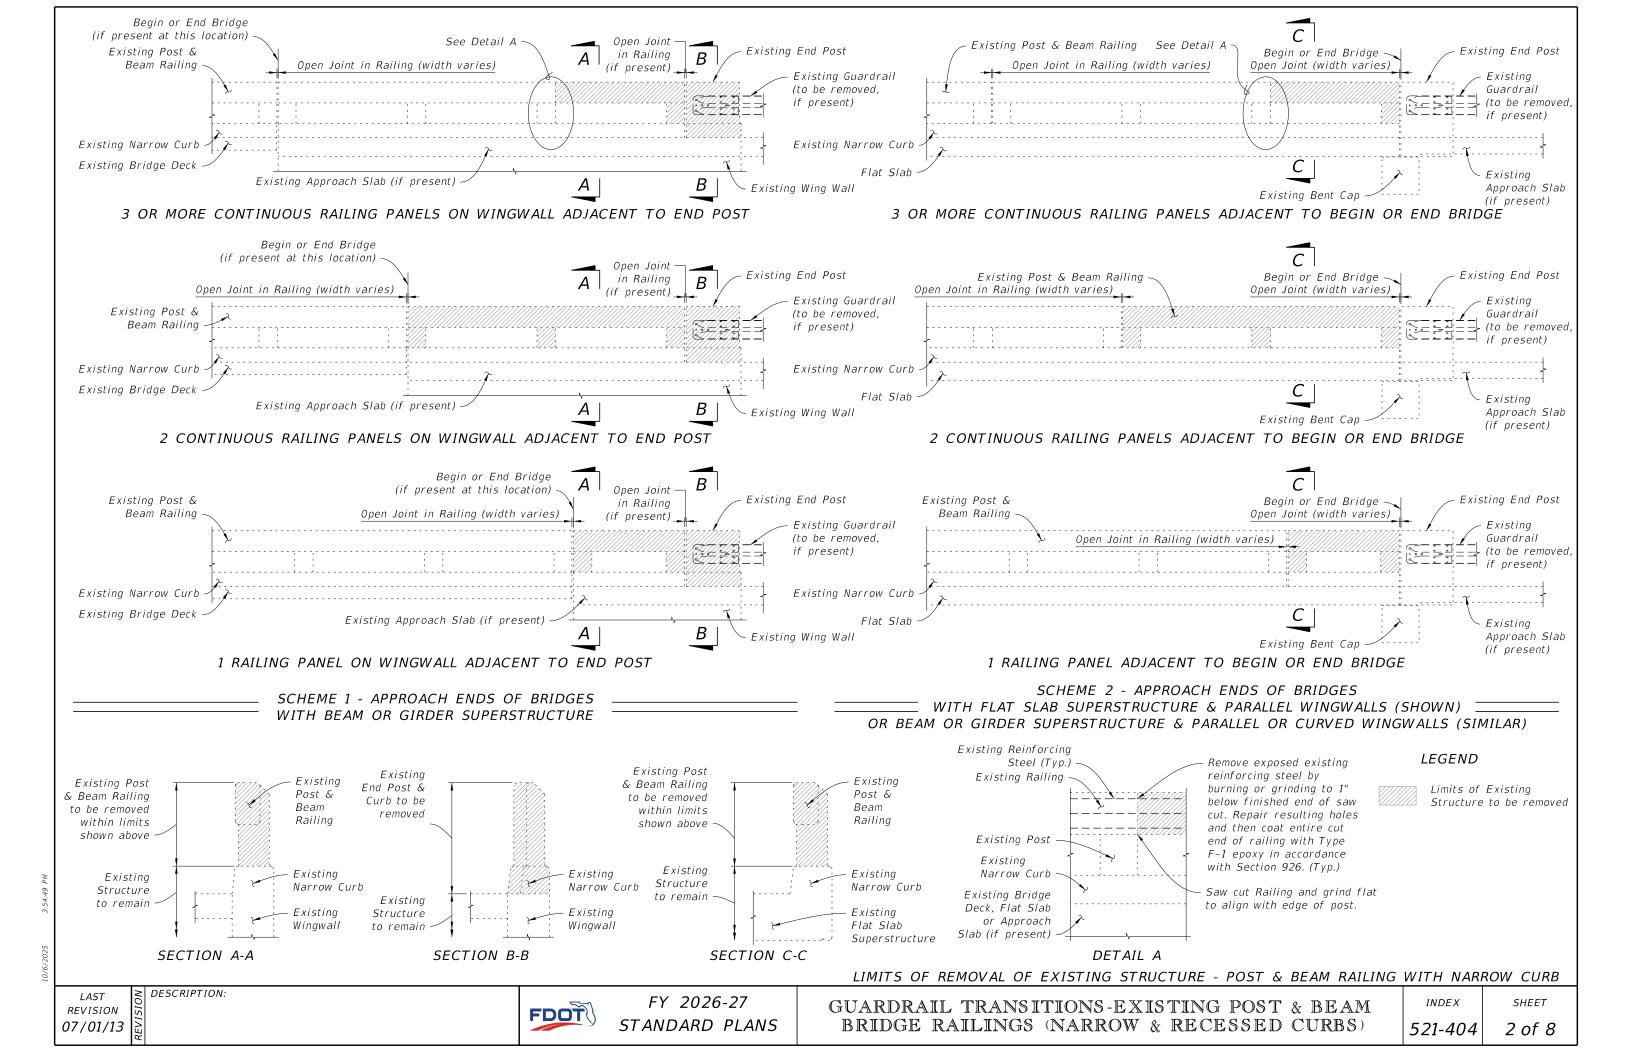

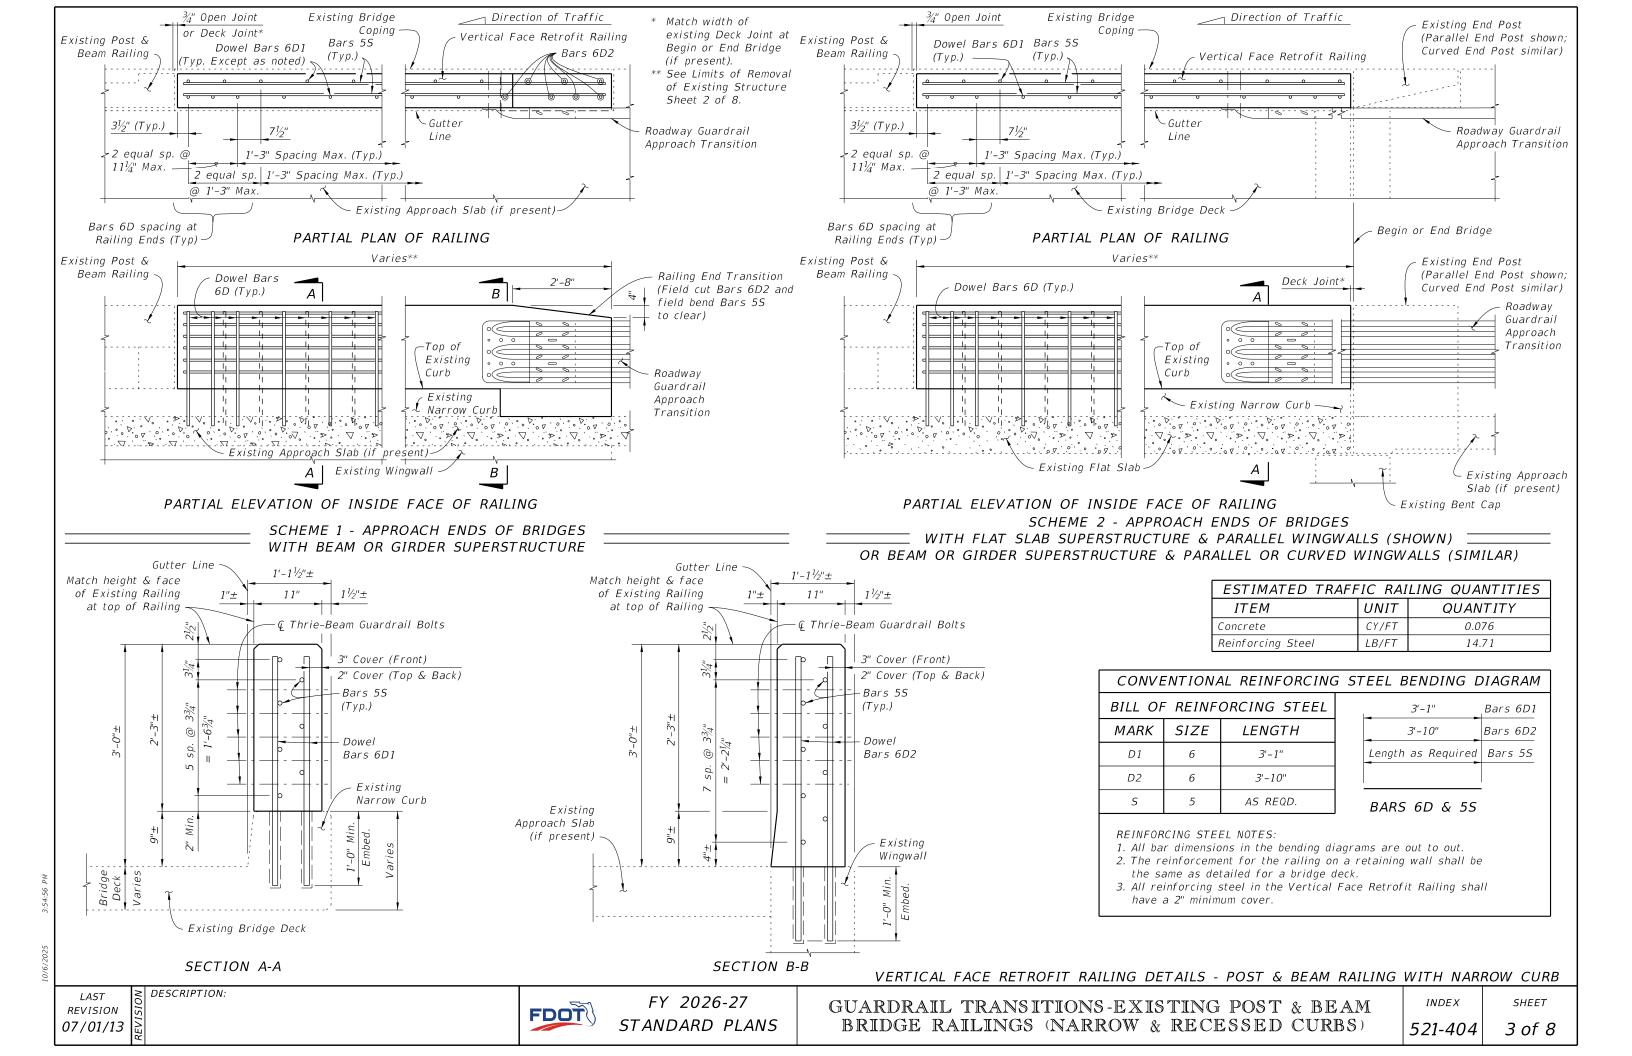

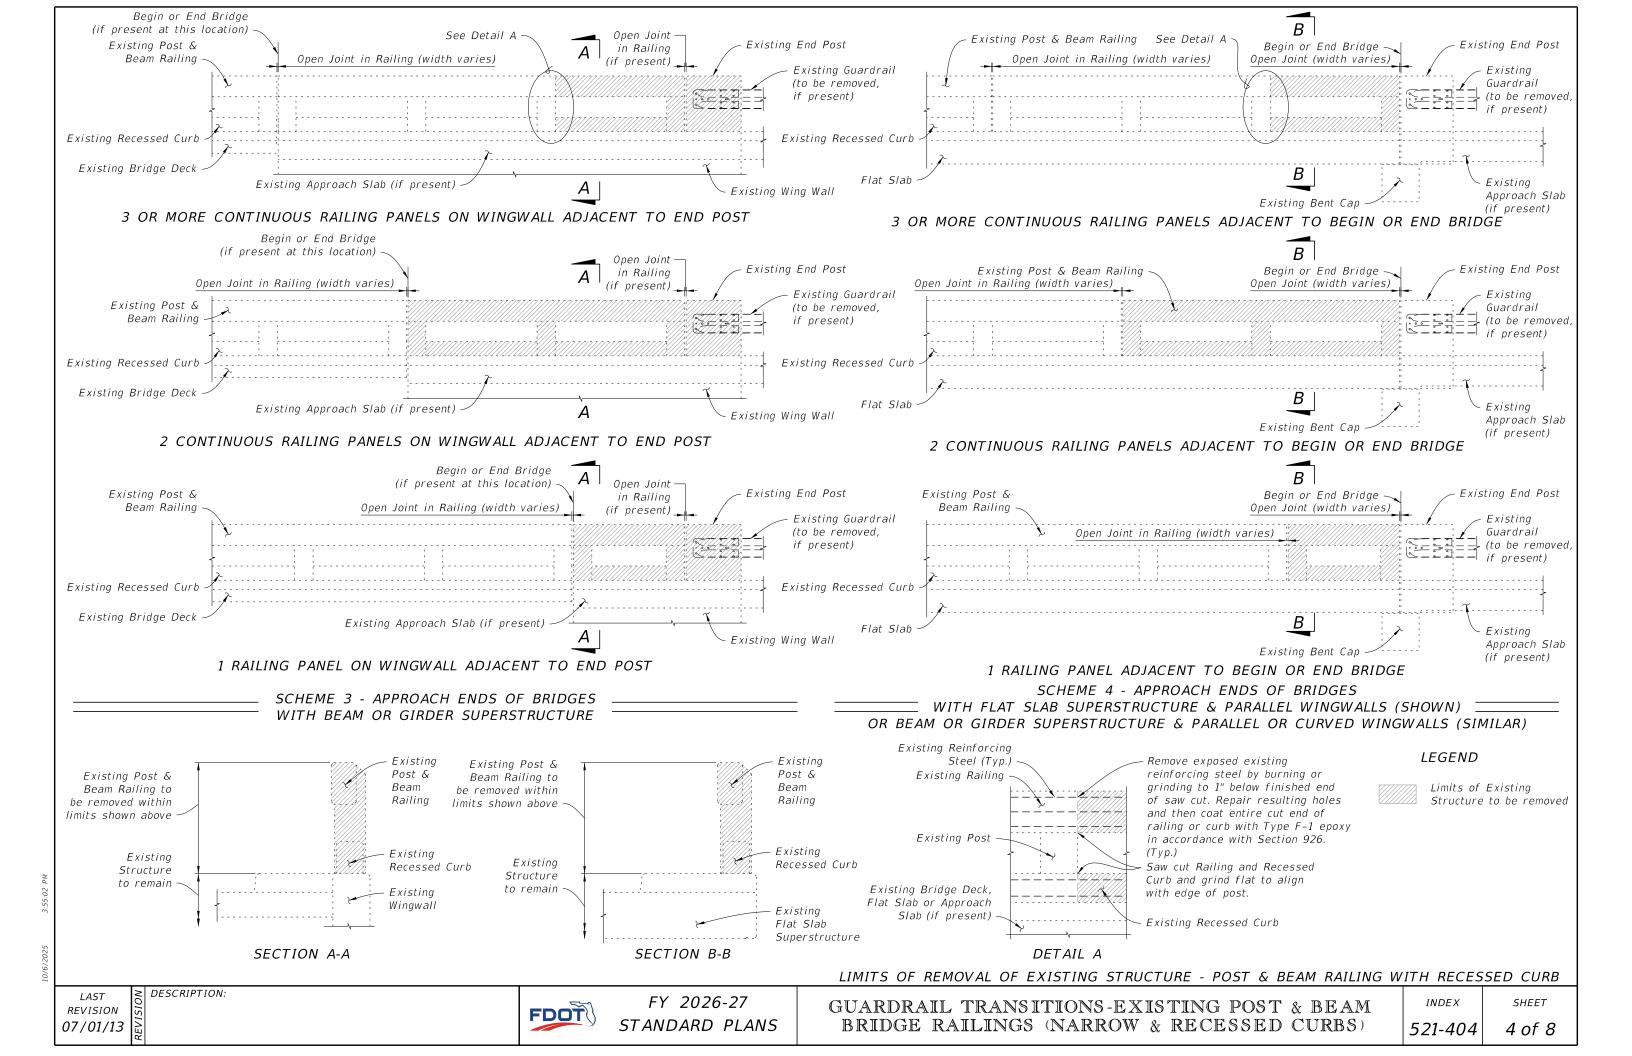


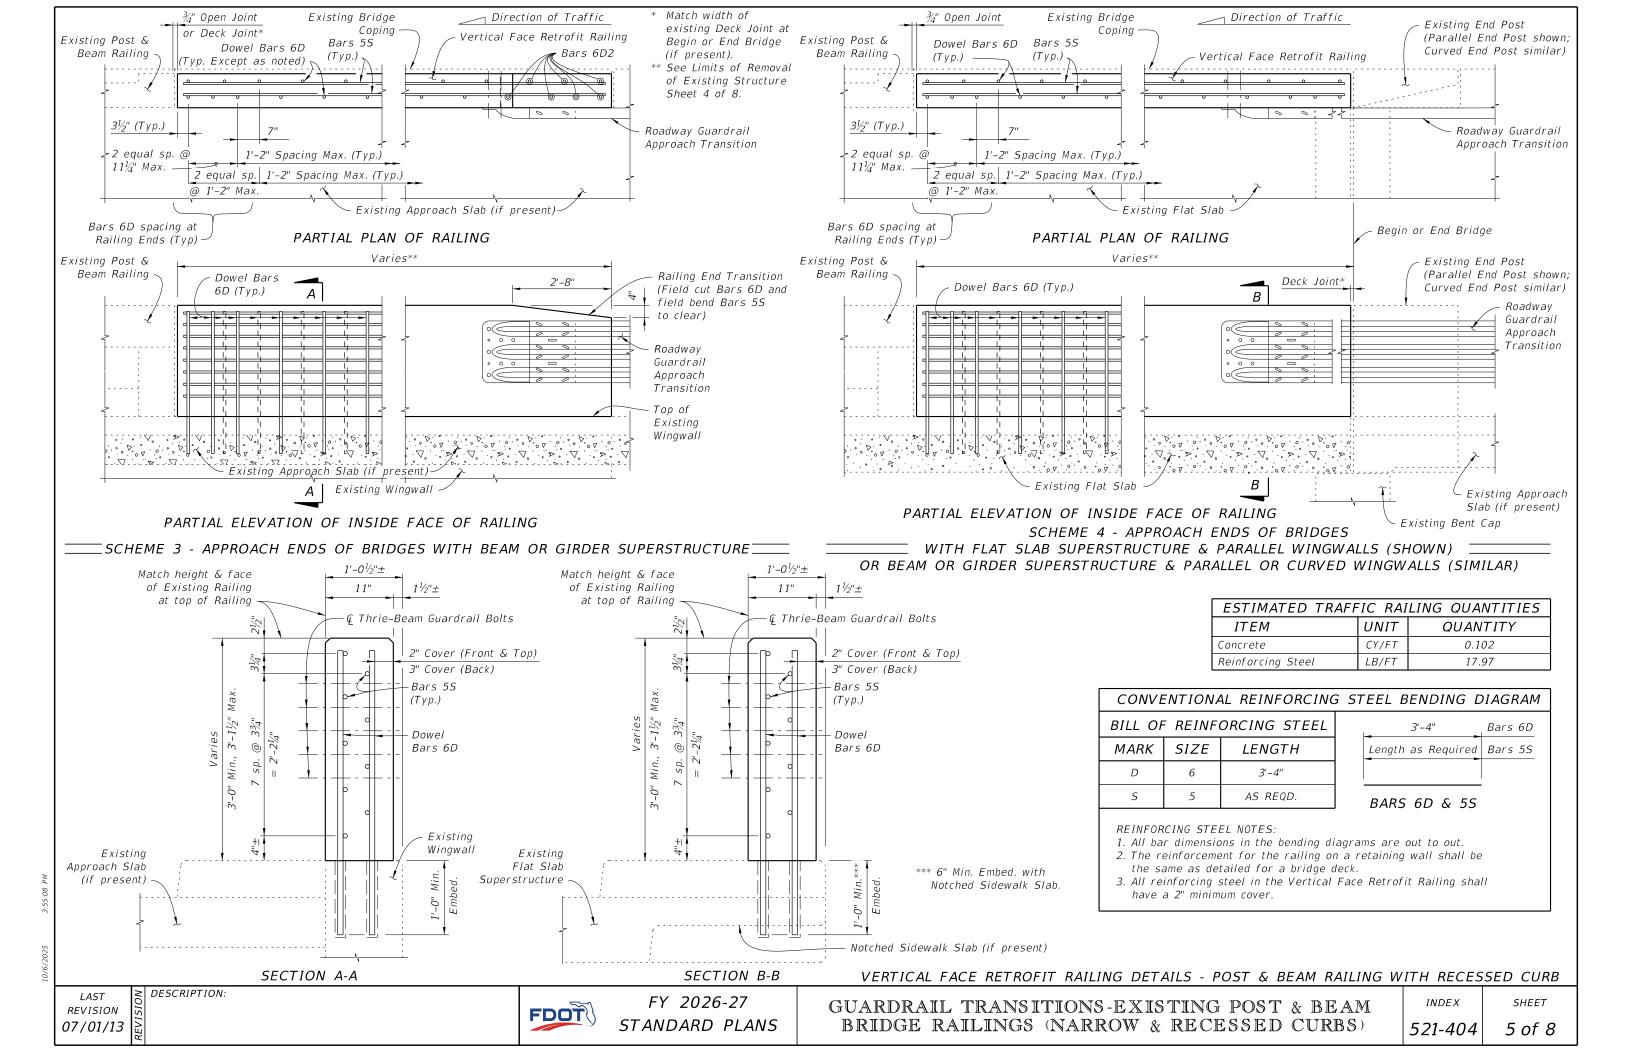


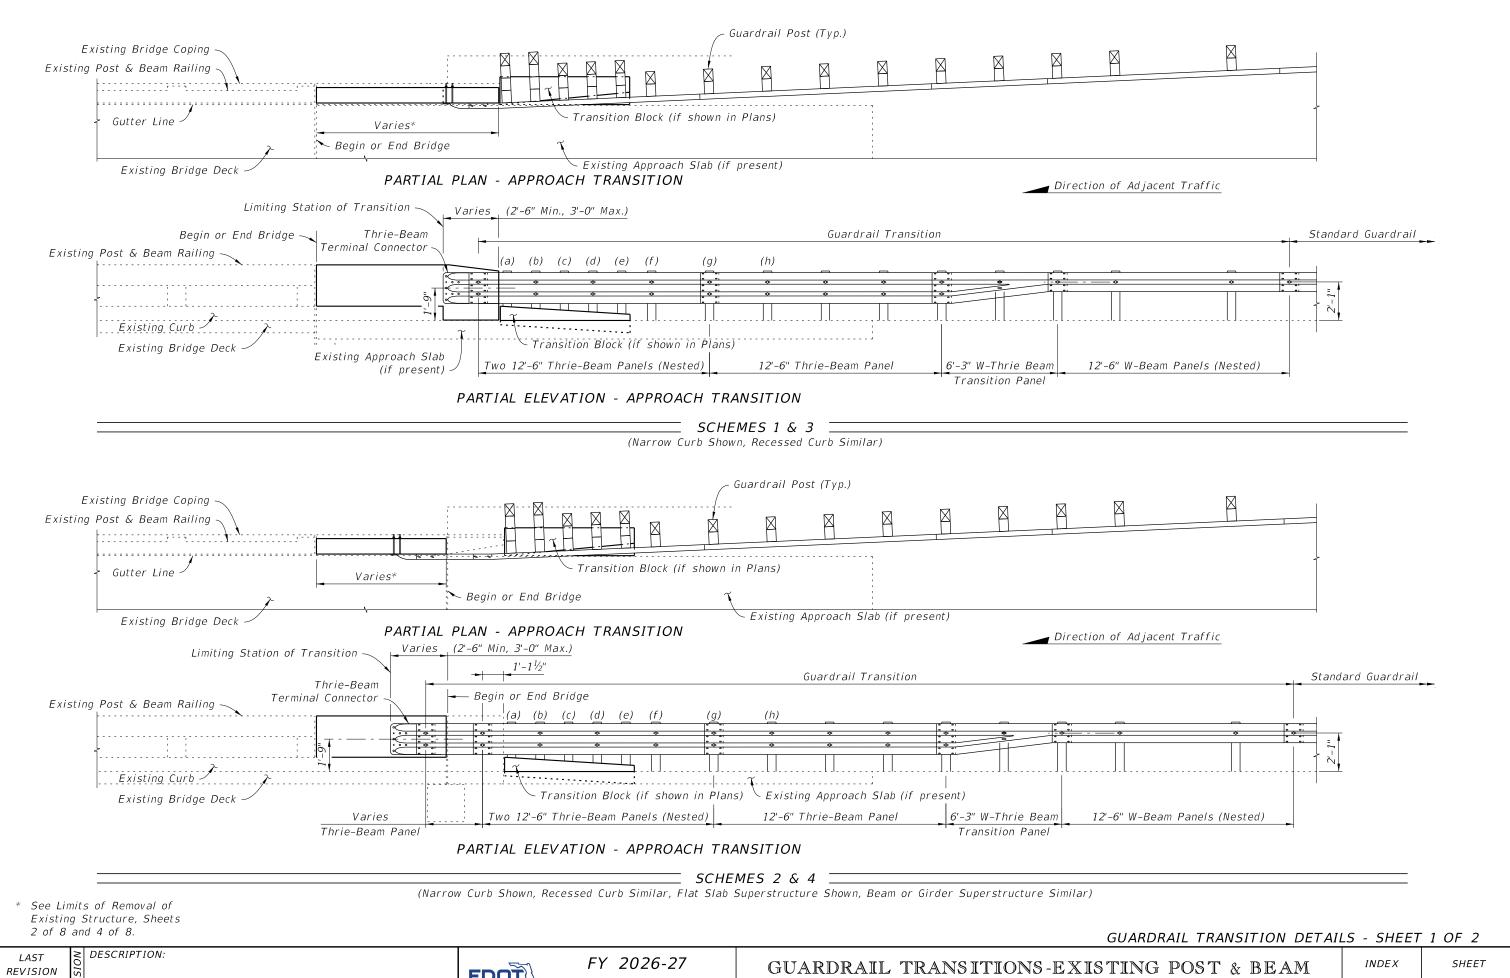

07/01/14

FDOT

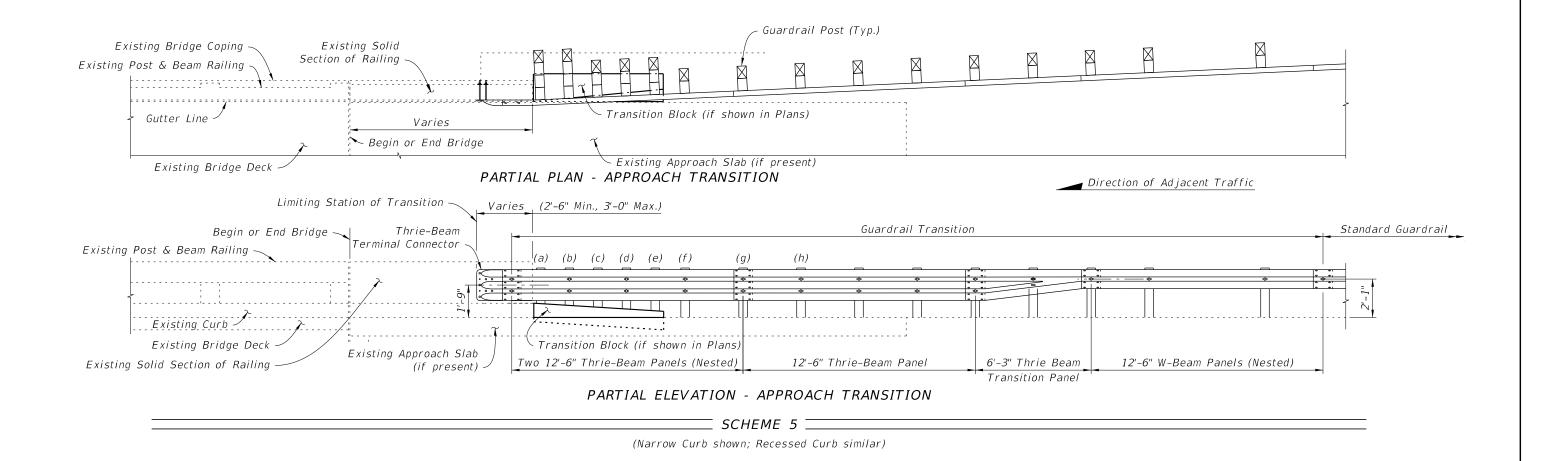

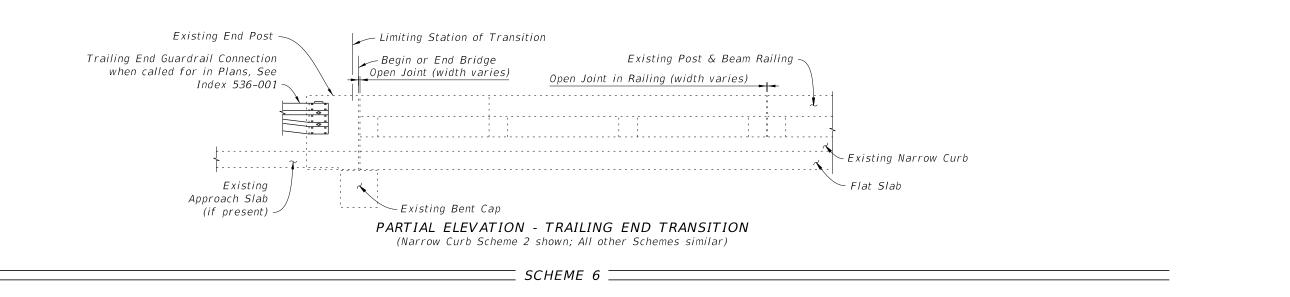

FDOT


GUARDRAIL TRANSITION DETAILS - SHEET 2 OF 2

LAST REVISION 11/01/25 DESCRIPTION:

STANDARD PLANS


*521-404* 7 of 8

PLAN VIEW OF TRANSITION BLOCK (GUARDRAIL NOT SHOWN FOR CLARITY)

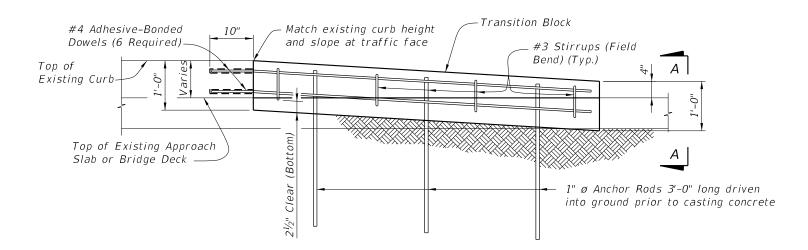


ELEVATION OF TRANSITION BLOCK (GUARDRAIL AND POSTS NOT SHOWN FOR CLARITY)

ESTIMATED QUANTITIES PER TRANSITION BLOCK		
ITEM	UNIT	QUANTITY
Concrete Class II (Bridge Deck)	CY	0.4
Reinforcing Steel	LB	61

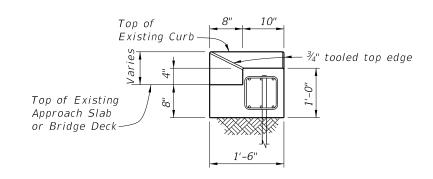

END VIEW A-A



#3 STIRRUP (FIELD BEND)

NOTES:

ANCHOR RODS: Steel Anchor Rods shall be ASTM A36, ASTM A709 Grade 36 or ASTM A615 Grade 60 hot-dip galvanized in accordance with Specification Section 962.

ADHESIVE-BONDED DOWELS: Adhesive Bonded Dowels are shown installed in an existing curb or sidewalk integrally reinforced with Approach Slab, Wingwall or Bridge Deck. For installations in existing detached curbs or sidewalks, install dowels in available sound concrete.

Shift bars (as needed) to install six dowels into existing bridge or approach slab mounted curb.

REINFORCING STEEL: Reinforcing steel shall be ASTM A615, Grade 60, except Expansion Dowel Bar B which shall be ASTM A36 smooth round bar hot-dip galvanized in accordance with the Specifications.

EXPANSION SLEEVE ASSEMBLY: Pipe sleeve shall be ASTM D2241 PVC pipe, SDR13.5. End Cap shall be ASTM D2466 PVC socket fitting, Schedule 40. End of Sleeve assembly at railing open joint shall be sealed with silicone to prevent concrete intrusion during railing casting. A compressible expanded polystyrene plug is required in the opposite end of the assembly for correct dowel positioning during railing casting. Correct dowel positioning is required in order to provide for thermal movement of the deck.

ADHESIVE-BONDED ANCHORS AND DOWELS: Adhesive Bonding Material Systems for Anchors and Dowels shall comply with Specification Section 937 and be installed in accordance with Specification Section 416. The field testing proof loads required by Specification Section 416 shall be 23,800 lbs. for Dowel Bars 6D on the inside face (traffic side) of the railing (1'-0" embedment) and 18,500 lbs for Dowel Bars 6D along the outside face of the traffic railing (5" min. embedment).


BRIDGES ON CURVED ALIGNMENTS: The details presented in these Standards are shown for bridges on tangent alignments. Details for bridges on horizontally curved alignments are similar.

BARRIER DELINEATORS: Barrier Delineators shall meet Specification Section 993. Install barrier delineators on top of the Traffic Railing along the entire length of bridge 2" from the face on the traffic side in accordance with Specification Section 705. Barrier Delineator color (white or yellow) shall match the color of the near edgeline.

PAYMENT: Concrete Traffic Railing - Bridge Retrofit - Post & Beam Railing (each) includes all materials and labor required to demolish a portion of the existing structure where required and to construct the concrete portion of the retrofit railings. Guardrail Approach Transition to Rigid Barriers (EA) includes all transition blocks, and necessary hardware to complete the Guardrail transitions shown.


ESTIMATED TRAFFIC RAILING QUANTITIES			
ITEM	LINIT	QUAN	ITITY
11 E M	UNIT	9" Curb	Increment
Concrete	CY/FT	0.064	0.003 per in. height
Reinforcing Steel	LB/FT	13.27	0.10 per in. length

(Quantities are based on a 9" curb, no curb cross slope and 1'-0" embedment length of Bars 6D. If the curb height or embedment length differs from that shown, increase or decrease quantity by the given per inch increment.)

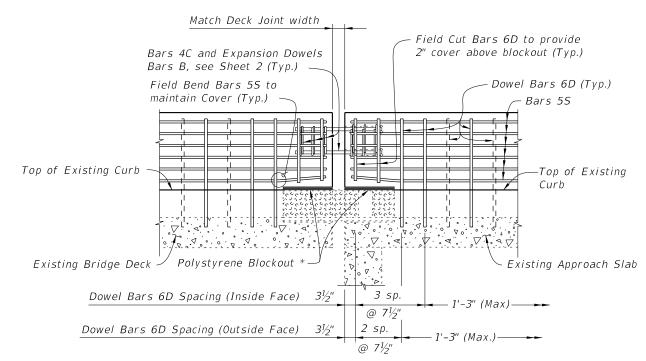


PARTIAL ELEVATION OF RAILING SHOWING FINGER/SLIDING PLATE JOINT AT BEGIN OR END BRIDGE - SCHEMES 2 THRU 5

\* Place 1" thick polystyrene blockout over limits of bridge deck expansion joint full width to the end of the Traffic Railing to allow for thermal movement. Seal Forms to prevent mortar leakage into the expansion joint.

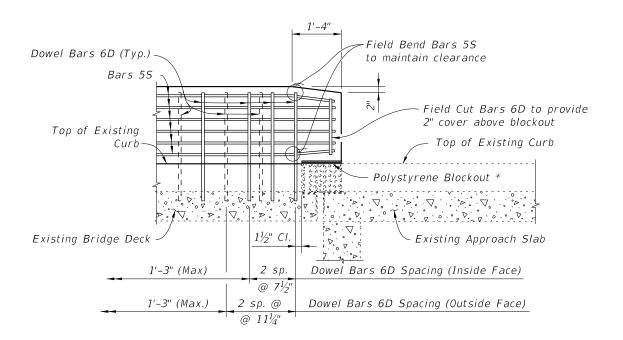


PARTIAL ELEVATION OF RAILING SHOWING FINGER/SLIDING PLATE
JOINT AT BEGIN OR END BRIDGE - SCHEME 1
(Guardrail Transition not shown for clarity)

3:55:34 PI

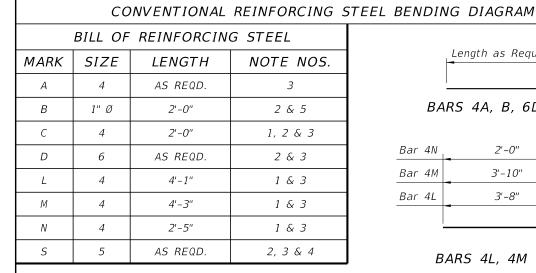


#### REINFORCING STEEL NOTES:

- 1. All bar dimensions in the bending diagrams are out to out. 2. The reinforcement for the railing on a retaining wall shall
- be the same as detailed for a bridge deck.
- 3. All reinforcing steel in the Vertical Face Retrofit Railing shall have a 2" minimum cover.
- 4. Bars 5S may be continuous or spliced at the construction joints. Bar splices for Bars 5S shall be a minimum of 2'-
- 5. Expansion Dowel Bars B shall be ASTM A36 smooth round bar and hot-dip galvanized in accordance with the Specifications.

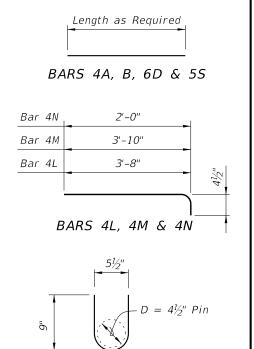


BARS 4C

(12 required per open joint)

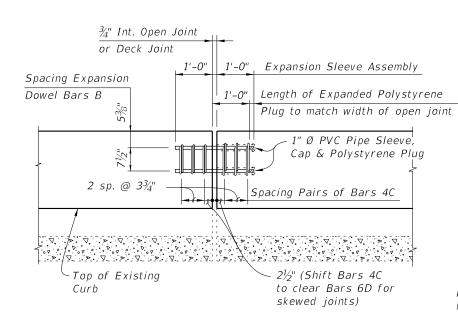


OPEN JOINT EXPANSION DOWEL DETAIL (Railing Reinforcing Not Shown For Clarity)

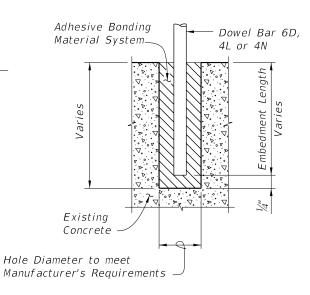

## DOWEL DETAIL

Dowel Installation Note: Shift dowel holes to clear if the existing reinforcement is encountered.

\*  $\frac{1}{2}$ " Preformed Joint Filler at top of Existing Curb shall extend beyond the joint material (Silicone, poured rubber, armored neoprene seal or sliding plates) as shown to prevent concrete intrusion during railing casting and shall be placed so as not to restrict in any way normal joint movement.

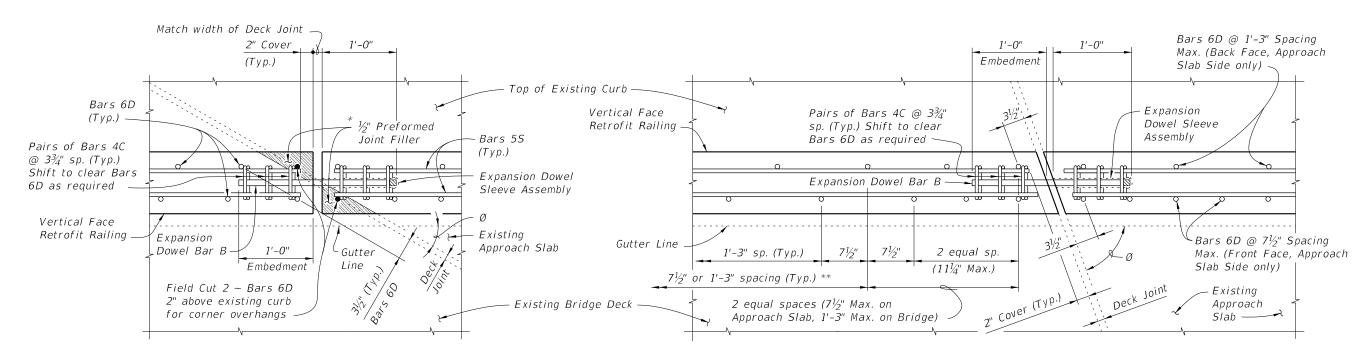

PARTIAL PLAN OF RAILING (SKEW ANGLE Ø LESS THAN 70°)

PARTIAL PLAN OF RAILING (SKEW ANGLE  $\emptyset = 70^{\circ}$  OR GREATER)

SKEW DETAIL

REVISION 07/01/13

DESCRIPTION:

FDOT


FY 2026-27 STANDARD PLANS

POST & BEAM BRIDGE RAILINGS (WIDE CURBS)

INDEX

SHEET


521-405 2 of 6

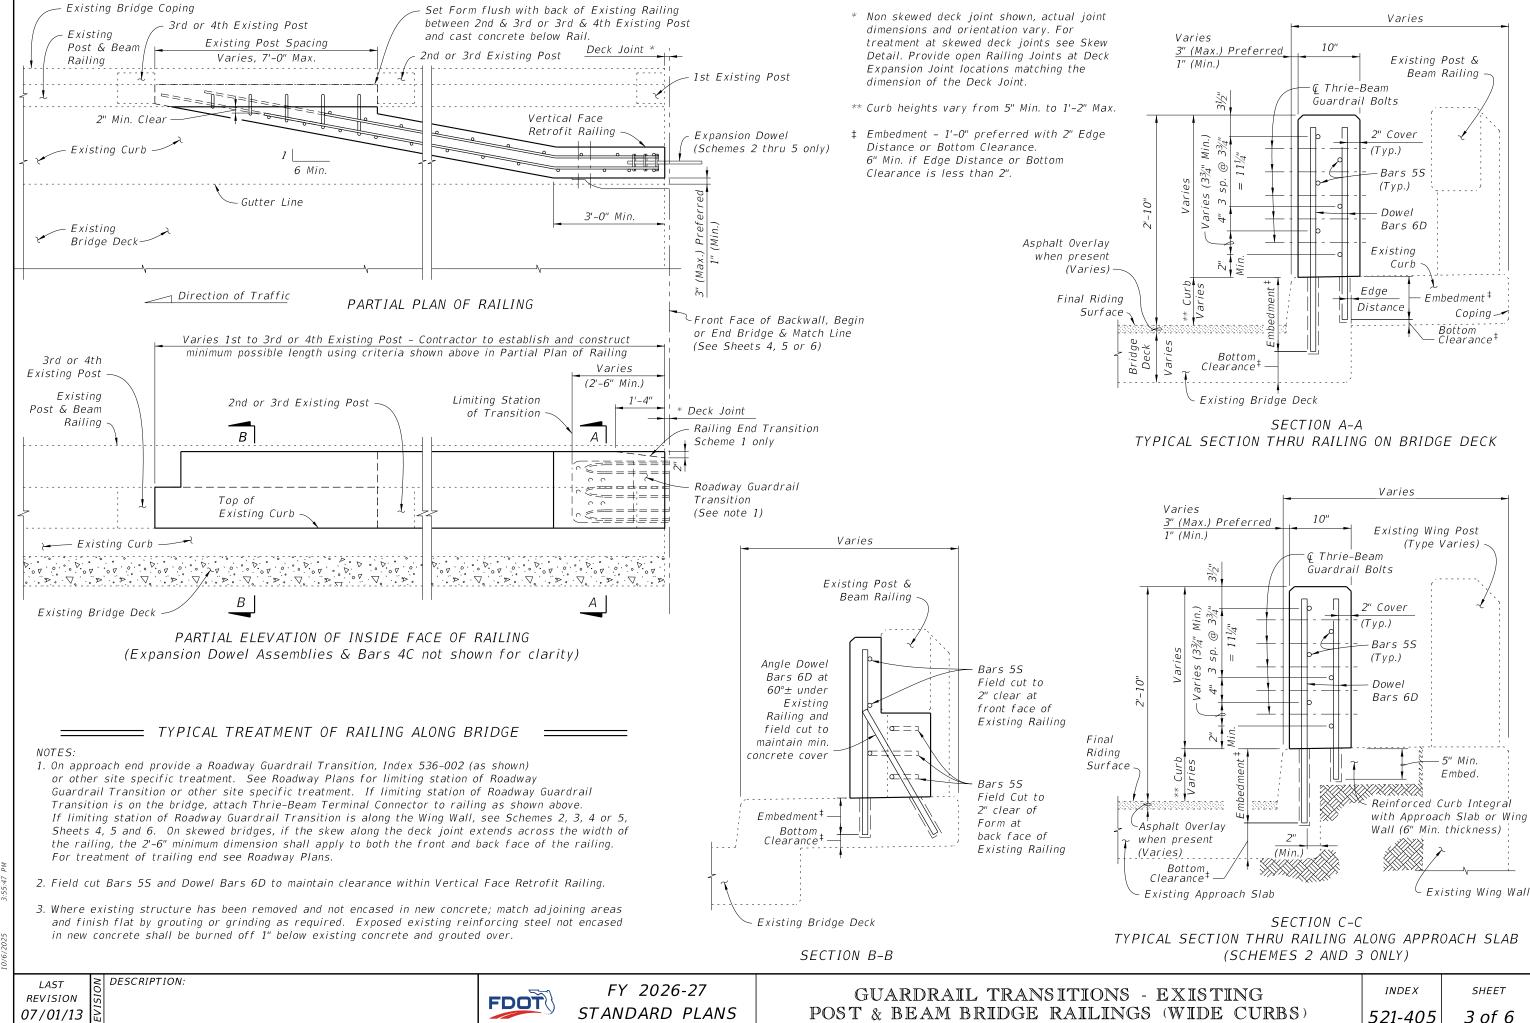





DESCRIPTION:

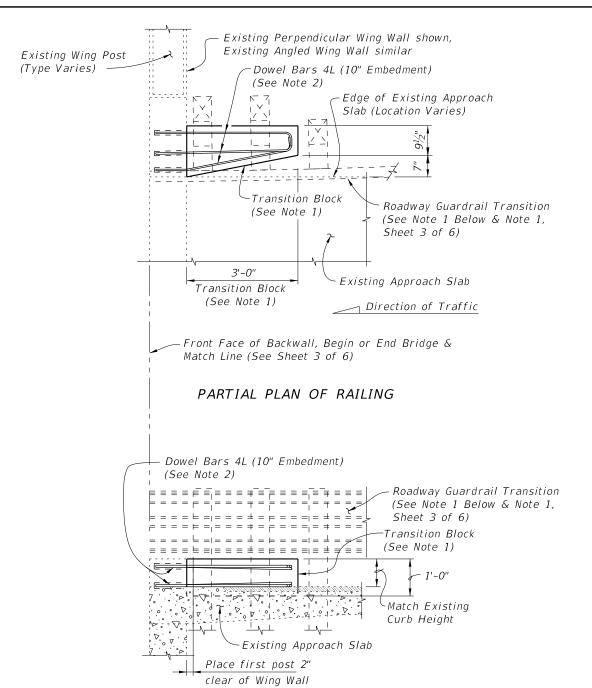


PARTIAL ELEVATION OF INSIDE FACE OF GUARDRAIL (Existing Wing Post not shown for clarity)

## === SCHEME 1 === RAILING END TREATMENT FOR PERPENDICULAR OR ANGLED WING WALLS

## SCHEME 1 NOTES:

- 1. Provide Transition Block (as shown) or Curb if existing Approach Slab does not have a curb, see Roadway Plans. Shape and height of Transition Block or Curb shall match existing bridge curb. Railing End Transition and Transition Block may be omitted on trailing ends with no opposing traffic.
- 2. Field bend Dowel Bars 4L within Transition Block as required to maintain 2" top and side clearance and 3" bottom clearance.
- 3. If a Special Steel Guardrail Post is required for attachment to the top of a sloping Wing Wall, saw cut and remove a wedge shaped portion of the sloping Wing Wall as required to provide a level surface for post installation.

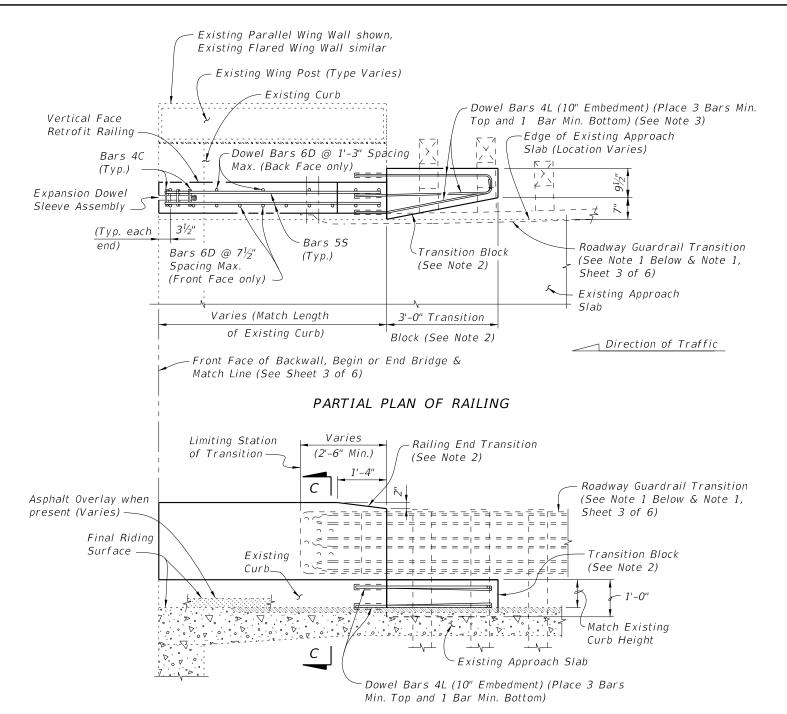


PARTIAL ELEVATION OF INSIDE FACE OF RAILING (Existing Wing Post, Railing Reinforcing and Expansion Dowel Assemblies not shown for clarity)


> \_\_\_\_\_\_ SCHEME 2 \_\_\_\_\_ RAILING END TREATMENT FOR PARALLEL CURBS

SCHEME 2 NOTES:

- 1. See Roadway Plans for limiting station of Roadway Guardrail Transition or other site specific treatment. If limiting station of Roadway Guardrail Transition is along the Wing Wall, attach Thrie-Beam Terminal Connector to railing as shown above. If limiting station of Roadway Guardrail Transition is on the bridge, see Sheet 3 of 6. On skewed bridges, if the skew along the deck joint extends across the width of the railing, the 2'-6" minimum dimension shall apply to both the front and back face of the railing.
- 2. Provide Transition Block (as shown) or Curb if existing Approach Slab Curb does not extend beyond end of existing End Bent Wing Wall, see Roadway Plans. Shape and height of Transition Block or Curb shall match existing bridge curb. Railing End Transition and Transition Block may be omitted on trailing ends with no opposing traffic.
- 3. Field bend Dowel Bars 4L within Transition Block as required to maintain 2" top and side clearance and 3" bottom clearance.

FY 2026-27 FDOT STANDARD PLANS

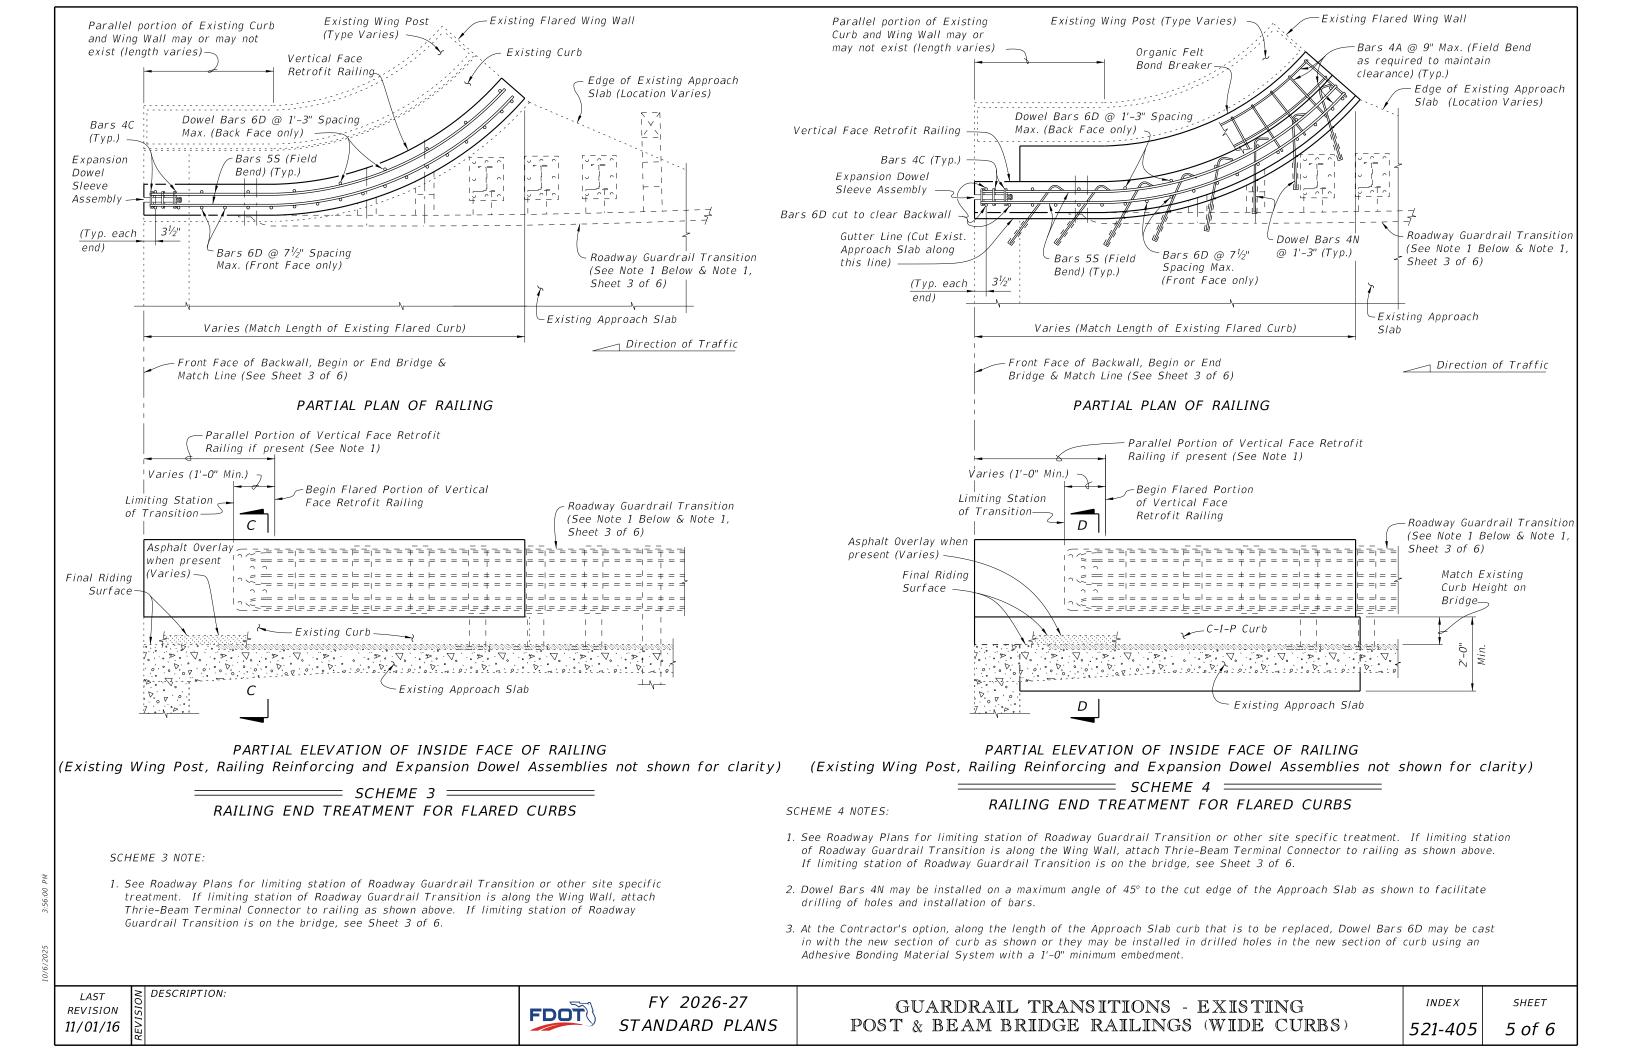

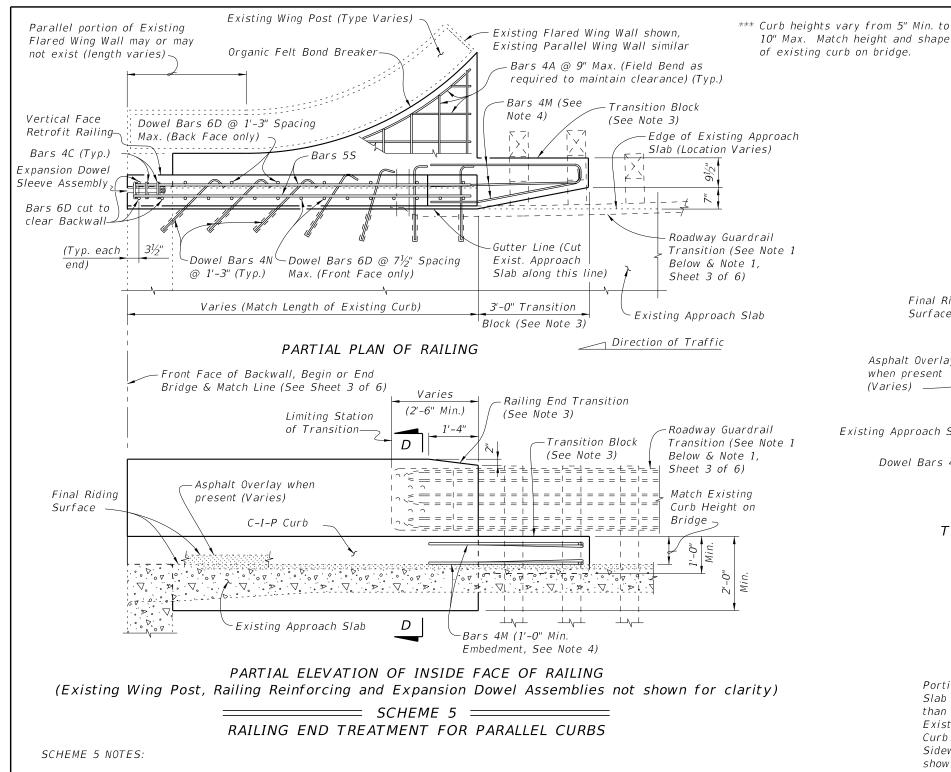


- 1. See Roadway Plans for limiting station of Roadway Guardrail Transition or other site specific treatment. If limiting station of Roadway Guardrail Transition is along the Wing Wall, attach Thrie-Beam Terminal Connector to railing as shown above. If limiting station of Roadway Guardrail Transition is on the bridge, see Sheet 3 of 6.
- 2. Dowel Bars 4N may be installed on a maximum angle of 45° to the cut edge of the Approach Slab as shown to facilitate drilling of holes and installation of bars.
- 3. Provide Transition Block (as shown) or Curb if existing Approach Slab Curb does not extend beyond end of existing End Bent Wing Wall, see Roadway Plans. Shape and height of Transition Block or Curb shall match existing bridge curb. Railing End Transition and Transition Block may be omitted on trailing ends with no opposing traffic.
- 4. Field bend Dowel Bars 4M within Transition Block as required to maintain 2" top and side clearance and 3" bottom clearance.
- 5. At the Contractor's option, along the length of the Approach Slab curb that is to be replaced, Dowel Bars 6D may be cast in with the new section of curb as shown or they may be installed in drilled holes in the new section of curb using an Adhesive Bonding Material System with a 1'-0" minimum embedment.

10" Max. Match height and shape Varies (1'-2" Min.) of existing curb on bridge. Varies 3" (Max.) Preferred 1" Min. Existing Wing Post ⊊ Thrie-Beam (Type Varies) Guardrail Bolts 2" Clear Min.) 3¾", (Typ.)(3¾" Bars 5S (Typ.)Dowel Bars 6D (See Note 5) Organic Felt Bond Breaker Final Riding Surface Bars 4A @ 9" Max. Asphalt Overlay when present 2" Min. Clear. Top (Varies) and Sides, 4" Min. Clear. Bottom + Existing Approach Slab Dowel Bars 4N @ 1'-3" (Typ.) Embedmen Bars 4A @ 9" Max., Min. 3 full length bars required Top & Bottom (Field Bend to clear) (Typ.) SECTION D-D

Varies

TYPICAL SECTION THRU RAILING ALONG APPROACH SLAB (SCHEME 4 SHOWN, SCHEME 5 SIMILAR)

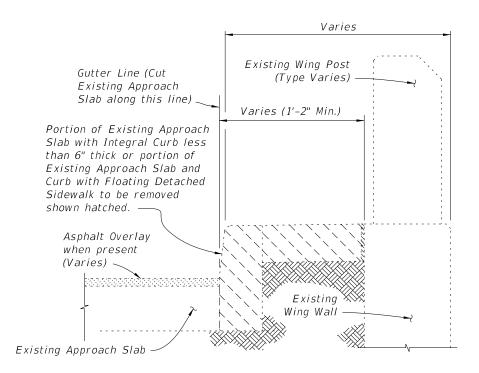

TYPICAL SECTION THRU EXISTING APPROACH SLAB AND END BENT WING WALL SHOWING LIMITS OF REMOVAL (SCHEMES 4 AND 5 ONLY)

REVISION 11/01/16

DESCRIPTION:


FDOT

FY 2026-27 STANDARD PLANS

GUARDRAIL TRANSITIONS - EXISTING POST & BEAM BRIDGE RAILINGS (WIDE CURBS)

INDEX *521-405* 


SHEET 6 of 6

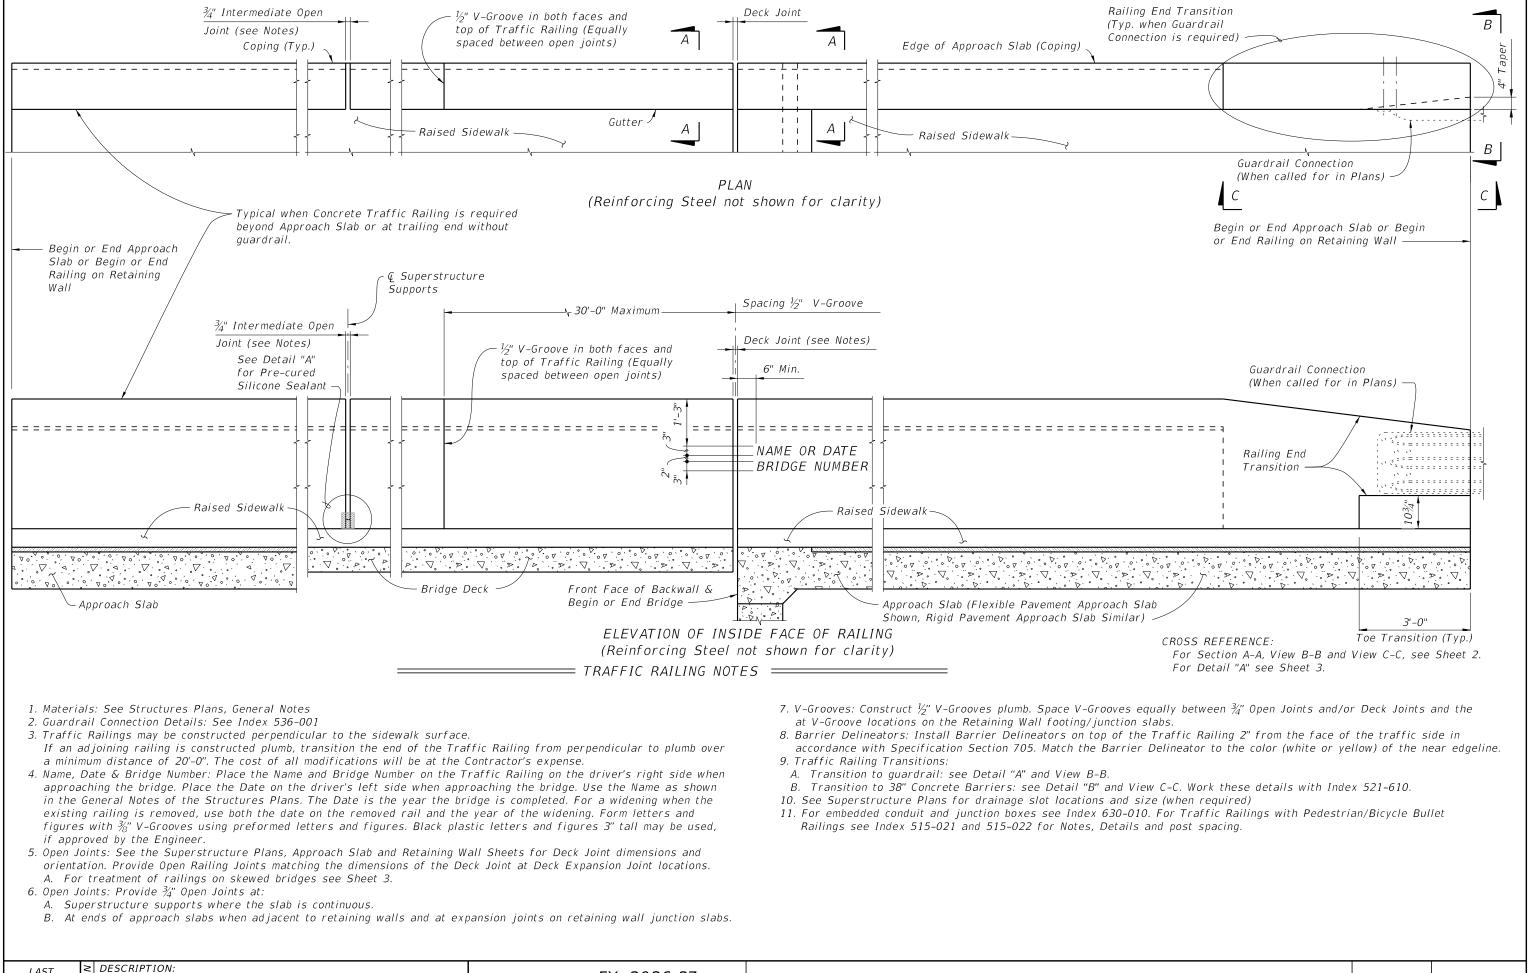


1

LAST REVISION 11/01/20

FDOT

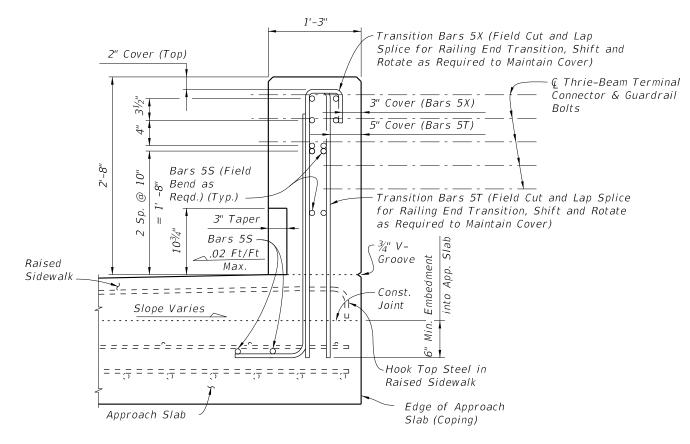

VIEW B-B (END VIEW OF TRAFFIC RAILING END TRANSITION) (Approach Slab shown, Retaining Wall Junction Slab similar)



2'-0" ← Thrie-Beam Terminal Connector Bolts Bars 5X @ 1'-0" sp. (Max.) 11". Field Bend  $2^{1/2}$ " 111/2" 8" Bars 5T @ 1'-0" sp. (Max.) Bars 5S as Required -В Bars 5S Transition Bars 5T Field Cut, Lap Splice (2'-2" Min.) Approach Slab Transition Bars 5X Raised Sidewalk-Field Cut & Lap 3'-0" Taper

6'-8"

CROSS REFERENCE: For location of Section A-A, View B-B and View C-C, see Sheet 1.

## NOTES:

- 1. Begin placing Railing Bars 5T and 5X on Approach Slab at the railing end and proceed toward Begin or End Bridge to avoid conflict with guardrail bolt holes. If required, adjustments to the bar spacing for Bars 5T and 5X shall be made immediately adjacent to Begin or End Bridge. Cut, shift and rotate Bars 5T and 5X as required to maintain cover in Railing End Transition.
- 2. Omit Railing End Transition and Guardrail if Concrete Traffic Railing is used beyond the Approach Slab or Retaining Wall. See Structures Plans, Plan and Elevation Sheet and Roadway Plans. If Taper and Railing End Transition is omitted, extend Typical Section to end of the Approach Slab or limiting station on Retaining Wall, and space Bars 5T and 5X at 1'-0" (Typ.)

VIEW C-C RAILING END TRANSITION (Guardrail Not Shown For Clarity)

REVISION 11/01/25

DESCRIPTION:




Splice (2'-2" Min.) —

*521-422* 2 of 3


## CONVENTIONAL REINFORCING STEEL BENDING DIAGRAMS

BILL OF REINFORCING STEEL			
MARK	SIZE LENGTI		
S	5	As Reqd.	
T	5	10'-8"	
Χ	5	6'-9"	


ROADWAY	ØA	
CROSS-SLOPE	LOW GUTTER	HIGH GUTTER
0% to 2%	90°	90°
2% to 6%	87°	8 <i>3</i> °
6% to 10%	84°	96°




BAR 5S




STIRRUP BAR 5T




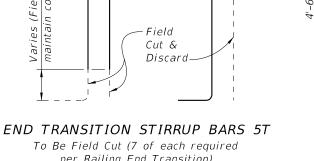

To Be Field Cut (7 of each required per Railing End Transition)



STIRRUP BAR 5X




END TRANSITION STIRRUP BARS 5X To Be Field Cut (7 of each required per Railing End Transition)

#### REINFORCING STEEL NOTES:


- 1. All bar dimensions in the bending diagrams are out to out.
- 2. The  $4'-6^{3}/4''$  vertical dimension shown for Bars 5T and 5X is based on a bridge deck with a 6" thick x 6' wide raised sidewalk at low side of deck, 2% deck cross slope and a counter 2% raised sidewalk cross slope. If the raised sidewalk thickness, width or cross slope vary from the above amounts, adjust this dimension accordingly to achieve a 6" minimum embedment into the bridge deck. See Structures Plans, Superstructure and Approach Slab Sheets.
- 3. The reinforcement for the railing on a retaining wall shall be the same as detailed above with
- 4. All reinforcing steel at the open joints shall have a 2" minimum cover.
- 5. Bars 5S may be continuous or spliced at the construction joints. Bar splices for Bars 5S shall be a minimum of 2'-2".
- 6. The Contractor may utilize Welded Wire Reinforcement (WWR) when approved by the Engineer. WWR must consist of Deformed wire meeting the requirements of Specification Section 931.

#### INTERMEDIATE JOINT SEAL NOTES:

- 1. At Intermediate Open Joints, seal the lower 6" portion of the open joint with Pre-cured Silicone Sealant in accordance with Specification Section 932.
- 2. Apply sealant prior to any Class V finish coating and remove all curing compound and loose material from the surface prior to application of bonding agent.
- 3. The cost of the Pre-cured Silicone Sealant shall be included in the Contract Unit Price for the Traffic Railing.
- 4. As an alternative option, a mortar plug may be used to seal the joint as shown in the mortar plug detail and in accordance with Specification Section 400.




OPTION I



OPTION II (Alternative Mortar Plug at Open Joint)


DETAIL "A"



## SECTION THRU RECESSED "V" GROOVE TO FORM INSCRIBED LETTERS AND FIGURES

ESTIMATED TRAFFIC RAILING QUANTITIES		
ITEM	UNIT	QUANTITY
Concrete	CY/LF	0.145
Reinforcing Steel	LB/LF	30.68

(The above quantities are based on a 6" thick x 6' wide raised sidewalk at low side of deck, 2% deck cross slope and counter 2% sidewalk cross slope)

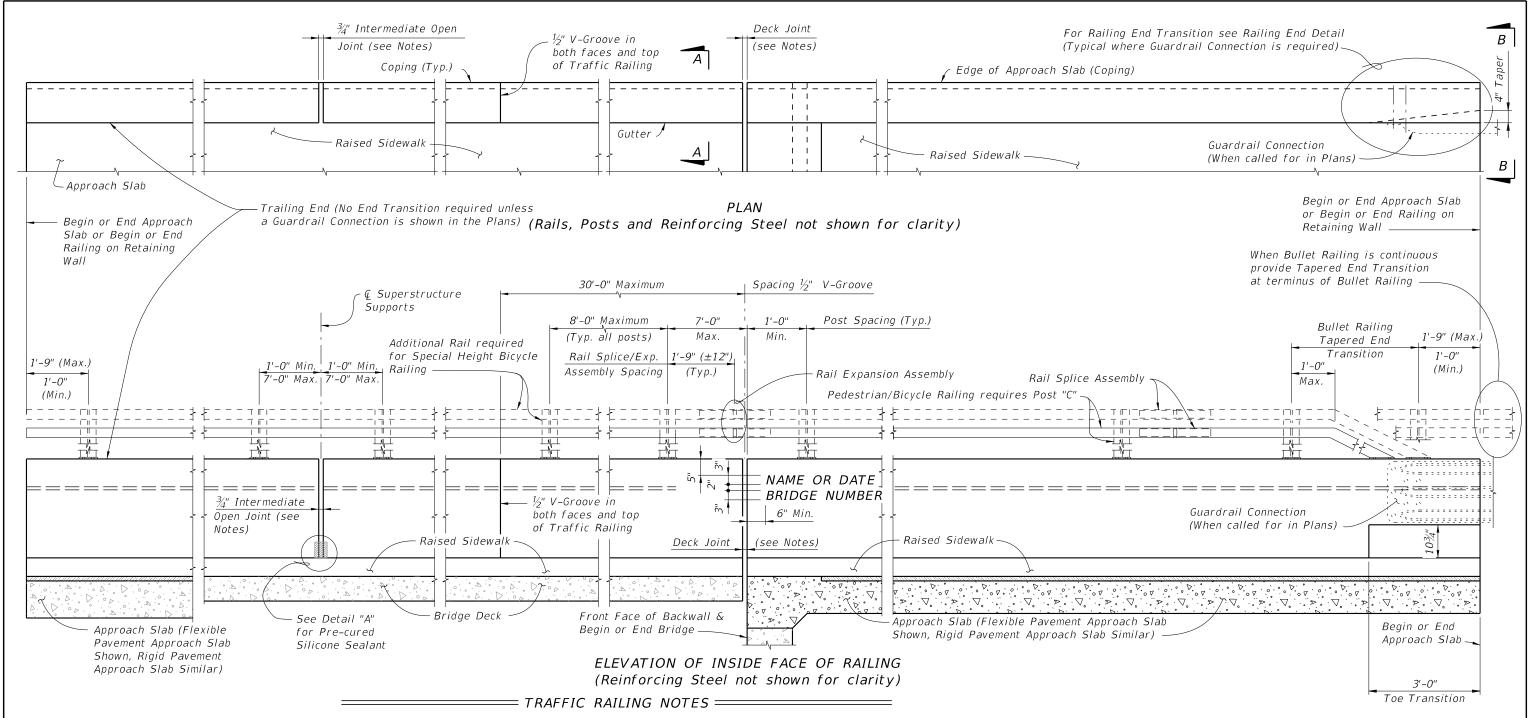

- 1. Materials: See Structures Plans, General Notes
- 2. Guardrail Connection Details: See Index 536-001
- 3. Traffic Railings may be constructed perpendicular to the sidewalk surface. If an adjoining railing is constructed plumb, transition the end of the Traffic Railing from perpendicular to plumb over a minimum distance of 20'-0". The cost of all modifications will be at the Contractor's expense.
- 4. Name, Date & Bridge Number: Place the Name and Bridge Number on the Traffic Railing on the driver's right side when approaching the bridge. Place the Date on the driver's left side when approaching the bridge. Use the Name as shown in the General Notes of the Structures Plans. The Date is the year the bridge is completed. For a widening when the existing railing is removed, use both the date on the removed rail and the year of the widening. Form letters and figures with  $\frac{3}{6}$ " V-Grooves using preformed letters and figures. Black plastic letters and figures 3" tall may be used, if approved by the Engineer.
- 5. Open Joints: See the Superstructure Plans, Approach Slab and Retaining Wall Sheets for Deck Joint dimensions and orientation. Provide Open Railing Joints matching the dimensions of the Deck Joint at Deck Expansion Joint locations. A. For treatment of railings on skewed bridges see Sheet 3.
- 6. Open Joints: Provide 3/4" Open Joints at:

DESCRIPTION:

- A. Superstructure supports where the slab is continuous.
- B. At ends of approach slabs when adjacent to retaining walls and at expansion joints on retaining wall junction slabs.

- 7. V-Grooves: Construct  $\frac{1}{2}$ " V-Grooves plumb. Space V-Grooves equally between  $\frac{3}{4}$ " Open Joints and/or Deck Joints and the at V-Groove locations on the Retaining Wall footing/junction slabs.
- 8. Barrier Delineators: Install Barrier Delineators on top of the Traffic Railing 2" from the face of the traffic side in accordance with Specification Section 705. Match the Barrier Delineator to the color (white or yellow) of the near edgeline.
- 9. For embedded conduit and junction boxes see Index 630-010.
- 10. For Traffic Railings with Pedestrian/Bicycle Bullet Railings see Index 515-021 and 515-022 for Notes, Details and post spacing.

CROSS REFERENCE: For Section A-A and View B-B, see Sheet 2. For Detail "A" see Sheet 3

REVISION 11/01/20

FDOT

FY 2026-27 STANDARD PLANS

INDEX *521-423* 


SHEET 1 of 3

## SECTION A-A TYPICAL SECTION THRU TRAFFIC RAILING (Section Thru Bridge Deck shown)

#### NOTES:

DESCRIPTION:

- 1. Begin placing Railing Bars 5T and 5X on Approach Slab at the railing end and proceed toward Begin or End Bridge to avoid conflict with guardrail bolt holes. If required, adjustments to the bar spacing for Bars 5T and 5X shall be made immediately adjacent to Begin or End Bridge. Cut, shift and rotate Bars 5T and 5X as required to maintain cover in Railing End Transition.
- 2. Omit Railing End Transition and Guardrail if Concrete Traffic Railing is used beyond the Approach Slab or Retaining Wall. See Structures Plans, Plan and Elevation Sheet and Roadway Plans. If Taper and Railing End Transition is omitted, extend Typical Section to end of the Approach Slab or limiting station on Retaining Wall, and space Bars 5T and 5X at 1'-0" (Typ.)

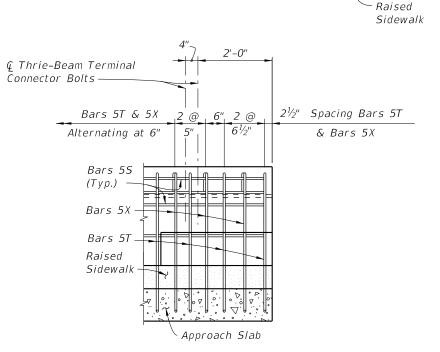

VIEW B-B APPROACH SLAB END VIEW OF TRAFFIC RAILING

Bars 5S

1'-0"

1'-1"

-Bars 5X @ 1'-0" sp. (Max.) (Alternate with

Bars 5T) (See Note 1)

← Thrie-Beam Terminal

Connector & Guardrail

Bars 5S (Field Bend as

Bars 5T @ 1'-0" sp. (Max.)

(Alternate with Bars 5X)

Required) (Typ.)

(See Note 1)

Additional Rail required for

Bicycle

(Pedestrian/Bicycle

Special Height Bicycle Railing

Pedestrian/Bicycle Railing

2" Cover (Top)

3" Taper

.02 Ft/Ft

Мах.

CROSS REFERENCE: For location of Section A-A and View B-B see Sheet 1.

Const

Joint

Hook Top Steel in

Edge of Approach

Raised Sidewalk

Slab (Coping)

NOTE: For Bullet Railing Details, see Index 515-022.

RAILING END DETAIL (Guardrail Not Shown For Clarity)

REVISION 11/01/25

FDOT

FY 2026-27 STANDARD PLANS

TRAFFIC RAILING - (32" VERTICAL SHAPE)

Approach

Slab


INDEX *521-423* 


SHEET 2 of 3


#### CONVENTIONAL REINFORCING STEEL BENDING DIAGRAMS

BILL OF REINFORCING STEEL			
MARK	SIZE	LENGTH	
5	5	As Reqd.	
Т	5	9'-0"	
Х	5	5'-10"	

Ø	Ā
LOW GUTTER	HIGH GUTTER
90°	90°
87°	93°
84°	96°
	LOW   GUTTER   90°   87°

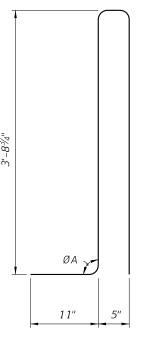

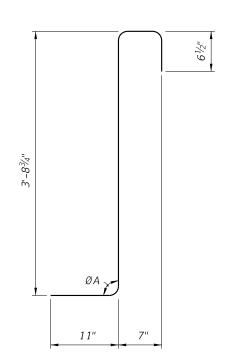



BAR 5S

STIRRUP BAR 5T

DESCRIPTION:


STIRRUP BAR 5X

## REINFORCING STEEL NOTES:


- 1. All bar dimensions in the bending diagrams are out to out.
- 2. The 3'-8¾" vertical dimensions shown for Bars 5T and 5X are based on a bridge deck with a 6" thick x 6' wide raised sidewalk at low side of deck, 2% deck cross slope and a counter 2% raised sidewalk cross slope. If the raised sidewalk thickness, width or cross slopes vary from the above amounts, adjust these vertical dimensions accordingly to achieve a 6" minimum embedment into the bridge deck.
- 3. The reinforcement for the railing on a Retaining Wall shall be the same as detailed with  $\emptyset A = 90^{\circ}$ .
- 4. All reinforcing steel at the open joints shall have a 2" minimum cover.
- 5. Bars 5S may be continuous or spliced at the construction joints. Bar splices for Bars 5S shall be a minimum of 2'-2".
- 6. The Contractor may utilize Welded Wire Reinforcement (WWR) when approved by the Engineer. WWR must consist of Deformed wire meeting the requirements of Specification Section 931.

#### INTERMEDIATE JOINT SEAL NOTES:

- 1. At Intermediate Open Joints, seal the lower 6" portion of the open joint with Pre-cured Silicone Sealant in accordance with Specification Section 932.
- 2. Apply sealant prior to any Class V finish coating and remove all curing compound and loose material from the surface prior to application of bonding agent.
- 3. The cost of the Pre-cured Silicone Sealant shall be included in the Contract Unit Price for the Traffic Railing.
- 4. As an alternative option, a mortar plug may be used to seal the joint as shown in the mortar plug detail and in accordance with Specification Section 400.




OPTION I



OPTION II (Alternative Mortar Plug at Open Joint)


DETAIL "A"




## SECTION THRU RECESSED "V" GROOVE TO FORM INSCRIBED LETTERS AND FIGURES

ESTIMATED TRAFFIC RAILING QUANTITIES		
ITEM	UNIT	QUANTITY
Concrete	CY/LF	0.095
Reinforcing Steel	LB/LF	25.90

(The above quantities are based on a 6" thick x 6' wide raised sidewalk at low side of deck, 2% deck cross slope and counter 2% sidewalk cross slope.)

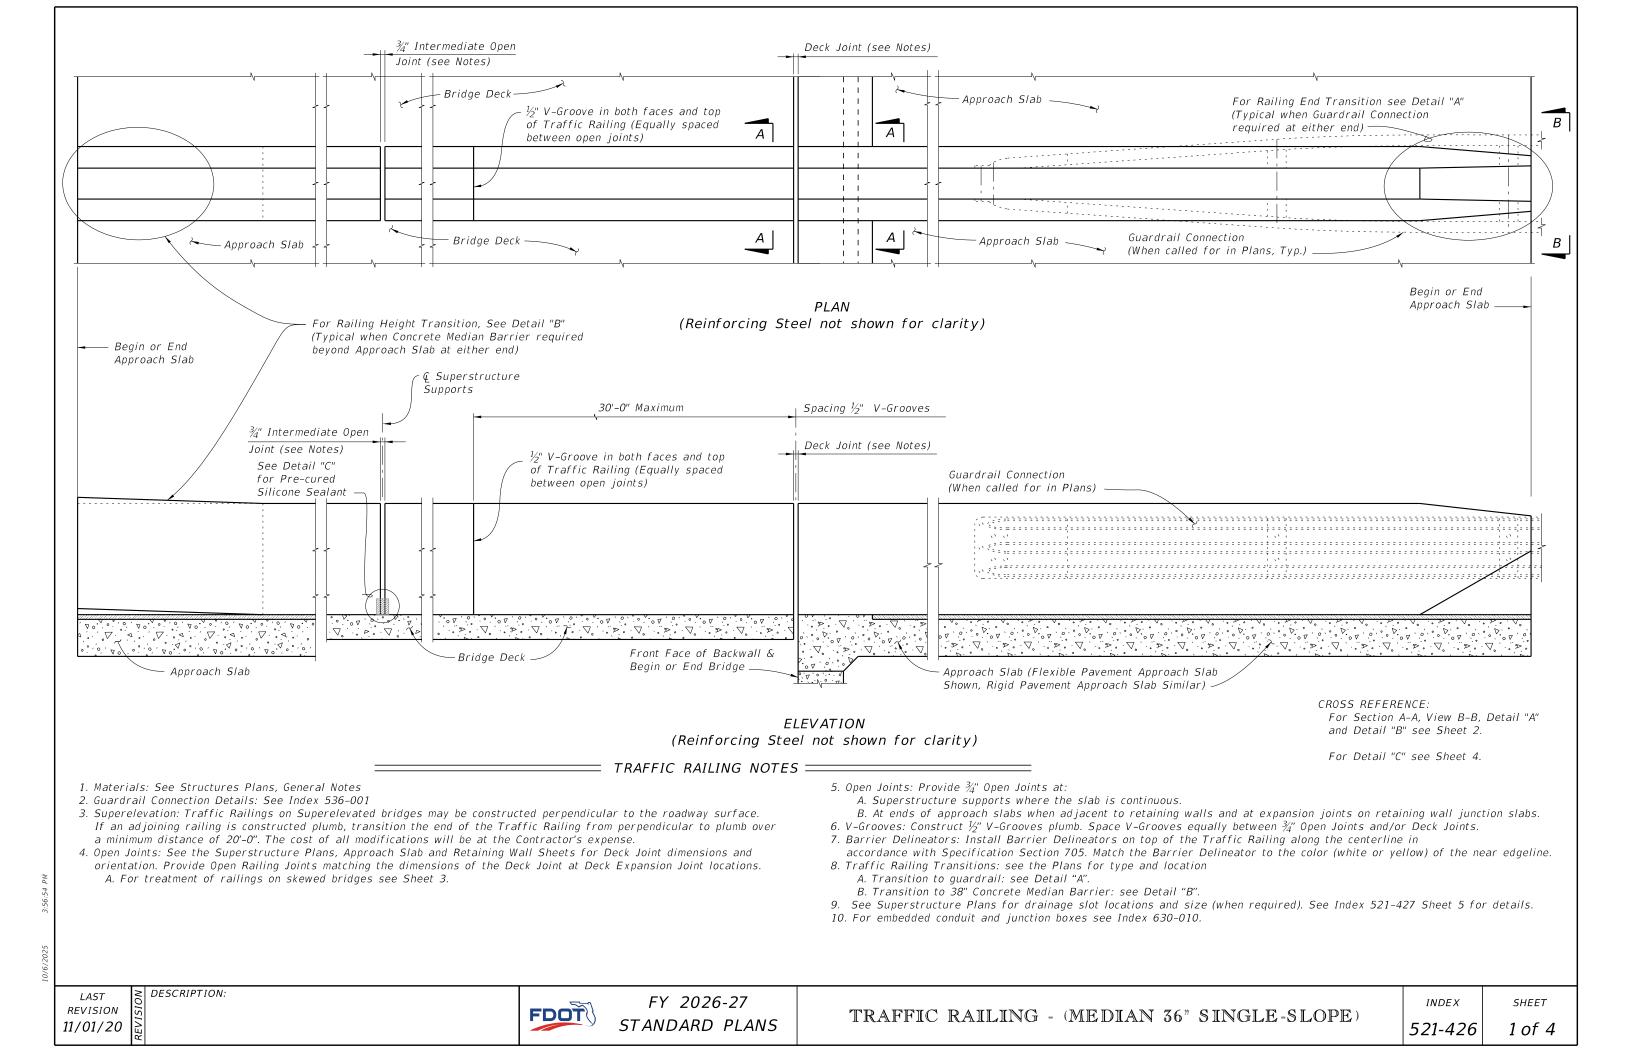


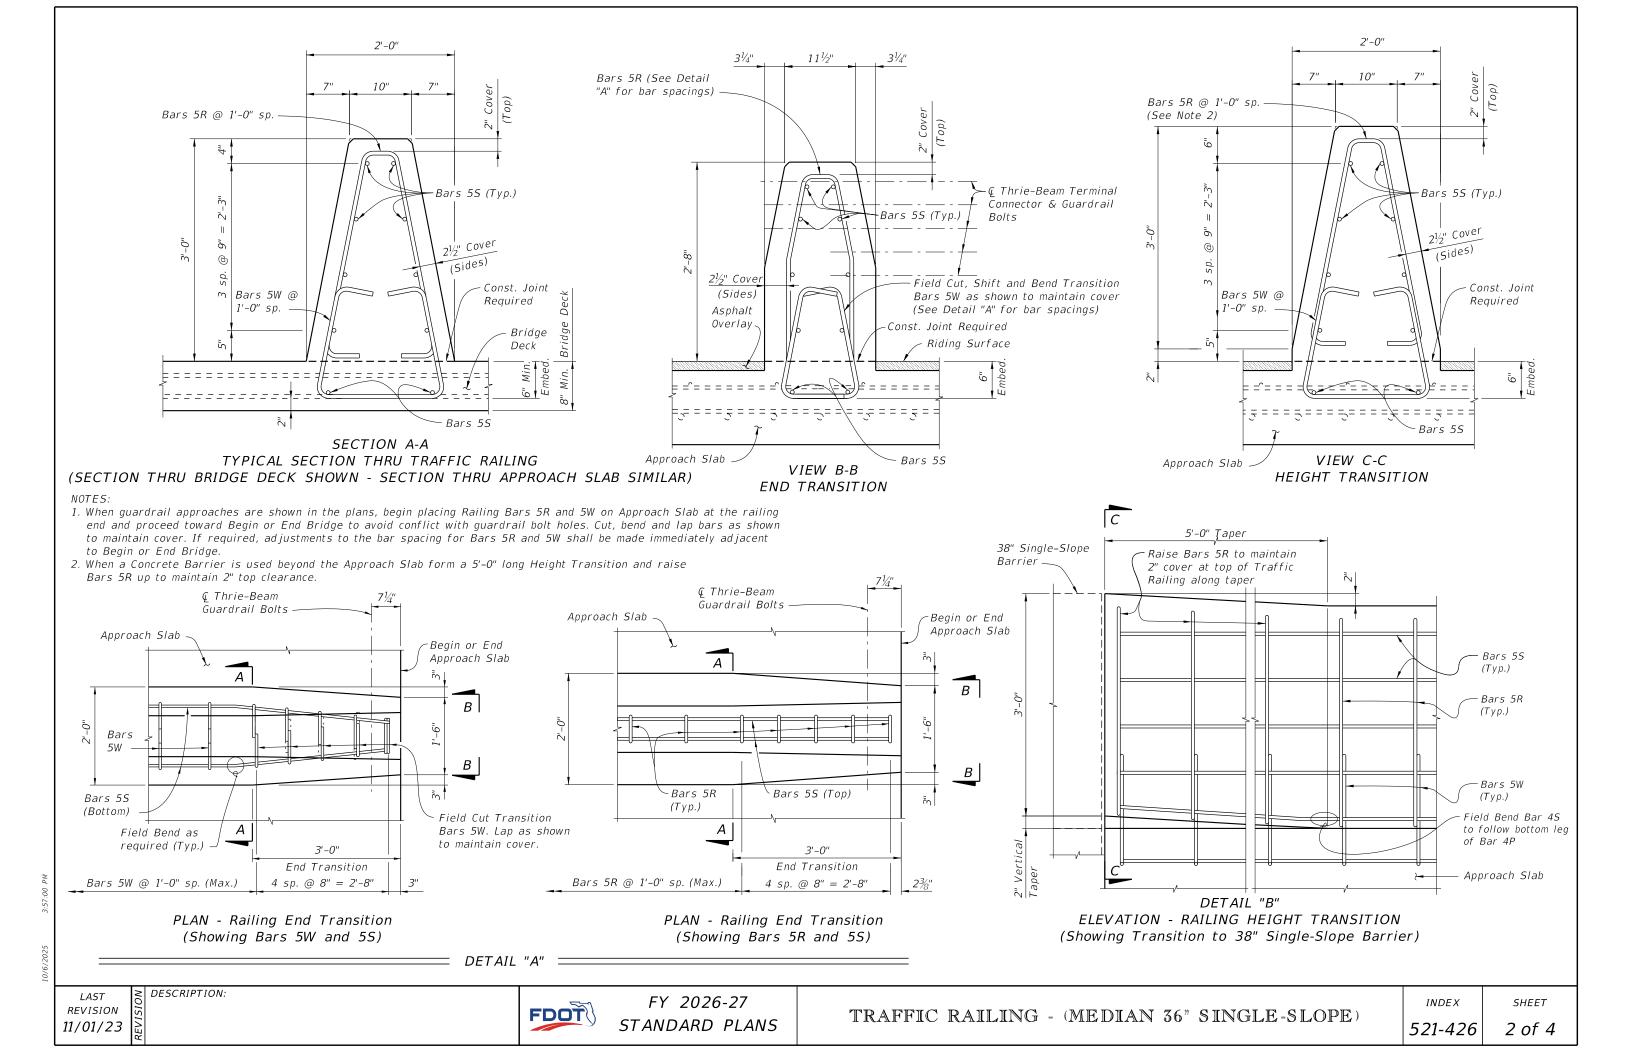

# PARTIAL PLAN VIEW OF BRIDGE DECK AND APPROACH SLAB WITH MEDIAN TRAFFIC RAILING

#### NOTES:

- 1) Median Traffic Railing reinforcement vertical Bars 5W may be shifted up to 1" (Max.) and rotated up to 10 degrees as required to allow proper placement.
- 2) Transition Stirrup Bars 5W shall be used as required at railing ends adjacent to expansion joints to facilitate placement of bars in acute corners. Place Transition Bars 5W in a fan pattern to maintain spacing. Rotate bars in 10° (Max.) increments as required.
- 3) Median Traffic Railing ends at deck expansion joints shall follow the deck joint with allowance for joint movement. See Structures Plans, Superstructure and Approach Slab Sheets for Details.
- 4)  $\frac{3}{4}$ " Intermediate Open Joints and V-Grooves in railing shall be placed perpendicular or radial to the  $\mathbb{Q}$  of the median railing. See Structures Plans, Superstructure and Approach Slab Sheets for locations.
- 5) At begin or end approach slab extend slab at the median railing ends 3" (open side) as shown to provide a base for casting of the railing.
- 6) Work this Sheet with Approach Slab Indexes as applicable.
- 7) Deck Expansion Joint at begin or end bridge shown. Deck Expansion Joints at © Pier or Intermediate Bents are similar.
- 8) Partial Plan Views shown are intended as guides only. See Structures Plans, Superstructure and Approach Slab Sheets for skew angles, joint orientation, dimensions and details.
- 9) If Welded Wire Reinforcement is used in lieu of conventional reinforcement, placement of the WWR vertical elements shall be similar to those shown above. Clipping of horizontal elements to facilitate placement shall be minimized where possible. Where clipping is required, supplement horizontal elements by lap splicing with deformed bars having an equivalent area of steel.

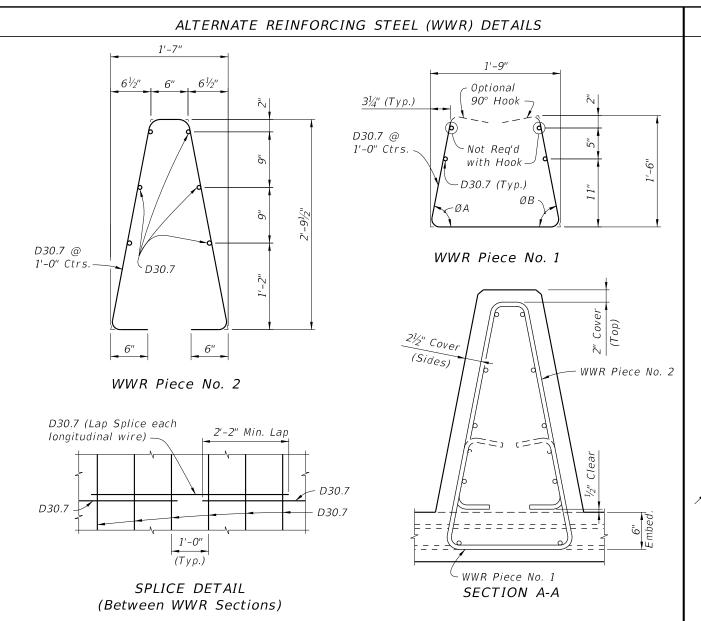


ROADWAY ON SLOPE AT CROWN CROSS-SLOPE ØΑ ØB ØΑ 79° 79° 79°  $79^{\circ}$ 0% to 2% 81° 77° 79° 79° >2% to 6% >6% to 10%  $84^{\circ}$ 74° 79°  $79^{\circ}$ 

CONVENTIONAL REINFORCING STEEL BENDING DIAGRAMS

ØA and ØB shall be 79° if Contractor elects to place railing perpendicular to the deck, and approach slabs. BILL OF REINFORCING STEEL SIZE MARK LENGTH 5 7'-2" 5 5 As Regd. 5'-10"

Length as Required

BAR 5S

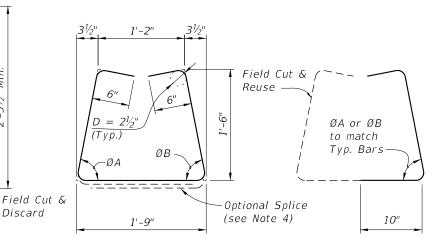

TRANSITION STIRRUP BAR 5R (5 required per Railing End Transition)

Discard

STIRRUP BAR 5W

TRANSITION STIRRUP BAR 5W To Be Field Cut (10 required per Railing End Transition)

## REINFORCING STEEL NOTES:

1'-7"

6"

 $D = 2\frac{1}{2}$ "  $\overline{(Typ.)}$ 

STIRRUP BAR 5R

6½"

- 1. All bar dimensions in the bending diagrams are out to out.
- 2. All reinforcing steel at the open joints shall have a 2" minimum cover.

Field Bend as required


to maintain cover

- Bars 5S may be continuous or spliced at the construction joints. Bar splices for Bars 5S shall be a minimum of 2'-2".
- 4. At the Contractor's option, Bars 5W may be fabricated as a two piece bar with a 1'-2" lap splice of the bottom legs.


## WELDED WIRE REINFORCEMENT NOTES:

Overhangs greater than 6" are not permitted.

- 1. At the option of the Contractor deformed Welded Wire Reinforcement (WWR) may be utilized in lieu of all Bars 5R, 5S and 5W. WWR must meet the requirements of Specification Section 931.
- 2. WWR at Railing End Transition shall be field bent inward as required (Pieces 1 & 2) to maintain cover. The bottom of Piece 1 shall be cut to allow overlap. 3. Place WWR panels so as to minimize the end overhang of longitudinal wires at Railing Ends and Open Joints.

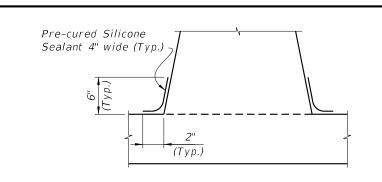

OPTION I



OPTION II (Alternative Mortar Plug at Open Joint)

## INTERMEDIATE JOINT SEAL NOTES:

- 1. At Intermediate Open Joints, seal the lower 6" portion of the open joint with Pre-cured Silicone Sealant in accordance with Specification Section 932
- 2. Apply sealant prior to any Class V finish coating and remove all curing compound and loose material from the surface prior to application of bonding agent.
- 3. Include the cost of the Pre-cured Silicone Sealant in the Contract Unit Price for the Traffic Railing.
- 4. As an alternative option, a mortar plug may be used to seal the joint as shown in the mortar plug detail and in accordance with Specification Section 400.

ESTIMATED TRAFFIC RAILING QUANTITIES		
ITEM	UNIT	QUANTITY
Concrete	CY/LF	0.157
Reinforcing Steel	LB/LF	23.99

(The above quantities are based on a crowned roadway, with a 2% cross slope)

REVISION 11/01/25

FDOT


FY 2026-27 STANDARD PLANS

= DETAIL "C" 💳

TRAFFIC RAILING - (MEDIAN 36" SINGLE-SLOPE)


INDEX *521-426* 

SHEET 4 of 4

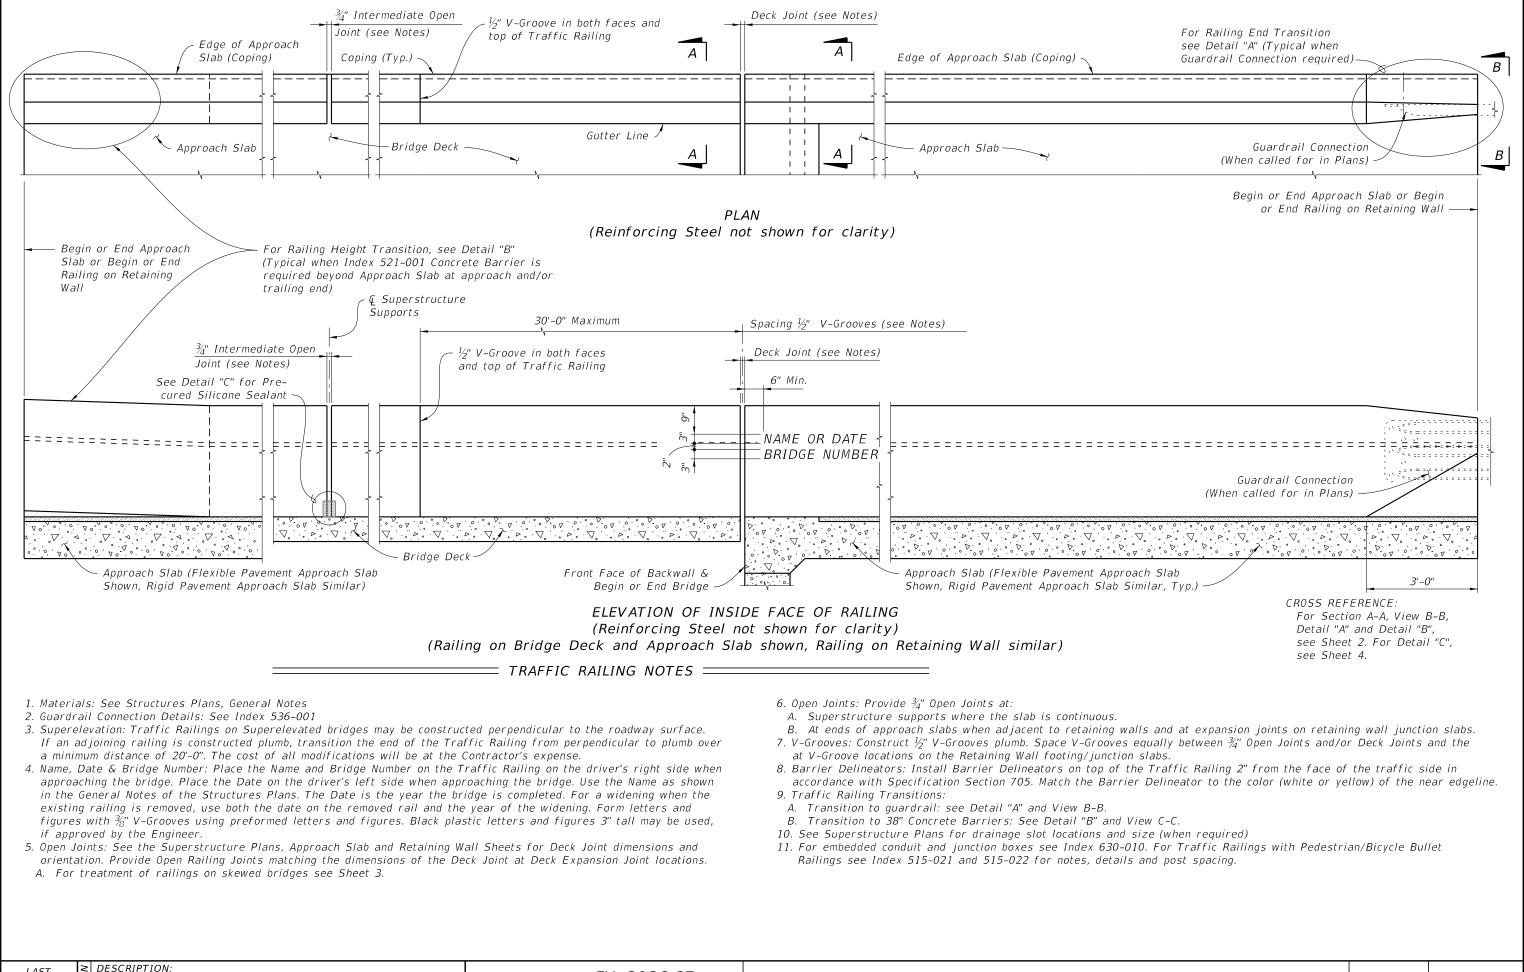


LAST REVISION 11/01/20

FDOT

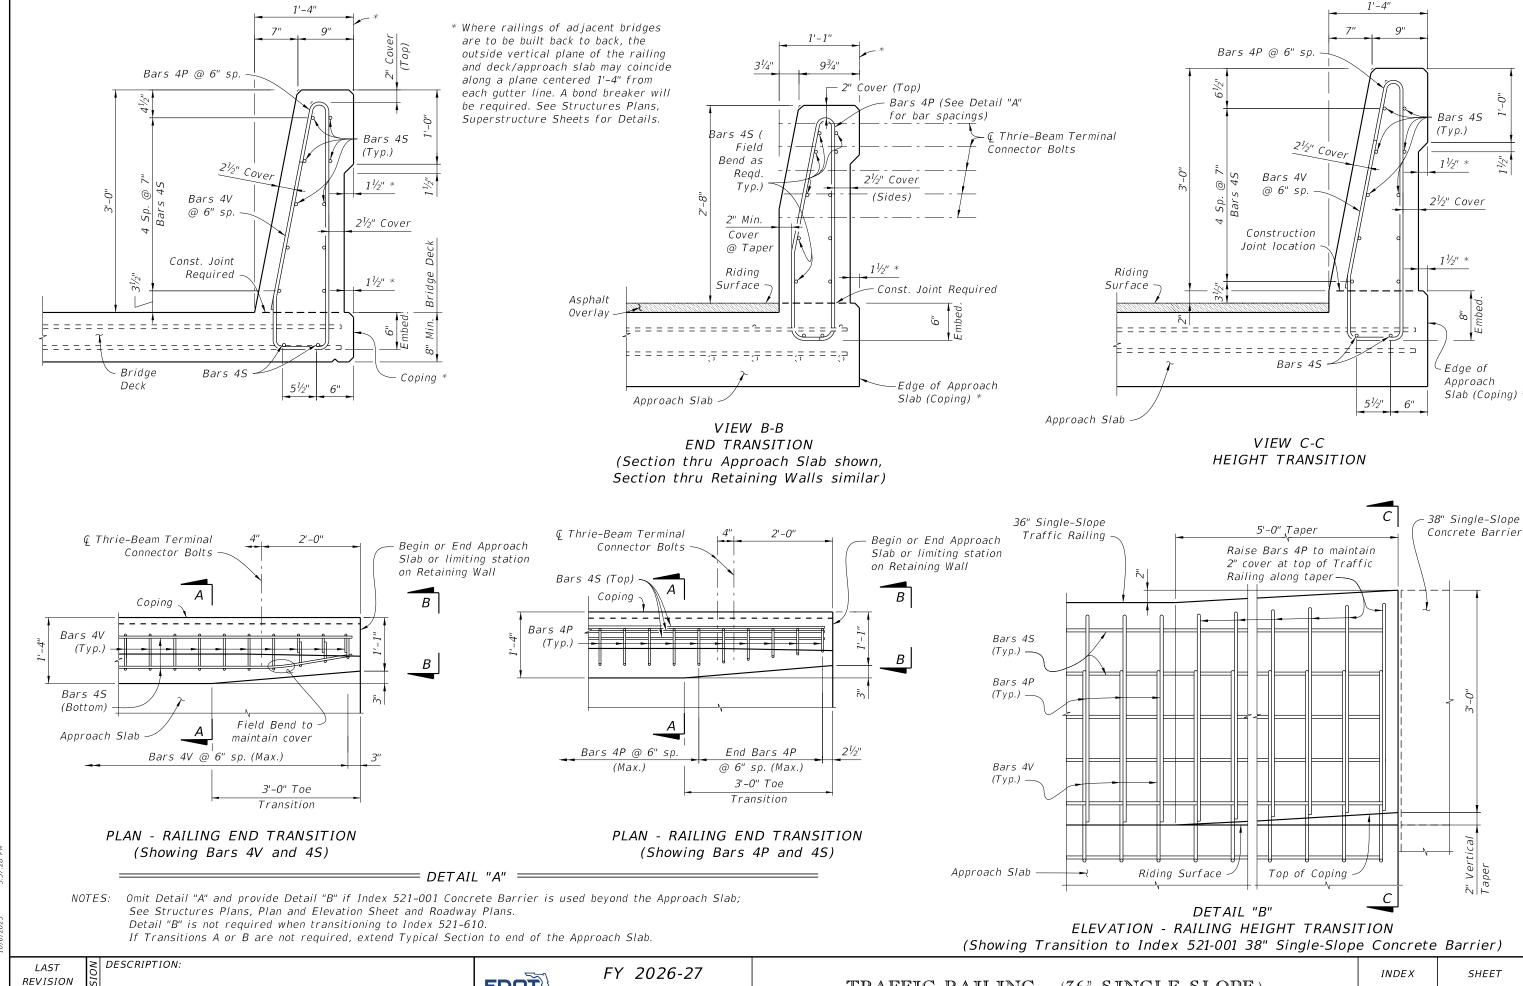


11/01/20

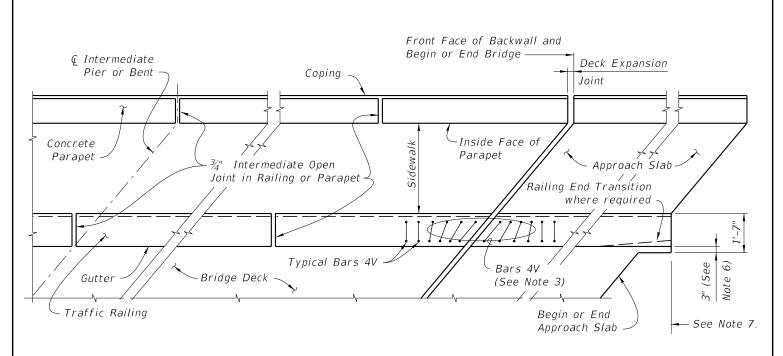

PARTIAL PLAN VIEW OF SKEWED BRIDGE DECK AND APPROACH SLAB WITH SIDEWALK, SINGLE-SLOPE TRAFFIC RAILING AND PEDESTRIAN/BICYCLE RAILING INDEX 521-820 or 521-825, OTHER TRAFFIC RAILINGS SIMILAR

#### NOTES:

- 1) Concrete Parapet reinforcement is not effected by skew angle, see Index 521-820 for details.
- 2) Parapet expansion joint shall match the deck expansion joint which shall be turned perpendicular or radial to the gutter line. See Structures Plans, Superstructure Sheets for details.
- 3) Traffic Railing reinforcement vertical Bars 4V & 4P may be shifted up to 1" (Max.) and rotated up to 10 degrees as required to allow proper placement. Bars 4V adjacent to expansion joints shall be field adjusted to maintain clearance and spacing, extra Bars 4V will be required. Cut bottom horizontal portion of 4V Bars to maintain maximum horizontal length to each vertical leg being placed. Discard the remainder of the bar. Rotate cut bars to maintain clearance.
- 4) Railing ends at deck expansion joints shall follow the deck joint with allowance for joint movement. Expansion joint at the inside face of parapet shall be turned perpendicular or radial to this line. See Structures Plans, Superstructure and Approach Slab Sheets for details.
- 5)  $\frac{3}{4}$ " Intermediate Open Joints and V-Grooves in railing and parapet shall be placed perpendicular or radial to the gutter line or inside face of parapet line. See Structures Plans, Superstructure Sheets for locations.
- 6) At begin or end approach slab extend slab at the railing ends 3" (gutter side or back face of railing as required) as shown to provide a base for casting of the railing. Field trim toe of Bars 4V by 1 inch as required to maintain concrete cover at edge of deck.
- 7) When Guardrail is shown on the approach, begin placing Railing Bars 4P and 4V on Approach Slab at the railing end and proceed toward Begin or End Bridge to ensure placement of guardrail bolt holes. If required, adjustments to the bar spacing for Bars 4P and 4V shall be made immediately adjacent to Begin or End Bridge.

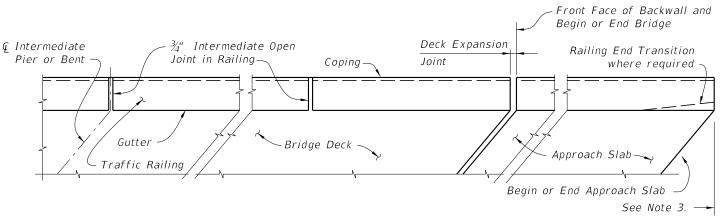

## PARTIAL PLAN VIEW OF SKEWED BRIDGE DECK AND APPROACH SLAB WITH SINGLE-SLOPE TRAFFIC RAILING, OTHER TRAFFIC RAILINGS SIMILAR

#### NOTES:


- 1) Railing expansion joint shall match the deck expansion joint which shall be turned perpendicular or radial to the gutter line. See Structures Plans, Superstructure Sheets for details.
- 2)  $\frac{3}{4}$ " Intermediate Open Joints and  $\frac{1}{2}$ " V-Grooves in railing shall be placed perpendicular or radial to the gutter line. See Structures Plans, Superstructure and Approach Slab Sheets for locations.
- 3) When Guardrail is shown on the approach, begin placing Railing Bars 4P and 4V on Approach Slab at the railing end and proceed toward Begin or End Bridge to ensure placement of guardrail bolt holes. If required, adjustments to the bar spacing for Bars 4P and 4V shall be made immediately adjacent to Begin or End Bridge.

GENERAL NOTES:

- 1) Work this Sheet with Traffic Railing, Pedestrian/Bicycle Railing, and Approach Slab Indexes as applicable
- 2) Deck Expansion Joint at begin or end bridge shown. Deck Expansion Joints at © Pier or Intermediate Bents are similar.
- 3) Partial Plan Views shown are intended as guides only. See Structures Plans, Superstructure and Approach Slab Sheets for skew angles, joint orientation, dimensions and details.
- 4) Railings on Raised Sidewalks shall be treated similar to the Partial Plan View of Bridge Deck with Traffic Railing.
- 5) If Welded Wire Reinforcement is used in lieu of conventional reinforcement, placement of the WWR vertical elements shall be similar to those shown above. Clipping of horizontal elements to facilitate placement shall be minimized where possible. When clipping is required, supplement horizontal elements by lap splicing with deformed bars having an equivalent area of steel.

REVISION 11/01/17

DESCRIPTION:

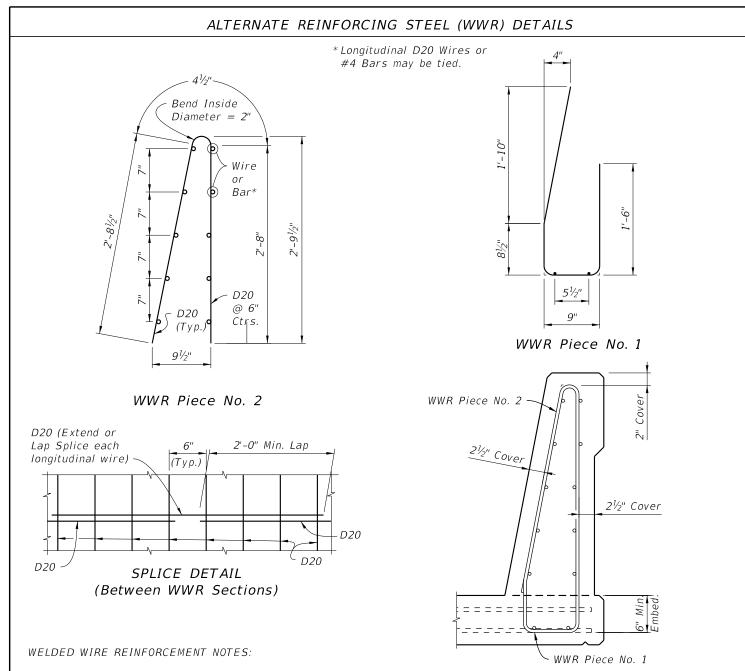

1. At the option of the Contractor deformed Welded Wire Reinforcement (WWR) may be utilized in lieu of all Bars 4P, 4S and 4V. WWR must consist of Deformed wire meeting the requirements of Specification Section 931.


2. WWR at Railing End Transition shall be field bent inward as required (Piece 2) to maintain cover. The bottom of the vertical wires (D20) in Piece 2 shall be cut a maximum of 4 inches and the gutter side portion bent inward as required to allow placement.

# CONVENTIONAL REINFORCING STEEL BENDING DIAGRAMS


ROADWAY		LOW GUTTER	HIGH GUTTER
	CROSS-SLOPE	ØB	ØB
	0% to 2%	90°	90°
	2% to 6%	87°	93°
	6% to 10%	84°	96°

BILL OF REINFORCING STEEL			
MARK SIZE		LENGTH	
Р	4	5'-11"	
S	4	As Reqd.	
V	4	4'-10"	

ØB shall be 90° if Contractor elects to place railing perpendicular to the deck and approach slabs.




Length as Required

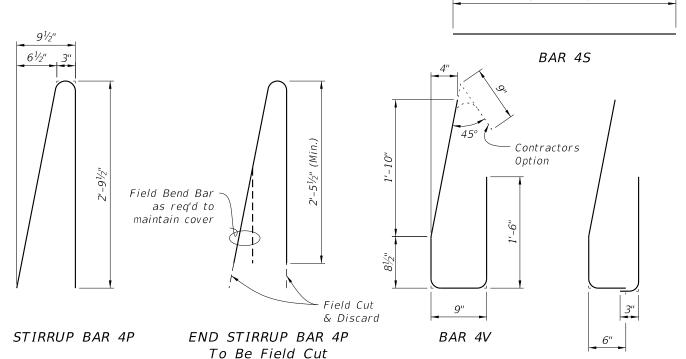


REINFORCING STEEL NOTES:

- 1. All bar dimensions in the bending diagrams are out to out.
- 2. The  $8\frac{1}{2}$ " vertical dimensions shown for Bar 4V is based on a 6" embedment into the bridge deck without a raised sidewalk. If a raised sidewalk is to be provided, increase this dimension to achieve a 6" minimum embedment into the bridge deck. See Structures Plans, Superstructure and Approach Slab Sheets.
- 3. All reinforcing steel at the open joints shall have a 2" minimum cover.
- 4. Bars 45 may be continuous or spliced at the construction joints. Bar splices for Bars 45 shall be a minimum of 2'-0".

and Bent






OPTION II (Alternative Mortar Plug at Open Joint)

DETAIL "C" =

# INTERMEDIATE JOINT SEAL NOTES:

- 1. At Intermediate Open Joints, seal the lower 6" portion of the open joint with Pre-cured Silicone Sealant in accordance with Specification Section 932.
- 2. Apply sealant prior to any Class V finish coating and remove all curing compound and loose material from the surface prior to application of bonding agent.
- 3. Include the cost of the Pre-cured Silicone Sealant in the Contract Unit Price for the Traffic Railing.
- 4. As an alternative option, a mortar plug may be used to seal the joint as shown in the mortar plug detail and in accordance with Specification Section 400.



SECTION THRU RECESSED "V" GROOVE TO FORM INSCRIBED LETTERS AND FIGURES

ESTIMATED TRAFFIC RAILING  QUANTITIES			
ITEM	UNIT	QUANTITY	
Concrete	CY/LF	0.107	
Reinforcing Steel	LB/LF	24.78	

(The above quantities are based on a 2% deck cross slope; railing on low side of deck.)

DESCRIPTION:

REVISION

11/01/25

FDOT


FY 2026-27 STANDARD PLANS

TRAFFIC RAILING - (36" SINGLE-SLOPE)


INDEX SHEET

END TRANSITION BAR 4V

Field Cut and Lapped

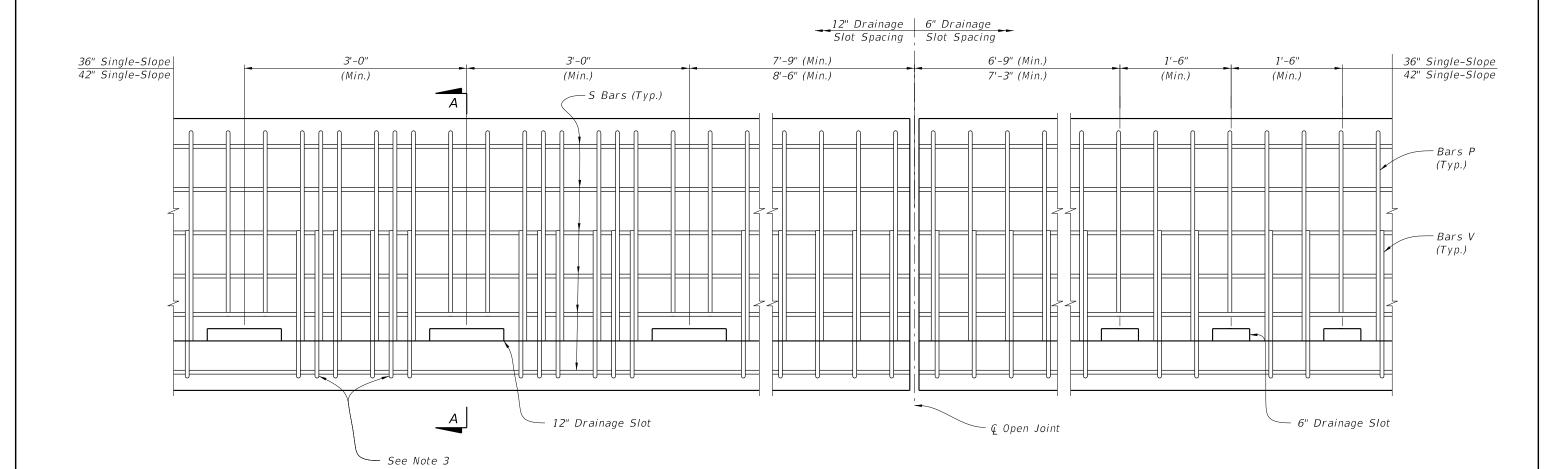

ELEVATION

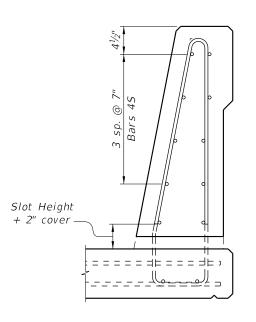


SECTION A-A 36" Single-Slope Shown Other traffic railings similar

#### DRAINAGE SLOT NOTES:

- 1. Use only when required for safety. See Plans for locations and size of drainage slots.
- 2. Maintain 2" minimum cover to all reinforcing. Trim P Bars over drainage slots and raise bottom S bars as necessary to maintain cover.
- 3. For slots greater than 6" in length, add additional vertical bars (V & P) on each side of the opening.
- 4. Drainage slot heights are 2" or 3". See the plans for size and location details.

DESCRIPTION:

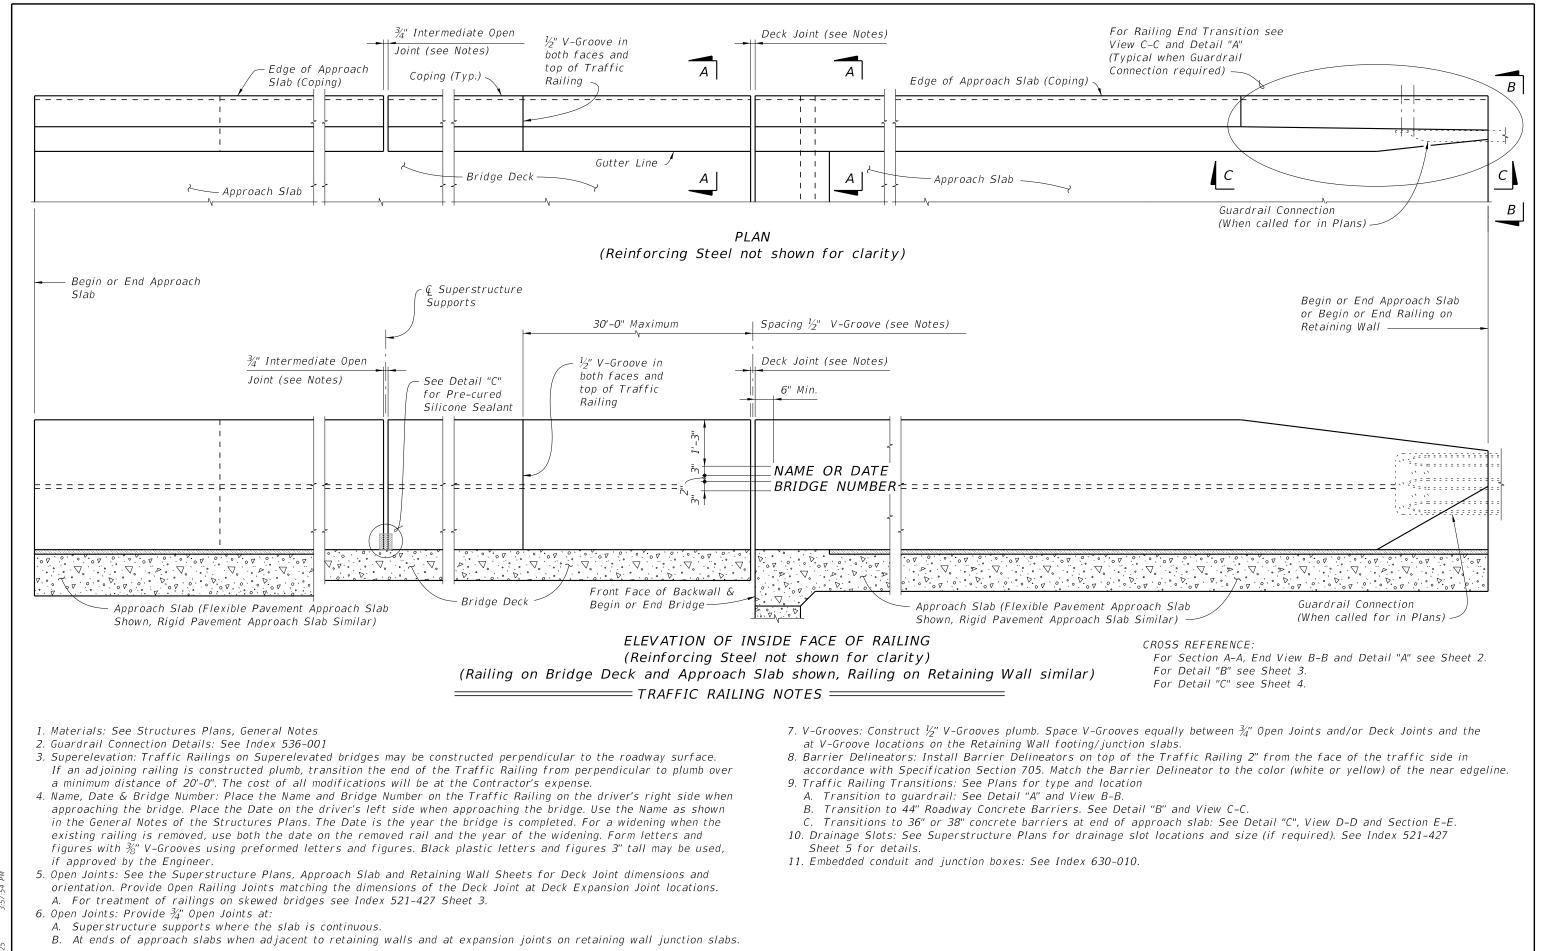

DESCRIPTION: REVISION

11/01/20


FDOT

FY 2026-27 STANDARD PLANS

TRAFFIC RAILING - (42" SINGLE-SLOPE)


INDEX 521-428


SHEET 1 of 4

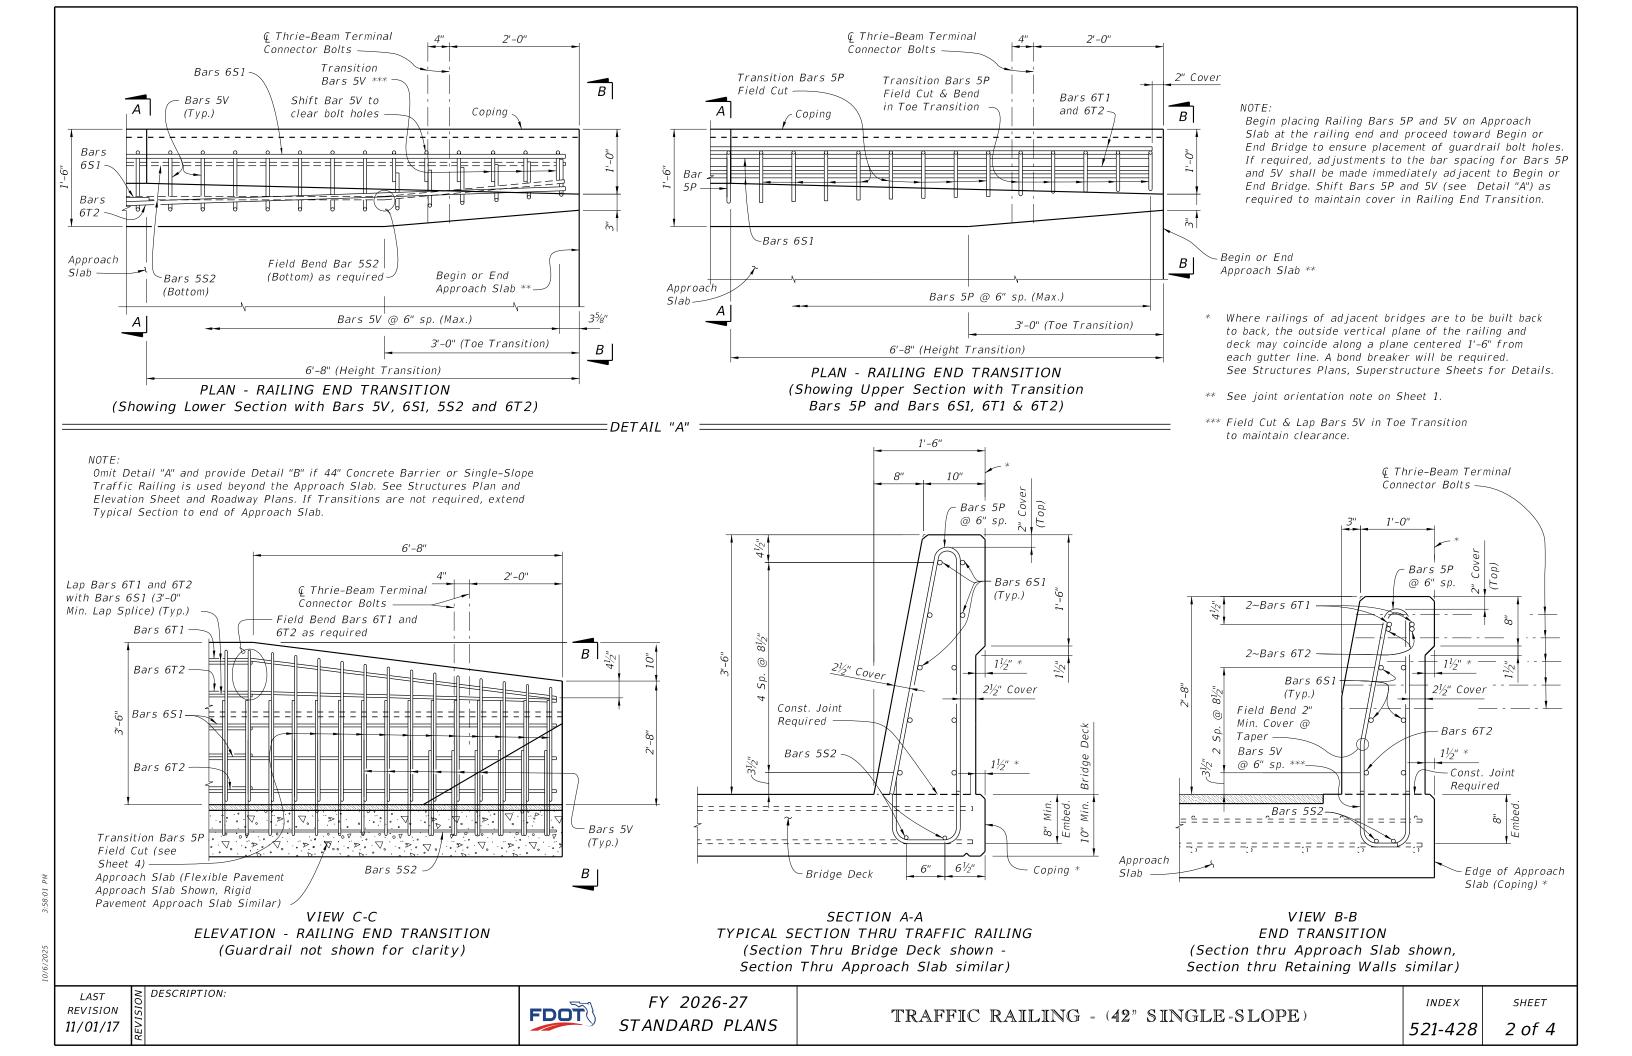


#### NOT

- 1. Provide Detail "B" height transition where 42" Traffic Railings are required on bridge, and 36" or 38" Barriers are shown on approaches. See Structures Plans for coping details.
- 2. Work Detail "B" with Indexes 400-090 or 400-091, 521-427, and 521-610 as necessary.
- 3. Field cut 5P Bars as shown to maintain 2" min. (4" max.) cover at top of traffic railing.

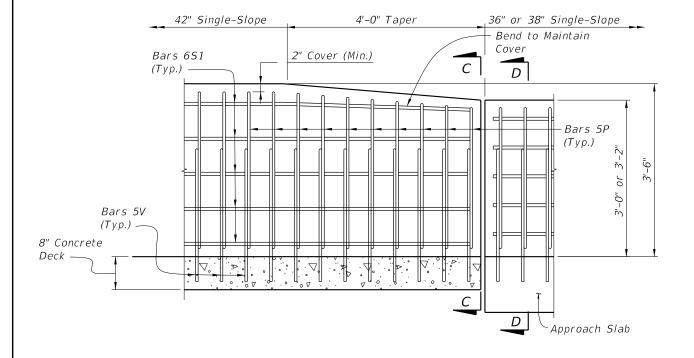



VIEW C-C RAILING HEIGHT TRANSITION (Begin/End of Bridge) (Bars 5V not shown for clarity)



SECTION D-D (Index 400-091 Shown, 400-090 Similar) (Index 521-427 Bars 4V not shown for Clarity)

DETAIL "B"

DESCRIPTION:


# CONVENTIONAL REINFORCING STEEL BENDING DIAGRAMS

BILL OF	BILL OF REINFORCING STEEL		
MARK	SIZE	LENGTH	
Р	5	7'-0"	
51	6	As Regd.	
<i>52</i>	5	As Reqd.	
T1 & T2	6	10'-0"	
V	5	5'-9"	


Length as Required

ROADWAY	LOW GUTTER	HIGH GUTTER
CROSS-SLOPE	ØВ	ØB
0% to 2%	101°	101°
2% to 6%	98°	104°
6% to 10%	95°	107°


ØA and ØB shall be 90° if Contractor elects to place Railing perpendicular to the Deck.



BARS 651 & 552

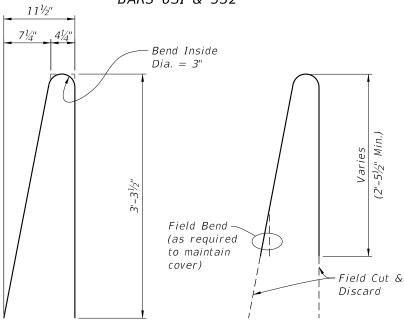

# TRANSITION BARS 6T1 & 6T2 (2~Bars 6T1 & 3~Bars 6T2 required per Railing End Transition)

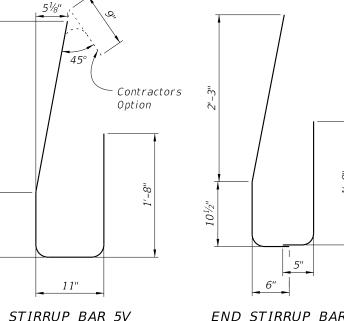

STIRRUP BAR 5P

TRANSITION STIRRUP BAR 5P To Be Field Cut (10 of each required per Railing End Transition)

REINFORCING STEEL NOTES:


DESCRIPTION:

- 1. All bar dimensions in the bending diagrams are out to out.
- 2. All reinforcing steel at the open joints shall have a 2" minimum cover.
- 3. Bars 6S1 may be continuous or spliced at the construction joints. Lap splices for Bars 6S1 and 5S2 shall be a minimum of 3'-0" and 2'-2", respectively.
- 4. The Contractor may utilize deformed WWR when approved by the Engineer. WWR must meet the requirements of Specification Section 931.


END STIRRUP BAR 5V To Be Field Cut and Lapped

#### INTERMEDIATE JOINT SEAL NOTES:

- 1. At Intermediate Open Joints, seal the lower 6" portion of the open joint with Pre-cured Silicone Sealant in accordance with Specification Section 932.
- 2. Apply sealant prior to any Class V finish coating and remove all curing compound and loose material from the surface prior to application of bonding agent.
- 3. The cost of the Pre-cured Silicone Sealant shall be included in the Contract Unit Price for the Traffic Railing.
- 4. As an alternative option, a mortar plug may be used to seal the joint as shown in the mortar plug detail and in accordance with Specification Section 400.




OPTION I



OPTION II (Alternative Mortar Plug at Open Joint)

DETAIL "C"



# SECTION THRU RECESSED "V" GROOVE TO FORM INSCRIBED LETTERS AND FIGURES

ESTIMATED	TRAFFIC RAILING	QUANTITIES	
ITEM	UNIT	QUANTITY	
Concrete	CY/LF	0.143	
Reinforcing Steel	LB/LF	39.34	

Note:

The estimated railing quantities are based on a 2% deck cross slope; railing on low side of deck.

CONCRETE: Concrete for the Traffic Railing (Vertical Face Retrofit), Spread Footing Approaches and replacement curb sections shall be Class IV. Concrete for Curb Transition Blocks shall be Class II (Bridge Deck).

REINFORCING STEEL: Reinforcing steel shall be ASTM A615, Grade 60, except Expansion Dowel Bar B which shall be ASTM A36 smooth round bar hot-dip galvanized in accordance with the Specifications.


EXPANSION SLEEVE ASSEMBLY: Pipe sleeve shall be ASTM D2241 PVC pipe, SDR13.5. End Cap shall be ASTM D2466 PVC socket fitting, Schedule 40. End of Sleeve assembly at railing open joint shall be sealed with silicone to prevent concrete intrusion during railing casting. A compressible expanded polystyrene plug is required in the opposite end of the assembly for correct dowel positioning during railing casting. Correct dowel positioning is required in order to provide for thermal

ADHESIVE-BONDED ANCHORS AND DOWELS: Adhesive Bonding Material Systems for Anchors and Dowels shall comply with Specification Section 937 and be installed in accordance with Specification Section 416. The field testing proof loads required by Specification Section 416 shall be 23,800 lbs. for Dowel Bars 6D on the inside face (traffic side) of the railing (1'-0" embedment) and 18,500 lbs for Dowel Bars 6D along the outside face of the traffic railing (5" min. embedment). BRIDGES ON CURVED ALIGNMENTS: The details presented in these Indexes are shown for bridges on tangent alignments. Details for bridges on horizontally curved alignments are similar.

NAME, DATE AND BRIDGE NUMBER: The Name and Bridge Number shall be placed on the Traffic Railing so as to be seen on the driver's right side when approaching the bridge. The Date shall be placed on the driver's left side when approaching the bridge. The Date shall be the year the bridge was constructed. Letters and figures may be 3" tall black plastic as approved by the Engineer or  $\frac{3}{8}$ " V-Grooves. V-Grooves shall be formed by preformed letters and figures. ELEVATION MARKERS: Elevation Markers need not be replaced when portions of the existing traffic railing carrying existing elevation markers are removed.


BARRIER DELINEATORS: Barrier Delineators shall meet Specification Section 993. Install Barrier Delineators on top of the Traffic Railing 2" from the face on the traffic side in accordance with Specification Section 705. Match the Barrier Delineator color (white or yellow) to the near edgeline.

PAYMENT: Payment under Traffic Railing (Vertical Face Retrofit) includes all materials and labor required to construct the railing and incidental work as required for transition blocks, curbs, spread footing approaches, and Barrier Delineators.

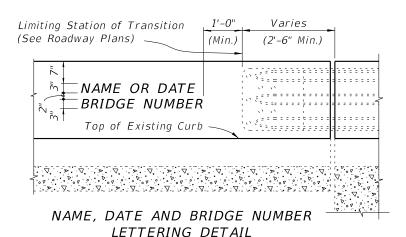


ESTIMAT	JANTITIES		
ITEM	LINIT	QUAN	NTITY
I I EM	UNIT 9" Curb	Increment	
Concrete	CY/FT	0.064	0.003 per in. height
Reinforcing Steel	LB/FT	13.27	0.10 per in. length

(Quantities are based on a 9" curb, no curb cross slope and 1'-0" embedment length of Bars 6D. If the curb height or embedment length differs from that shown, increase or decrease quantity by the given per inch increment.) See Index 521-484, Sheet 4 for Spread Footing Approach Quantities.

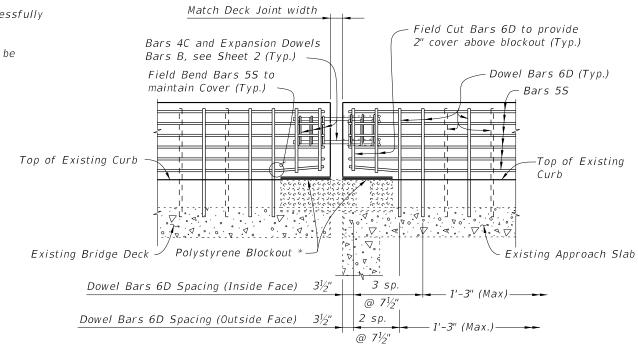

PARTIAL ELEVATION OF RAILING SHOWING FINGER/SLIDING PLATE JOINT - SCHEMES 2 THRU 5 (Begin or End Bridge Shown, Intermediate Joints Similar)

\* Place 1" thick polystyrene blockout over limits of bridge deck expansion joint full width to the end of the Traffic Railing to allow for thermal movement. Seal Forms to prevent mortar leakage into the expansion joint.

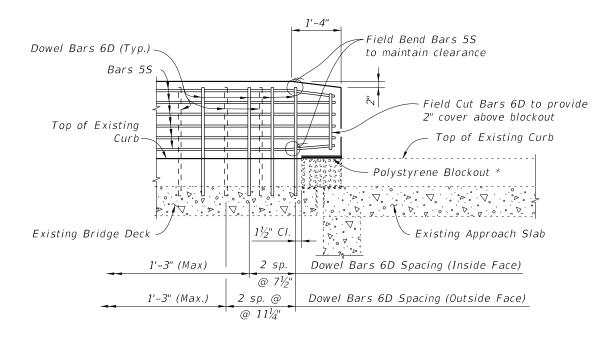

PARTIAL ELEVATION OF RAILING SHOWING FINGER/SLIDING PLATE JOINT AT BEGIN OR END BRIDGE - SCHEME 1 (Guardrail Transition not shown for clarity)


REVISION 07/01/19

DESCRIPTION:

FY 2026-27 STANDARD PLANS


TRAFFIC RAILING - (VERTICAL FACE RETROFIT) TYPICAL DETAILS & NOTES

INDEX *521-480*  SHEET

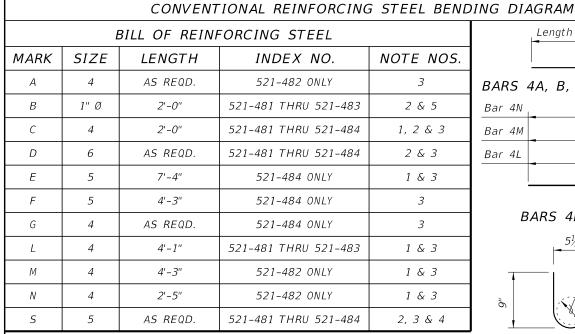


# Length as Required

BARS 4A, B, 6D, 5F, 4G & 5S





BARS 4L, 4M & 4N




### REINFORCING STEEL NOTES:

- 1. All bar dimensions in the bending diagrams are out to out.
- 2. The reinforcement for the railing on a retaining wall shall be the same as detailed for a bridge deck.
- 3. All reinforcing steel in the Vertical Face Retrofit Railing shall have a 2" minimum cover.
- 4. Bars 5S may be continuous or spliced at the construction joints. Bar splices for Bars 5S shall be a minimum of 2'-2".
- 5. Expansion Dowel Bars B shall be ASTM A36 smooth round bar and hot-dip galvanized in accordance with the Specifications.






(Typical Section) (Tapered End Transition)

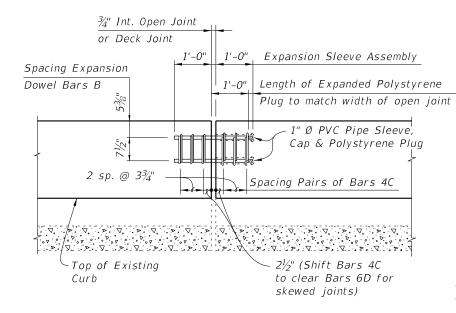

OPEN JOINT EXPANSION DOWEL DETAIL (Railing Reinforcing Not Shown For Clarity)

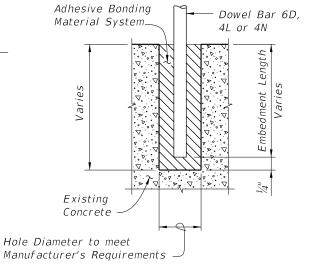


#### DOWEL DETAIL

Dowel Installation Notes:

- 1. Shift dowel holes to clear if the existing reinforcement is encountered.
- 2. See Index 521-481 thru 521-484 for required embedment length of Bars 6D, 4L or 4N.
- \*  $\frac{1}{2}$ " Preformed Joint Filler at top of Existing Curb shall extend beyond the joint material (Silicone, poured rubber, armored neoprene seal or sliding plates) as shown to prevent concrete intrusion during railing casting and shall be placed so as not to restrict in any way normal joint movement.

\*\* See Index 521-481 thru 521-484 for spacing of Bars 6D.

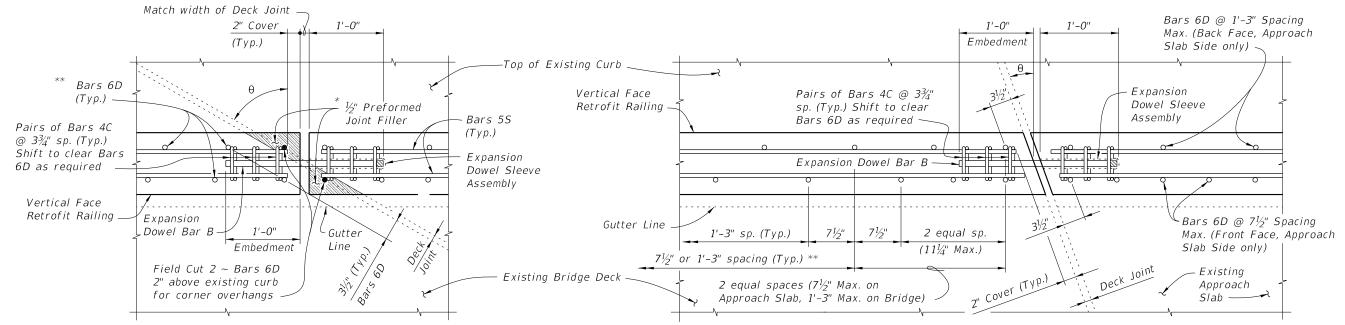

PARTIAL PLAN OF RAILING (SKEW ANGLE 0 GREATER THAN 20°) (Skewed Deck Joint at Begin or End Bridge Shown, Skewed Deck Joint at Intermediate Pier or Bent Similar)

PARTIAL PLAN OF RAILING (SKEW ANGLE  $\theta = 20^{\circ}$  OR LESS) (Skewed Deck Joint at Begin or End Bridge Shown, Skewed Deck Joint at Intermediate Pier or Bent Similar)

SKEW DETAIL

REVISION 11/01/16

DESCRIPTION:

FDOT


FY 2026-27 STANDARD PLANS

TRAFFIC RAILING - (VERTICAL FACE RETROFIT) TYPICAL DETAILS & NOTES

INDEX


SHEET

521-480 2 of 2

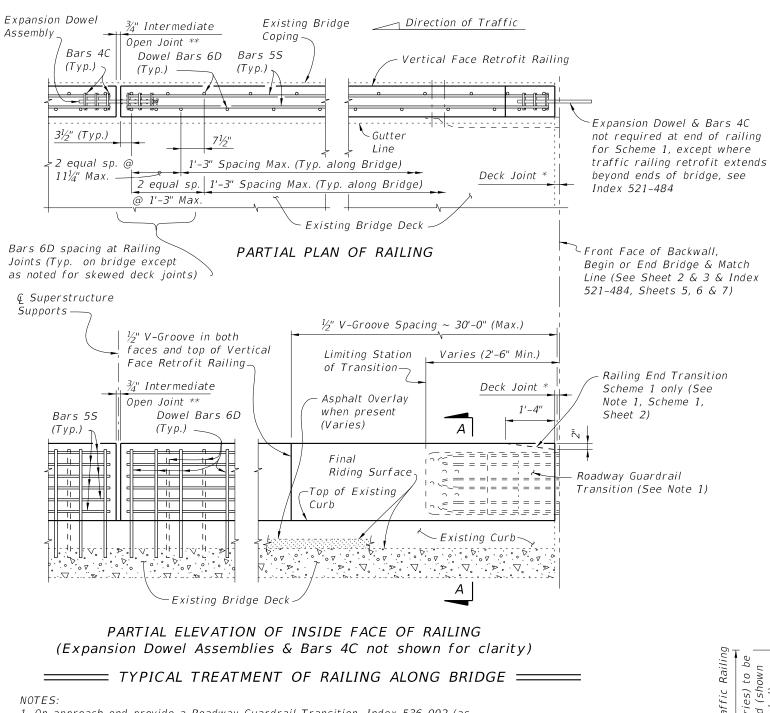

- 1. On approach end provide a Roadway Guardrail Transition, Index 536-002 (as shown) or other site specific treatment. See Roadway Plans for limiting station of Roadway Guardrail Transition or other site specific treatment. If limiting station of Roadway Guardrail Transition is on the bridge, attach Thrie Beam Terminal Connector to railing as shown above. If limiting station of Roadway Guardrail Transition is along the Wing Wall, see Schemes 2 or 3, Index 521-481, Sheet 2 and 3. On skewed bridges, if the skew along the deck joint extends across the width of the railing, the 2'-6" minimum dimension shall apply to both the front and back face of the railing. For treatment of trailing end see Roadway Plans. If vertical face retrofit extends beyond bridge and approach slab ends, see Index 521-484 for treatment and Details.
- 2. Field cut Bars 5S and Dowel Bars 6D to maintain clearance within Vertical Face Retrofit Railing.
- 3. Where existing structure has been removed and not encased in new concrete; match adjoining areas and finish flat by grouting or grinding as required. Exposed existing reinforcing steel not encased in new concrete shall be burned off 1" below existing concrete and grouted over.


- \* Non skewed deck joint shown, actual joint dimensions and orientation vary. For treatment at skewed deck joints see Skew Detail, Index 521-480. Provide open Railing Joints at Deck Expansion Joint locations matching the dimension of the Deck Joint.
- \*\* Provide 3/4" Intermediate Open Joints at: (1) - Superstructure supports where slab is continuous
- \*\*\* Curb heights vary from 5" Min. to 1'-2" Max.

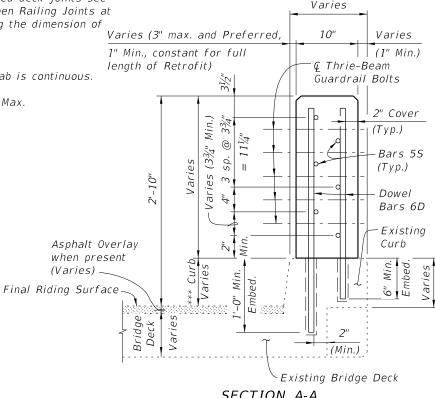


SECTION A-A TYPICAL SECTION THRU RAILING ON CURB WITH CORBELS

#### CROSS REFERENCE:

For General Notes, Estimated Quantities, Dowel Detail, Expansion Dowel Detail, Reinforcing Steel Notes & Bending Diagrams see Index 521-480.



TYPICAL SECTION THRU EXISTING TRAFFIC RAILING SHOWING LIMITS OF REMOVAL (BRIDGE DECK SHOWN, WING WALL SIMILAR)

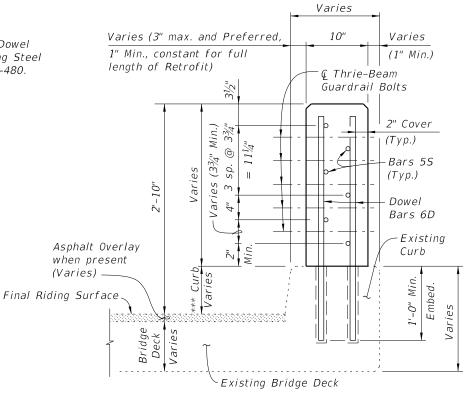

SECTION A-A TYPICAL SECTION THRU RAILING ON FULL DEPTH CURB (BRIDGE SHOWN, WING WALL SIMILAR)

LAST REVISION 07/01/13

DESCRIPTION:


FDOT

FY 2026-27 STANDARD PLANS

*INDEX* 

SHEET

521-481 1 of 3

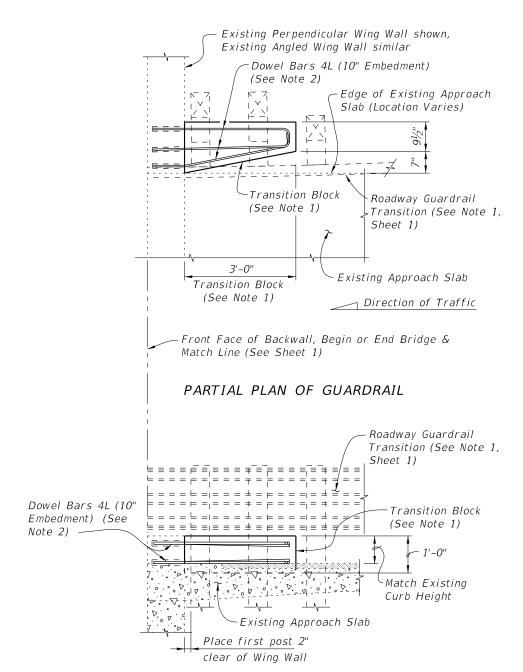


#### PARTIAL ELEVATION OF INSIDE FACE OF GUARDRAIL

# RAILING END TREATMENT FOR PERPENDICULAR OR ANGLED WING WALLS

#### SCHEME 1 NOTES:

- 1. Provide Transition Block (as shown) or Curb if existing Approach Slab does not have a curb, see Roadway Plans. Shape and height of Transition Block or Curb shall match existing bridge curb. Railing End Transition and Transition Block may be omitted on trailing ends with no opposing traffic.
- 2. Field bend Dowel Bars 4L within Transition Block as required to maintain 2" top and side clearance and 3" bottom clearance.

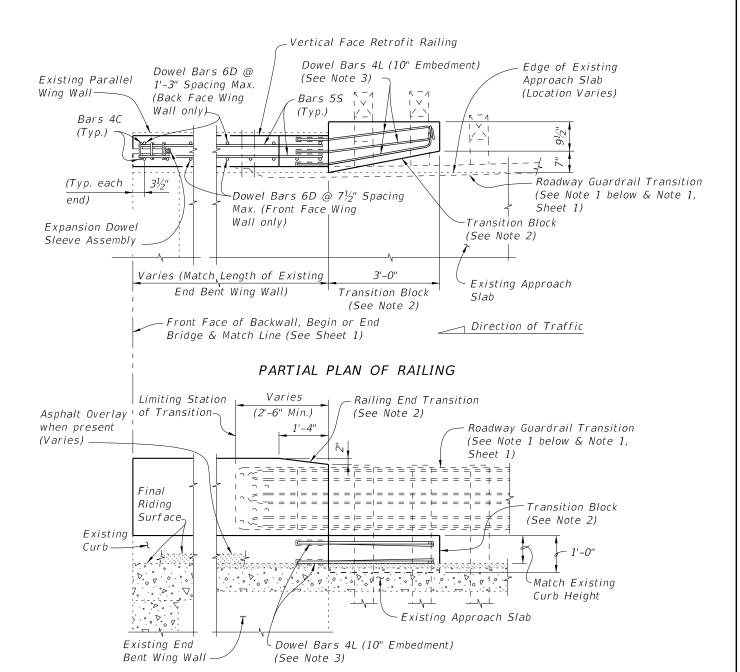

PARTIAL ELEVATION OF INSIDE FACE OF RAILING (Railing Reinforcing and Expansion Dowel Assemblies not shown for clarity)

# RAILING END TREATMENT FOR PARALLEL WING WALLS

#### SCHEME 2 NOTES:

- 1. See Roadway Plans for limiting station of Roadway Guardrail Transition or other site specific treatment. If limiting station of Roadway Guardrail Transition is along the Wing Wall, attach Thrie-Beam Terminal Connector to railing as shown above. If limiting station of Roadway Guardrail Transition is on the bridge, see Index 521-481, Sheet 1. On skewed bridges, if the skew along the deck joint extends across the width of the railing, the 2'-6" minimum dimension shall apply to both the front and back face of the railing.
- 2. Provide Transition Block (as shown) or Curb if existing Approach Slab does not have a curb, see Roadway Plans. Shape and height of Transition Block or Curb shall match existing bridge curb. Railing End Transition and Transition Block may be omitted on trailing ends with no opposing traffic.
- 3. Field bend Dowel Bars 4L within Transition Block as required to maintain 2" top and side clearance and 3" bottom clearance.





PARTIAL ELEVATION OF INSIDE FACE OF RAILING (Railing Reinforcing and Expansion Dowel Assemblies not shown for clarity)

> RAILING END TREATMENT FOR FLARED WING WALLS

SCHEME 3 NOTE:


1. See Roadway Plans for limiting station of Roadway Guardrail Transition or other site specific treatment. If limiting station of Roadway Guardrail Transition is along the Wing Wall, attach Thrie-Beam Terminal Connector to railing as shown above. If limiting station of Roadway Guardrail Transition is on the bridge, see Sheet 1.

LAST REVISION 07/01/07

DESCRIPTION:

FDOT

FY 2026-27 STANDARD PLANS

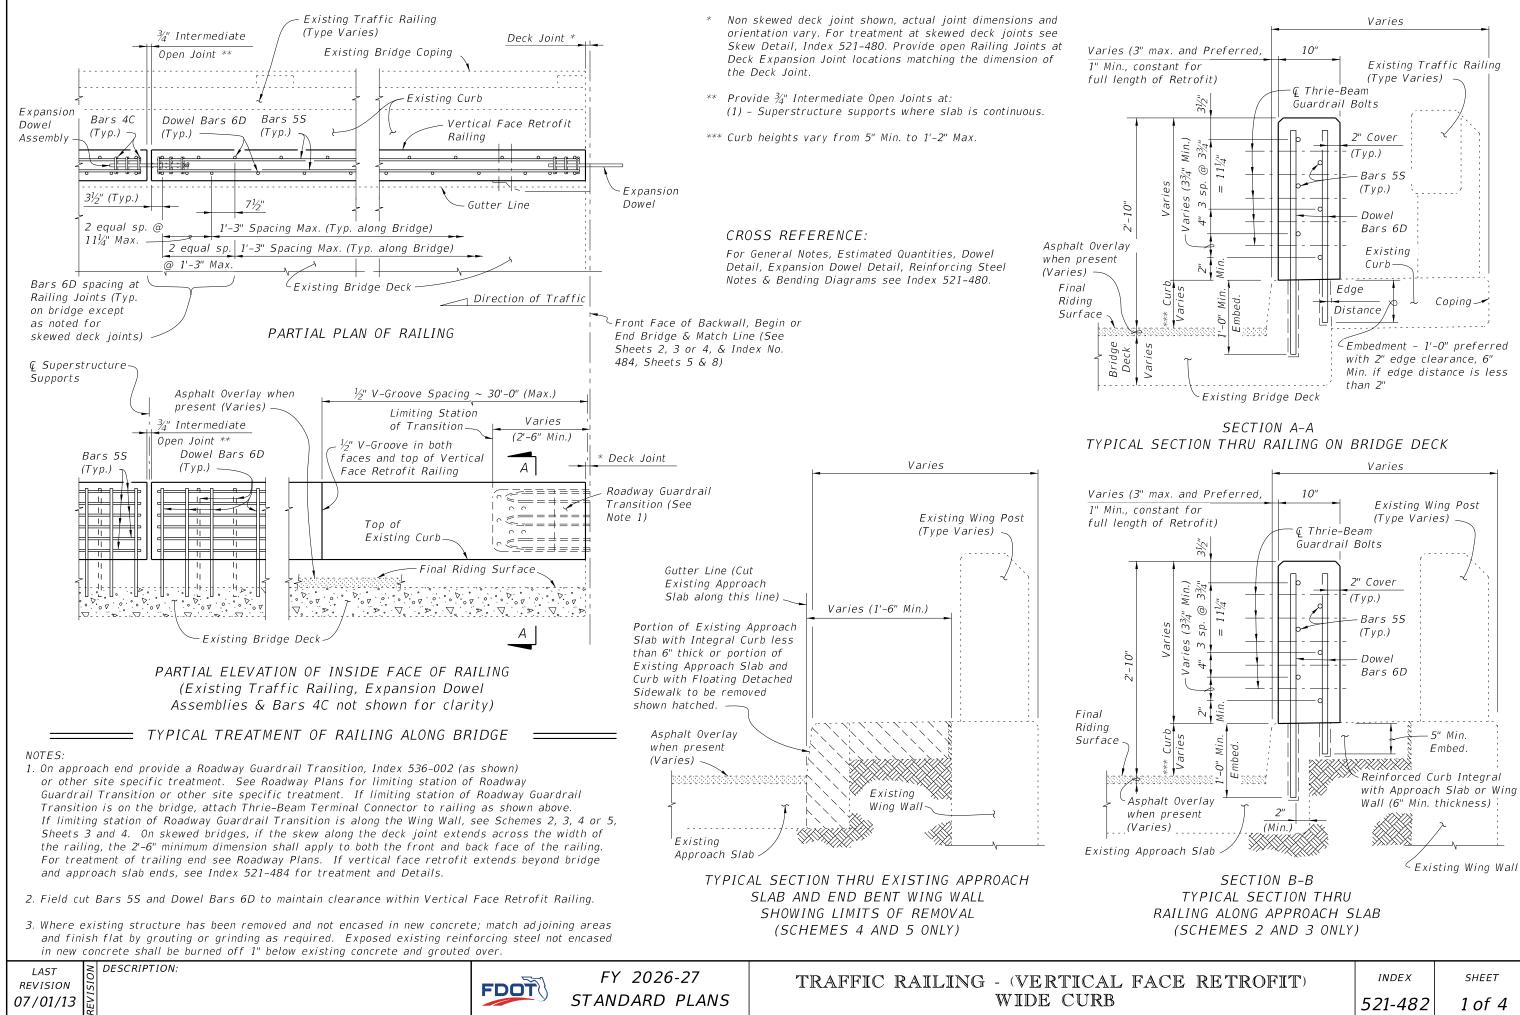

10/6/2025





bottom clearance.


DESCRIPTION:

installation.

LAST

REVISION

07/01/05

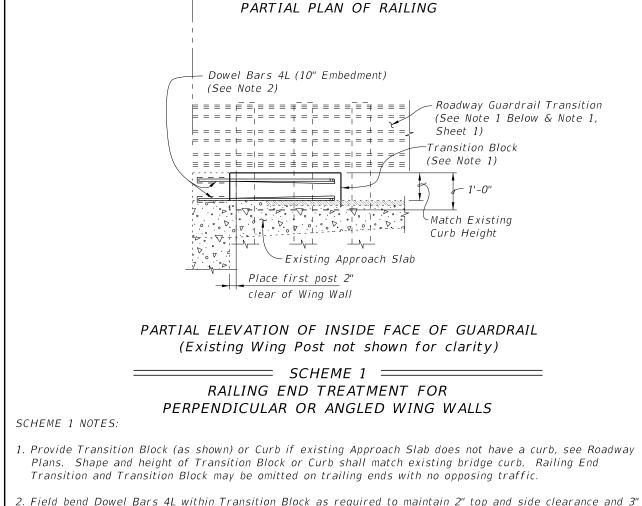

3. If a Special Steel Guardrail Post is required for attachment to the top of a sloping Wing Wall, saw cut

and remove a wedge shaped portion of the sloping Wing Wall as required to provide a level surface for post

Existing Perpendicular Wing Wall shown,

Dowel Bars 4L (10" Embedment)

- Edge of Existing Approach

Roadway Guardrail Transition

(See Note 1 Below & Note 1,

Slab (Location Varies)

Sheet 1)

Existing Approach Slab

Direction of Traffic

Existing Angled Wing Wall similar

(See Note 2)

Transition Block

Front Face of Backwall, Begin or End Bridge &

(See Note 1)


3'-0"

Transition Block

(See Note 1)

Match Line (See Sheet 1)

Existing Wing Post (Type Varies)

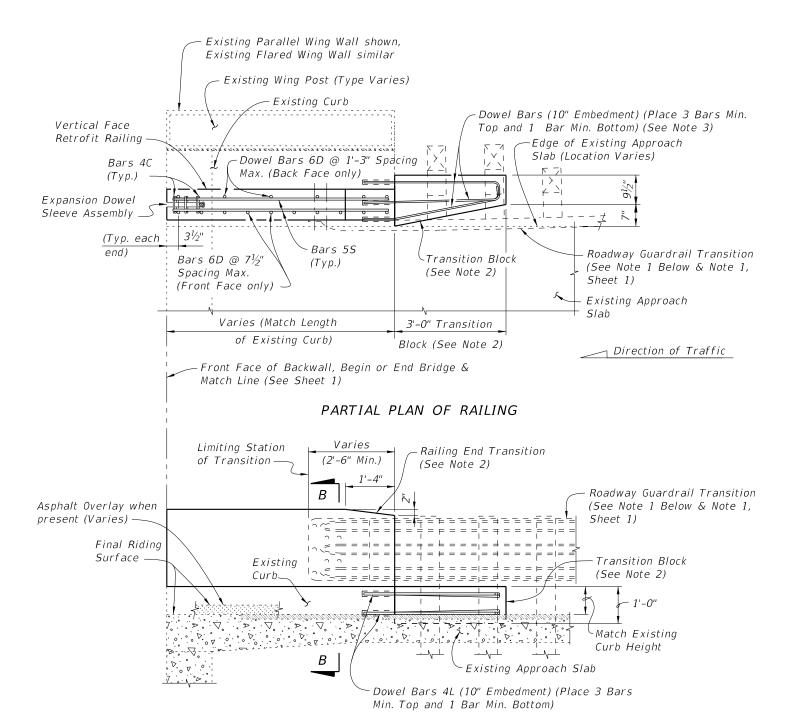

PARTIAL ELEVATION OF INSIDE FACE OF RAILING (Existing Wing Post, Railing Reinforcing and Expansion Dowel Assemblies not shown for clarity)

# \_\_\_\_\_\_\_ SCHEME 2 \_\_\_\_\_ RAILING END TREATMENT FOR PARALLEL CURBS

SCHEME 2 NOTES:


- 1. See Roadway Plans for limiting station of Roadway Guardrail Transition or other site specific treatment. If limiting station of Roadway Guardrail Transition is along the Wing Wall, attach Thrie-Beam Terminal Connector to railing as shown above. If limiting station of Roadway Guardrail Transition is on the bridge, see Sheet 1. On skewed bridges, if the skew along the deck joint extends across the width of the railing, the 2'-6" minimum dimension shall apply to both the front and back face of the railing.
- 2. Provide Transition Block (as shown) or Curb if existing Approach Slab Curb does not extend beyond end of existing End Bent Wing Wall, see Roadway Plans. Shape and height of Transition Block or Curb shall match existing bridge curb. Railing End Transition and Transition Block may be omitted on trailing ends with no opposing traffic.
- 3. Field bend Dowel Bars 4L within Transition Block as required to maintain 2" top and side clearance and 3" bottom clearance.


FDOT

FY 2026-27 STANDARD PLANS *INDEX* 

SHEET


WIDE CURB 521-482

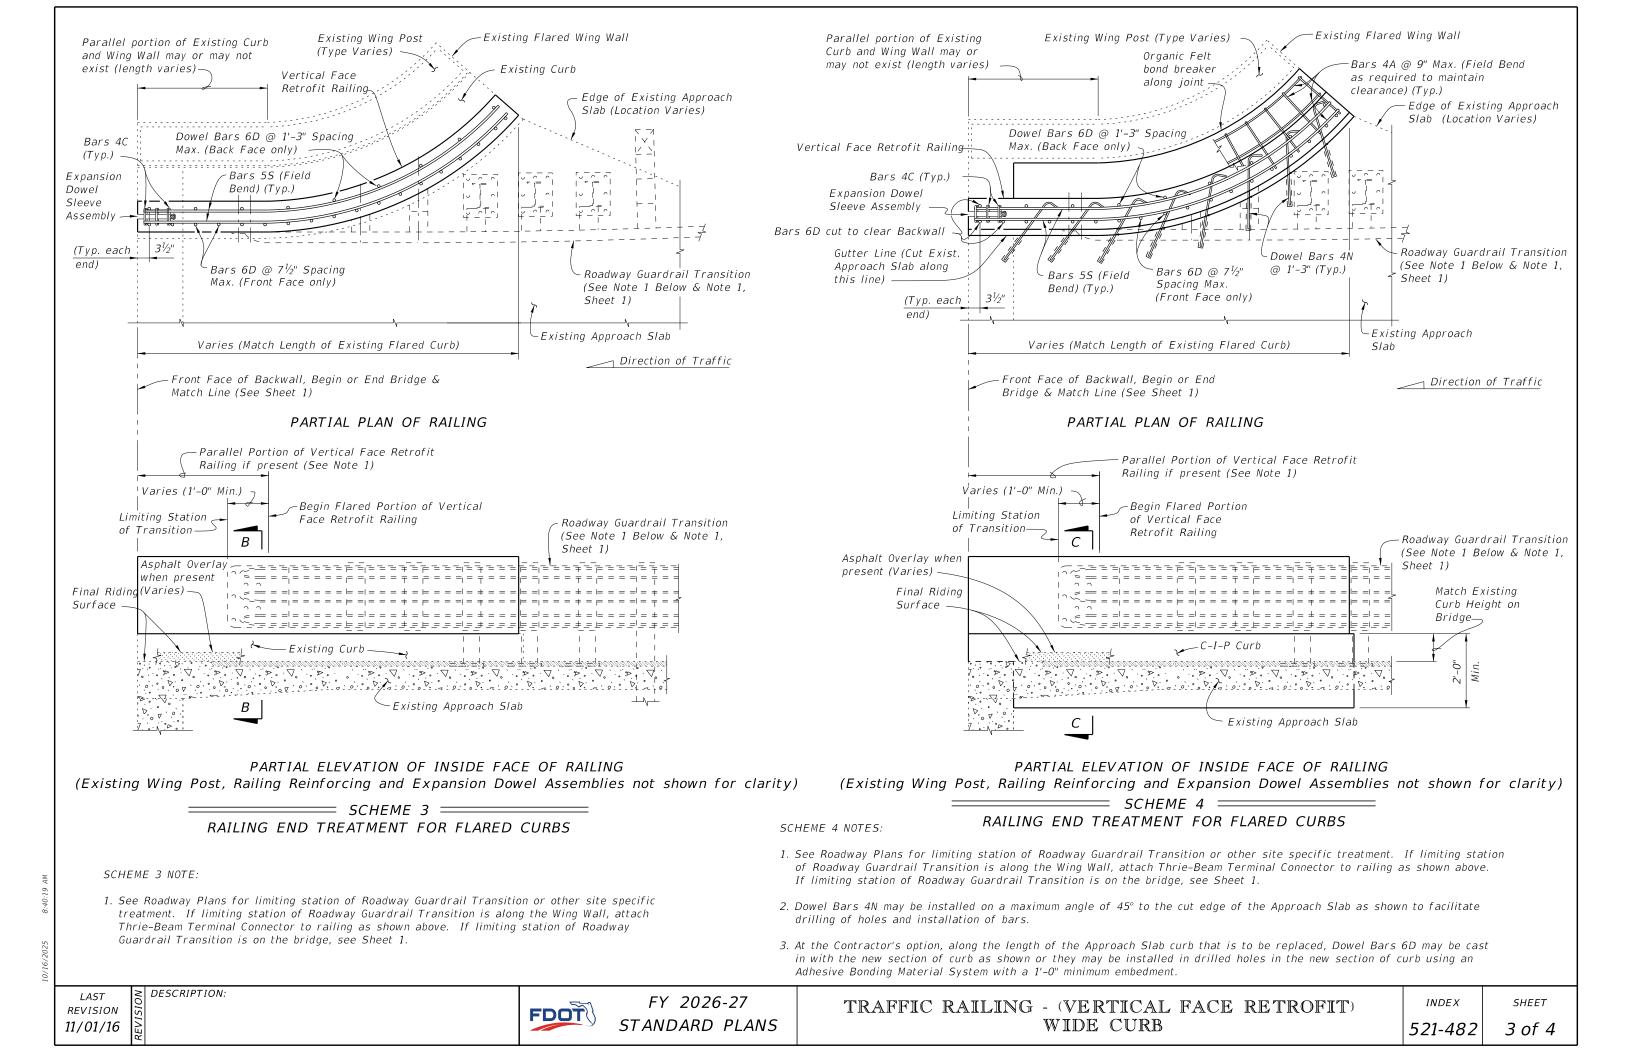

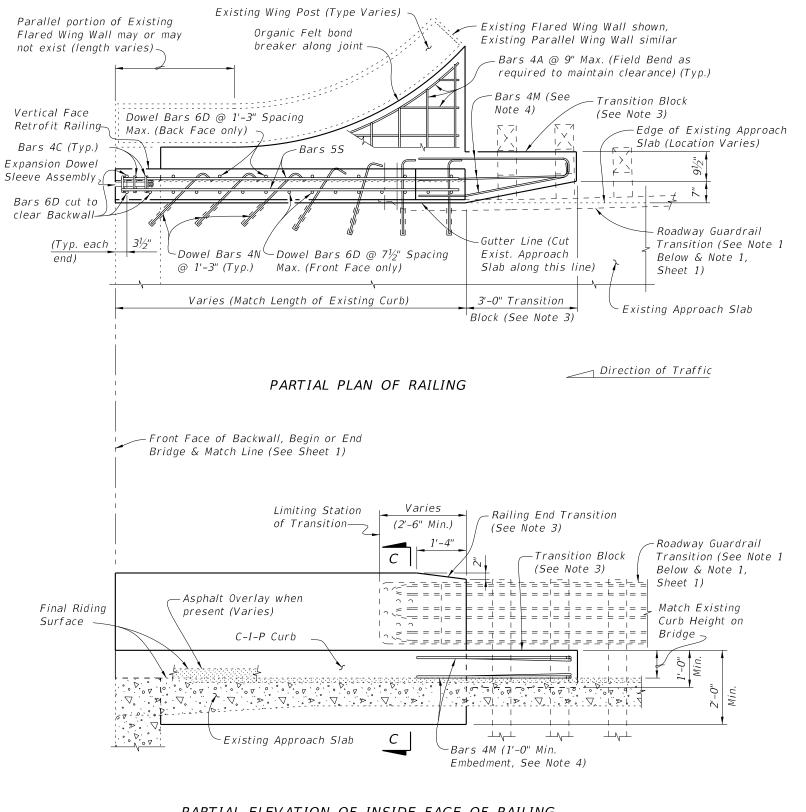

PARTIAL ELEVATION OF INSIDE FACE OF RAILING (Existing Wing Post, Railing Reinforcing and Expansion Dowel Assemblies not shown for clarity)

RAILING END TREATMENT FOR PARALLEL CURBS

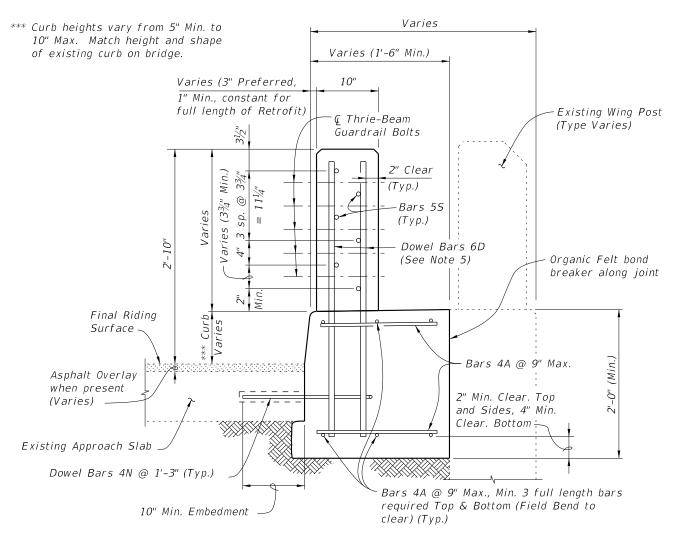

SECTION C-C TYPICAL SECTION THRU RAILING ALONG APPROACH SLAB (SCHEME 4 SHOWN, SCHEME 5 SIMILAR)

### SCHEME 5 NOTES:

- 1. See Roadway Plans for limiting station of Roadway Guardrail Transition or other site specific treatment. If limiting station of Roadway Guardrail Transition is along the Wing Wall, attach Thrie-Beam Terminal Connector to railing as shown above. If limiting station of Roadway Guardrail Transition is on the bridge, see Sheet 1.
- 2. Dowel Bars 4N may be installed on a maximum angle of 45° to the cut edge of the Approach Slab as shown to facilitate drilling of holes and installation of bars.
- 3. Provide Transition Block (as shown) or Curb if existing Approach Slab Curb does not extend beyond end of existing End Bent Wing Wall, see Roadway Plans. Shape and height of Transition Block or Curb shall match existing bridge curb. Railing End Transition and Transition Block may be omitted on trailing ends with no opposing traffic.
- 4. Field bend Dowel Bars 4M within Transition Block as required to maintain 2" top and side clearance and 3" bottom clearance.
- 5. At the Contractor's option, along the length of the Approach Slab curb that is to be replaced, Dowel Bars 6D may be cast in with the new section of curb as shown or they may be installed in drilled holes in the new section of curb using an Adhesive Bonding Material System with a 1'-0" minimum embedment.

LAST REVISION 11/01/16

DESCRIPTION:

FDOT


FY 2026-27 STANDARD PLANS

TRAFFIC RAILING - (VERTICAL FACE RETROFIT)
WIDE CURB

INDEX

SHEET

521-482 4 of 4

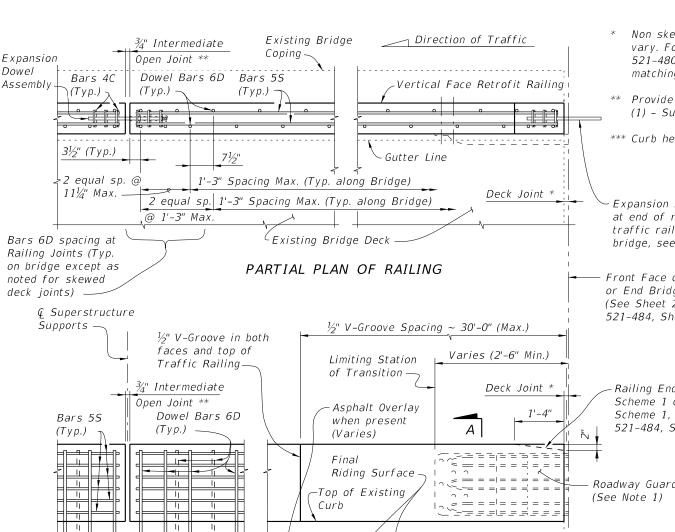

PARTIAL ELEVATION OF INSIDE FACE OF RAILING (Expansion Dowel Assemblies and Bars 4C not shown for clarity

Existing Bridge Deck-

TYPICAL TREATMENT OF RAILING ALONG BRIDGE

- 1. On approach end provide a Roadway Guardrail Transition, Index 536-002 (as shown) or other site specific treatment. See Roadway Plans for limiting station of Roadway Guardrail Transition or other site specific treatment. If limiting station of Roadway Guardrail Transition is on the bridge, attach Thrie-Beam Terminal Connector to railing as shown above. If limiting station of Roadway Guardrail Transition is along the Wing Wall, see Schemes 2 or 3, Sheets 2 & 3. On skewed bridges, if the skew along the deck joint extends across the width of the railing, the 2'-6" minimum dimension shall apply to both the front and back face of the railing. For treatment of trailing end see Roadway Plans. If vertical face retrofit extends beyond bridge and approach slab ends, see Index 521-484 for treatment and Details.
- 2. Field cut Bars 5S and Dowel Bars 6D to maintain clearance within Vertical Face Retrofit Railing.

DESCRIPTION:

REVISION

07/01/13

3. Where existing structure has been removed and not encased in new concrete; match adjoining areas and finish flat by grouting or grinding as required. Exposed existing reinforcing steel not encased in new concrete shall be burned off 1" below existing concrete and grouted over.

- Non skewed deck joint shown, actual joint dimensions and orientation vary. For treatment at skewed deck joints see Skew Detail, Index 521-480. Provide open Railing Joints at Deck Expansion Joint locations matching the dimension of the Deck Joint.
- \*\* Provide ¾" Intermediate Open Joints at : (1) - Superstructure supports where slab is continuous.
- \*\*\* Curb heights vary from 5" Min. to 1'-2" Max.

Expansion Dowel & Bars 4C not required at end of railing for Scheme 1, except where traffic railing retrofit extends beyond ends of bridge, see Index 521-484

Front Face of Backwall, Begin or End Bridge & Match Line (See Sheet 2 and 3 and Index 521-484, Sheets 5, 9 & 10.)

Railing End Transition Scheme 1 only (See Note 1, Scheme 1, Sheet 2, & Index 521-484, Sheet 5, 9 & 10)


Roadway Guardrail Transition

Existing


TYPICAL SECTION THRU EXISTING TRAFFIC RAILING SHOWING LIMITS OF REMOVAL (BRIDGE DECK SHOWN, WING WALL SIMILAR)

#### CROSS REFERENCE:

For General Notes, Estimated Quantities, Dowel Detail, Expansion Dowel Detail, Reinforcing Steel Notes & Bending Diagram see Index 521-480.

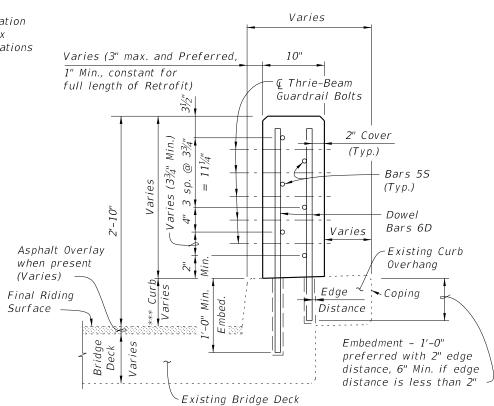

### SECTION A-A TYPICAL SECTION THRU RAILING ON BRIDGE DECK

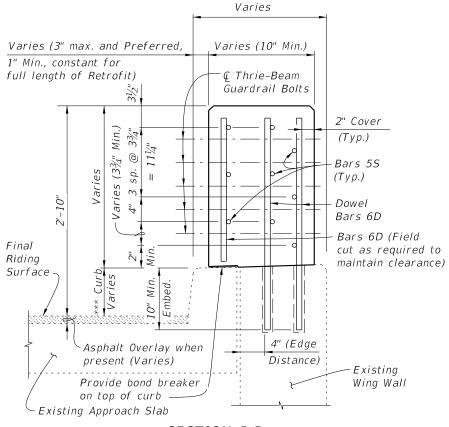

SECTION B-B TYPICAL SECTION THRU RAILING ON WING WALL

FDOT


FY 2026-27 STANDARD PLANS

TRAFFIC RAILING - (VERTICAL FACE RETROFIT) INTERMEDIATE CURB







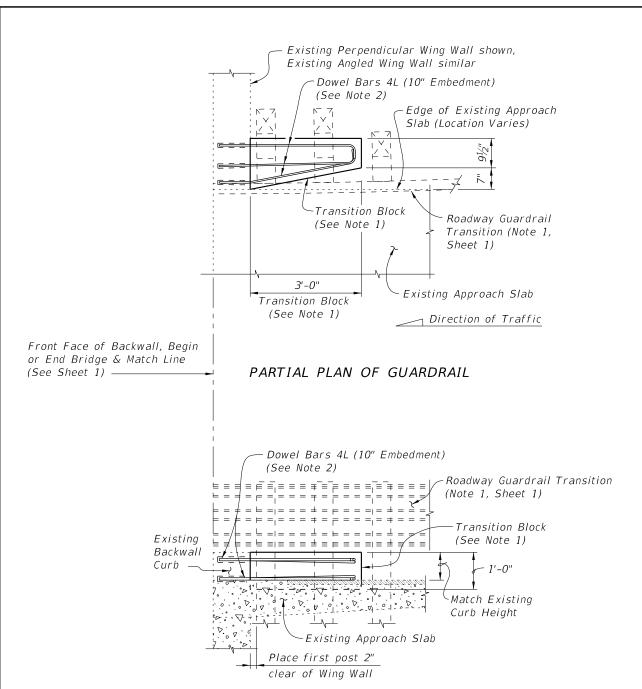


## PARTIAL ELEVATION OF INSIDE FACE OF GUARDRAIL

# RAILING END TREATMENT FOR PERPENDICULAR OR ANGLED WING WALLS

#### SCHEME 1 NOTES:

- Provide Transition Block (as shown) or Curb if existing Approach Slab does not have a curb, see Roadway Plans. Shape and height of Transition Block or Curb shall match existing bridge curb. Railing End Transition and Transition Block may be omitted on trailing ends with no opposing traffic.
- 2. Field bend Dowel Bars 4L within Transition Block as required to maintain 2" top and side clearance and 3" bottom clearance.
- 3. If a Special Steel Guardrail Post is required for attachment to the top of a sloping Wing Wall, saw cut and remove a wedge shaped portion of the sloping Wing Wall as required to provide a level surface for post installation.

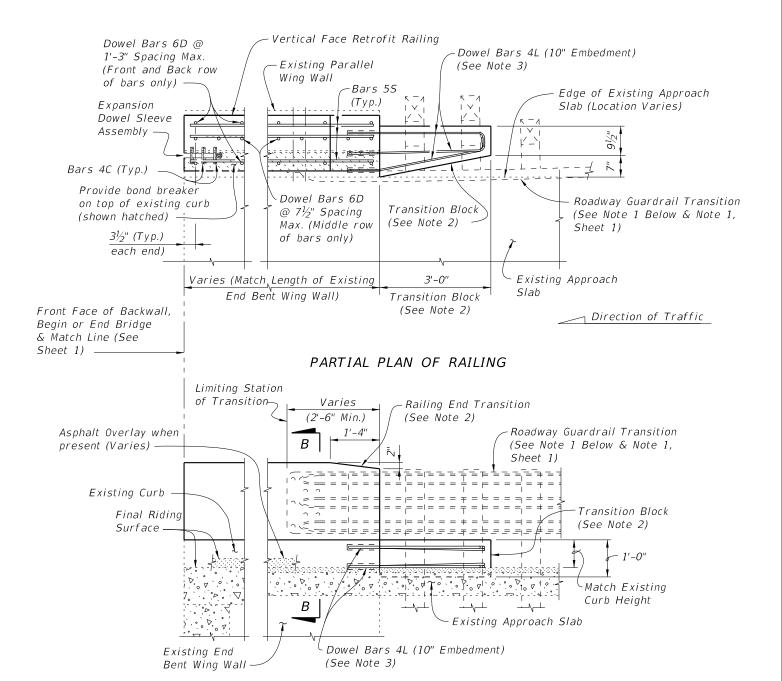

PARTIAL ELEVATION OF INSIDE FACE OF RAILING (Railing Reinforcing and Expansion Dowel Assemblies not shown for clarity)

# RAILING END TREATMENT FOR PARALLEL WING WALLS


#### SCHEME 2 NOTES:

- 1. See Roadway Plans for limiting station of Roadway Guardrail Transition or other site specific treatment. If limiting station of Roadway Guardrail Transition is along the Wing Wall, attach Thrie-Beam Terminal Connector to railing as shown above. If limiting station of Roadway Guardrail Transition is on the bridge, see Sheet 1. On skewed bridges, if the skew along the deck joint extends across the width of the railing, the 2'-6" minimum dimension shall apply to both the front and back face of the railing.
- 2. Provide Transition Block (as shown) or Curb if existing Approach Slab Curb does not extend beyond end of existing End Bent Wing Wall, see Roadway Plans. Shape and height of Transition Block or Curb shall match existing bridge curb. Railing End Transition and Transition Block may be omitted on trailing ends with no opposing traffic.
- 3. Field bend Dowel Bars 4L within Transition Block as required to maintain 2" top and side clearance and 3" bottom clearance.

PARTIAL ELEVATION OF INSIDE FACE OF RAILING (Railing Reinforcing and Expansion Dowel Assemblies not shown for clarity)

> RAILING END TREATMENT FOR FLARED WING WALLS

DESCRIPTION:

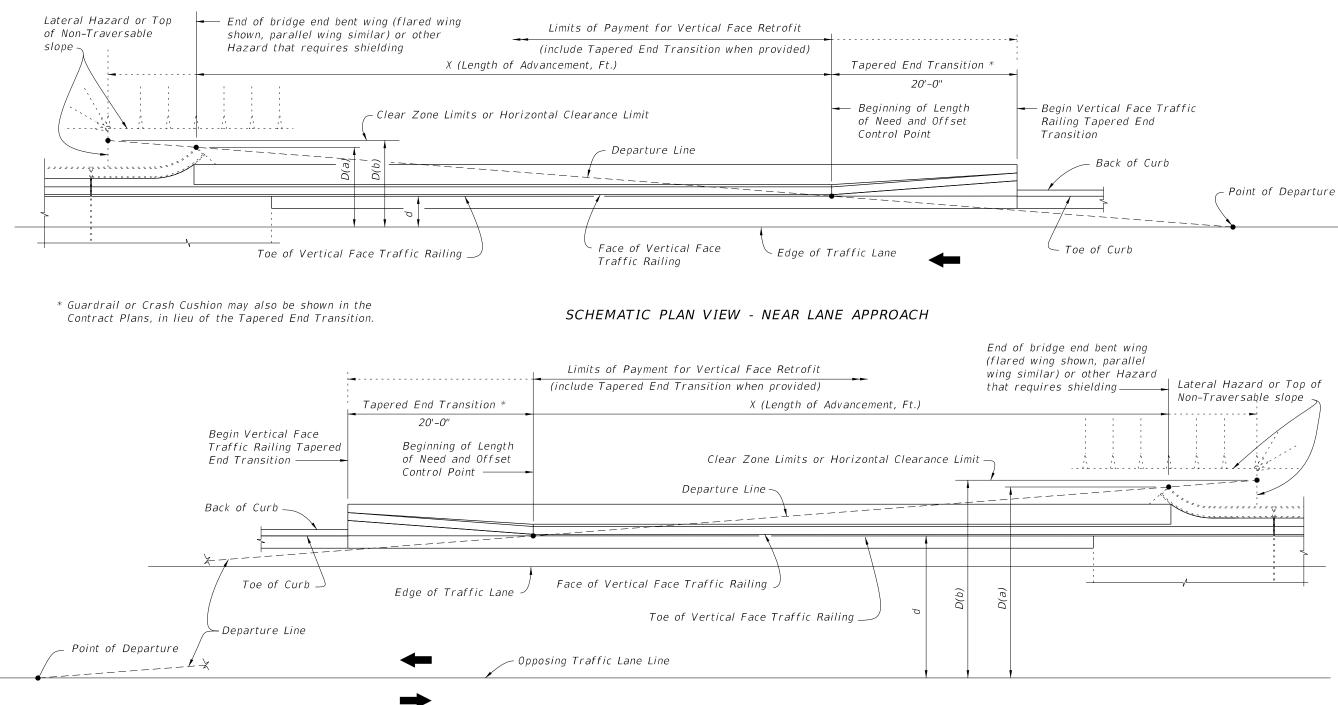

SCHEMATIC PLAN VIEW - OPPOSING LANE APPROACH


CROSS REFERENCES:


For General Notes, Dowel Details, Expansion Dowel Details, Reinforcing Steel Notes and Reinforcing Steel Bending Diagram see Index 521-480.

REVISION 07/01/09

DESCRIPTION:

FDOT

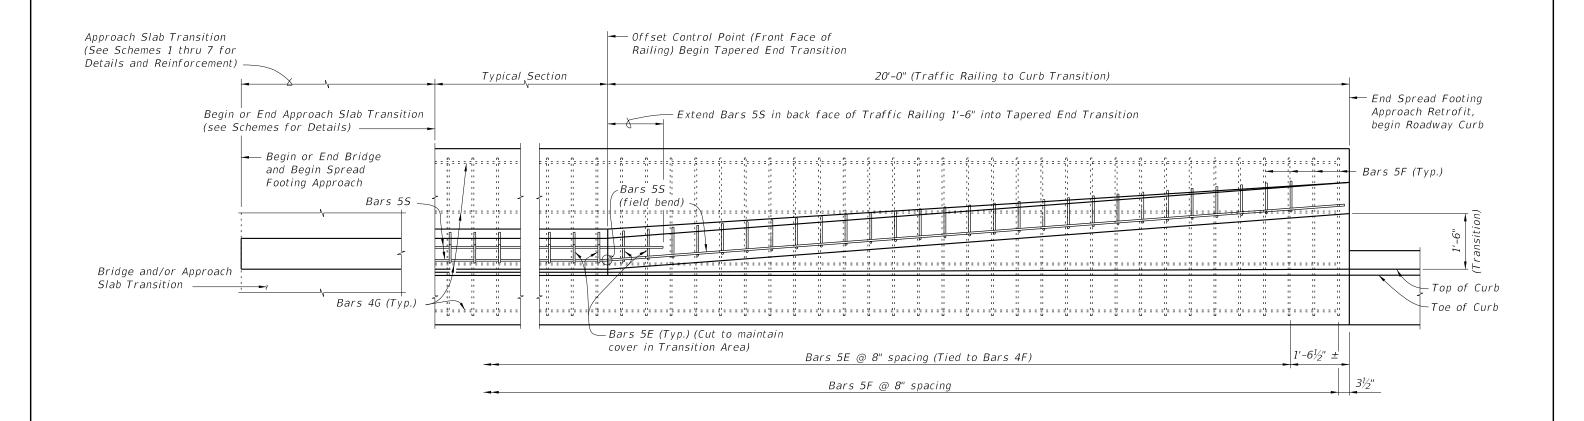

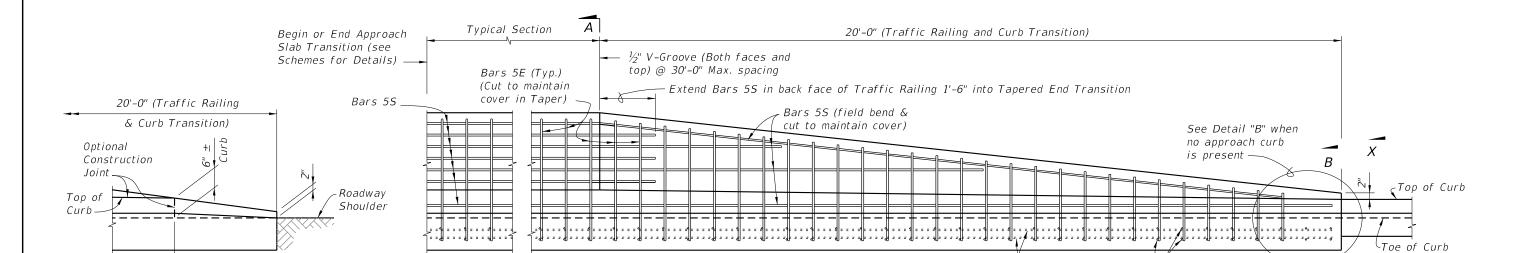

DETAIL "B" TRANSITION TO NON-CURB APPROACH (Reinforcing Not Shown For Clarity)

2'-9" Vertical Curb Transition

PARTIAL ELEVATION VIEW

PARTIAL PLAN VIEW

*TAPERED END TRANSITION* =

CROSS REFERENCES: For Section A-A, B-B and X-X see Sheet 4.

REVISION 07/01/09

DESCRIPTION:

FDOT

FY 2026-27 STANDARD PLANS

A


TRAFFIC RAILING - (VERTICAL FACE RETROFIT) SPREAD FOOTING APPROACH

Bars 4G (Typ.)

-Bars 5F (Typ.)

INDEX

SHEET

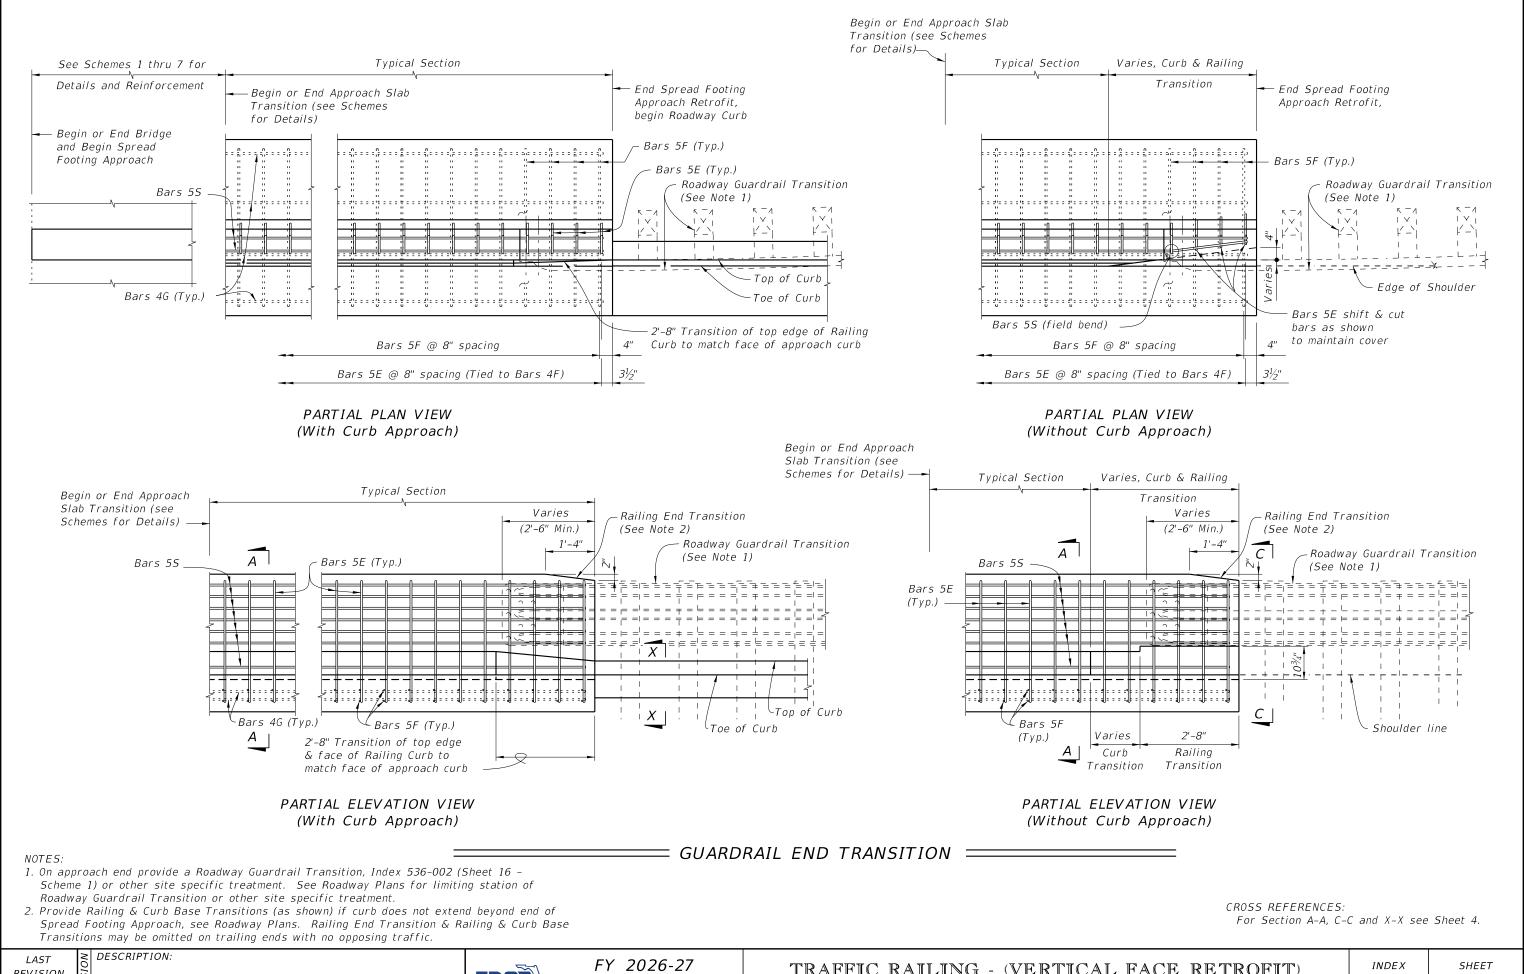


REVISION 07/01/09

FDOT


ESTIMATED TRAFFIC RAILING RETROFIT SPREAD FOOTING APPROACH QUANTITIES			
ITEM	11017	QUANTITY	
ITEM	UNIT	9" Curb	
Concrete - Typical Section	CY/Ft.	0.25	
Reinforcing Steel - Typical Section	Lb./Ft.	38	
Concrete - 20'-0" Tapered End Transition plus Footing	CY	4.57 Total	
Reinforcing Steel - 20'-0" Tapered End Transition plus Footing	Lb.	776 Total	

NOTE: Quantities are based on a 9" curb, no curb cross slope.



SECTION X-X (TYPICAL CURB, TYPE VARIES, TYPE F SHOWN) (See Index 520-001 and Plans for Details)

- \* Match Cross Slope of high side and low side at begin or end bridge or approach slab.
- \*\* Match curb height of adjacent bridge and approach slab. Adjust height in Transition area to match adjoining Roadway curb.

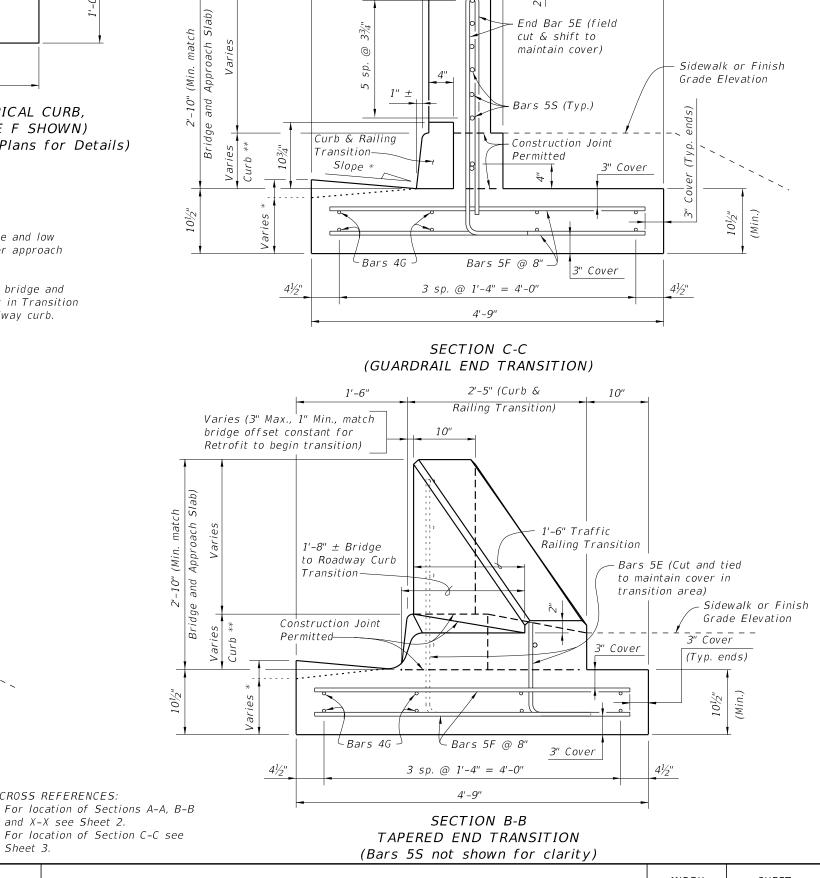

2'-2"

Varies (0" to 2")


1'-6"

Varies (3" Max., 1" Min., match bridge offset constant for Retrofit

to begin Curb & Railing Transition)


1'-1"

10"

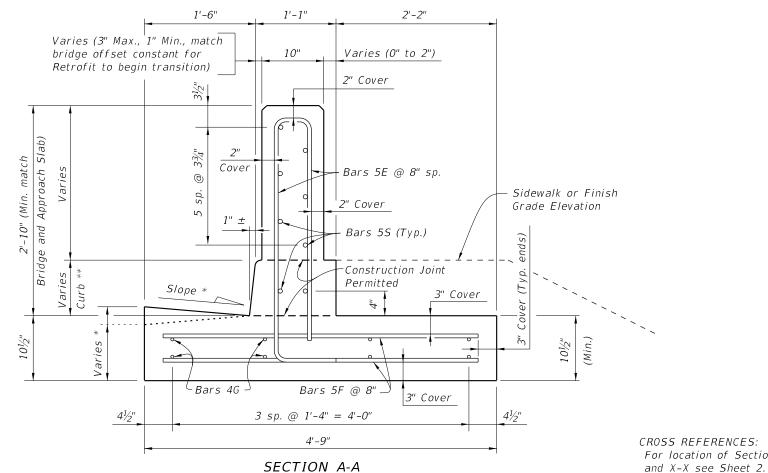

FY 2026-27 FDOT STANDARD PLANS

Sheet 3.

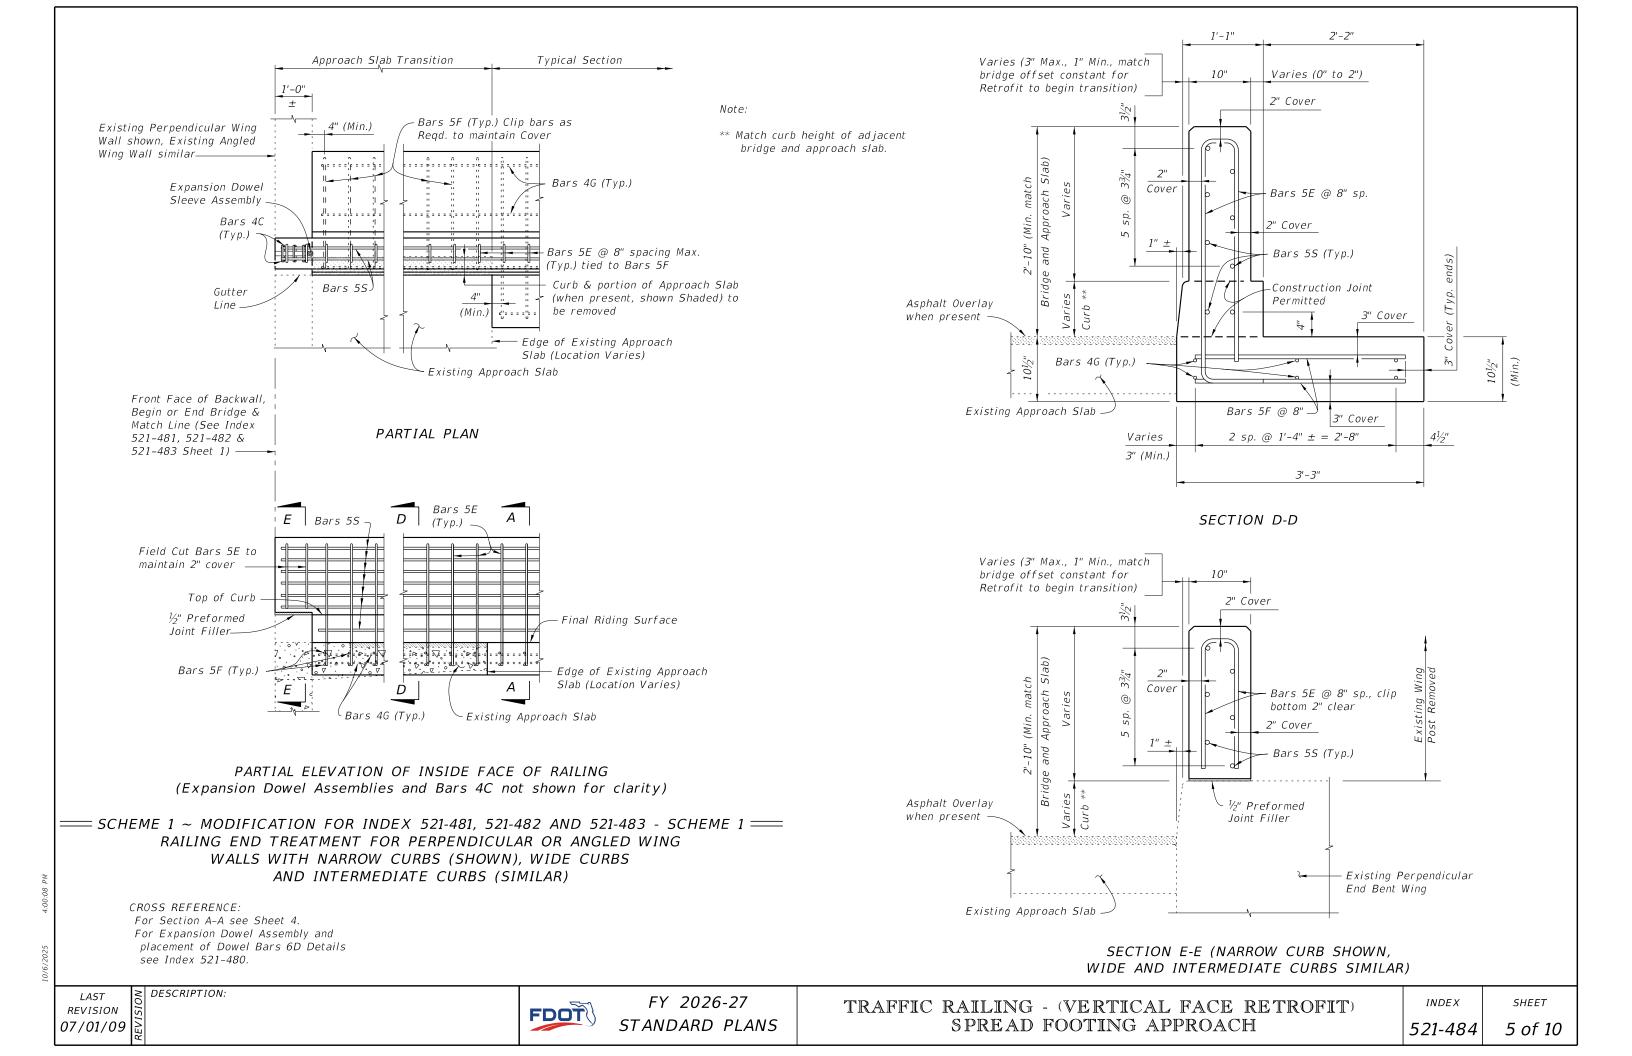


PARTIAL ELEVATION OF INSIDE FACE OF RAILING (Expansion Dowel Assemblies and Bars 4C not shown for clarity)


==== SCHEME 2 ~ MODIFICATION FOR INDEX 521-481 - SCHEME 2 ====== RAILING END TREATMENT FOR PARALLEL WING WALLS WITH NARROW CURBS

DESCRIPTION:

1. Remove existing concrete along saw cut joints. Existing reinforcing steel may be cut at joint or extended into new concrete. Exposed existing reinforcing not encased in new concrete shall be removed 1" below existing concrete surface and grouted over.

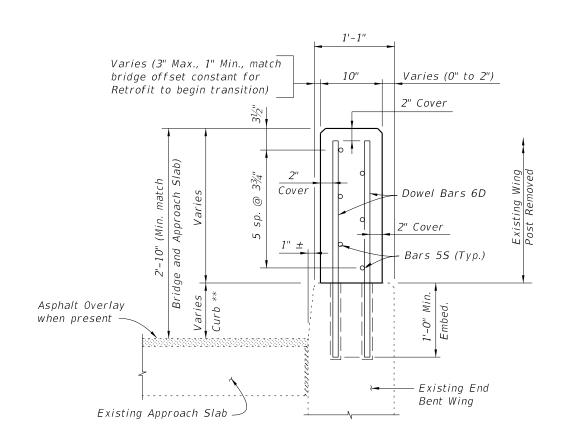

SECTION F-F

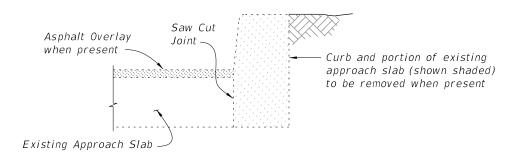

SECTION THRU EXISTING CURB AND APPROACH SLAB TO BE REMOVED (Free Standing Curb Similar)

CROSS REFERENCES:

For Section A-A see Sheet 4. For Section D-D see Sheet 5. For Expansion Dowel Assembly and placement of Dowel Bars 6D Details see Index 521-480.

REVISION 07/01/09

FDOT


FY 2026-27 STANDARD PLANS

TRAFFIC RAILING - (VERTICAL FACE RETROFIT) SPREAD FOOTING APPROACH

INDEX


SHEET

6 of 10 *521-484* 

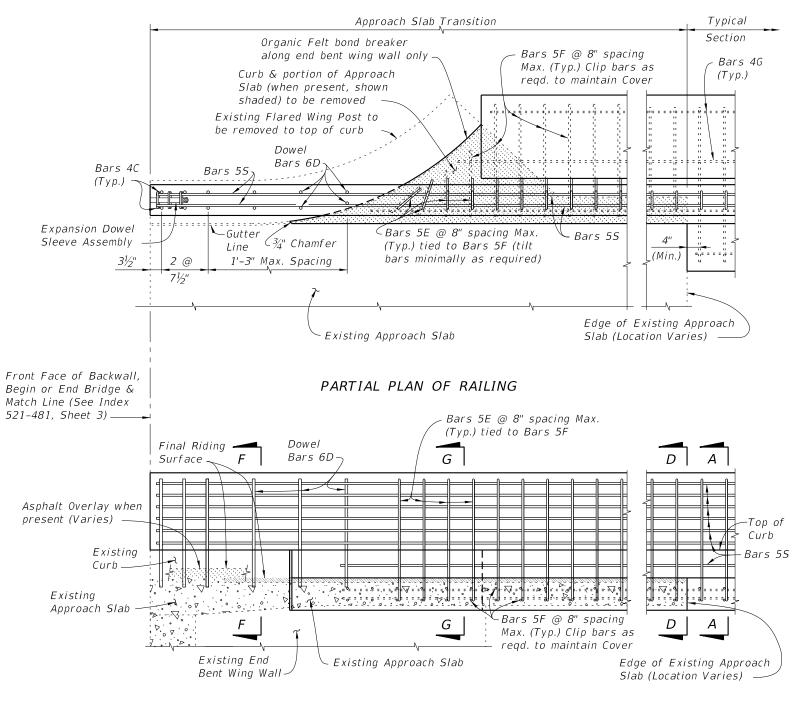

PARTIAL ELEVATION OF INSIDE FACE OF RAILING (Expansion Dowel Assemblies and Bars 4C not shown for clarity)

= SCHEME 3 ~ MODIFICATION FOR INDEX 521-481 SCHEME 3 == RAILING END TREATMENT FOR FLARED WING WALLS WITH NARROW CURBS

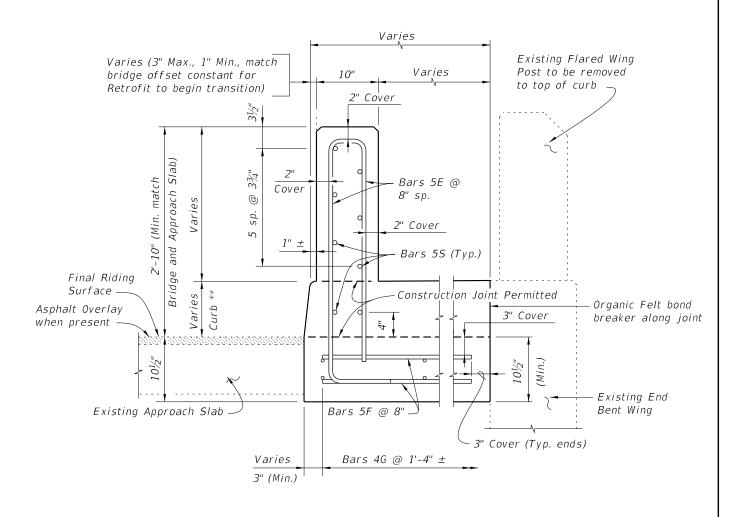

SECTION G-G

\*\* Match curb height at adjoining existing end bent wing.

CROSS REFERENCES:

For Section A-A see Sheet 4.

For Section D-D see Sheet 5.

For Section F-F see Sheet 6.

For Expansion Dowel Assemblies Details and


placement of Dowel Bars 6D see Index 521-480.


REVISION 11/01/16

DESCRIPTION:

FDOT

FY 2026-27 STANDARD PLANS

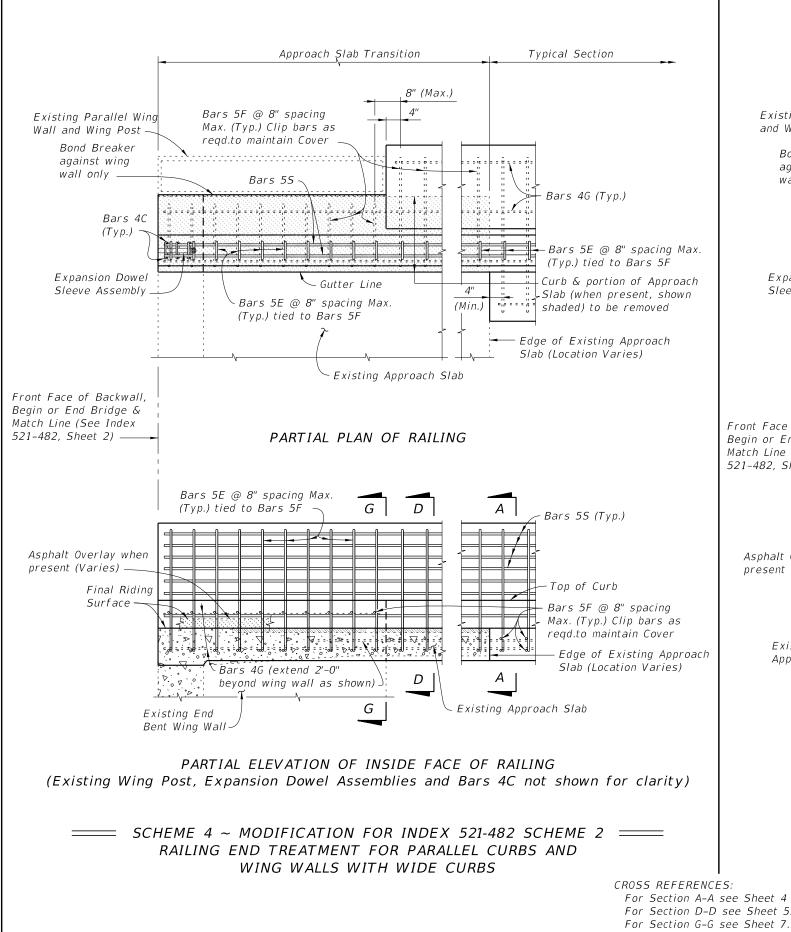

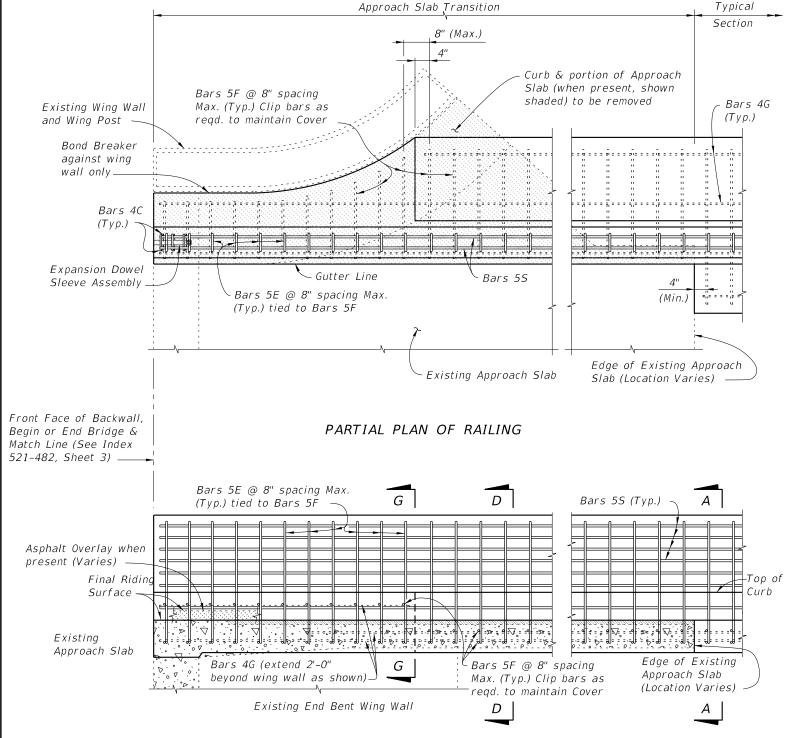

PARTIAL ELEVATION OF INSIDE FACE OF RAILING (Existing Wing Post, Expansion Dowel Assemblies and Bars 4C not shown for clarity)

=== SCHEME 5 ~ MODIFICATION FOR INDEX 521-482 SCHEME 3 AND 4 ==== RAILING END TREATMENT FOR PARALLEL CURBS AND FLARED WING WALLS WITH WIDE CURBS

For Section A-A see Sheet 4

For Section D-D see Sheet 5.

For Expansion Dowel Assemblies Details see Index 521-480.

REVISION 07/01/09 DESCRIPTION:

FY 2026-27 STANDARD PLANS


TRAFFIC RAILING - (VERTICAL FACE RETROFIT) SPREAD FOOTING APPROACH

INDEX

SHEET


8 of 10

521-484

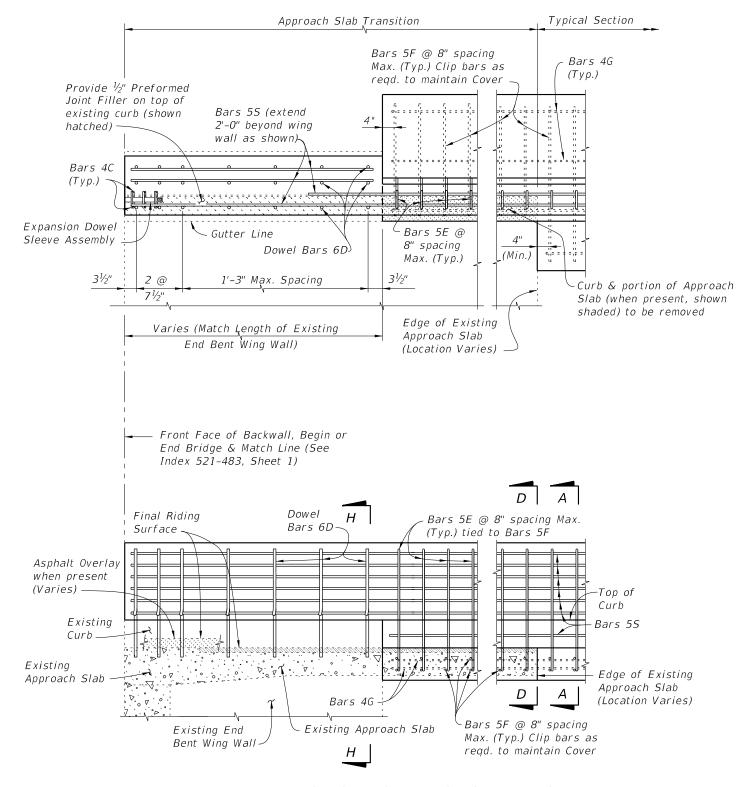

PARTIAL ELEVATION OF INSIDE FACE OF RAILING (Expansion Dowel Assemblies and Bars 4C not shown for clarity)

= SCHEME 6 ~ MODIFICATION FOR INDEX 521-483 SCHEME 2 ===== RAILING END TREATMENT FOR PARALLEL CURBS AND WING WALLS WITH INTERMEDIATE CURBS

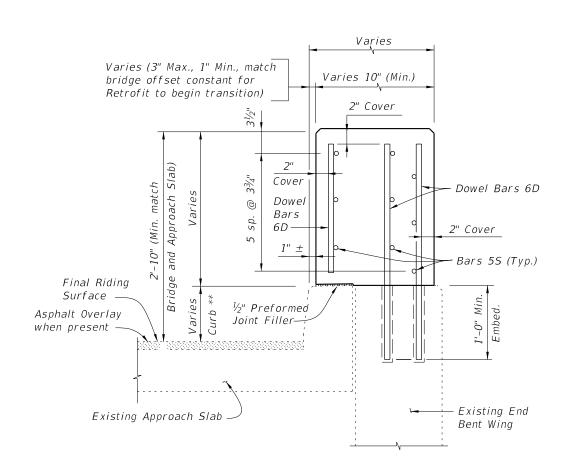

SECTION H-H

\*\* Match curb height at adjoining existing end bent wing.

CROSS REFERENCES:


For Section A-A see Sheet 4. For Section D-D see Sheet 5. For Expansion Dowel Assembly and placement of Dowel Bars 6D Details see Index 521-480.

REVISION 07/01/09

DESCRIPTION:


FY 2026-27 STANDARD PLANS

*521-484* 9 of 10

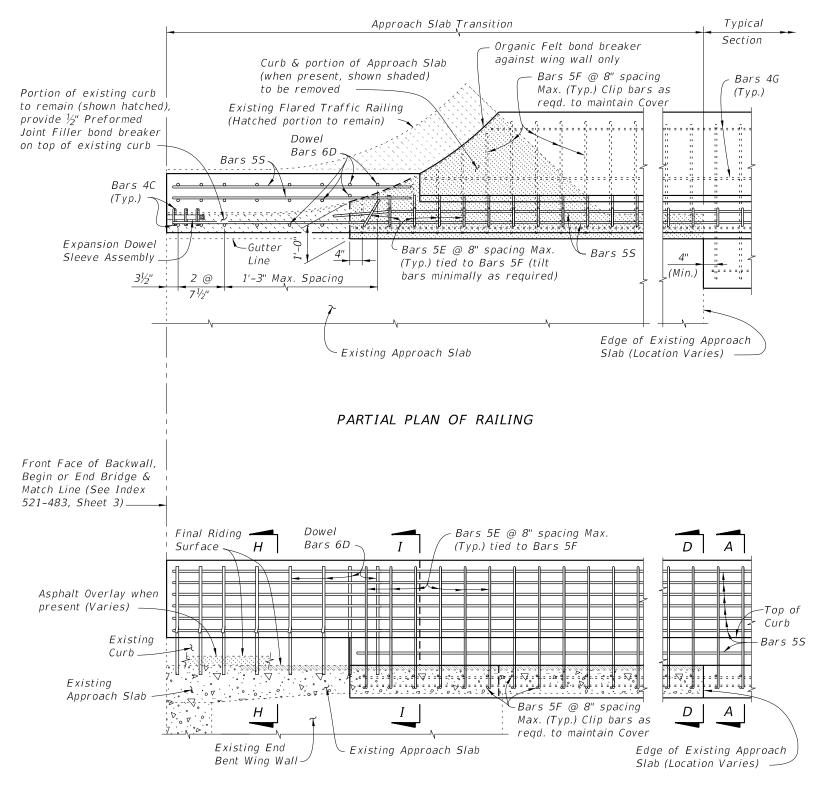

PARTIAL ELEVATION OF INSIDE FACE OF RAILING (Expansion Dowel Assemblies and Bars 4C not shown for clarity)

= SCHEME 7 ~ MODIFICATION FOR INDEX 521-483 SCHEME 3 === RAILING END TREATMENT FOR PARALLEL CURBS AND FLARED WING WALLS WITH INTERMEDIATE CURBS

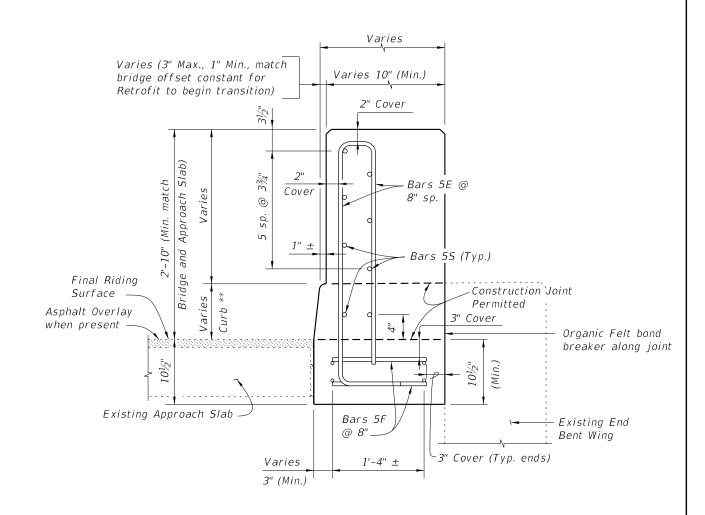

#### SECTION I-I

Note:

\*\* Match curb height at adjoining existing end bent wing.

> CROSS REFERENCES: For Section A-A see Sheet 4. For Section D-D see Sheet 5. For Section H-H see Sheet 9. For Expansion Dowel Assemblies and placement of Dowel Bars 6D Details

see Index 521-480.


REVISION 11/01/16

DESCRIPTION:


FDOT

FY 2026-27 STANDARD PLANS

*521-484* 10 of 10

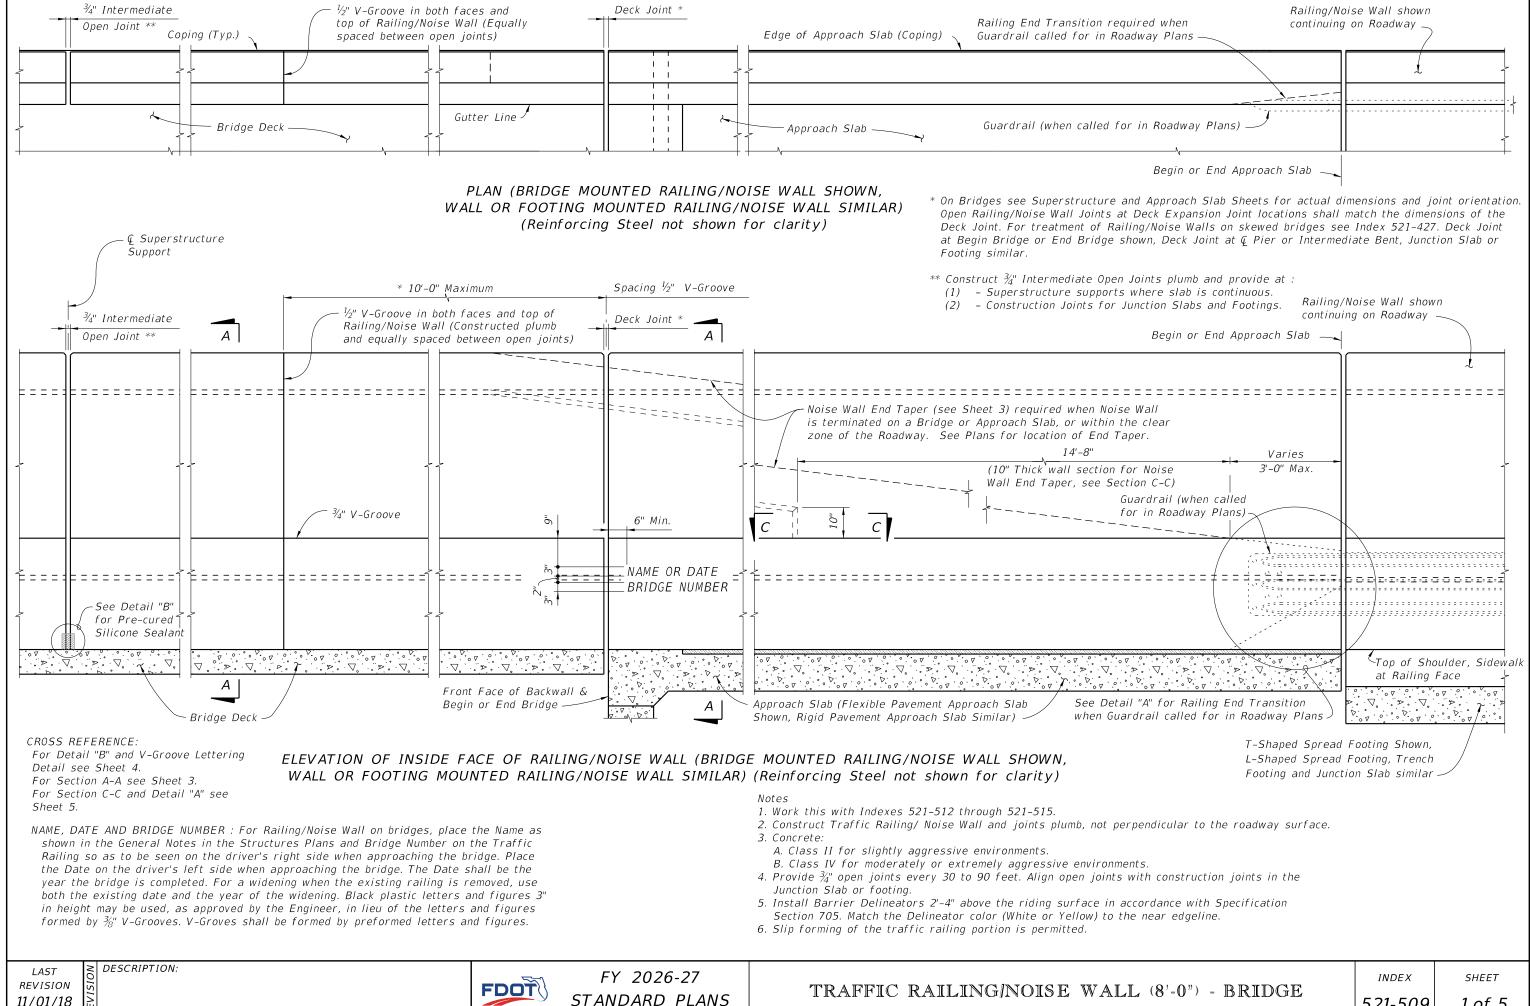

11/01/18

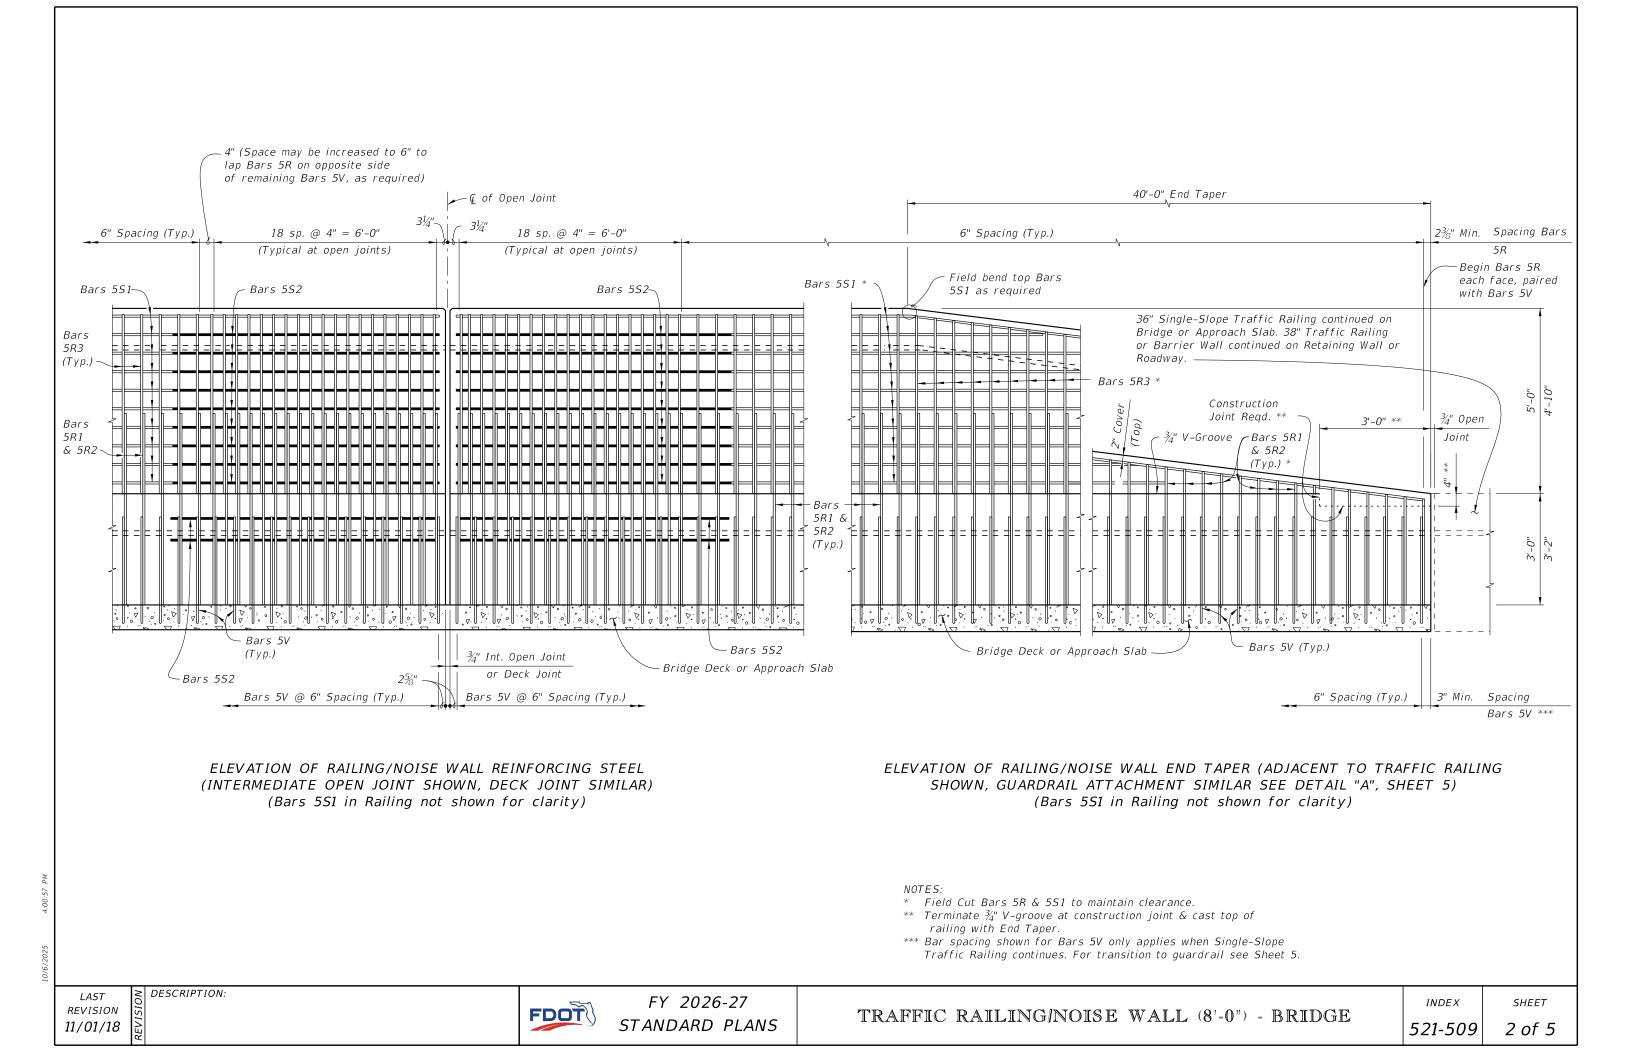


# SECTION A-A TYPICAL SECTION THRU TRAFFIC RAILING/NOISE WALL (Section Thru Bridge Deck Shown, Section Thru Approach Slab Similar)

CROSS REFERENCE:
For locations of Section A-A see Sheet 1.

For location of View B-B, see Sheet 5.

1. Bottom Bars 5S1 shown are part of the Traffic Railing/Noise Wall reinforcing. See Superstructure Sheets in the Plans for additional Bridge Deck Reinforcing.

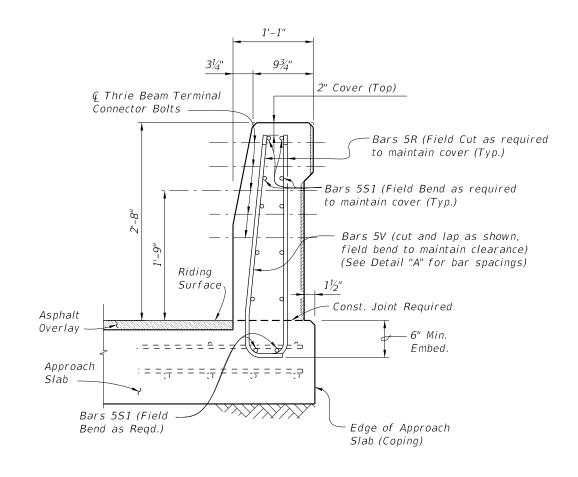

VIEW B-B
END VIEW OF RAILING END TRANSITION FOR
GUARDRAIL ATTACHMENT AT END OF APPROACH SLAB
(Flexible Pavement Approach Slab Shown, Rigid Pavement Approach Slab Similar)


LAST REVISION 11/01/18

DESCRIPTION:


FDOT

FY 2026-27 STANDARD PLANS

- 1. At Intermediate Open Joints, seal the lower 6" portion of the open joint with Pre-cured Silicone Sealant in accordance with Specification Section 932.
- 2. Apply sealant prior to any Class V finish coating and remove all curing compound and loose material from the surface prior to application of bonding agent.
- 3. The cost of the Pre-cured Silicone Sealant shall be included in the Contract Unit Price for the Traffic Railing.
- 4. As an alternative option, a mortar plug may be used to seal the joint as shown in the mortar plug detail and in accordance with Specification Section 400.




OPTION I



OPTION II (Alternative Mortar Plug at Open Joint)

DETAIL "B" =



# SECTION THRU RECESSED "V" GROOVE TO FORM INSCRIBED LETTERS AND FIGURES

ESTIMATED TRAFFIC RAILING/NOISE WALL QUANTITIES		
ITEM	QUANTITY	
Concrete (Railing)	CY/LF	0.107
Concrete (Noise Wall)	CY/LF	0.136
Reinforcing Steel (Typical)	LB/LF	79.17
Additional Reinf. @ Open Joint	LB	208.86

(The above quantities are based on the bridge mounted typical section, 2% deck cross slope and railing on low side of deck.)


# REINFORCING STEEL BENDING DIAGRAMS


BILL OF REINFORCING STEEL			
MARK	SIZE	LENGTH	
R1	5	5'-2"	
R2	5	5'-2 <sup>1</sup> / <sub>2</sub> "	
R3	5	4'-10"	
S1	5	As Reqd.	
52	5	7'-3"	
V	5	6'-6 <sup>1</sup> / <sub>2</sub> "	


BRIDGE		LOW G	UTTER	HIGH C	GUTTER
CRO	OSS-SLOPE	ØA	ØB	ØA	ØB
E ED	0% to 2%	90°	90°	90°	90°
BRIDGE MOUNTEL	2% to 6%	93°	87°	87°	93°
OW 18	6% to 10%	96°	84°	84°	96°

551	Length as Required
552	7'-3"

BARS 5S1 & 5S2

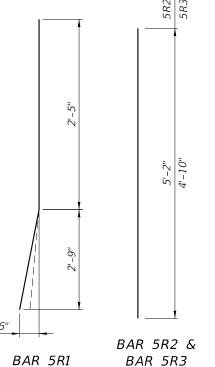

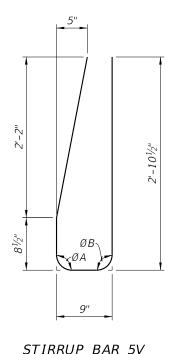



(Field Cut and Bend for Railing End Transition)


END STIRRUP BAR 5V To Be Field Cut (Railing End Transition)

#### REINFORCING STEEL NOTES:


- 1. All bar dimensions in the bending diagrams are out to out.
- 2. All reinforcing steel at the open joints shall have a 2" minimum cover.
- 3. Bars 5R shall be one continuous or lap spliced bar. No mechanical couplers are permitted.
- 4. Bars 5S1 may be continuous or spliced at the construction joints. Lap splices for Bars 5R2 and 5S1 shall be a minimum of 2'-2".
- 5. The Contractor may use Welded Wire Reinforcement (WWR) when approved by the Engineer. WWR must consist of deformed wire meeting the requirements of Specification Section 931.

CROSS REFERENCE: For locations of Detail "B", see Sheet 1.

DESCRIPTION:

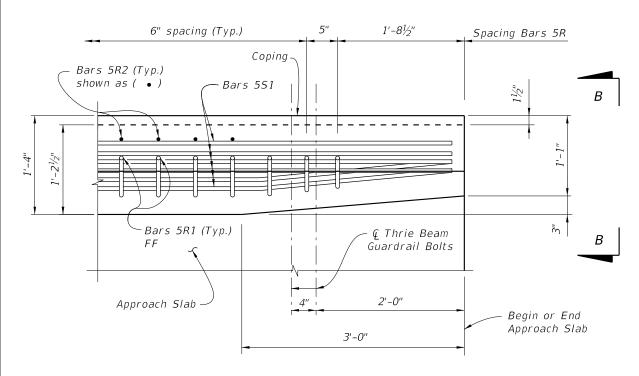

PLAN - RAILING END TRANSITION (Showing Bars 5R, and Bars 5S1) (Bars 5V & Noise Wall Reinforcement not shown for Clarity)

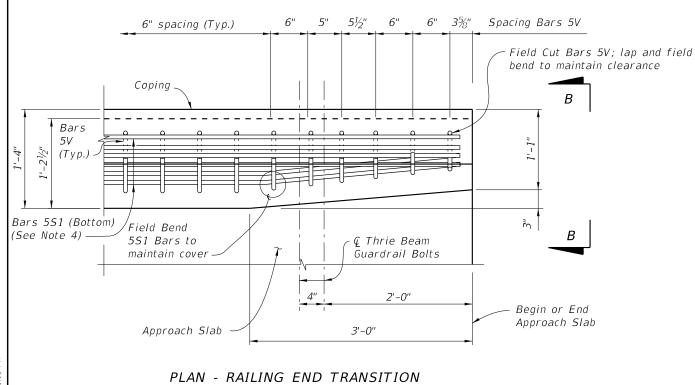

(Showing Bars 5V and Bars 5S1) (Bars 5R not shown for Clarity)


DETAIL "A" ==

#### DESCRIPTION: LAST REVISION 11/01/18

FY 2026-27 FDOT STANDARD PLANS

#### DETAIL "A" NOTES:

- 1. Begin placing Railing Bars 5V at the railing end and proceed toward the guardrail (thrie beam) terminal connector to ensure placement of guardrail bolt holes. Pair Bars 5R with Bars 5V as shown. Clearance of Bars 5R & 5V to guardrail bolt holes shall be checked to prevent cutting of bars if holes are to be drilled. Shift bars locally where conflicts occur.
- 2. For Guardrail connection details see Index 536-001.
- Omit Railing End Transition if a 36" Single-Slope Traffic Railing is used beyond the End Taper. See the Plan Sheets.
- 4. Field cut Bars 5R2 to maintain cover. Field cut Bars 5V and lap as necessary to maintain cover; field cut & bend Bars 5R1 front leg (more plumb) to maintain cover and tie to S1 Bars.

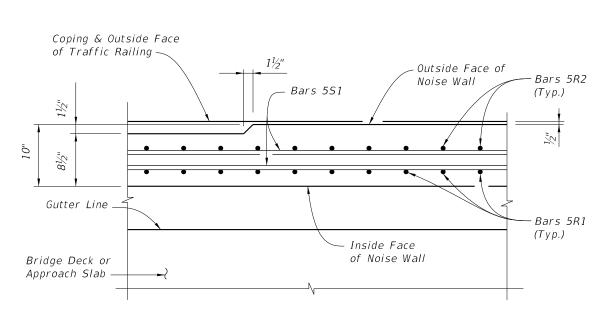


SECTION C-C THRU NOISE WALL END TAPER


> CROSS REFERENCE: For location of Detail "A" see Sheet 1. For location of Section C-C see Sheet 1.

For View B-B see Sheet 3.


INDEX

SHEET

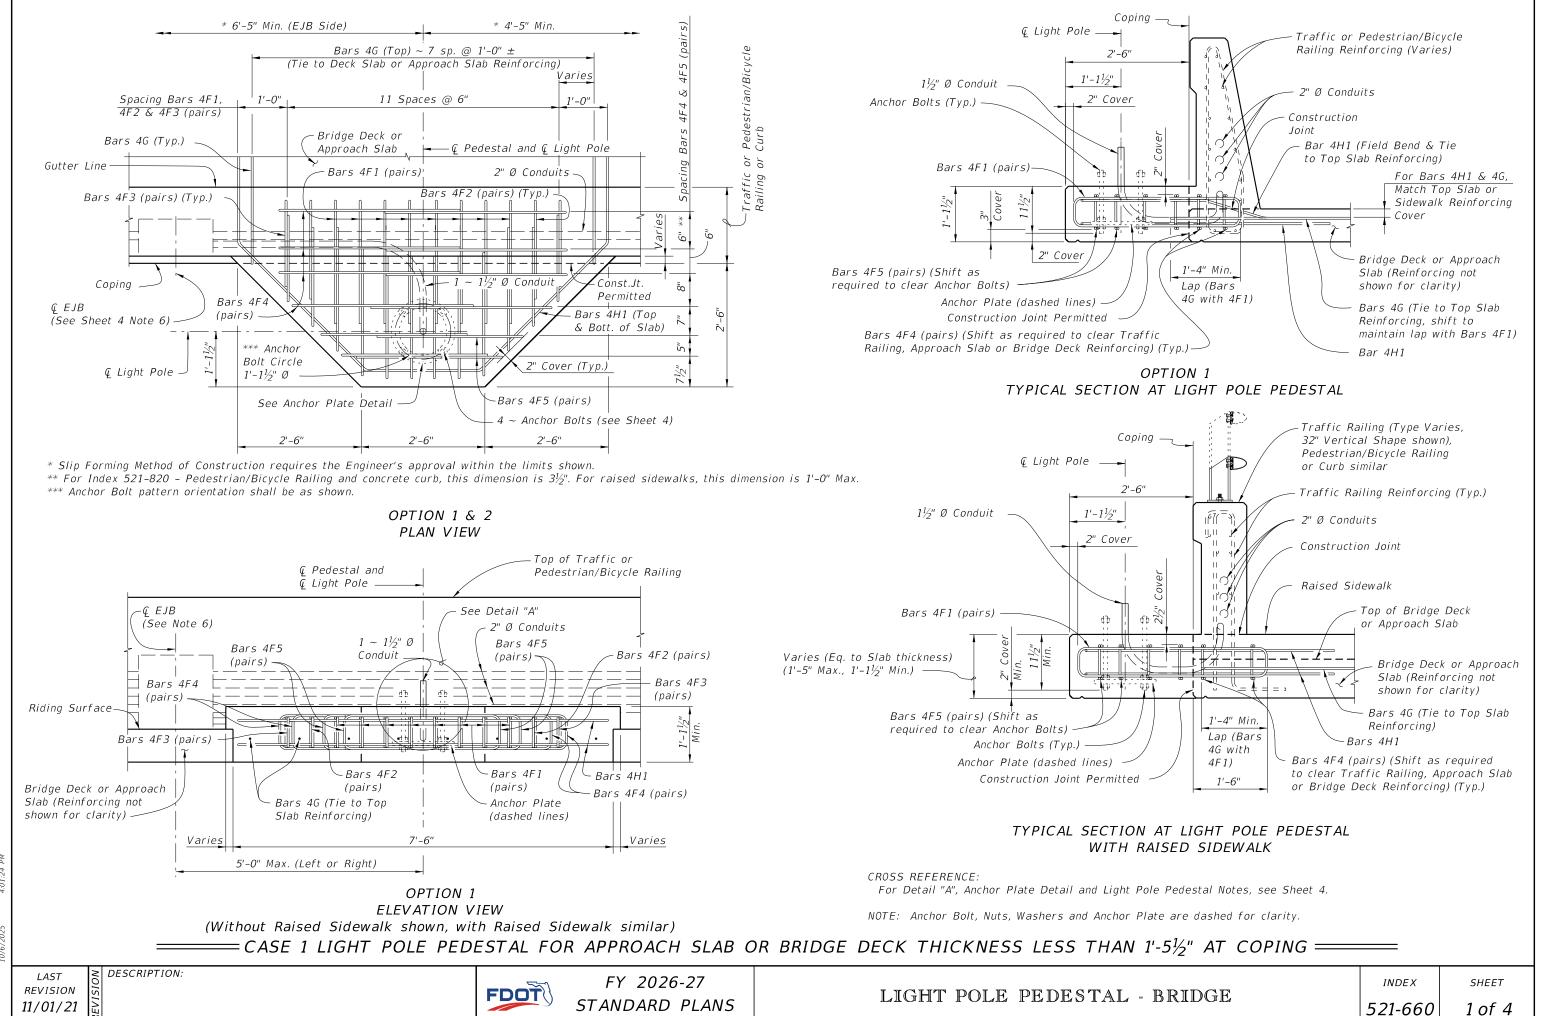


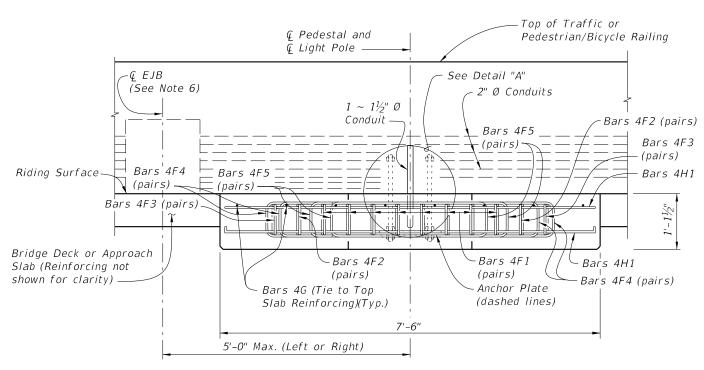


OPTION 2 - ELEVATION VIEW

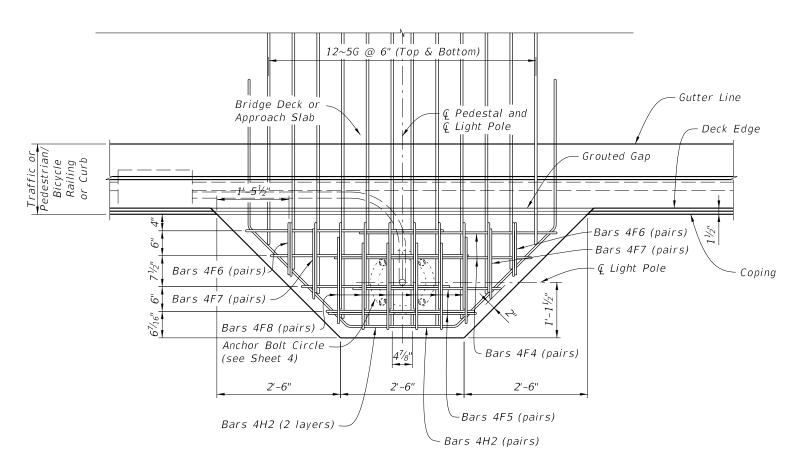

OPTION 3 - PLAN VIEW
WITH GAP BETWEEN BARRIER AND PEDESTAL TO ALLOW SLIP FORMING

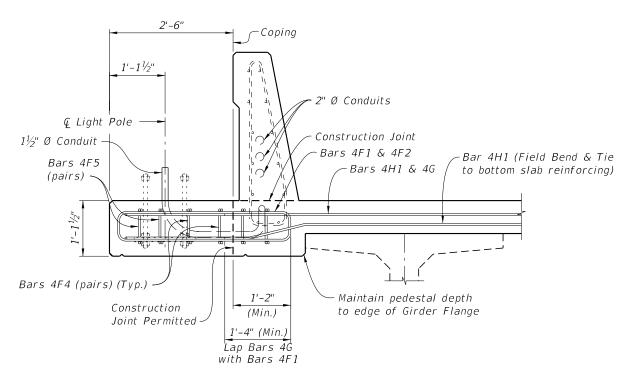

OPTION 2 - TYPICAL SECTION AT LIGHT POLE PEDESTAL (Approach Slab Similar)

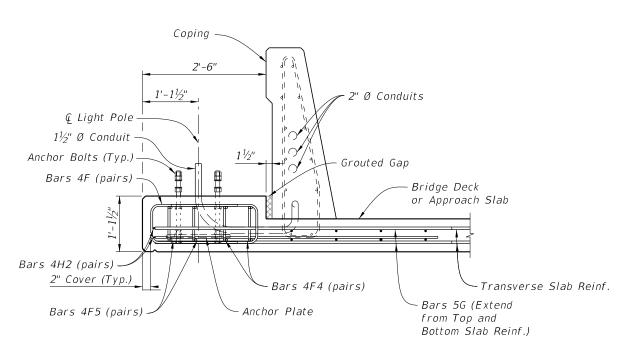

OPTION 3 - TYPICAL SECTION AT LIGHT POLE PEDESTAL WITH GAP BETWEEN BARRIER AND PEDESTAL TO ALLOW SLIP FORMING

CROSS REFERENCE:

For Detail "A", Anchor Plate Detail and Light Pole Pedestal Notes, see Sheet 4.

NOTE: Anchor Bolt, Nuts, Washers and Anchor Plate are dashed for clarity.

= CASE 1 LIGHT POLE PEDESTAL FOR APPROACH SLAB OR BRIDGE DECK LESS THAN 1'-5 $^1\!\!/_2$ " AT COPING =

LAST REVISION 11/01/24

DESCRIPTION:

FDOT


FY 2026-27 STANDARD PLANS

LIGHT POLE PEDESTAL - BRIDGE

INDEX

<sup>SHEET</sup> 2 of 4


521-660

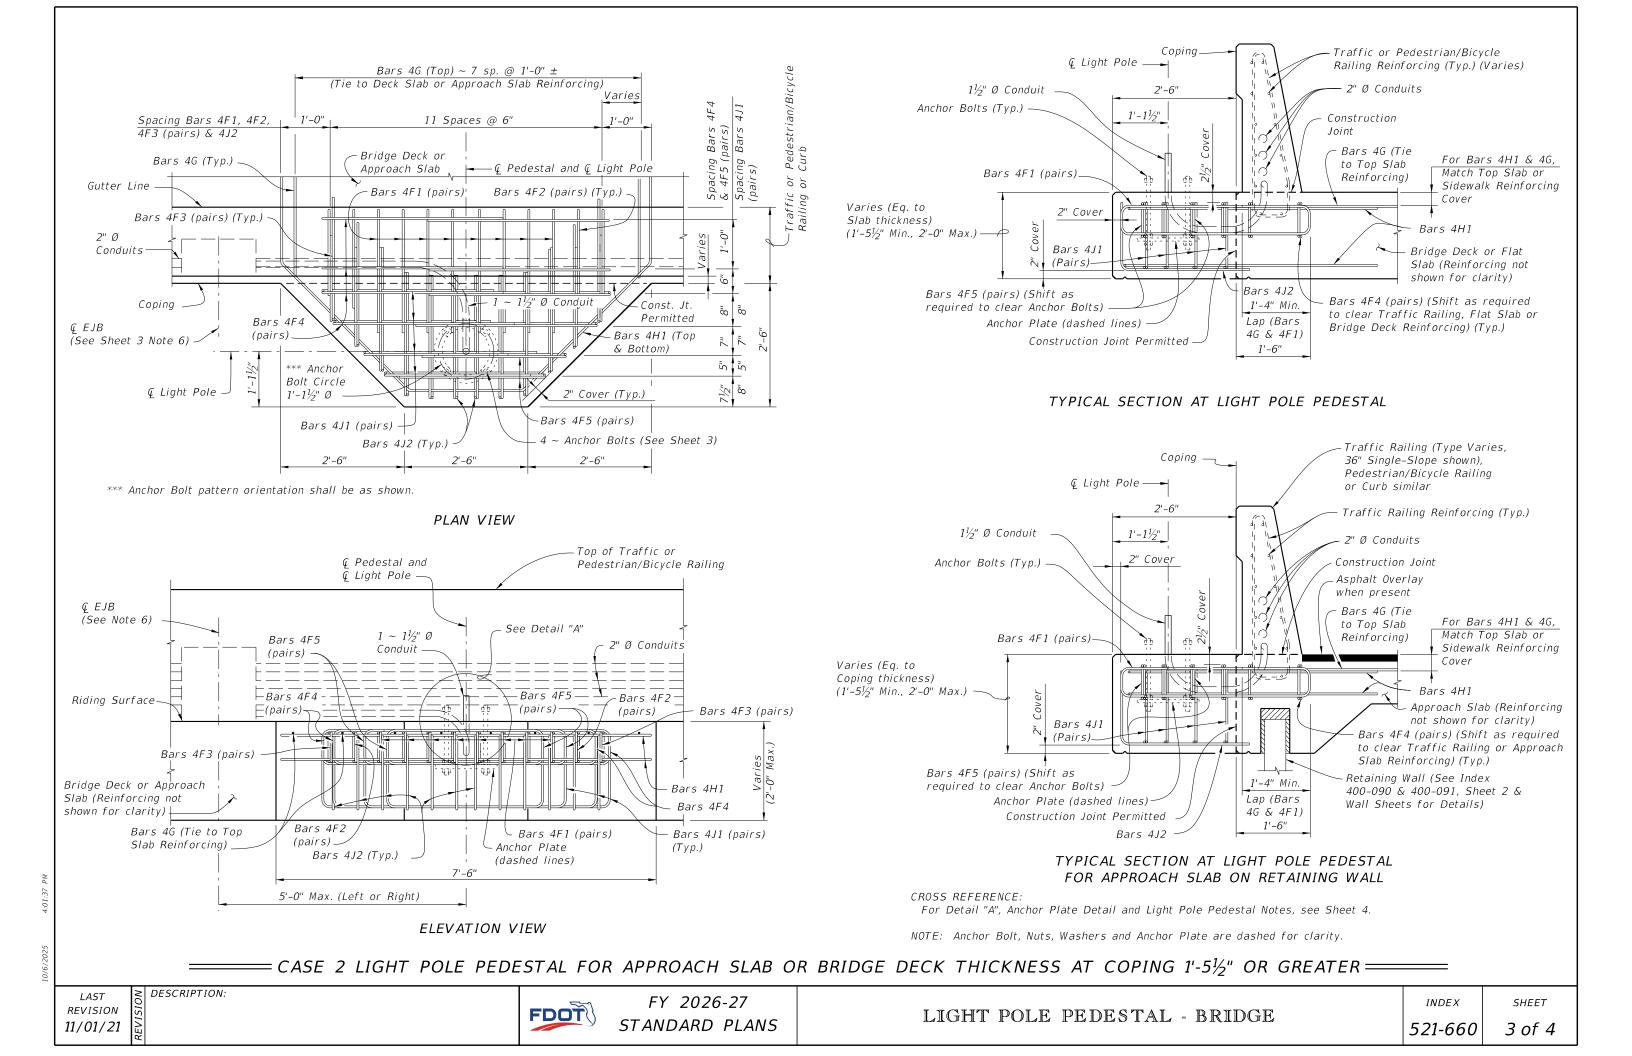

#### CONVENTIONAL REINFORCING STEEL BENDING DIAGRAMS

#### REINFORCING STEEL NOTES:

- a. When Pedestal is attached to Pedestrian/Bicycle Railing Index 521-820 or an 8" wide concrete curb and the Bridge Deck or Approach Slab thickness is less than 1'-1½", Bars 4F3 shall have leg length and bar length shown in parentheses.
- b. The number of bars shown in parentheses is for Bars 4F4 when Pedestal is attached to Pedestrian/Bicycle Railing - Index 521-820 or an 8" wide concrete curb, and the Bridge Deck or Approach Slab thickness is less than  $1'-1\frac{1}{2}''$ .
- c. Lap Splices for Bars 4F1, 4F2 & 4F3 shall be a minimum of 1'-4". Lap Splices for Bars 4F4 & 4F5 shall be minimum of 1'-8".
- d. Bars 4J1 and 4J2 are not required when Pedestal thickness is less than  $1'-5\frac{1}{2}$ ". Field trim height of bars to maintain cover when Pedestal thickness is less than 2'-0". Field trim length of Bars 4J2 on Retaining Wall Coping to maintain cover.
- e. All bar dimensions in the bending diagrams are out to out.

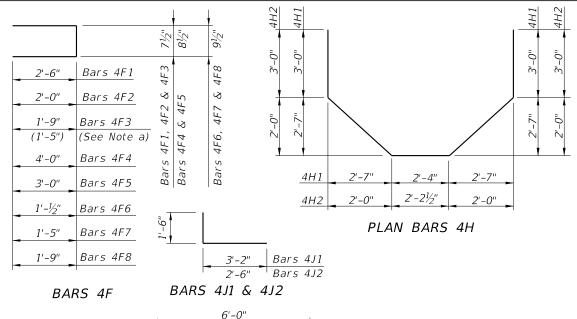


	BILL OF REINFORCING STEEL				
MARK	SIZE	NO. REQD.	LENGTH	NOTES	
F 1	4	16	5'-8"	С	
F2	4	4	4'-8"	С	
F3	4	4	4'-2'' (3'-6")	а, с	
F 4	4	8 (6) [4 for Option 3]	8'-9"	b, c	
F5	4	4	6'-9"	С	
F6	4	4	2'-11"	-	
F7	4	4	3'-8"	-	
F8	4	12	4'-4"	-	
G	4 [5 for Option 3]	8 [24 for Option 3]	6'-0"	-	
H1	4	2	15'-8"	-	
H2	4	2	13'-10"	-	
J 1	4	8	4'-8"	d	
J2	4	12	4'-0''	d	

( ) See Reinforcing Steel Note a & b.

# 1'-31/5' 111/5" $1'-1\frac{1}{2}$ " Ø bolt hole circle $4 \sim (Bolt \ Dia. + \frac{1}{16}") \ \emptyset$ Holes equally spaced

# ANCHOR PLATE DETAIL

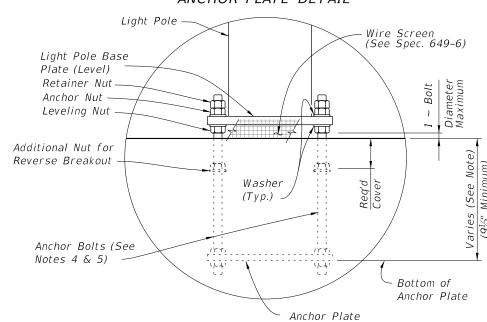

DETAIL "A"

#### LIGHT POLE PEDESTAL NOTES

1. Concrete and Reinforcing Steel required for the construction of the Pedestal shall meet the same requirements as the Traffic Railing or Pedestrian/Bicycle Railing the Pedestal is attached to.

BAR 5G

2. Light Pole Pedestal may be used with the following:

Index 521-422 - Traffic Railing (42" Vertical Shape),

Index 521-423 - Traffic Railing (32" Vertical Shape),

Index 521-427 - Traffic Railing (36" Single-Slope),

Index 521-428 - Traffic Railing (42" Single-Slope),

Index 521-820 - Pedestrian/Bicycle Railing,

Index 515-021 - Pedestrian/Bicycle Bullet Railing for

Traffic Railing or

Index 515-509 - Traffic Railing /Noise Wall - Bridge.

3. Unless otherwise noted, Traffic Railing (36" Single-Slope) is shown in all Views and Sections. The Pedestal details for other Traffic Railings or Pedestrian/Bicycle Railing are similar.

4. ANCHOR BOLTS:

Anchor Bolt design is based on the standard Roadway Aluminum Light Pole configurations shown on Index 715-002 with a maximum 40 ft. luminaire mounting height and a maximum 12 ft. arm length.

Use 1" Ø anchor bolt for up to 75 ft. bridge deck height above natural ground or MLW.

Anchor Bolts: ASTM F1554 Grade 55.

Nuts: ASTM A563 Grade A, Heavy-Hex.

Washers: ASTM F436 Type 1.

Anchor Plate: ASTM A709 (Grade 36) or ASTM A36.

Coating: Galvanize all Nuts, Bolts Washers, in accordance with ASTM F2329. Galvanize plates in accordance with ASTM A123.

The Contractor is responsible for ensuring the anchor bolt configuration is compatible with the light pole base plate. Submit modifications of the anchor bolt design to the Engineer for approval.

- 5. Install Anchor Bolts plumb.
- 6. For Conduit, Embedded Junction Boxes (EJB), Expansion/Deflection Fitting and adjacent Reinforcing Steel Details, see Utility Conduit Detail Sheets and Index 630-010.
- 7. PAYMENT: The cost of Wire Screen, Anchor Bolts, Nuts, Washers and Anchor Plates shall be included in the Bid Price for Light Poles. The cost of all Labor, Concrete and Reinforcing Steel required for the Construction of the Pedestals, and Miscellaneous Hardware required for the completion of the Electrical System, shall be included in the Bid Price for the Traffic Railing or Pedestrian/Bicycle Railing the Pedestal is attached to.

ESTIMATED LIGHT POLE PEDESTAL QUANTITIES PER LIGHT POLE PEDESTAL			
ITEM UNIT QUANTITY			
Concrete Per Pedestal Thickness	CY/In.	0.040	
Reinforcing Steel	LB	195 (182)	

(The Reinforcing Steel quantity shown in parenthesis is for a Pedestal attached to Pedestrian/Bicycle Railing - Index 521-820 with Bridge Deck or Approach Slab thinner than 1'-11/2". Add 59 Lbs. for Bars 4J1 & 4J2 when Pedestal Thickness is 1'-5½" or greater)

Note: Min. anchor bolt embed is 9 1/2". Max embed must maintain min. required bottom cover. Anchor bolt embed max. may be as long as required for constructability depending on which pedestal option is used.

REVISION 11/01/24

CROSS REFERENCE:

DESCRIPTION:

FDOT


FY 2026-27 STANDARD PLANS

LIGHT POLE PEDESTAL - BRIDGE

INDEX 521-660


SHEET


4 of 4

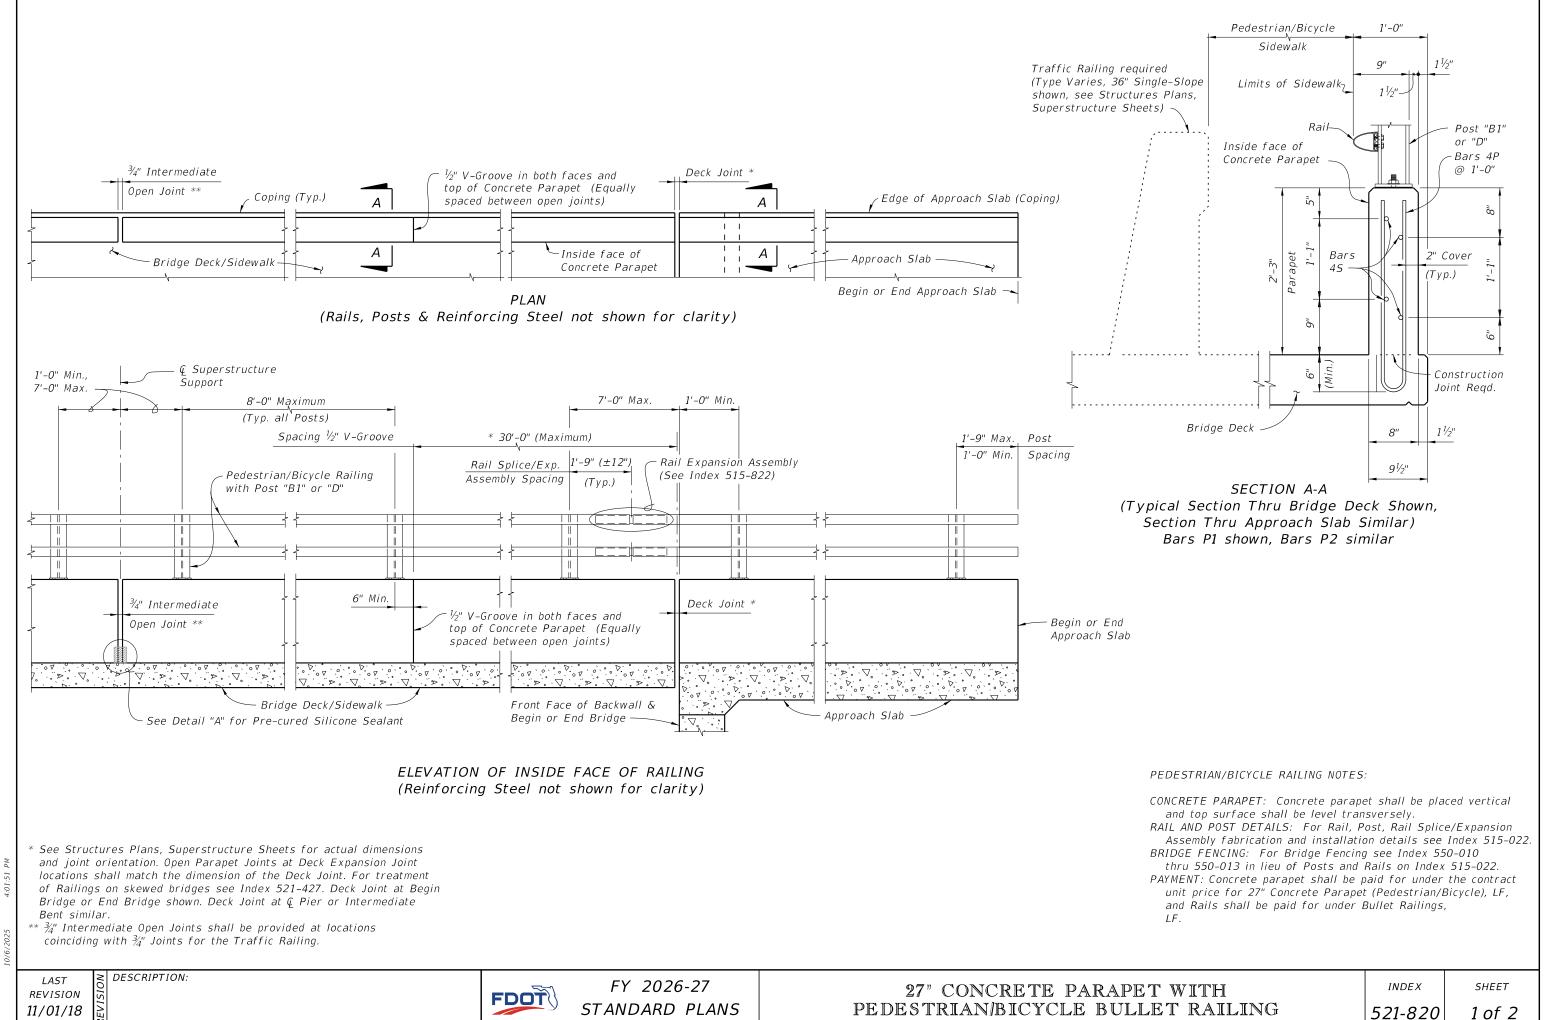


## ALTERNATE REINFORCING (WELDED WIRE REINF.) DETAILS

NOTE: Place wire panels to minimize the end overhang. End Overhangs greater than  $4\frac{3}{4}$ " are not permitted.






## WELDED WIRE REINFORCEMENT (WWR)



### CONVENTIONAL REINFORCING STEEL BENDING DIAGRAMS

# BILL OF REINFORCING STEEL

MARK	SIZE	LENGTH
P 1	4	5'-6"
P2	4	6'-0"
S	4	As Read.

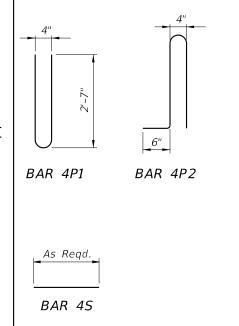


#### REINFORCING STEEL NOTES:


- 1. All bar dimensions in the bending diagrams are out to out.
- 2. The reinforcement for the parapet on a retaining wall shall be the same as detailed above for a 8" deck.
- 3. All reinforcing steel at the open joints shall have a 2" minimum cover.
- 4. Bars 4S may be continuous or spliced at the construction joints. Bar splices for Bars 4S shall be a minimum of 1'-8".
- 5. Bars 4P2 may be used in lieu of Bars 4P1.
- 6. At the option of the Contractor deformed WWR may be used in lieu of all Bars 4P or 4P2 and 4S.

#### INTERMEDIATE JOINT SEAL NOTE:

- 1. At Intermediate Open Joints, seal the lower 6" portion of the open joint with Pre-cured Silicone Sealant meeting the requirements of Specification Section 932.
- 2. Apply sealant prior to any Class V finish coating and remove all curing compound and loose material from the surface prior to application of bonding agent.
- 3. The cost of the Pre-cured Silicone Sealant shall be included in the Contract Unit Price for the Concrete Parapet.
- 4. As an alternative option, a mortar plug may be used to seal the joint as shown in the mortar plug detail and in accordance with Specification Section 400.








OPTION II (Alternative Mortar Plug at Open Joint)


 $\equiv$  DETAIL "A"  $\equiv$ 

	ESTIMATED CONCRETE PARAPET QUANTITIES		
ITEM	UNIT	QUANTITY	
Concrete	CY/LF	0.056	
Reinforcing Steel (P1 & S)	LB/FT	6.35	
Reinforcing Steel (P2 & S)	LB/FT	6.68	

(The above quantities are based on a deck with a 2% cross slope)

DESCRIPTION:

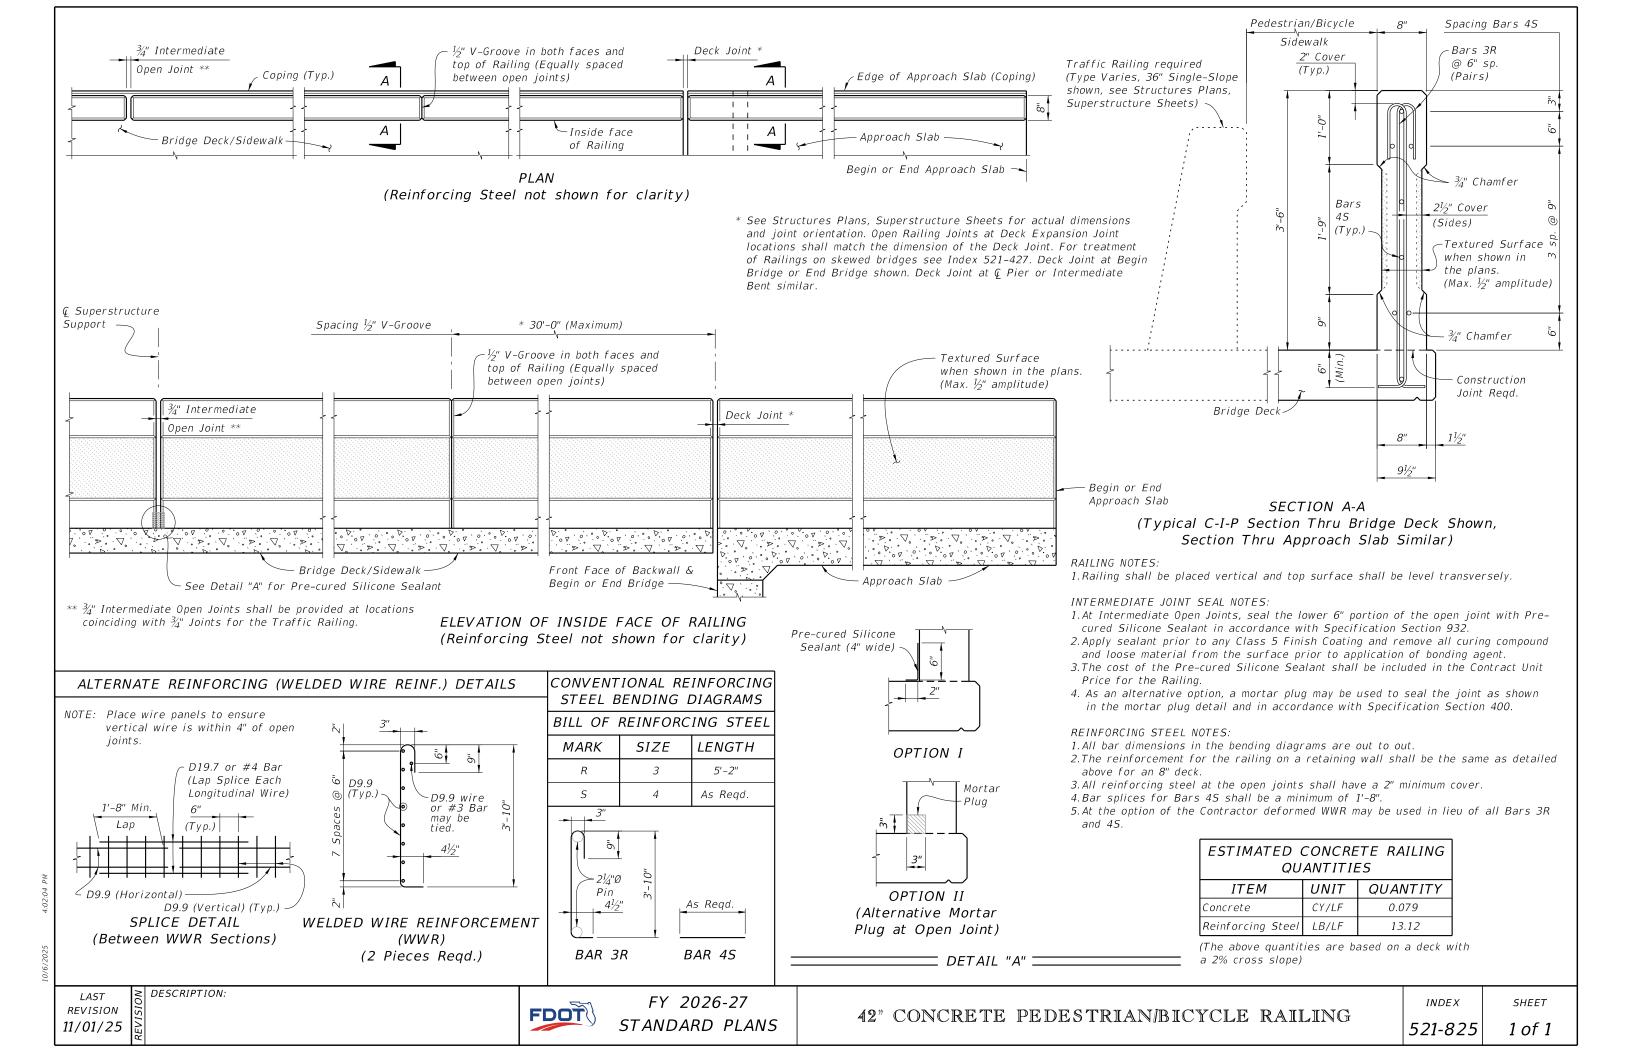

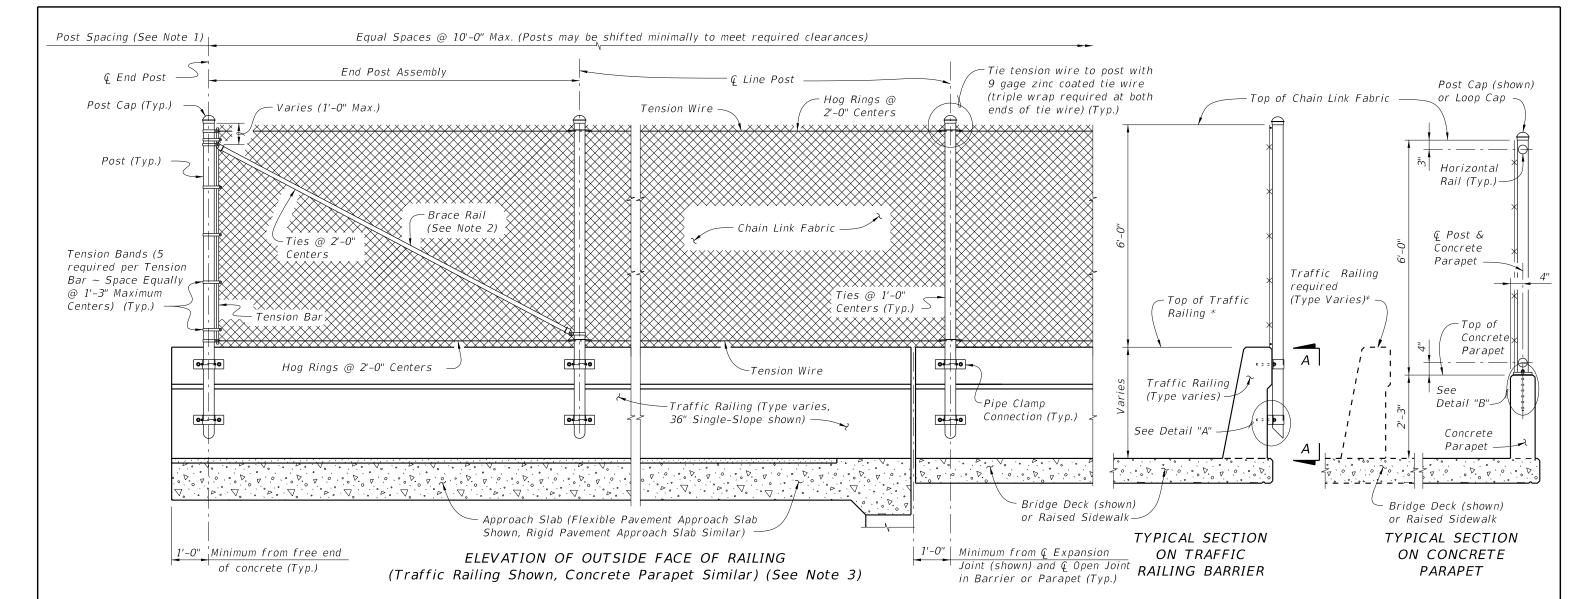

- 1. A Pull Post Assembly is required at maximum intervals of 500'-0". See Sheet 3.
- 2. Brace rails are only required for vertical fence installations on Traffic Railing.
- 3. Provide horizontal rails for vertical fence installations on Concrete Parapets in lieu of tension wire. Locate horizontal rails as shown in the Typical Section for Concrete Parapets at right.

#### FENCING NOTES

FENCE INSTALLATION:

Install posts plumb (within a tolerance of  $\pm 1\frac{1}{2}$ ). Use shim plates as required to achieve plumb. The required quantity and thickness of shim plates will be determined in the field. Install chain link fence in accordance with ASTM F567 as applicable. TRAFFIC RAILING DETAILS:

See Superstructure Sheets for Traffic Railing details.

CONCRETE PARAPET DETAILS:

DESCRIPTION:

See Index 521-820 - Pedestrian/Bicycle Railing for Concrete Parapet details. Provide fencing in lieu of aluminum bullet railing as shown on Index 521-820.

LIMITS OF FENCING:

Limits of fencing are from begin of approach slab at Begin Bridge to end of approach slab at End Bridge, unless otherwise shown in the plans.

PAYMENT:

Payment will be made under Fencing, Type R. Payment includes posts, horizontal and expansion rails, brace rails and bands, rail ends, combination rail ends, boulevard clamps, chain link fabric, tension wire, ties, hog rings, tension bars and bands, post and loop caps, pipe clamps, base plates, anchor rods, bolts, nuts, washers, shim plates, spacers, bearing pads, miscellaneous fence fittings and hardware and all incidental materials and labor required to complete installation of the fence.

#### CROSS REFERENCE:

For Table of Fence Components, Table of Post Attachment Components, View A-A and Detail "A" see Sheet 2.

\* Do not anchor fencing to the top of Traffic Railings.

For Pull Post Assembly Detail for Traffic Railings see Sheet 3.

For Pull Post Assembly Detail for Concrete Parapets and Detail "B" see Sheet 4.

LAST REVISION 11/01/17

FDOT

FY 2026-27 STANDARD PLANS


BRIDGE FENCING (VERTICAL)


INDEX 550-010

SHEET 1 of 4

	TABLE OF CHAIN LINK FENCE COMPONENTS				
	COMPONENT	ASTM DESIGNATION	COMPONENT INFORMATION		
	Posts	F1083	Galvanized Steel Pipe - 3" NPS, Schedule 40 Regular Grade		
	Chain Link Fabric (2" mesh with twisted	A392	Zinc Coated Steel - 9 gage (coated wire diameter), Class 2 Coating		
ets	top and knuckled bottom selvage)	A491	Aluminum Coated Steel - 9 gage (coated wire diameter)		
Traffic Railings and Concrete Parapets		F668	Polyvinyl Chloride (PVC) Coated Steel - 9 gage Class 2b		
ic Ra	Tie Wires	F626	Zinc Coated Steel Wire - 9 gage		
Traff Conc	Brace Bands	F626	12 Gage (Min. thickness) x $\frac{3}{4}$ " (Min. width) Steel Bands (Beveled or Heavy)		
and	Tension Bars	F626	$rac{3}{16}$ " (Min. thickness) x $rac{3}{4}$ " (Min. width) x 5'-10" (Min. height) Steel Bars		
	Tension Bands	F626	14 Gage (Min. thickness) x ¾" (Min. width) Steel Bands		
	Miscellaneous Fence Components	F626	Zinc Coated Steel ~ (includes post or loop caps, horizontal and brace rail ends, combination rail ends, boulevard clamps and all other miscellaneous fittings & hardware)		
	Horizontal Rails	F1083	Galvanized Steel Pipe – $2\frac{1}{2}$ " NPS, Schedule 40 Regular Grade		
e s	Expansion Rails	F1083	Galvanized Steel Pipe - 2" NPS, Schedule 40 Regular Grade		
Concrete Parapets	Bolts	A307	$^{1}\!\!\!/_{\!\!\!4}$ " Ø x $^{4}\!\!\!/_{\!\!\!4}$ " Hex Head Bolts for Expansion Rail Connections		
CC	Nuts	A563	Hex Nuts for Expansion Rail Connections		
	Washers	F 436	Flat Washers for Expansion Rail Connections		
gs	T . W.	1024 6 1017	Type II (Zinc Coated Steel Wire) - 7 gage, Class 4 Coating		
ailin	Tension Wire	A824 & A817	Type I (Aluminum Coated Steel Wire) - 7 gage		
Traffic Railings	Hog Rings	F626	Zinc Coated Steel Wire - 12 gage		
Traf	Brace Rails	F1083	Galvanized Steel Pipe – $1\frac{1}{4}$ " NPS, Schedule 40 Regular Grade		

	TABLE OF POST ATTACHMENT COMPONENTS			
	COMPONENT	ASTM DESIGNATION	COMPONENT INFORMATION	
Pipe	Clamps	A36 or A709 Grade 36	1/4" Steel P	
Base	Plates	A36 or A709 Grade 36	¾" Steel P	
Shim Plates		A36 or A709 Grade 36 or B209 Alloy 6061-T6 or B221 Alloy 6063-T5	Plate thicknesses as required. Holes in shim plates will be $\frac{3}{4}$ " Ø. For edge shims match the edge length of the base plate with a min. width of $3/4$ ". Apply adhesive bonding material bed of $1-1/2$ " (Min.) wide	
Space	ers	-	Plate thickness varies based on traffic railing type (See Detail "A")	
Pipe Clamp Connection	Adhesive Anchor Rods	F1554 Grade 36	Fully threaded Headless Anchor Rods $\sim \%$ " Ø x 6" (no spacer) or $\%$ " Ø x (6" + spacer thickness)	
	C-I-P Anchor Rods	F1554 Grade 36	Hex Head Anchor Rods $\sim \frac{5}{8}$ " Ø x 6" (no spacer) or $\frac{5}{8}$ " Ø x (6" + spacer thickness)	
Base Plate Connection	Adhesive Anchor Rods	F1554 Grade 36	Fully threaded Headless Anchor Rods $\sim$ $7/8$ " Ø x $14\frac{1}{2}$ "	
Base Conne	C-I-P Anchor Rods	F1554 Grade 36	Hex Head Anchor Rods $\sim \frac{7}{8}$ " Ø x 14 $\frac{1}{2}$ "	
Bolts		A307	¾" Ø x 4¾" Hex Head Bolts for Pipe Clamp Connections to Posts	
Nuts		A563	Hex Nuts for Pipe Clamp and Base Plate Connections	
Washers		F436	Flat Washers for Pipe Clamp and Base Plate Connections	
Bearing Pads (Plain Neoprene)		-	In accordance with Specification Section 932 for Ancillary Structures	

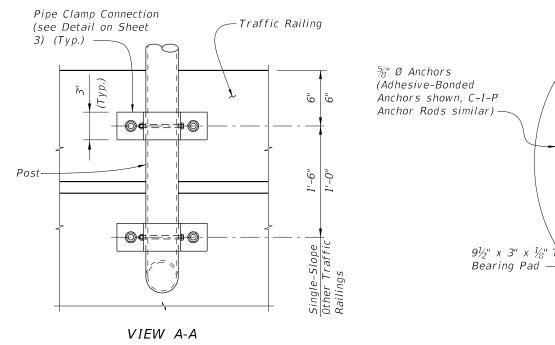

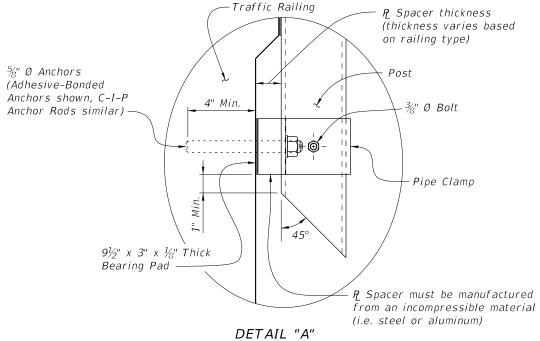

#### POST ATTACHMENT NOTES

ANCHOR RODS, NUTS AND WASHERS:

After the nuts have been tightened, distort the Anchor Rod threads to prevent removal of the nuts. Coat distorted threads and exposed trimmed ends of anchors with a galvanizing compound in accordance with Specification Section 562.

Hot-dip galvanize all Nuts, Washers, Bolts, C-I-P Anchor Rods, Adhesive Anchors and Fence Framework (Posts, Internal Sleeves, Shim Plates, Base Plates, Pipe Clamps and Spacers) in accordance with Specification Section 962. Hot-dip galvanize Fence Framework after fabrication.

ADHESIVE-BONDED ANCHORS AND DOWELS:

Adhesive Bonding Material Systems for Anchors and Dowels will comply with Specification Section 937 and be installed in accordance with Specification Section 416. Cutting of reinforcing steel is permitted for drilled hole installation.

#### WELDING:

All welding will be in accordance with the American Welding Society Structural Welding Code (Steel) ANSI/AWS D1.1 (current edition). Weld metal will be E60XX or E70XX. Nondestructive testing of welds is not required.

### CROSS REFERENCE:

For location of View A-A and Detail "A" see Sheet 1.


LAST REVISION 11/01/24


DESCRIPTION:

FDOT


FY 2026-27 STANDARD PLANS

INDEX

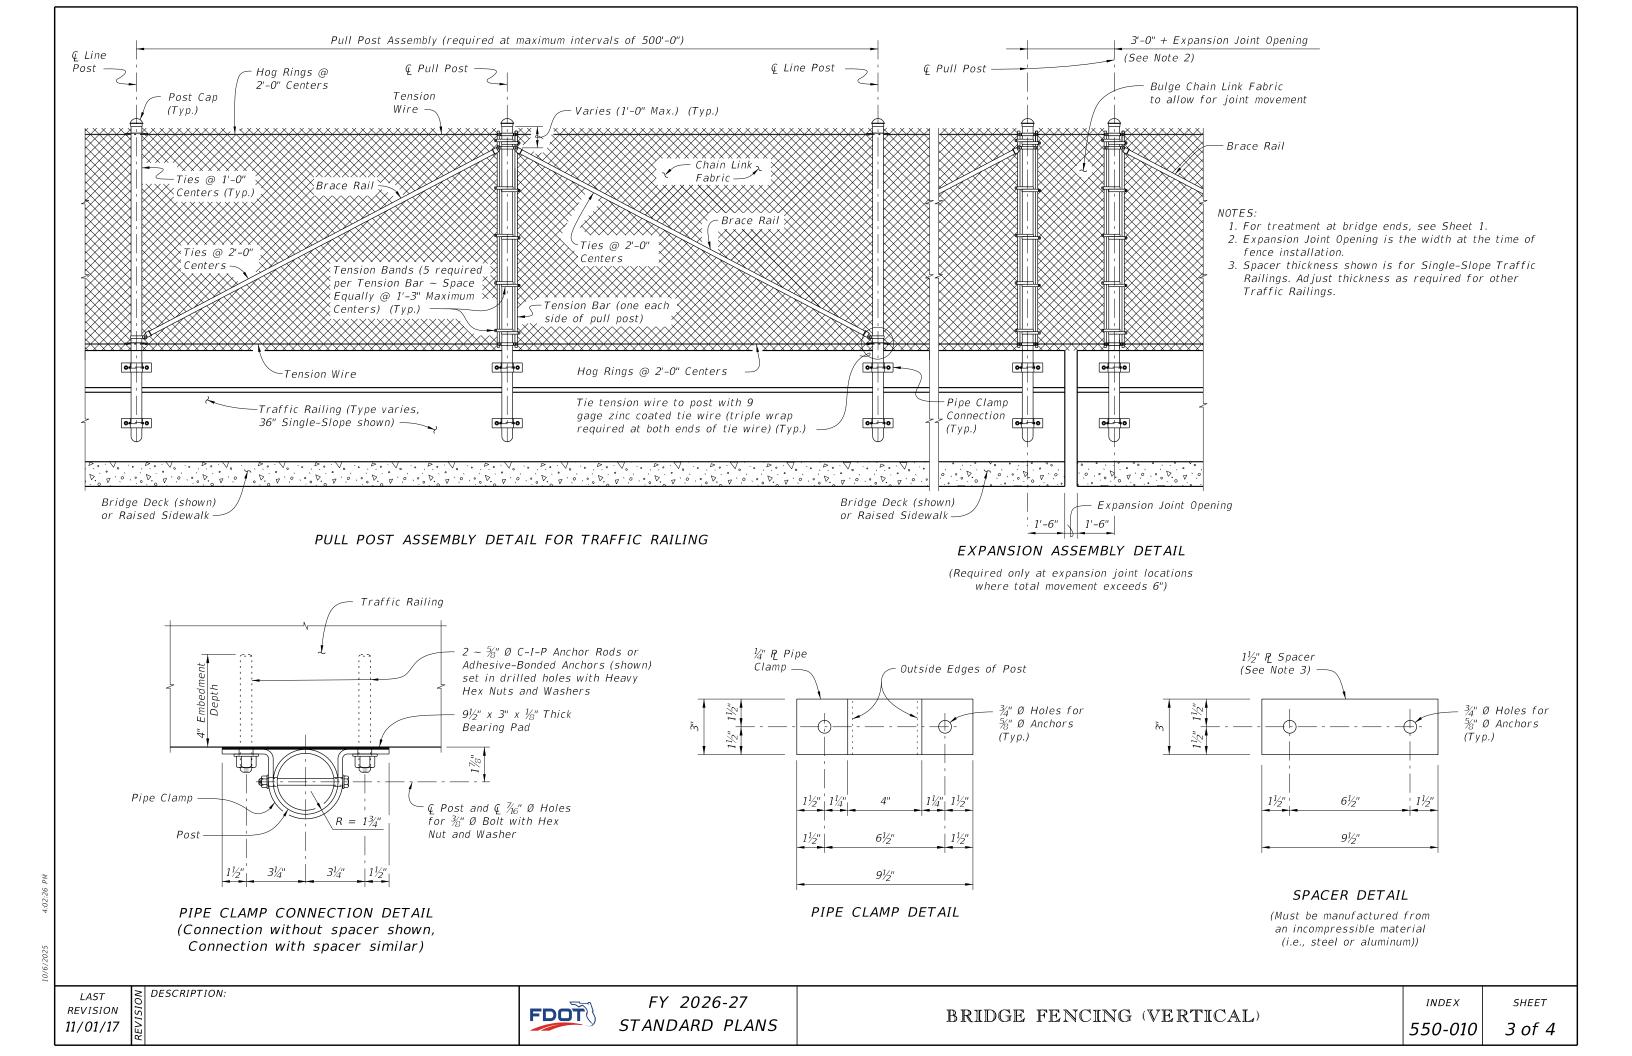

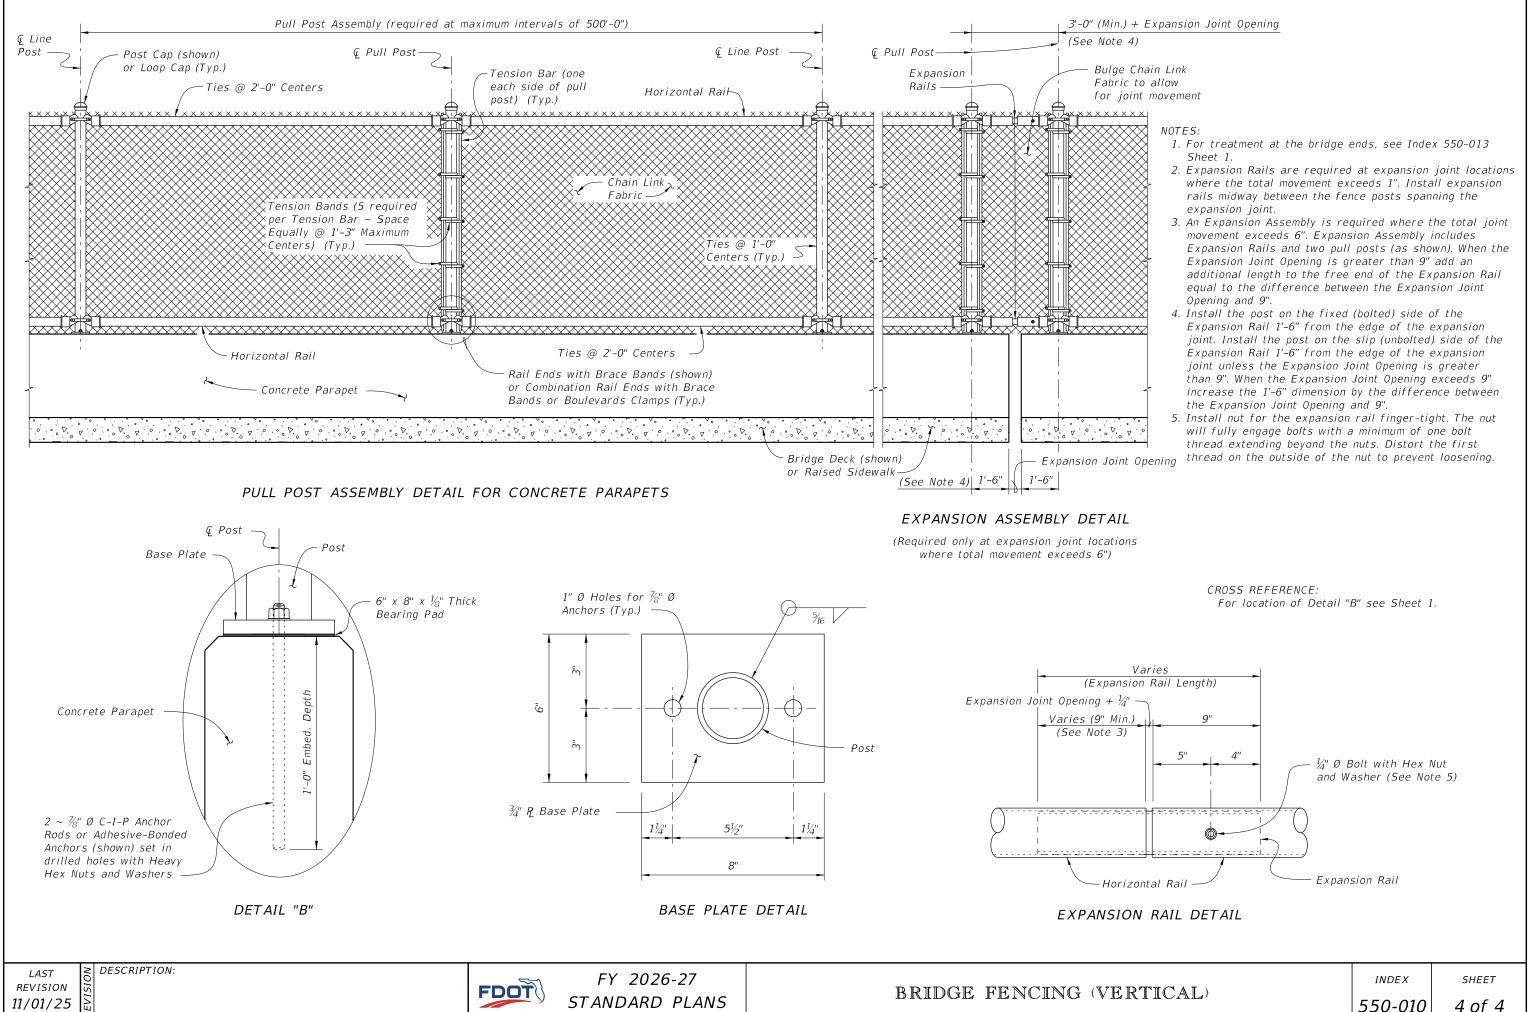

STANDARD PLANS

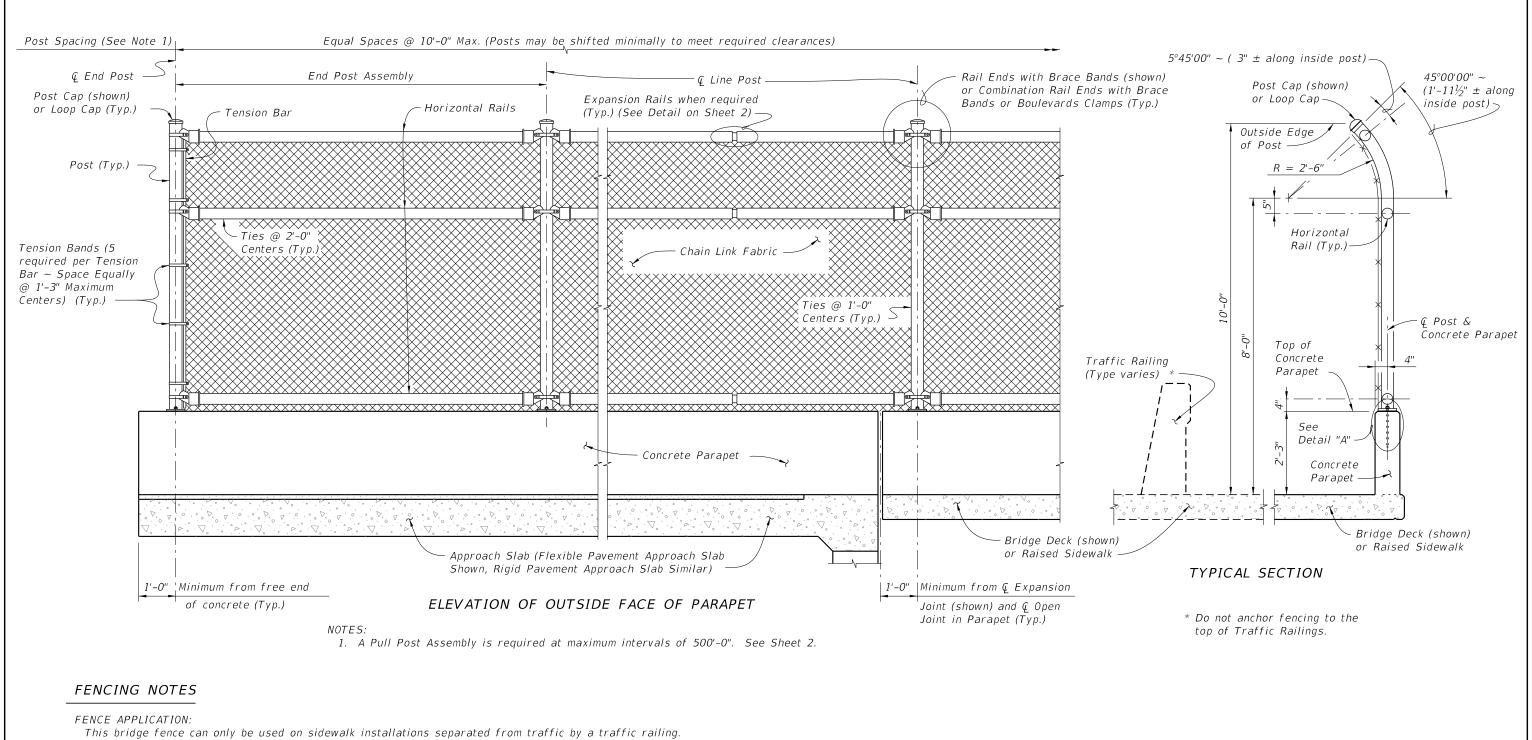

FENCE INSTALLATION:

Install posts plumb (within a tolerance of  $\pm 1\frac{1}{2}$ ). Use shim plates as required to achieve plumb. The required quantity and thickness of shim plates will be determined in the field. Install chain link fence in accordance with ASTM F567 as applicable.

CONCRETE PARAPET DETAILS:

See Index 521-820 - Pedestrian/Bicycle Bullet Railing for Concrete Parapet details. Provide fencing in lieu of aluminum bullet railing as shown on Index 521-820.

LIMITS OF FENCING:

DESCRIPTION:

Limits of fencing are from begin of approach slab at Begin Bridge to end of approach slab at End Bridge, unless otherwise shown in the plans.

PAYMENT:

Payment will be made under Fencing, Type R. Payment includes posts, horizontal and expansion rails, brace bands, rail ends, combination rail ends, boulevard clamps, chain link fabric, ties, tension bars and bands, post and loop caps, base plates, anchor rods, bolts, nuts, washers, shim plates, neoprene pads, miscellaneous fence fittings and hardware and all incidental materials and labor required to complete installation of the fence.

#### CROSS REFERENCE:

For Table of Fence Components and Pull Post Assembly Detail see Sheet 2. For Table of Post Attachment Components and Detail "A" see Sheet 3.

LAST REVISION 11/01/23


FDOT

FY 2026-27 STANDARD PLANS

BRIDGE FENCING ON PARAPET (CURVED TOP)

INDEX 550-011

SHEET 1 of 3

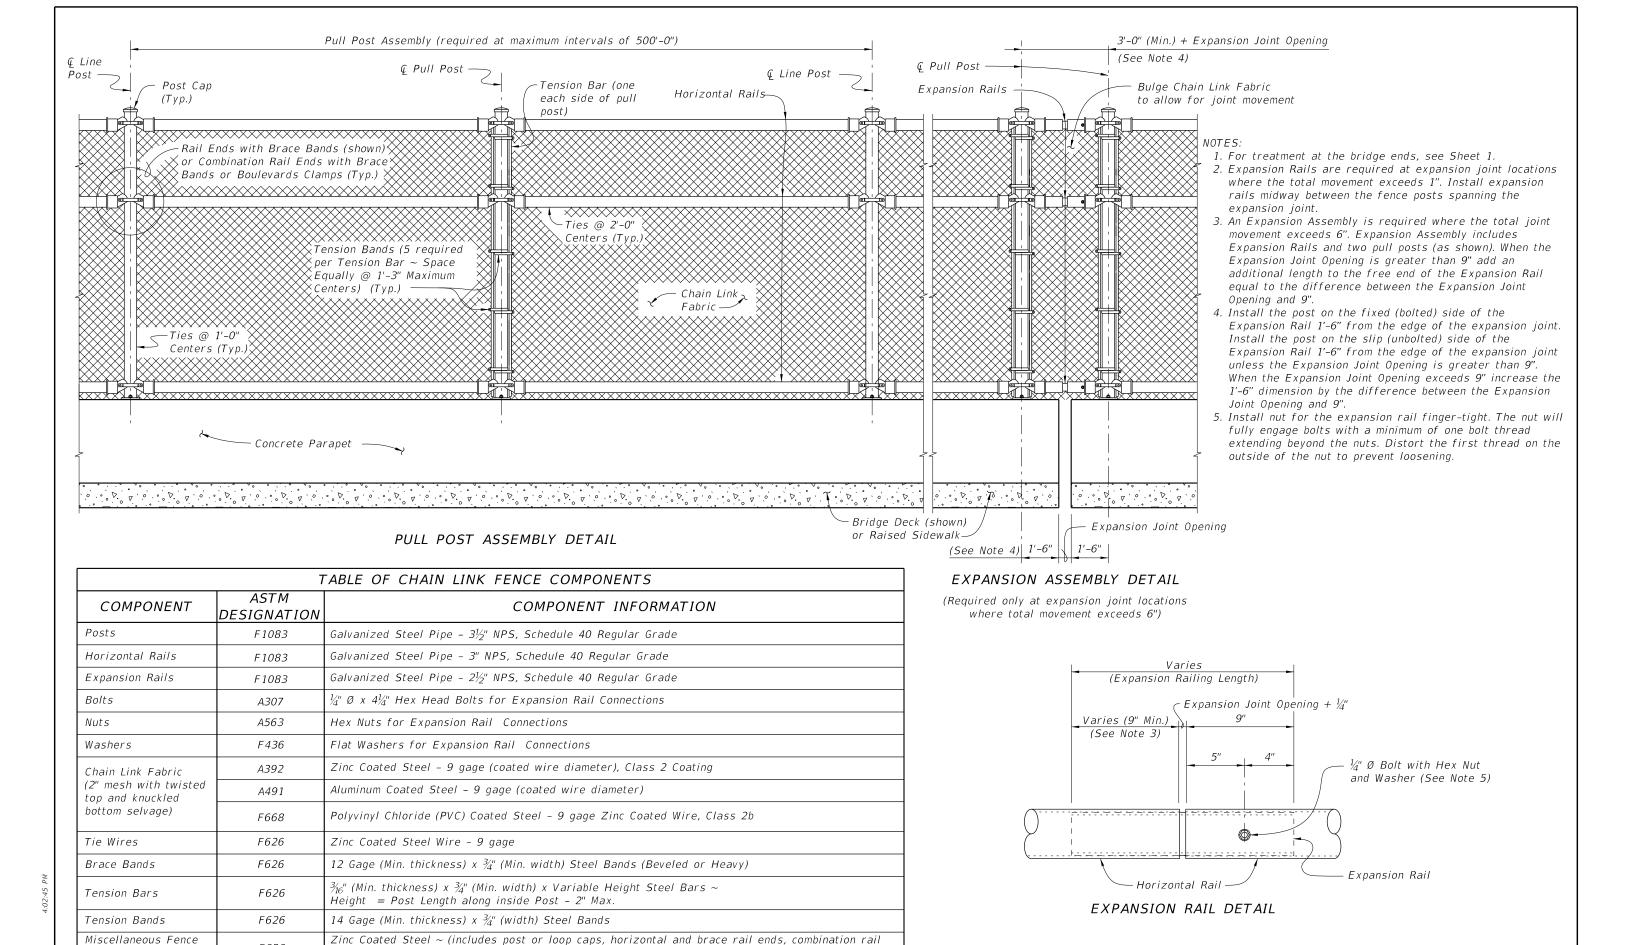

LEGEND: NPS = Nominal Pipe Size DESCRIPTION:

F626

REVISION 11/01/23

Components

FDOT

ends, boulevard clamps and all other miscellaneous fittings and hardware)

FY 2026-27 STANDARD PLANS

550-011 2 of 3

TABLE OF POST ATTACHMENT COMPONENTS			
COMPONENT	ASTM DESIGNATION	COMPONENT INFORMATION	
Base Plates A36 or A709 Grade 36		¾" Steel P	
A36 or A709 Grade 36 or B209 Alloy 6061-T6 or B221 Alloy 6063-T5		Plate thicknesses as required. Holes in shim plates will be $\frac{3}{4}$ " Ø. For edge shims match the edge length of the base plate with a min. width of $3/4$ ". Apply adhesive bonding material bed of $1-1/2$ " (Min.) wide	
Adhesive Anchor Rods F1554 Grade 36		Fully threaded Headless Anchor Rods $\sim \frac{7}{8}$ " Ø x $14\frac{1}{2}$ "	
C-I-P Anchor Rods F1554 Grade 36		Hex Head Anchor Rods $\sim \frac{7}{8}$ " Ø x $14\frac{1}{2}$ "	
Nuts	A563	Hex Nuts for Base Plate Connections	
Washers	F 436	Flat Washers for Base Plate Connections	
Bearing Pads (Plain) -		In accordance with Specification Section 932 for ancillary structures	

#### POST ATTACHMENT NOTES


ANCHOR RODS, NUTS AND WASHERS:

After the nuts have been tightened, distort the Anchor Rod threads to prevent removal of the nuts. Coat distorted threads and exposed trimmed ends of anchors with a galvanizing compound in accordance with Specification Section 562.


Hot-dip galvanize all Nuts, Washers, Bolts, C-I-P Anchor Rods, Adhesive Anchors and Fence Framework (Posts, Internal Sleeves, Shim Plates and Base Plates) in accordance with Specification Section 962. Hot-dip galvanize Fence Framework after fabrication. ADHESIVE-BONDED ANCHORS AND DOWELS:

Adhesive Bonding Material Systems for Anchors and Dowels will comply with Specification Section 937 and be installed in accordance with Specification Section 416. Cutting of reinforcing steel is permitted for drilled hole installation.

All welding will be in accordance with the American Welding Society Structural Welding Code (Steel) ANSI/AWS D1.1 (current edition). Weld metal will be E60XX or E70XX. Nondestructive testing of welds is not required.

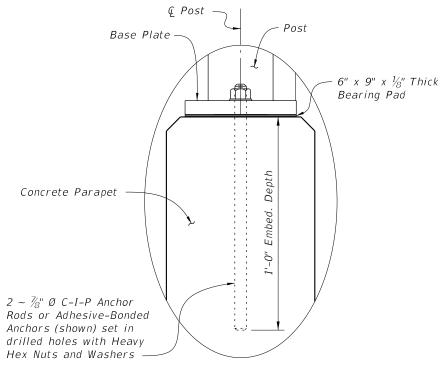


DETAIL "A"

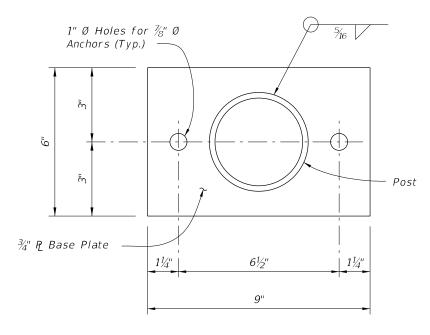

BASE PLATE DETAIL

CROSS REFERENCE: For location of Detail "A" see Sheet 1.

DESCRIPTION:

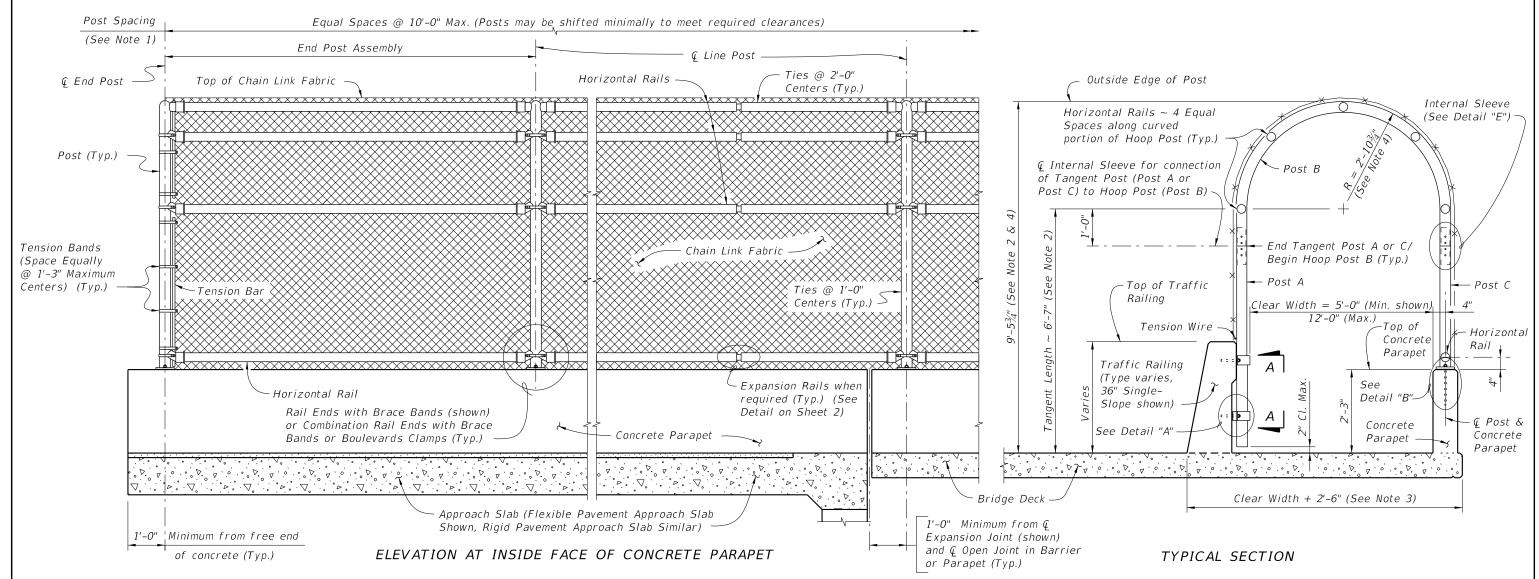

#### NOTES:

- 1. A Pull Post Assembly is required at maximum intervals of 500'-0". See Sheet 3.
- 2. Dimension is measured along Inside Face of Concrete Parapet.
- 3. Dimension shown is for 36" Single-Slope Traffic Railings as shown in Index 521-427. Adjust as required for other Traffic Railing Barriers and sidewalk widths.
- 4. For sidewalk clear widths greater than 5'-0", increase the radius of Post B at the rate of 6" for every one foot increase in sidewalk width.

#### FENCING NOTES

#### FENCE INSTALLATION:

Install posts plumb (within a tolerance of  $\pm 1\frac{1}{2}$ "). Use shim plates as required to achieve plumb. The required quantity and thickness of shim plates will be determined in the field. Install chain link fence in accordance with ASTM F567 as

#### TRAFFIC RAILING DETAILS:

See Superstructure Sheets for Traffic Railing details.

#### CONCRETE PARAPET DETAILS:

DESCRIPTION:

See Index 521-820 - Pedestrian/Bicycle Railing for Concrete Parapet details. Provide fencing in lieu of aluminum bullet railing as shown on Index 521-820.

#### LIMITS OF FENCING:

Limits of fencing are from begin of approach slab at Begin Bridge to end of approach slab at End Bridge, unless otherwise shown in the plans.

Payment will be made under Fencing, Type R. Payment includes posts, horizontal and expansion rails, brace bands, rail ends, combination rail ends, boulevard clamps, chain link fabric, tension wire, ties, hog rings, tension bars and bands, pipe clamps, base plates, anchor rods, bolts, nuts, washers, shim plates, spacers, neoprene pads, miscellaneous fence fittings and hardware and all incidental materials and labor required to complete installation of the fence.

#### CROSS REFERENCE:

For Table of Fence Components and Table of Post Attachment Components see Sheet 2. For Pull Post Assembly Detail, View A-A and Detail "A" see Sheet 3.

For Detail "B" and "E" see Sheet 4.

REVISION 11/01/23

FDOT

FY 2026-27 STANDARD PLANS


BRIDGE FENCING (ENCLOSED)

INDEX 550-012

SHEET 1 of 4

52
1202
9/0
1

TABLE OF CHAIN LINK FENCE COMPONENTS			
COMPONENT	ASTM DESIGNATION	COMPONENT INFORMATION	
Posts	F1083	Galvanized Steel Pipe - 3" NPS, Schedule 40 Regular Grade	
Horizontal Rails and Internal Sleeves	F1083	Galvanized Steel Pipe - $2\frac{1}{2}$ " NPS, Schedule 40 Regular Grade	
Expansion Rails	F1083	Galvanized Steel Pipe - 2" NPS, Schedule 40 Regular Grade	
	A392	Zinc Coated Steel - 9 gage (coated wire diameter), Class 2 Coating	
Chain Link Fabric (2" mesh with knuckled	A491	Aluminum Coated Steel - 9 gage (coated wire diameter)	
bottom selvages)	F668	Polyvinyl Chloride (PVC) Coated Steel - 9 gage Class 2b Zinc Coated Wire	
	A824 & A817	Type II (Zinc Coated Steel Wire) - 7 gage, Class 4 Coating	
Tension Wire		Type I (Aluminum Coated Steel Wire) - 7 gage	
Tie Wires	F626	Zinc Coated Steel Wire - 9 gage	
Hog Rings	F626	Zinc Coated Steel Wire - 12 gage	
Brace Bands	F626	12 gage (Min. thickness) x $\frac{3}{4}$ " (Min. width) Steel Bands (Beveled or Heavy)	
Tension Bars	F626	$rac{3}{16}$ " (Min. thickness) x $rac{3}{4}$ " (Min. width) x Variable Height Steel Bars $\sim$ Height = Tangent or Hoop Length - Barrier or Parapet Height - 2" max.	
Tension Bands	F626	14 gage (Min. thickness) x $rac{3}{4}$ " (Min. width) Steel Bands	
Miscellaneous Fence Components	F626	Zinc Coated Steel ~ (includes horizontal rail ends, combination rail ends, boulevard clamps and all other miscellaneous fittings and hardware)	
Bolts	A307	$\%$ " Ø x $4\frac{1}{4}$ " Hex Head Bolts for Internal Sleeve connections $\frac{1}{4}$ " Ø x $4\frac{1}{4}$ " Hex Head Bolts for Expansion Rail connections	
Nuts	A563	Hex Nuts for Internal Sleeve and Expansion Rail connections	
Washers	F 436	Flat Washers for Internal Sleeve and Expansion Rail connections	

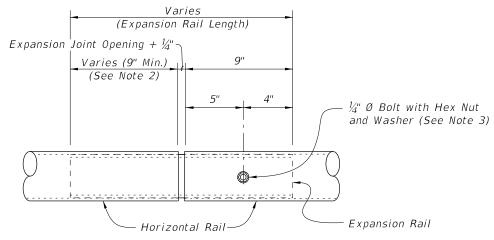

#### NOTES

#### EXPANSION RAIL DETAIL

- 1. Expansion Rails are required at expansion joint locations where the total movement exceeds 1". Install expansion rails midway between the fence posts spanning the expansion joint.
- 2. An Expansion Assembly is required where the total joint movement exceeds 6". Expansion Assembly includes Expansion Rails and two pull posts (see Sheet 3). When the Expansion Joint Opening is greater than 9" add an additional length to the free end of the Expansion Rail equal to the difference between the Expansion Joint Opening and 9".
- 3. Install nut for the expansion rail finger-tight. The nut will fully engage bolts with a minimum of one bolt thread extending beyond the nuts. Distort the first thread on the outside of the nut to prevent loosening.

	TABLE OF POST ATTACHMENT COMPONENTS					
COMPONENT		ASTM DESIGNATION	COMPONENT INFORMATION			
Pipe	Clamps	A36 or A709 Grade 36	¼" Steel ዊ			
Base	Plates	A36 or A709 Grade 36	¾" Steel PL			
Shim Plates		A36 or A709 Grade 36 or B209 Alloy 6061-T6 or B221 Alloy 6063-T5	Plate thicknesses as required. Holes in shim plates will be $\frac{3}{4}$ " Ø. For edge shims match the edge length of the base plate with a min. width of 3/4". Apply adhesive bonding material bed of 1-1/2" (Min.) wide			
Spacers		-	Plate thickness varies based on Traffic Railing type. (See Detail "A")			
Pipe Clamp Connection	Adhesive Anchor Rods	F1554 Grade 36	Fully threaded Headless Anchor Rods $\sim \frac{7}{8}$ " Ø x 6" (no spacer) or $\frac{7}{8}$ " Ø x (6" + spacer thickness)			
	C-I-P Anchor Rods	F1554 Grade 36	Hex Head Anchor Rods $\sim \frac{5}{8}$ " Ø x 6" (no spacer) or $\frac{5}{8}$ " Ø x (6" + spacer thickness)			
Base Plate Connection	Adhesive Anchor Rods	F1554 Grade 36	Fully threaded Headless Anchor Rods $\sim$ $\%$ 0 x 14 $\%$			
Base Conne	C-I-P Anchor Rods	F1554 Grade 36	Hex Head Anchor Rods $\sim \frac{7}{8}$ " Ø x $14\frac{1}{2}$ "			
Bolts		A307	¾" Ø x 4¾" Hex Head Bolts for Pipe Clamp Connections to Posts			
Nuts		A563	Hex Nuts for Pipe Clamp and Base Plate Connections			
Washers		F 436	Flat Washers for Pipe Clamp and Base Plate Connections			
Bearing Pads (Plain)		-	In accordance with Specification Section 932 for Ancillary Structures			

### POST ATTACHMENT NOTES

ANCHOR RODS, NUTS AND WASHERS:

After the nuts have been tightened, distort the Anchor Rod threads to prevent removal of the nuts. Coat distorted threads and exposed trimmed ends of anchors with a galvanizing compound in accordance with Specification Section 562. COATINGS:

Hot-dip galvanize all Nuts, Washers, Bolts, C-I-P Anchor Rods, Adhesive Anchors and Fence Framework (Posts, Internal Sleeves, Shim Plates, Base Plates, Pipe Clamps and Spacers) in accordance with Specification Section 962. Hot-dip galvanize Fence Framework after fabrication.

ADHESIVE-BONDED ANCHORS AND DOWELS:

Adhesive Bonding Material Systems for Anchors and Dowels will comply with Specification Section 937 and be installed in accordance with Specification Section 416. Cutting of reinforcing steel is permitted for drilled hole installation.


WELDING:


All welding will be in accordance with the American Welding Society Structural Welding Code (Steel) ANSI/AWS D1.1 (current edition). Weld metal will be E60XX or E70XX. Nondestructive testing of welds is not required.


LAST REVISION 11/01/24

DESCRIPTION:



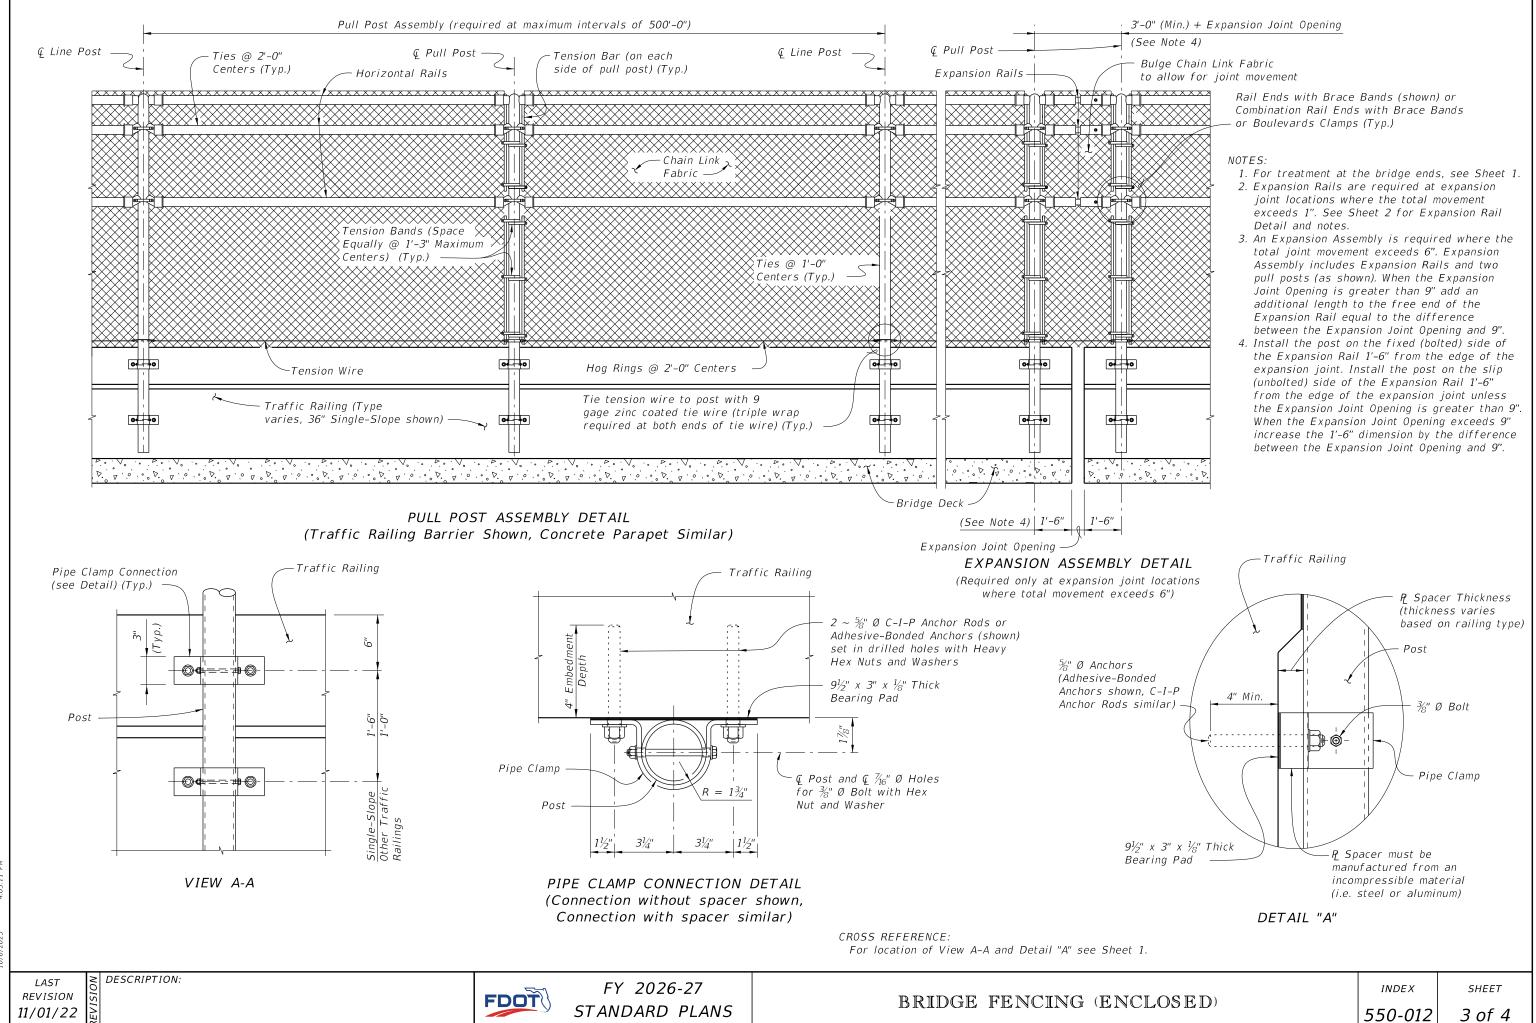

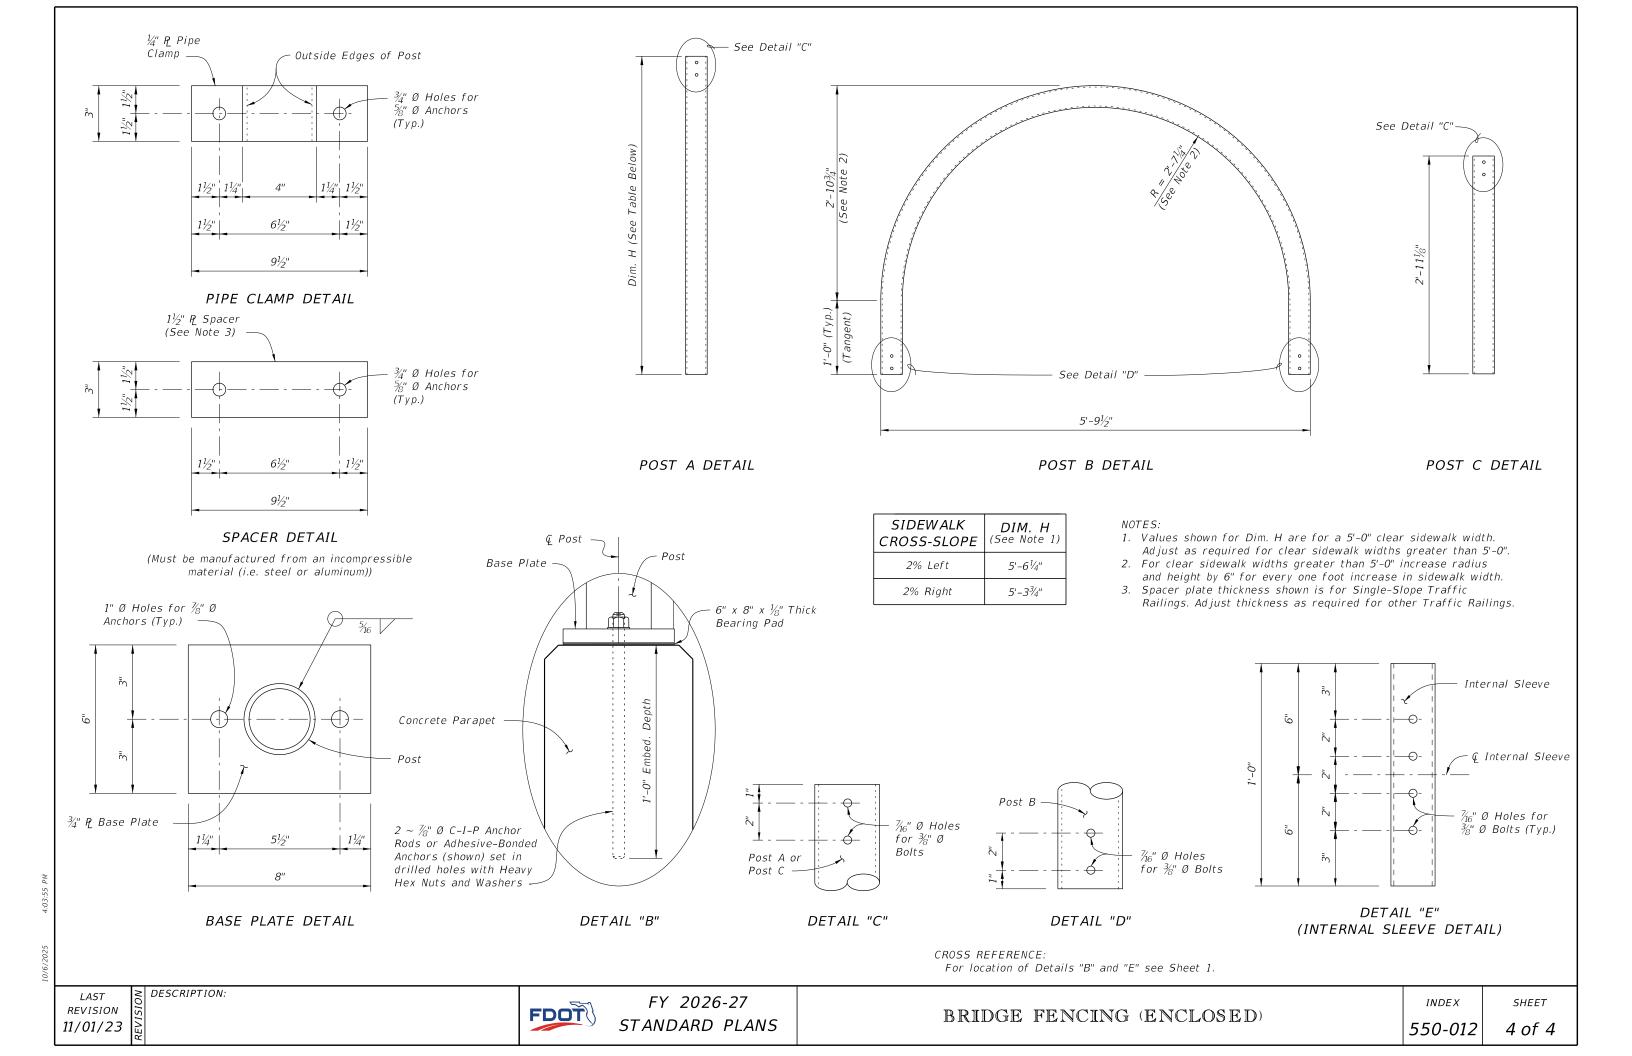

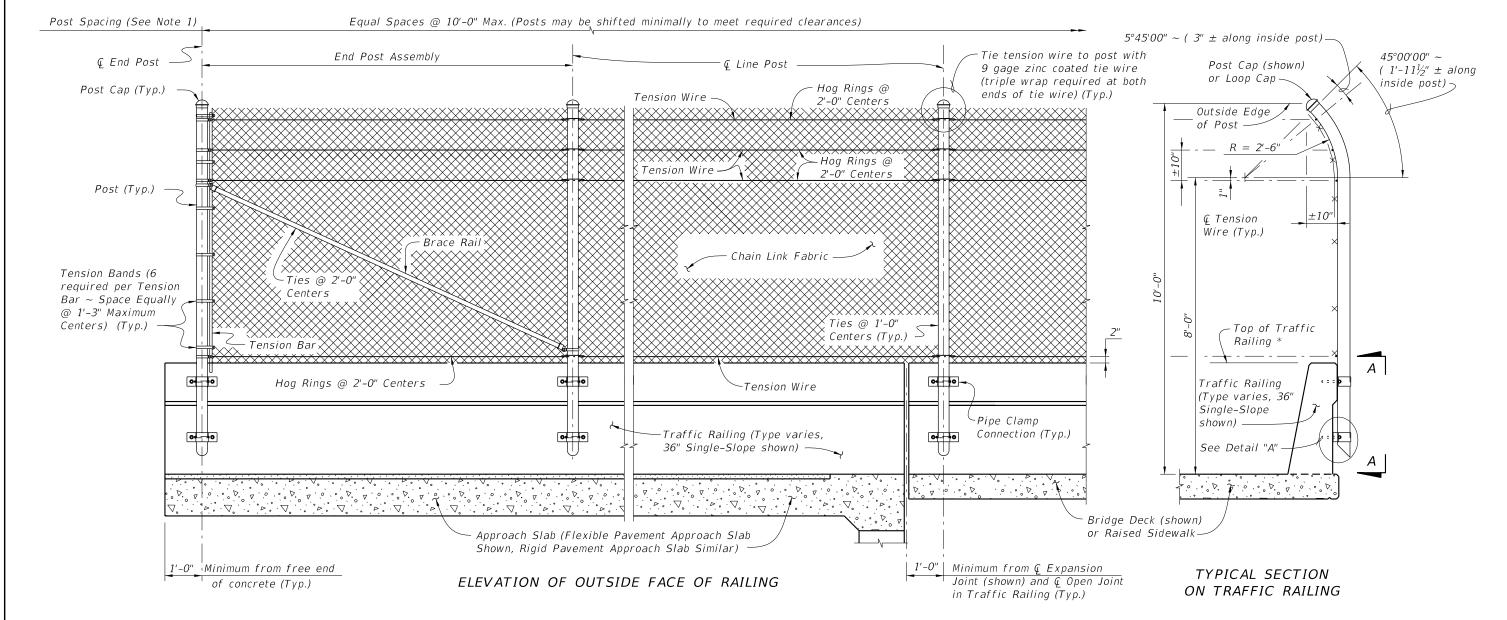

NOTES:

1. A Pull Post Assembly is required at maximum intervals of 500'-0". See Sheet 3.

\* Do not anchor Fencing to the top of Traffic Railings.

#### FENCING NOTES

FENCE INSTALLATION:

Install posts plumb (within a tolerance of  $\pm 1\frac{1}{2}$ ). Use shim plates as required to achieve plumb. The required quantity and thickness of shim plates will be determined in the field. Install chain link fence in accordance with ASTM F567 as applicable. TRAFFIC RAILING DETAILS:

See Superstructure Sheets for Traffic Railing details.

LIMITS OF FENCING:

DESCRIPTION:

Limits of fencing are from begin of approach slab at Begin Bridge to end of approach slab at End Bridge, unless otherwise shown in the plans.

PAYMENT:

Payment will be made under Fencing, Type R. Payment includes all materials and labor required to complete installation of the fence.

CROSS REFERENCE:

For Table of Fence Components, Table of Post Attachment Components, View A-A and Detail "A"


For Pull Post Assembly Detail for Traffic Railing see Sheet 3.

LAST REVISION 11/01/23



TABLE OF CHAIN LINK FENCE COMPONENTS			
COMPONENT	ASTM DESIGNATION	COMPONENT INFORMATION	
Posts	F1083	Galvanized Steel Pipe – $3\frac{1}{2}$ " NPS, Schedule 40 Regular Grade	
Chain Link Fabric (2" mesh with twisted	A392	Zinc Coated Steel - 9 gage (coated wire diameter), Class 2 Coating	
top and knuckled bottom selvage)	A491	Aluminum Coated Steel - 9 gage (coated wire diameter)	
-	F668	Polyvinyl Chloride (PVC) Coated Steel - 9 gage Class 2b	
Tie Wires	F626	Zinc Coated Steel Wire - 9 gage	
Brace Bands	F626	12 Gage (Min. thickness) x $\frac{3}{4}$ " (Min. width) Steel Bands (Beveled or Heavy)	
Tension Bars	F626	$^{3}\!$	
Tension Bands	F626	14 Gage (Min. thickness) x $\frac{3}{4}$ " (Min. width) Steel Bands	
Miscellaneous Fence Components	F626	Zinc Coated Steel ~ (includes post or loop caps, horizontal and brace rail ends, combination rail ends, boulevard clamps and all other miscellaneous fittings & hardware)	
Tanadan Mina	4024 6 4017	Type II (Zinc Coated Steel Wire) - 7 gage, Class 4 Coating	
Tension Wire	A824 & A817	Type I (Aluminum Coated Steel Wire) - 7 gage	
Hog Rings	F626	Zinc Coated Steel Wire - 12 gage	
Brace Rails	F1083	Galvanized Steel Pipe - 1½" NPS, Schedule 40 Regular Grade	

	TABLE OF POST ATTACHMENT COMPONENTS				
COMPONENT		ASTM DESIGNATION	COMPONENT INFORMATION		
Pipe Clamps		A36 or A709 Grade 36	¼" Steel ዊ		
Base	Plates	A36 or A709 Grade 36	¾" Steel P		
Shim Plates		A36 or A709 Grade 36 or B209 Alloy 6061-T6 or B221 Alloy 6063-T5	Plate thicknesses as required. Holes in shim plates will be $\frac{3}{4}$ " Ø. For edge shims match the edge length of the base plate with a min. width of $3/4$ ". Apply adhesive bonding material bed of $1$ - $1/2$ " (Min.) wide		
Space	ers	-	Plate thickness varies based on traffic railing type (See Detail "A")		
Pipe Clamp Connection	Adhesive Anchor Rods	F1554 Grade 36	Fully threaded Headless Anchor Rods $\sim \frac{5}{8}$ " Ø x 6" (no spacer) or $\frac{5}{8}$ " Ø x (6" + spacer thickness)		
Pipe ( Conne	C-I-P Anchor Rods	F1554 Grade 36	Hex Head Anchor Rods $\sim \frac{7}{8}$ " Ø x 6" (no spacer) or $\frac{7}{8}$ " Ø x (6" + spacer thickness)		
Bolts		A307	¾" Ø x 4¾" Hex Head Bolts for Pipe Clamp Connections to Posts		
Nuts		A563	Hex Nuts for Pipe Clamp Connections		
Washers		F436	Flat Washers for Pipe Clamp Connections		
	ing Pads n Neoprene)	-	In accordance with Specification Section 932 for Ancillary Structures		

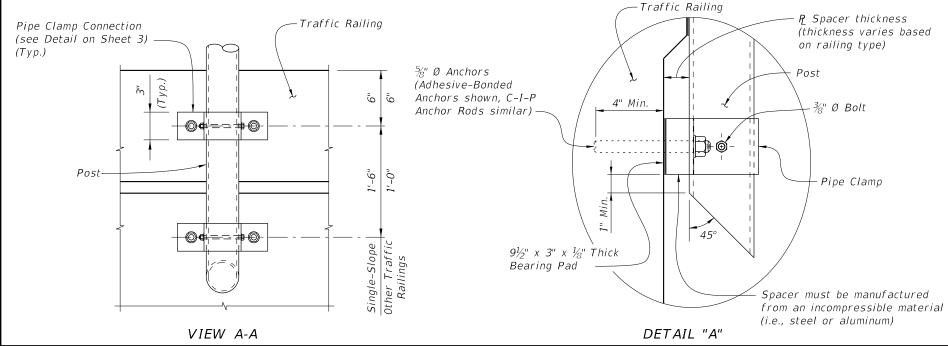

#### POST ATTACHMENT NOTES

#### ANCHOR RODS, NUTS AND WASHERS:

After the nuts have been tightened, distort the Anchor Rod threads to prevent removal of the nuts. Coat distorted threads and exposed trimmed ends of anchors with a galvanizing compound in accordance with Specification Section 562.

Hot-dip galvanize all Nuts, Washers, Bolts, C-I-P Anchor Rods, Adhesive Anchors and Fence Framework (Posts, Internal Sleeves, Shim Plates, Base Plates, Pipe Clamps and Spacers) in accordance with Specification Section 962. Hot-dip galvanize Fence Framework after fabrication.

ADHESIVE-BONDED ANCHORS AND DOWELS:

Adhesive Bonding Material Systems for Anchors and Dowels will comply with Specification Section 937 and be installed in accordance with Specification Section 416. Cutting of reinforcing steel is permitted for drilled hole installation.

#### WELDING:

All welding will be in accordance with the American Welding Society Structural Welding Code (Steel) ANSI/AWS D1.1 (current edition). Weld metal will be E60XX or E70XX. Nondestructive testing of welds is not required.

#### CROSS REFERENCE:

For location of View A-A and Detail "A" see Sheet 1.

REVISION 11/01/24

DESCRIPTION:

FDOT

FY 2026-27 STANDARD PLANS

INDEX

SHEET

