


GENERAL NOTES:




- 1. Work this Index with Index 425-001 and Index 425-010.
- 2. Use Grade 60 reinforcing bars with 2" minimum cover unless otherwise noted. See Index 425-001 for equivalent area of welded wire fabric. Cut or bend bars to provide 1½" minimum clearance around pipe.
- 3. Chamfer all exposed edges and corners ¾" or tool to ¼" radius.
- 4. Dimensions are for both precast and cast-in-place inlets unless otherwise noted.

TABLE OF CONTENTS:	
Sheet	Description
1	General Notes and Contents
2	Dimensional and Reinforcing Details
3	Transition and Apron Details
4	Steel Grate Details
5	Alternate A Structure Bottom - Top Slab Details

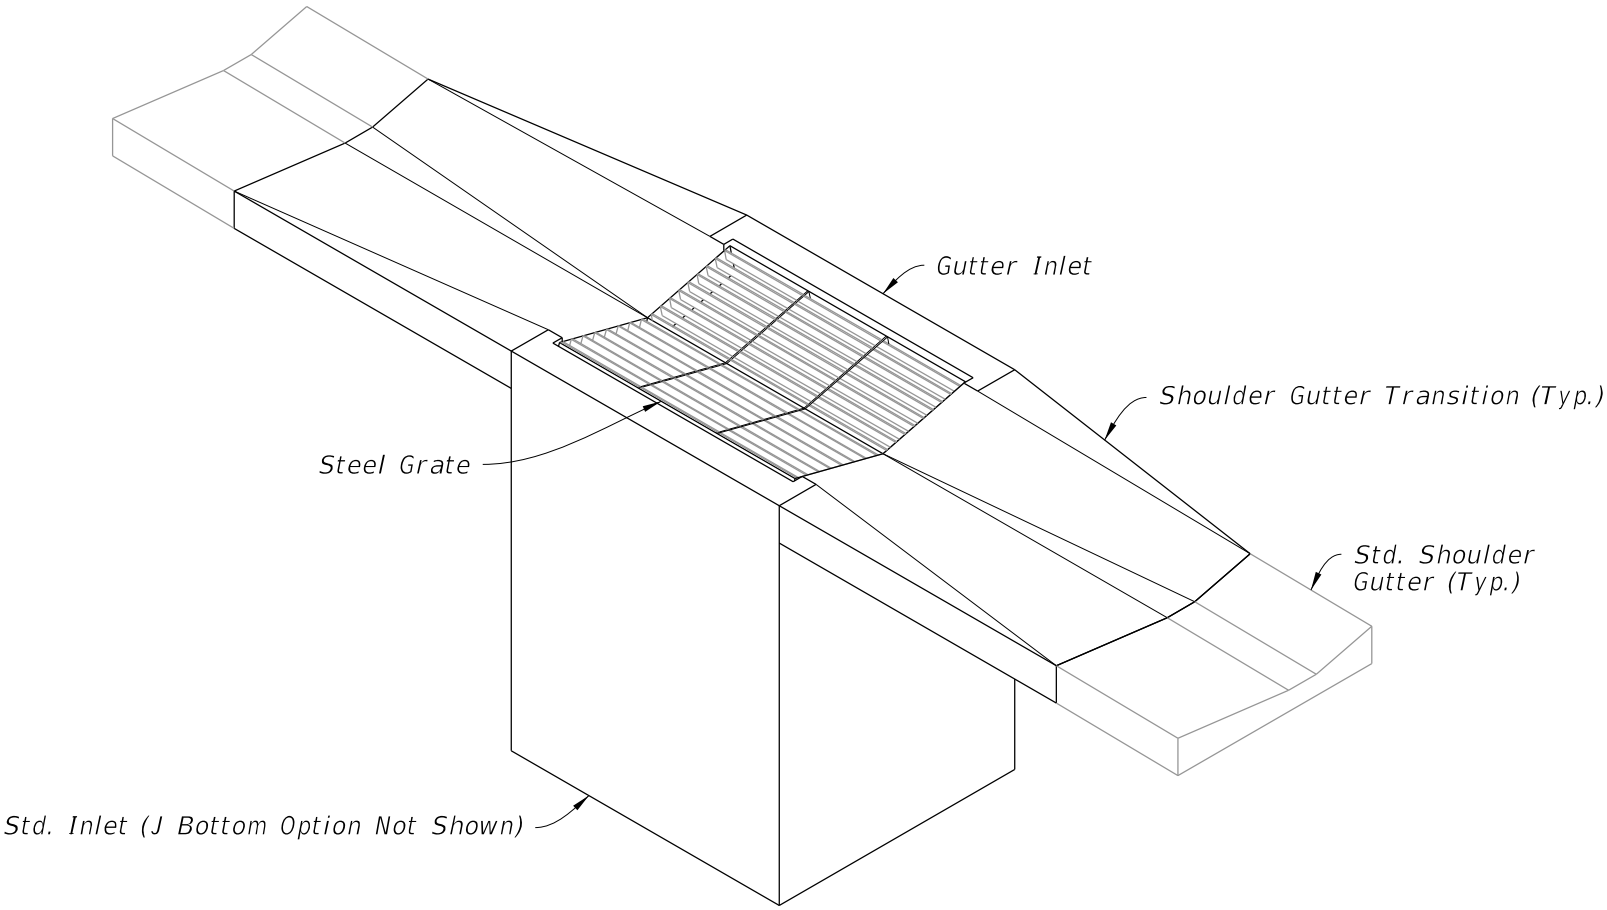

GUTTER INLET TYPE S
(Pipe Opening Not Shown)

9/28/2026 11:51:37 AM

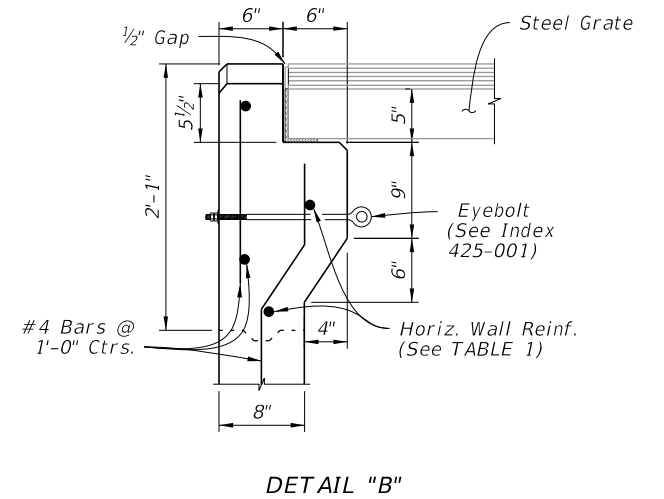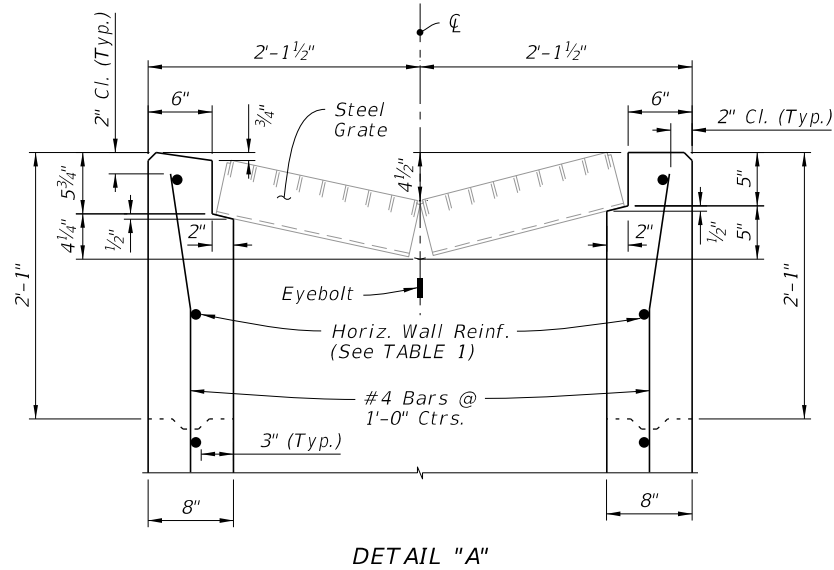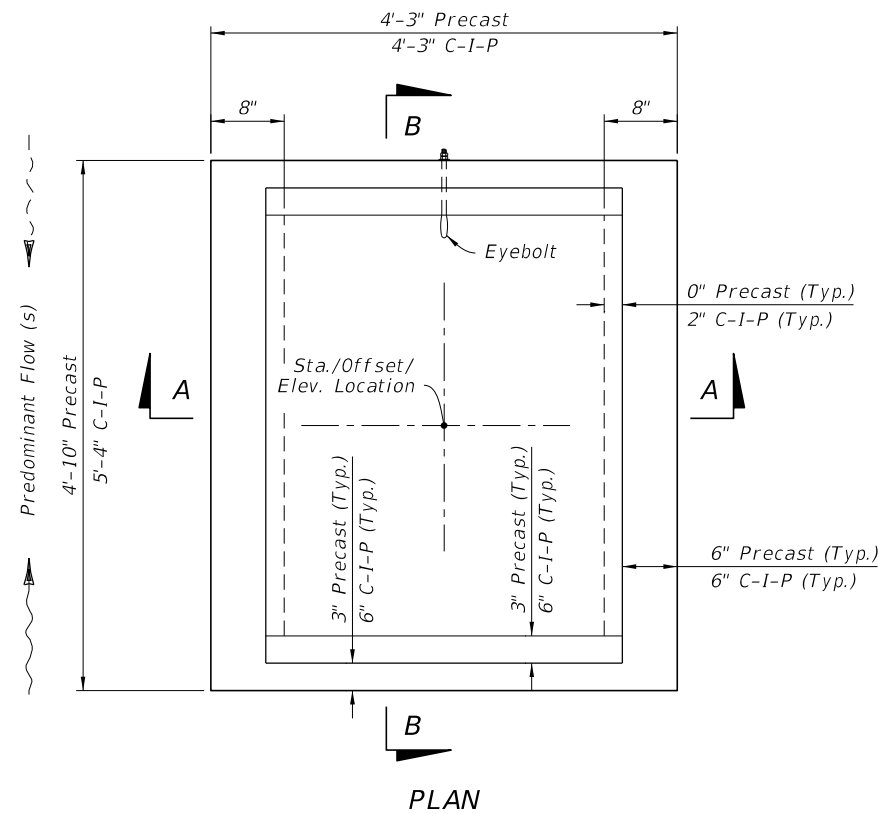

CAST-IN-PLACE OPTION

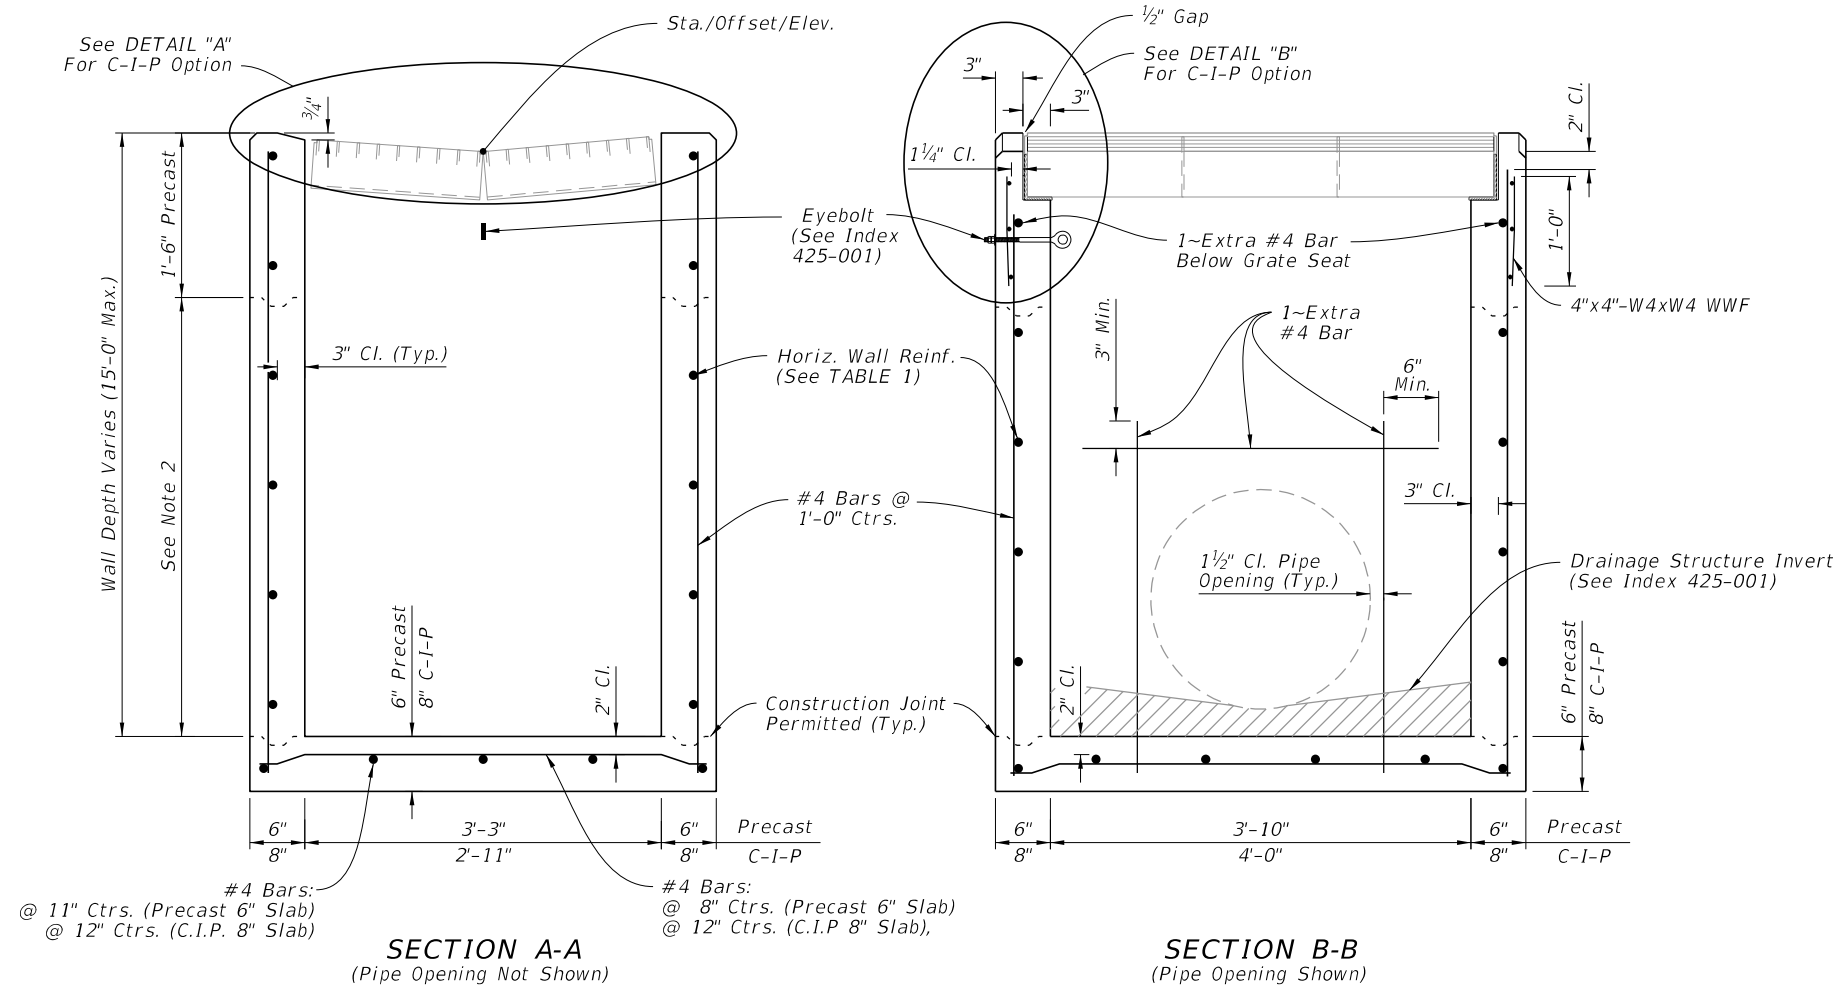


TABLE 1 HORIZONTAL WALL REINFORCING SCHEDULE				
WALL DEPTH	SCHEDULE	AREA (in. ² /ft.)	MAX. SPACING	
			BARS	WWR
0' - 5'	A12	0.20	12"	8"
5' - 9'	A6	0.20	6"	5"
9' - 12'	A4	0.24	4"	3"
9' - 15'	B5.5	0.24	5 1/2"	5"


NOTES:

- Concrete Apron/Transition not shown.
- Construction joints permitted between these limits. See Index 425-001 for minimum dimensions.


DIMENSIONAL AND REINFORCING DETAILS

9/28/2026 11:51:40 AM



LAST REVISION 11/01/20	DESCRIPTION:	FY 2027-28 STANDARD PLANS	GUTTER INLET TYPE S	INDEX 425-040	SHEET 2 of 5
------------------------------	--------------	------------------------------	---------------------	------------------	-----------------

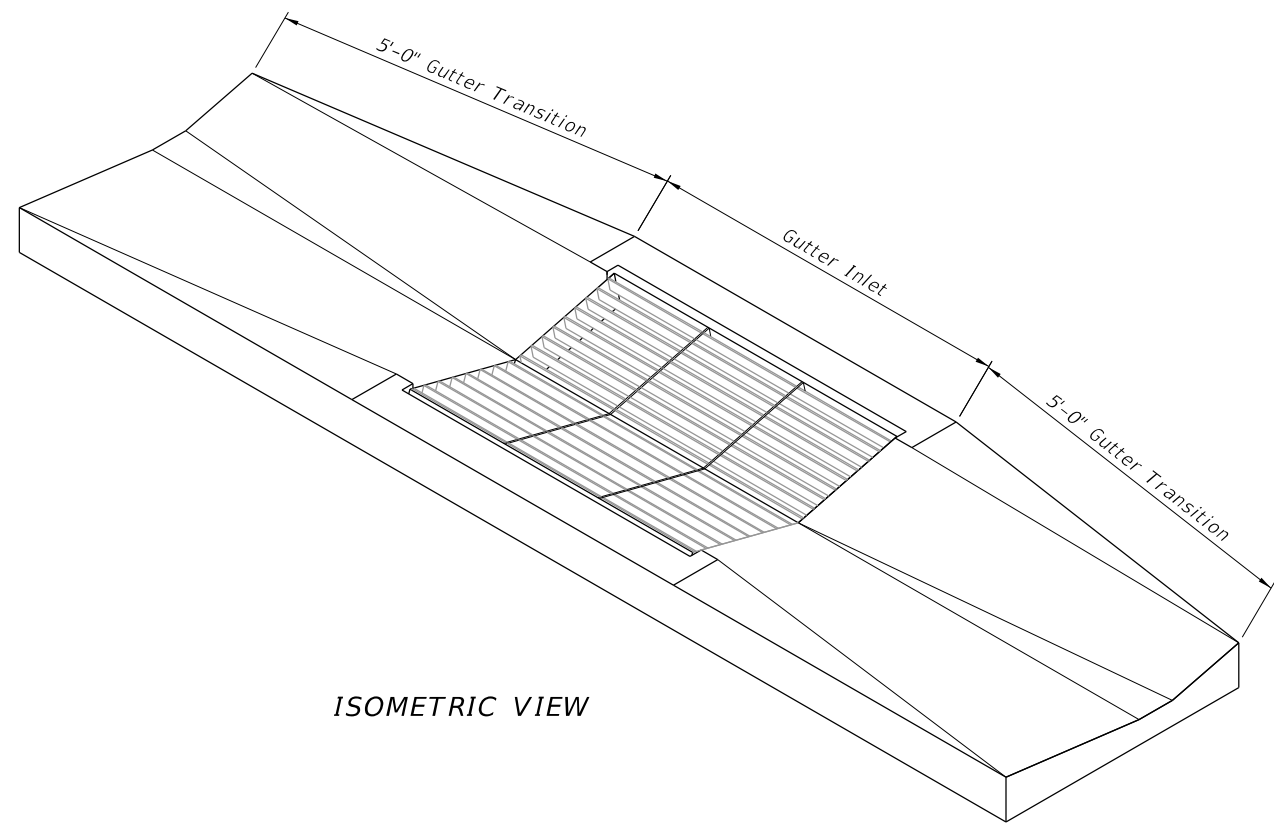

ISOMETRIC VIEW

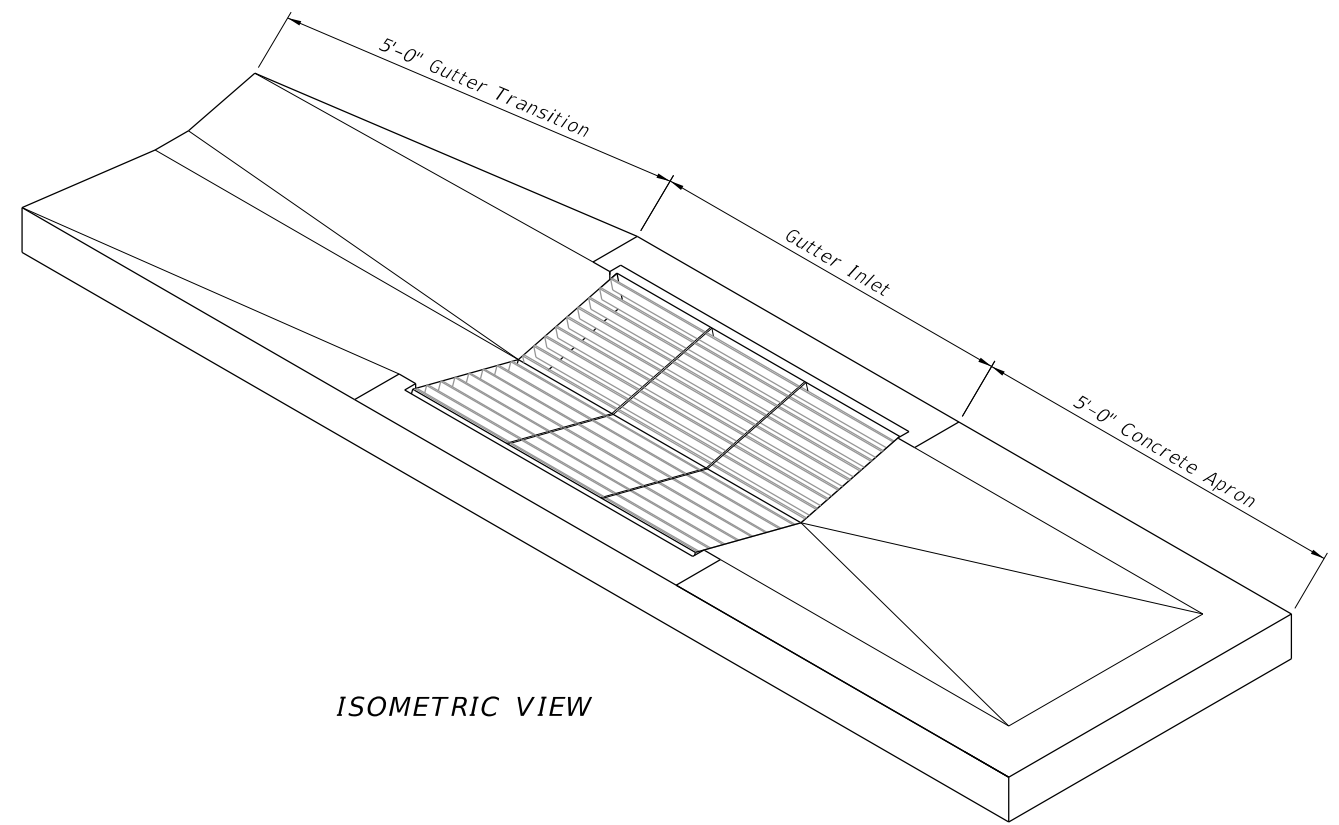



ISOMETRIC VIEW

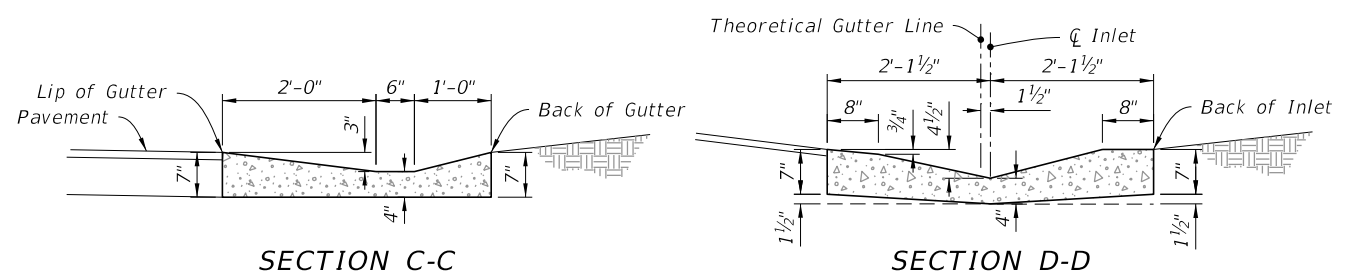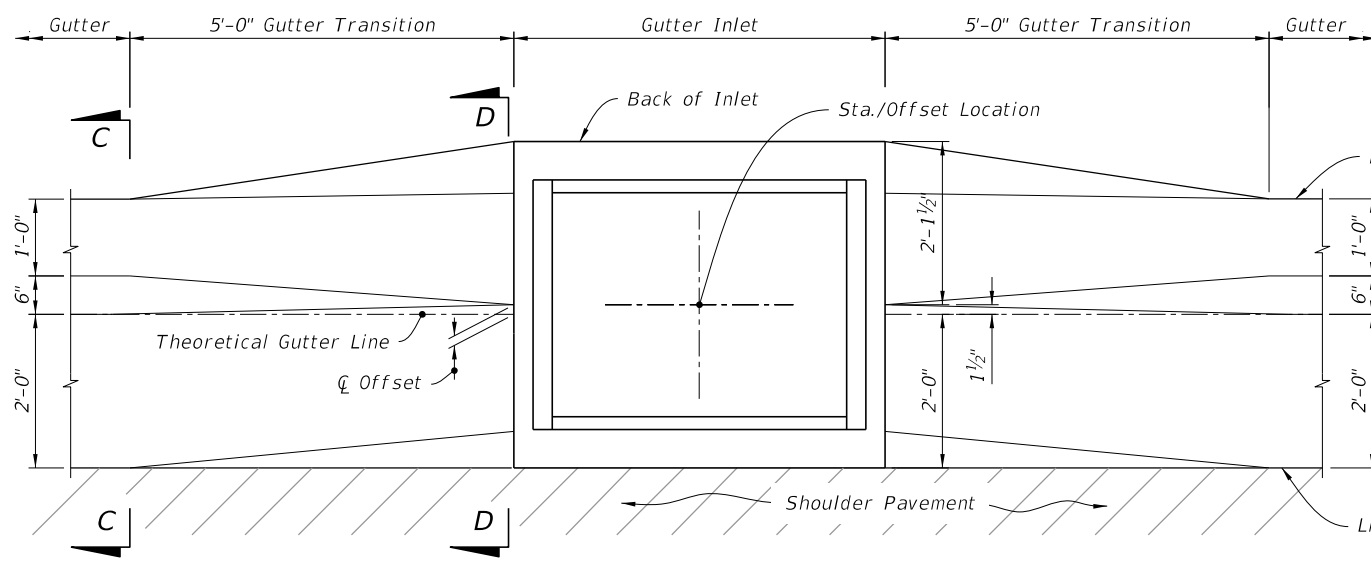

SECTION C-C

SECTION D-D

SHOULDER GUTTER TRANSITION

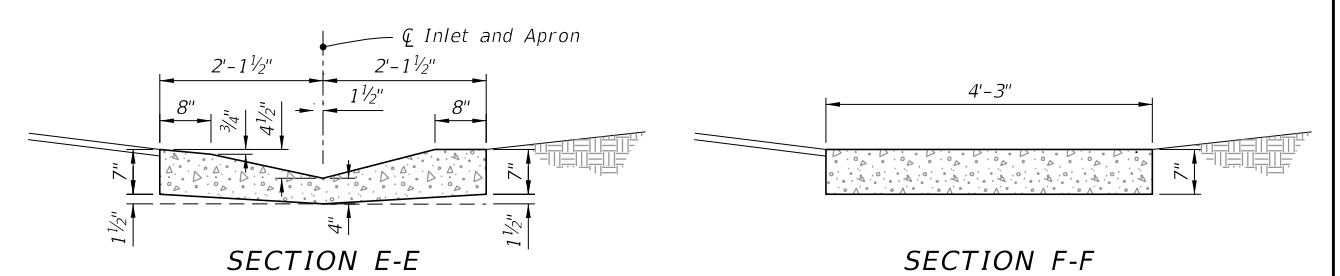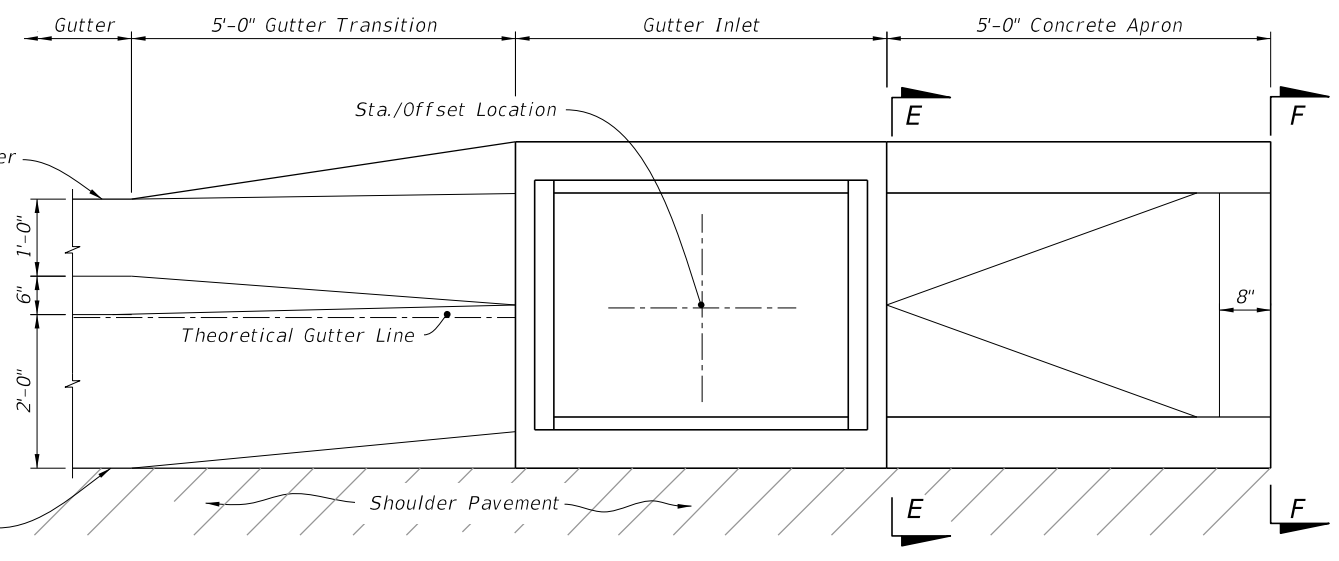

SECTION E-E





SECTION F-F

APRON AT TERMINAL INLETS

TRANSITION AND APRON DETAILS



9/28/2026 11:51:42 AM

LAST REVISION 11/01/20	REVISION DESCRIPTION:	FDOT FY 2027-28 STANDARD PLANS	GUTTER INLET TYPE S	INDEX 425-040	SHEET 3 of 5
---------------------------------------	-------------------------------------	--	----------------------------	--------------------------	-------------------------

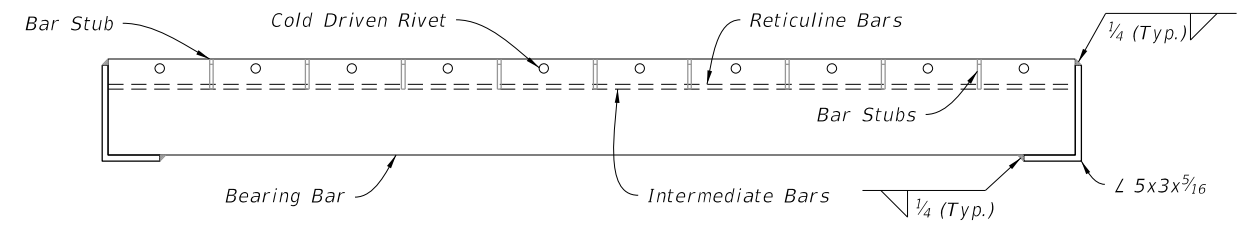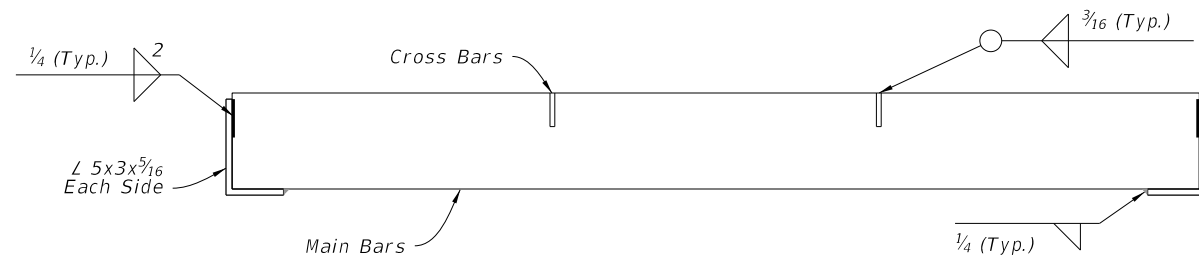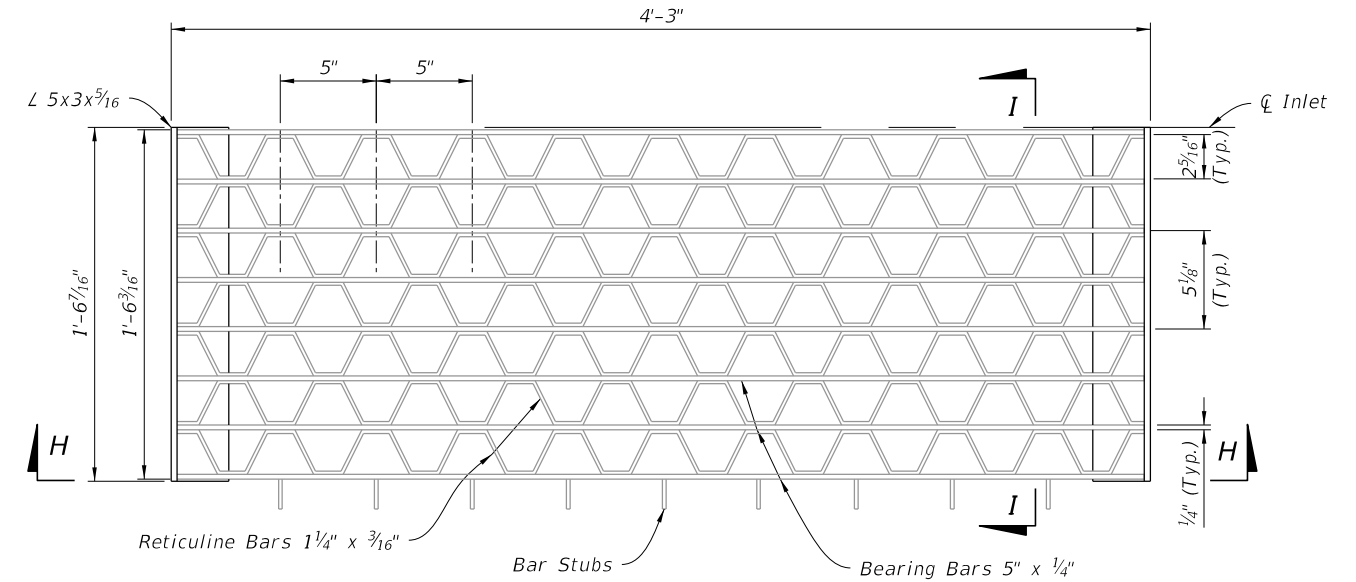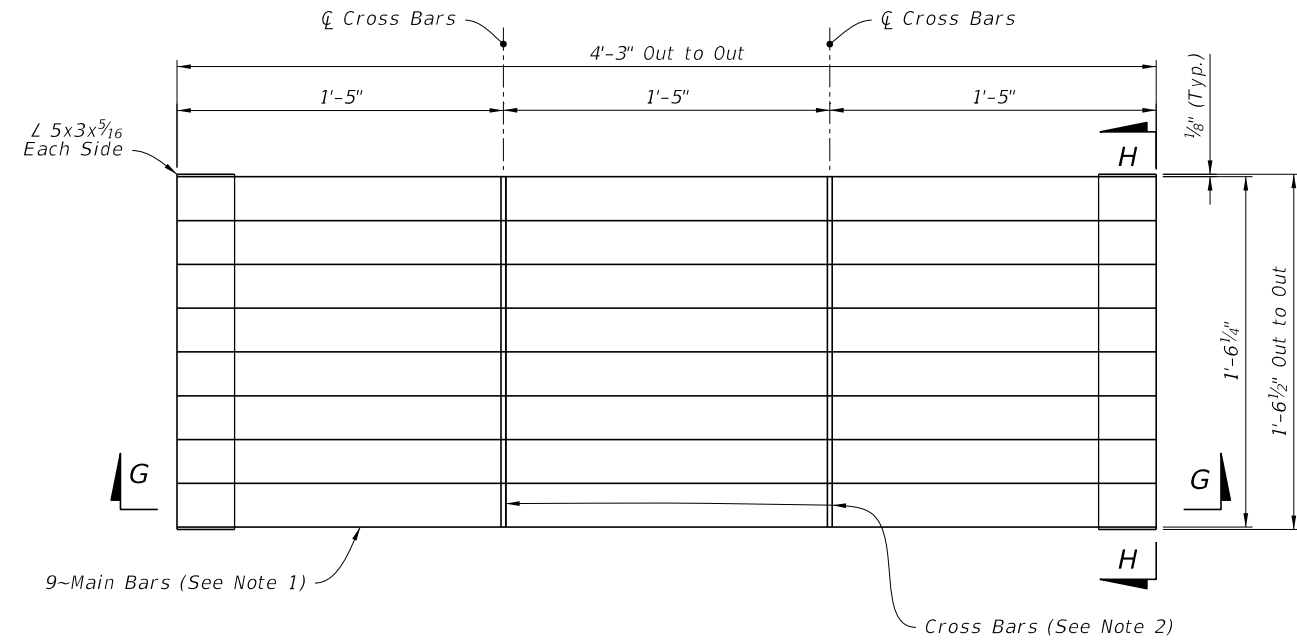

NOTES:

1. Main Bars are 5"x1/4", notched for Cross Bars, and spaced equally apart.
2. Cross Bars are 1 3/4"x1/4" and continuously welded at Main Bar Notches.
3. Main Bars and Cross Bars are flush on top.

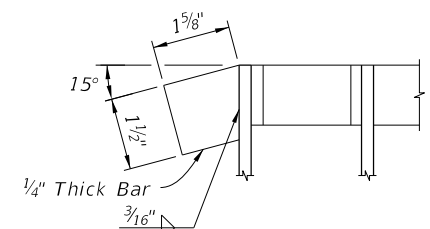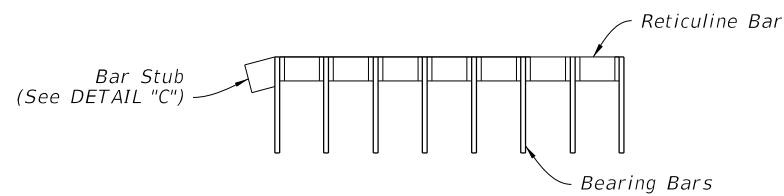

PARALLEL BARS

RETICULINE BARS

STEEL GRATE DETAILS

LAST REVISION 11/01/20	REVISION	DESCRIPTION:	 FY 2027-28 STANDARD PLANS	GUTTER INLET TYPE S	INDEX 425-040	SHEET 4 of 5
------------------------------	----------	--------------	--	----------------------------	------------------	-----------------

9/28/2026 11:51:48 AM



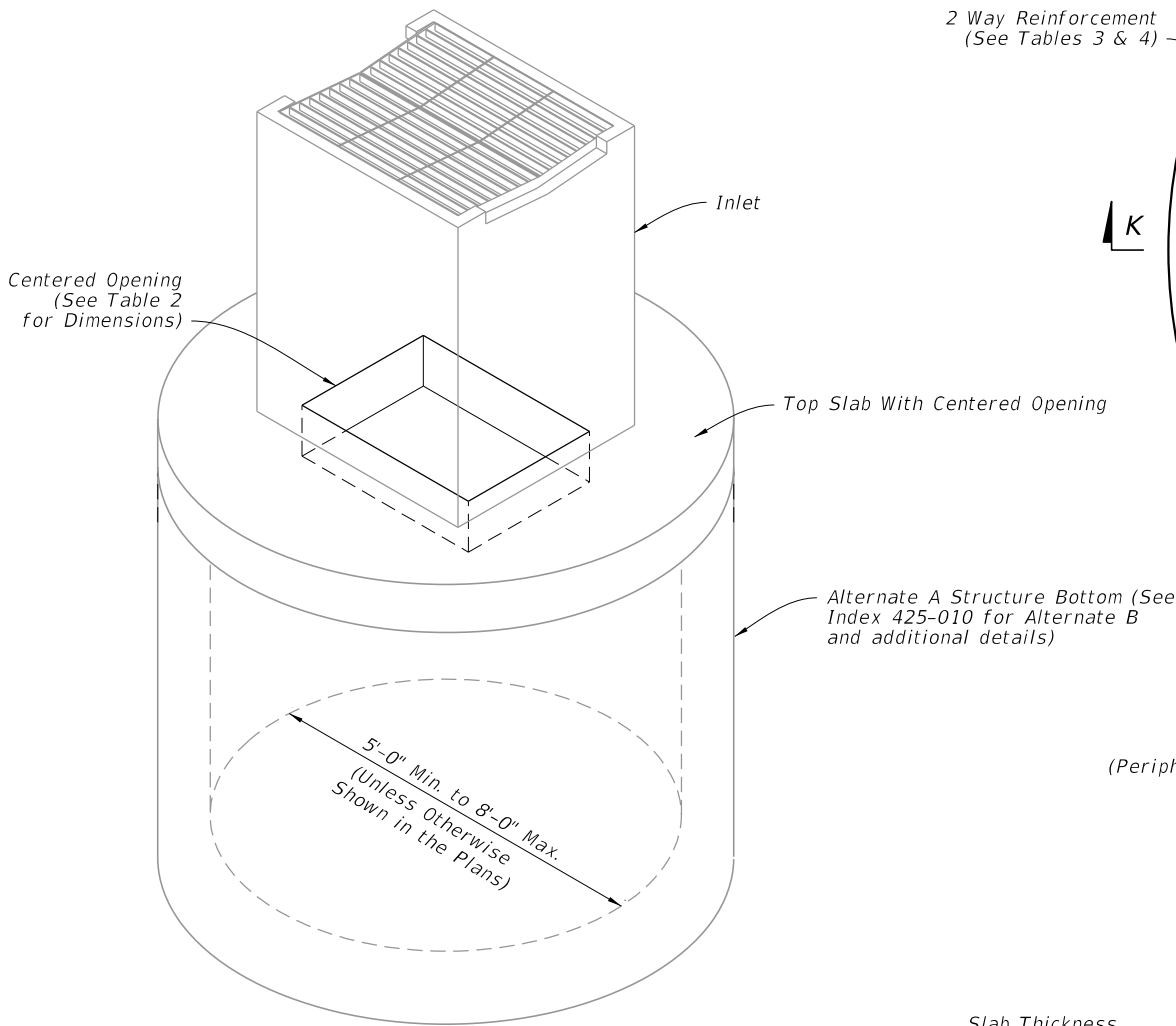


TABLE 2 TOP SLAB OPENING		
DIAMETER	OPENING SIZE	
	Min.	Max.
5'-0" to 8'-0"	2'-11" x 4'-0"	3'-3" x 3'-10"

ISOMETRIC VIEW

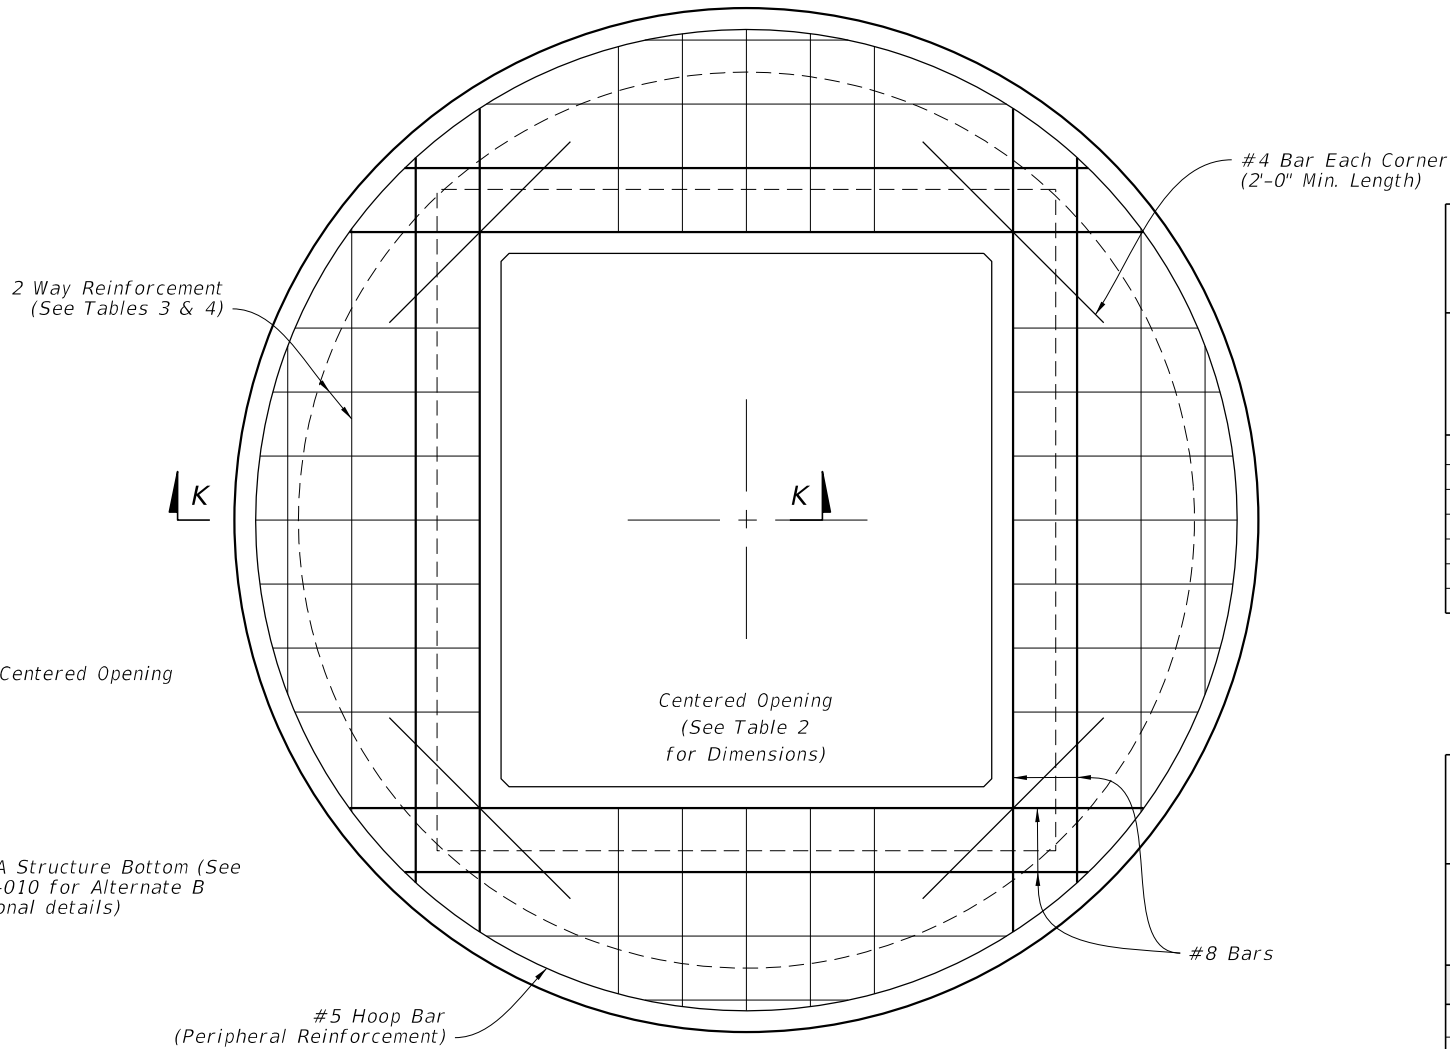

PLAN

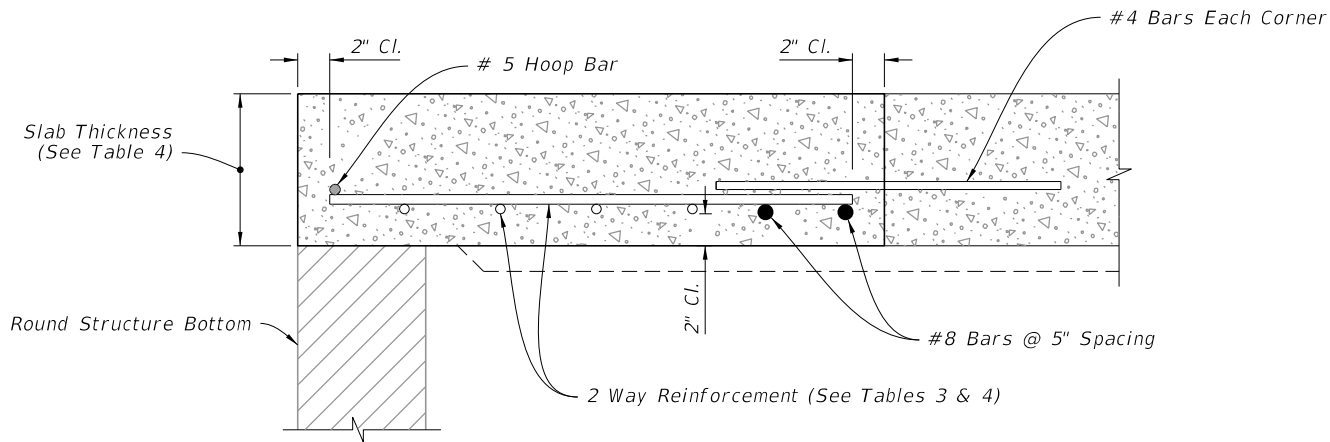

SECTION K-K

TOP SLAB REINFORCEMENT DETAILS

TABLE 3 TOP SLAB REINFORCING SCHEDULE	
SCHEDULE	GRADE 60 (BAR) OR 65 KSI & 70 KSI (WIRE FABRIC) In. ² /ft.
A	0.20
B	0.24
C	0.37
D	0.53
E	0.73
F	1.06
G	1.45

TABLE 4 TOP SLAB WITH CENTERED OPENING		
STRUCTURE DEPTH	SLAB THICKNESS	REINFORCING (2 WAY) SCHEDULE
SIZE: 5'-0"		
≥0.5'<30'	9½"	C
30'<40'	9½"	D
SIZE: 6'-0"		
≥0.5'<8'	9½"	B
8'<18'	9½"	C
18'<30'	9½"	D
30'<37'	9½"	E
37'-40'	9½"	G
SIZE: 8'-0"		
≥0.5'<9'	11½"	C
9'<15'	11½"	D
15'<23'	11½"	E
23'<33'	11½"	E
33'-40'	11½"	G

ALTERNATE A STRUCTURE BOTTOM - TOP SLAB DETAILS