


GENERAL NOTES:

- 1. Work this Index with Index 425-001 and Index 425-010.
- 2. When inlet is placed in areas subject to bicycle traffic, install filler bar when clearance or gap is greater than 5/8" as shown in Index 425-031.
- 3. These inlets may be used with Alternate B structure bottoms, Index 425-010.
- 4. Chamfer all exposed edges and corners 3/4" chamfer or tooled to 1/4" radius.
- 5. See Index for supplemental details.
- 6. Reinforcing bars are Grade 60 with 2" minimum cover unless otherwise noted. Cut or bend bars to provide 1 1/2" clearance around pipe opening. Provide one additional #4 bar above and at each side of pipe opening as shown.
- 7. Dimensions are for both precast and cast-in-place inlets unless otherwise noted.
- 8. Quantities are for informational and estimating purposes only.


TABLE OF CONTENTS:

Sheet	Description
1	General Notes and Contents
2	Type F - Dimensional, Reinforcing, and Grate Details
3	Type G - Dimensional, Reinforcing, and Grate Details
4	Concrete Apron and Sodded Area Details

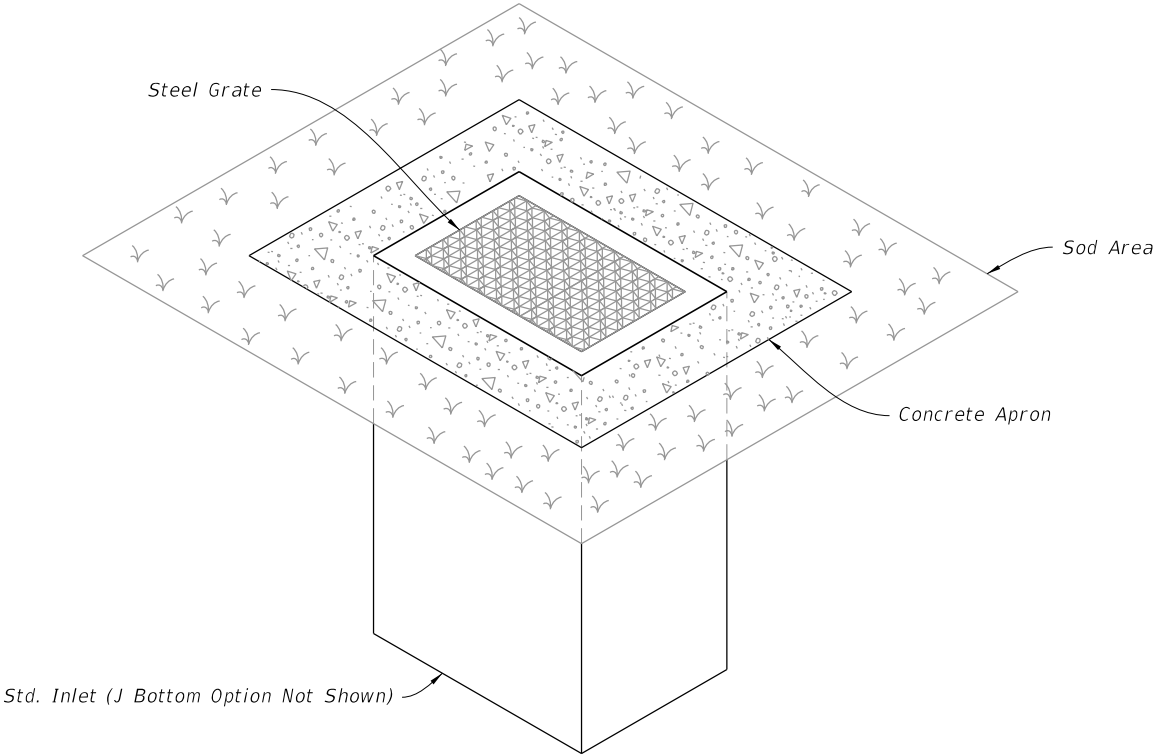

DITCH BOTTOM INLET TYPE F
(Type G Similar, Pipe Connection Not Shown)

9/28/2026 11:53:05 AM

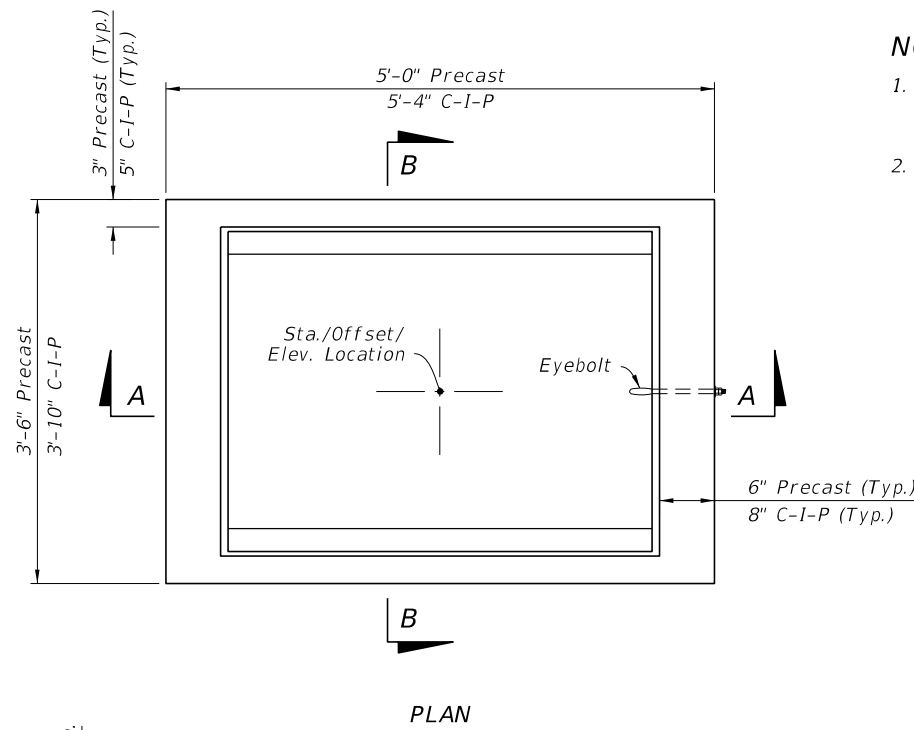

NOTES:

1. The Grate, Concrete Apron, and Sod not shown on Inlet PLAN view. See Sheet 4 for Concrete Apron and Sodded Area details.
2. Construction joints permitted between these limits. See Index 425-001 for minimum dimensions.




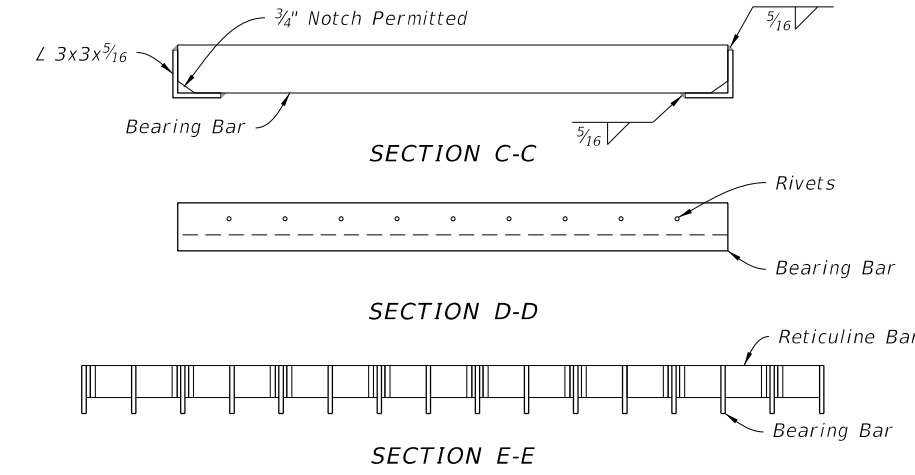



TABLE 1
HORIZONTAL WALL REINFORCING SCHEDULE

WALL DEPTH	SCHEDULE	AREA (in. ² /ft.)	MAX. SPACING	
			BARS	WWR
0' - 4'	A12	0.200	12"	8"
4' - 7'	A6	0.200	6"	5"
7' - 12'	B5.5	0.240	5 1/2"	5"
12' - 15'	Special 1	0.267	5"	4"

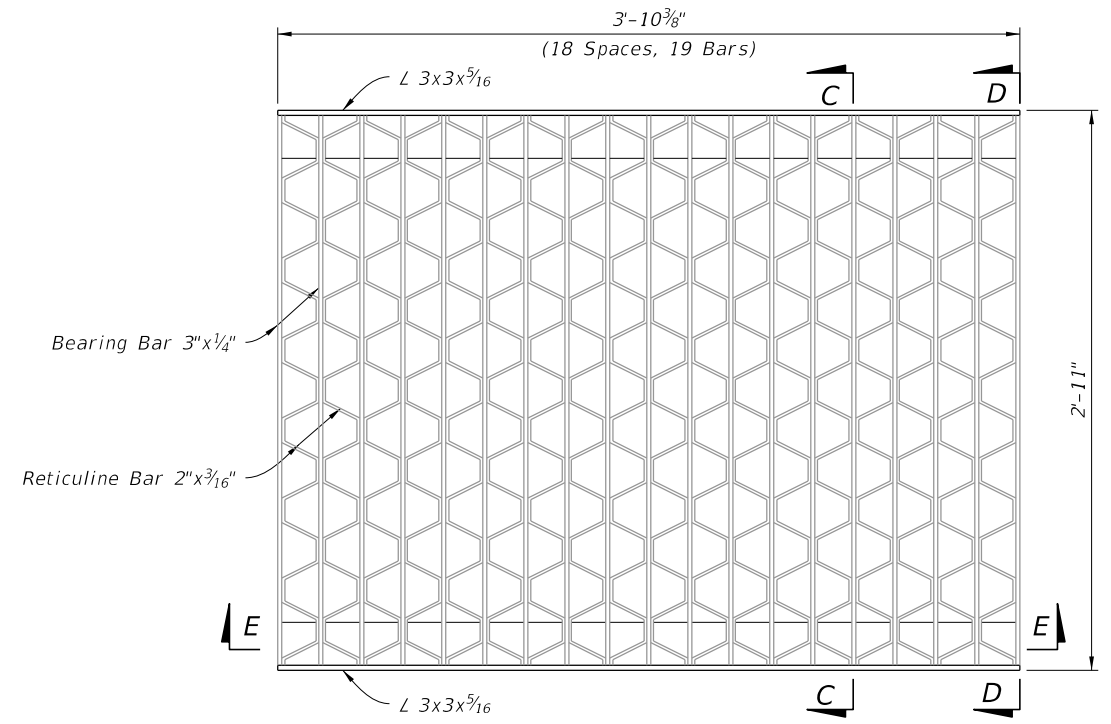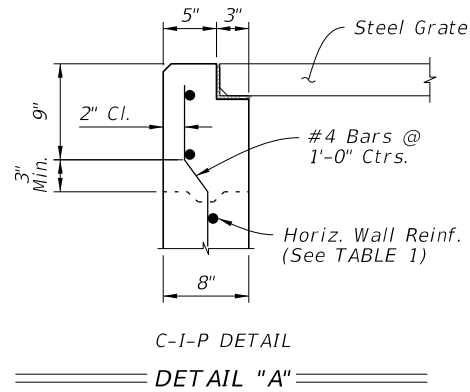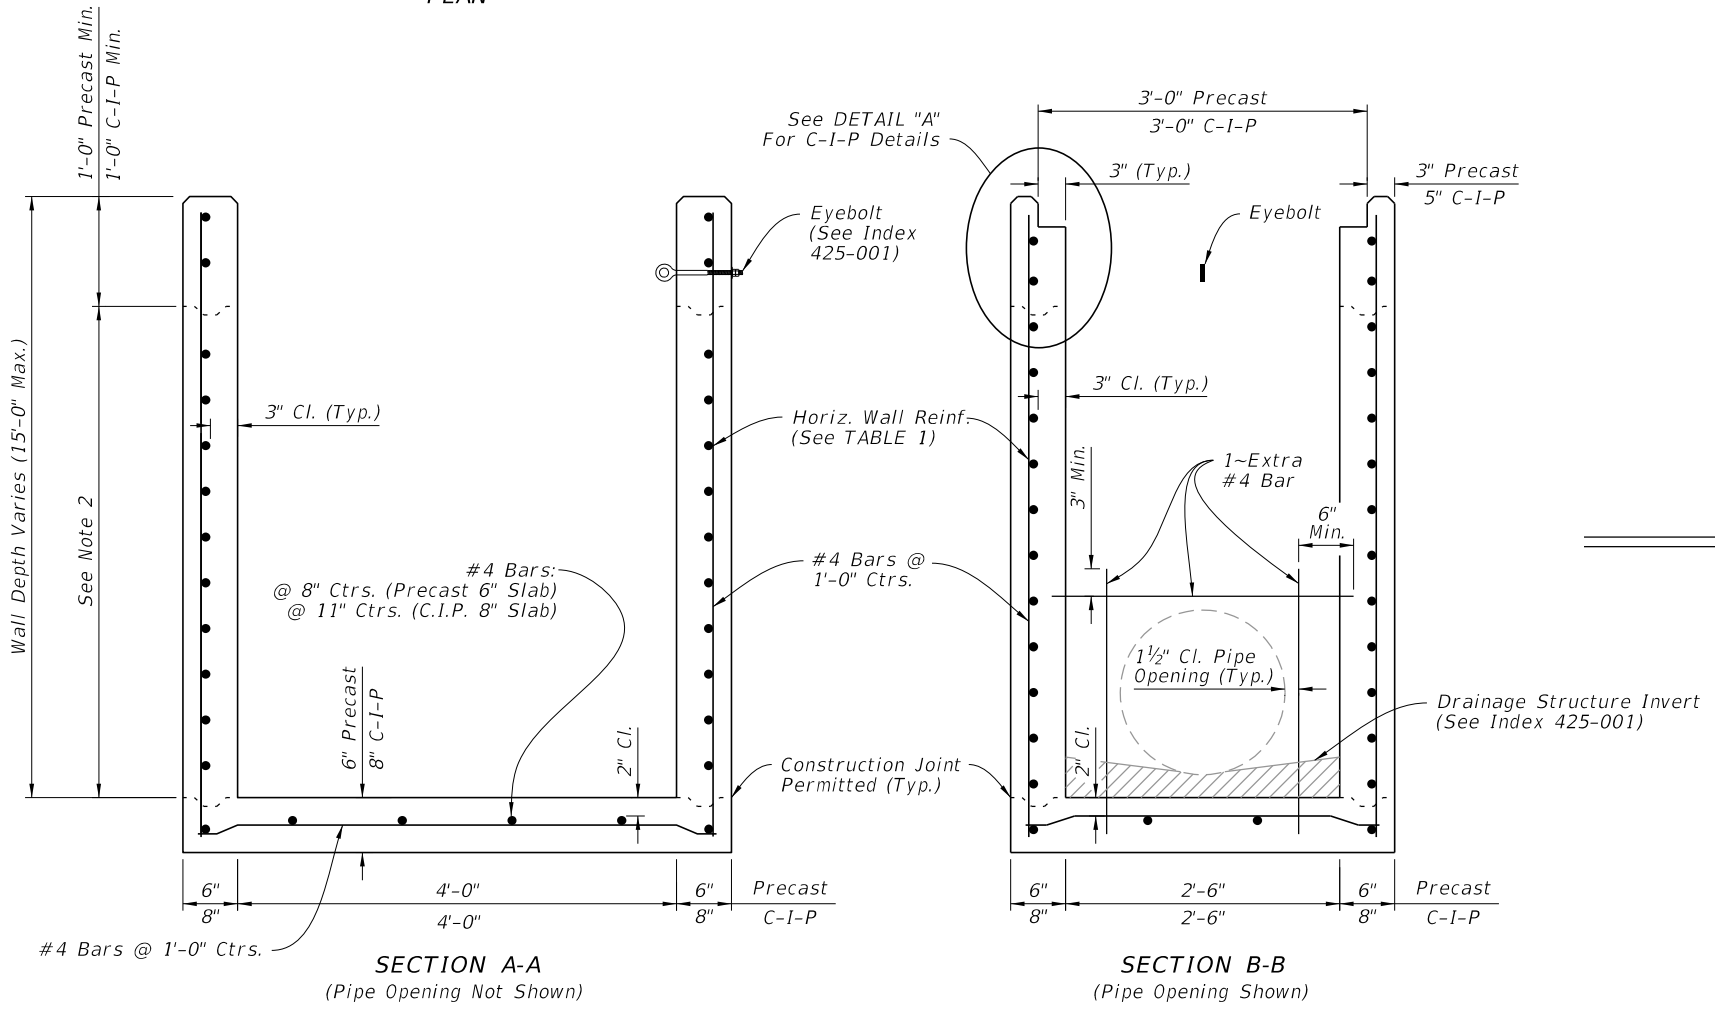



DIMENSIONAL AND REINFORCING DETAILS

TYPE F - DIMENSIONAL, REINFORCING, AND GRATE DETAILS

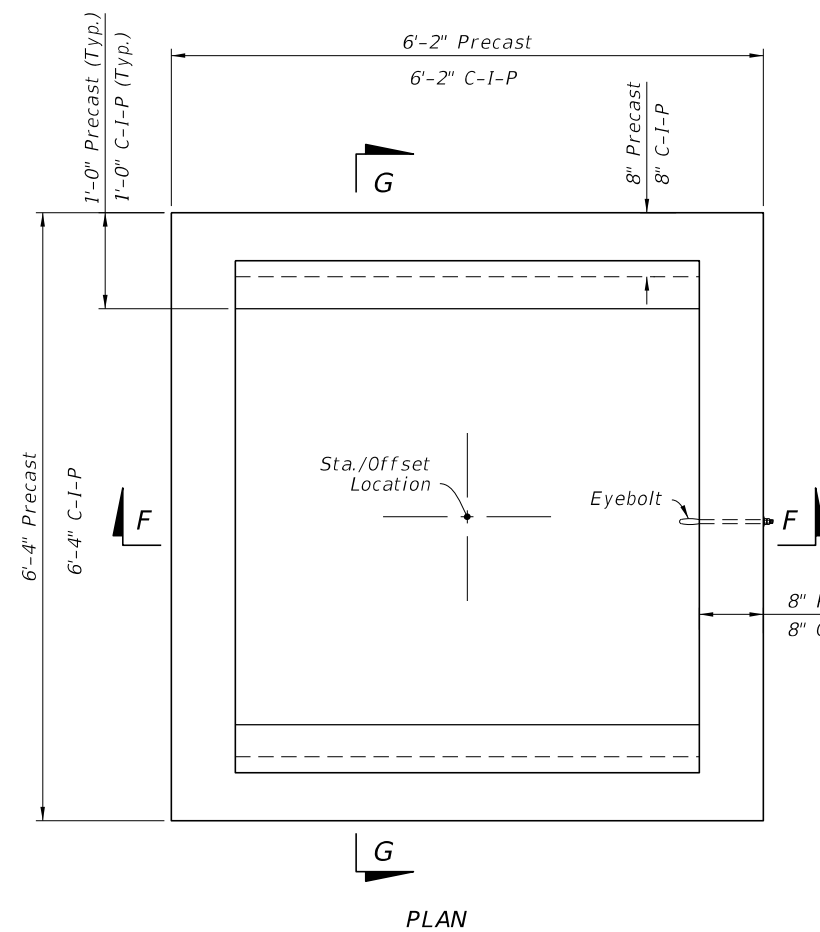

NOTES:

1. Grate, Concrete Apron, and Sod not shown in Plan view
2. See Sheet 4 for Concrete Apron and Sodded Area details.
3. Construction joints permitted between these limits. See Index 425-001 for minimum dimensions.

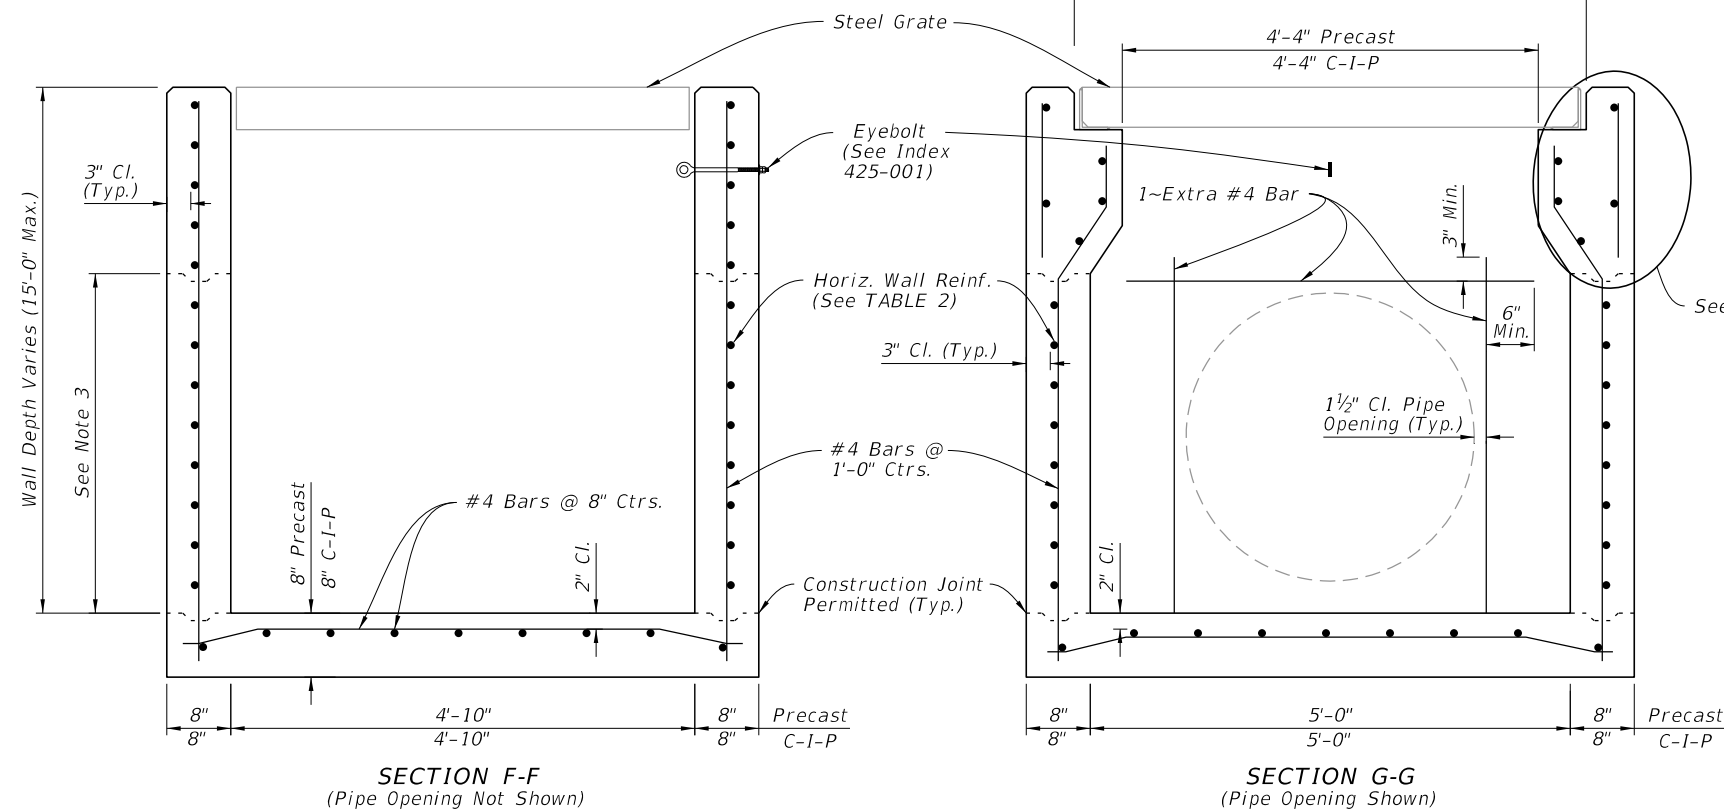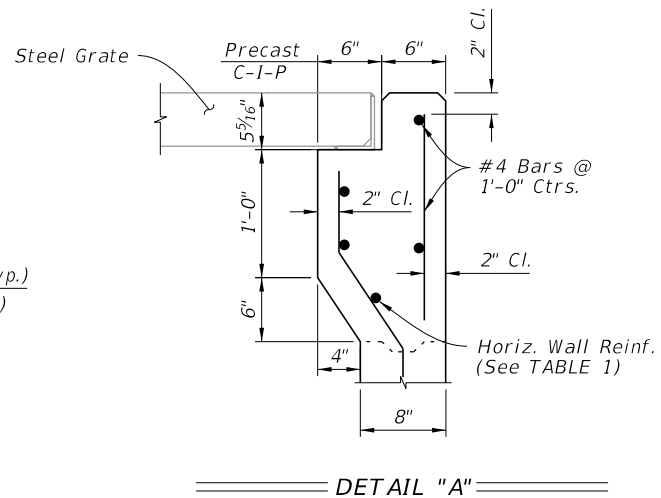

DIMENSIONAL AND REINFORCING DETAILS

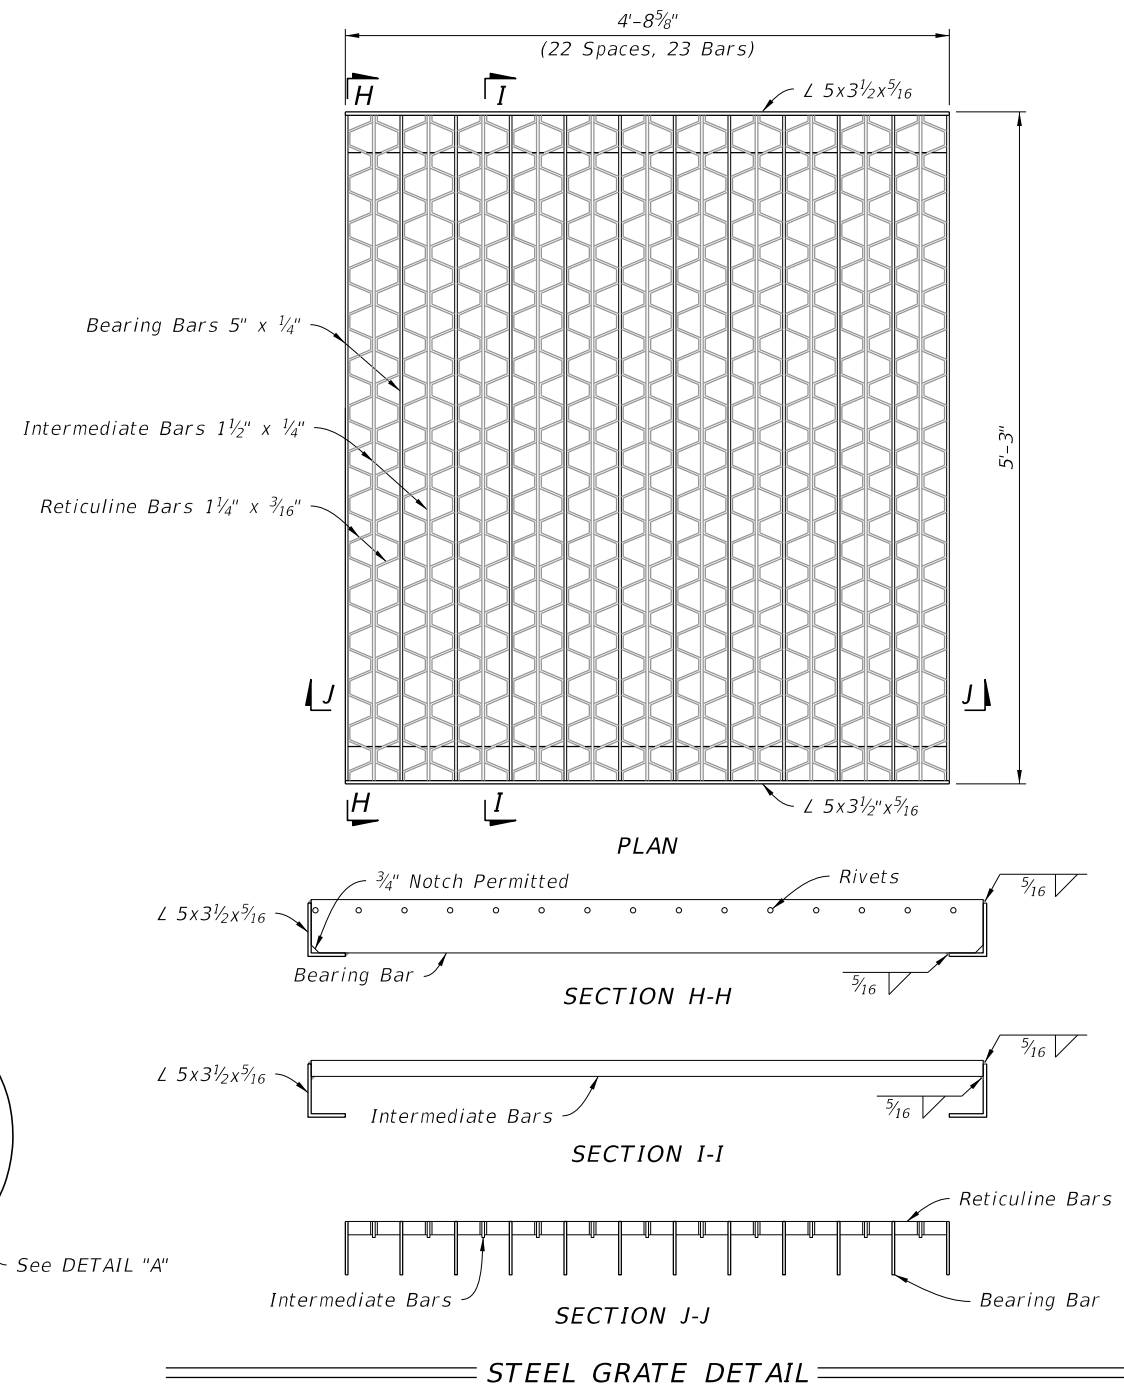


TABLE 2
HORIZONTAL WALL REINFORCING SCHEDULE

WALL DEPTH	SCHEDULE	AREA (in. ² /ft.)	MAX. SPACING	
			BARS	WWR
0' - 3'	A12	0.20	12"	8"
3' - 7'	A6	0.20	6"	5"
7' - 10'	B5.5	0.24	5 1/2"	5"
10' - 15'	C6.5	0.37	6 1/2"	6"

TYPE G - DIMENSIONAL, REINFORCING, AND GRATE DETAILS

9/28/2026 11:53:10 AM

LAST REVISION 11/01/20	DESCRIPTION:	FDOT FY 2027-28 STANDARD PLANS	DITCH BOTTOM INLET TYPES F AND G	INDEX 425-053	SHEET 3 of 4
---------------------------	--------------	--------------------------------------	----------------------------------	------------------	-----------------

