ORIGINATION FORM -


Proposed Revisions to a Standard Plans Index

(Please provide all information — Incomplete forms will be returned)				
Contact Information:			Standard Plans:	
Date: February 10, 2020			Index Number: 630-010	
Originator: Cheryl Hudson			Sheet Number (s): 1	
Phone: 414-5332			Index Title: Conduit Details - Embedded	
Email: cheryl.hudson@dot.state.fl.us				
Summary of the changes:				
Sheet 1: Added Note 5				
Commentary / Background:				
See plans for number of conduits - per SDG				
Other Affected Offices / Documents: (Provide name of person contacted)				
Yes	No			
		Other Standard Plans –		
		FDOT Design Manual –		
		Basis of Estimates Manual –		
		Standard Specifications –		
		Approved Product List –		
		Construction –		
		Maintenance –		
		n Package Includes: nd deliver package to Rick Jenkins)		Implementation: ☐ Design Bulletin (Interim)
Yes	N/A	ind deliver package to filek Jehkins)		DCE Memo
	✓✓	Redline Mark-ups		Program Mgmt. Bulletin
		Proposed Standard Plan Instruction (SPI)		FY-Standard Plans (Next Release)
		Revised SPI		
	\checkmark	Other Support Documents		


Contact the Roadway Design Office for assistance in completing this form

- 1. Furnish and install approved Conduits, Fittings and Embedded Junction Boxes (EBJ's) in accordance with Specification Sections 630 and 635, this Standard, the National Electric Code (NEC) and as directed by the Engineer.
- 2. Furnish and install Embedded Junction Boxes (EJB) with weatherproof covers sized in accordance with NEC requirements and the maximum size limits shown. Install EJB adjacent to the Begin and End of Bridges, Begin and End of Retaining Walls, (except omit EJB adjacent to the Bridge unless a precast Traffic Railing with junction slab is used), and at other locations as necessary to maintain 300 foot maximum spacing. See Plans for additional locations and details.
- 3. For Conduit not designated for future use, see Plans for details. For Conduit designated for future use, stub out and cap the Conduit. Drive a 3'-0" \pm long $\frac{3}{4}$ " (min.) diameter Steel Pipe flush with the ground line adjacent to the end of the Conduit as shown on Sheets 2, 3 or 4. Provide the location of the stub out with Steel Pipe to the Engineer for inclusion on the As-Built Plans.
- 4. Shift vertical Railing reinforcement symmetrically to provide 2" clearance to EJB. Space shifted vertical reinforcement at minimum 3" centers. Cut horizontal Railing reinforcement to provide 2" clearance to EJB and provide supplemental reinforcement as shown. To facilitate placement of Conduit, Expansion Fittings, and Expansion/Deflection Fittings, shift reinforcing a maximum of 1" but do not cut railing reinforcing to facilitate Conduit or Fittings. Do not bundle Conduits, or Conduit and horizontal reinforcement.
- 5. Place conduits as indicated in this Standard unless the Structures Plans show fewer.


* Reduce to 6" maximum when installed in Pedestrian/ Bicycle Railings.



EJB "A" Double or Triple Conduit (Maximum Dimensions)



EJB "B" Single Conduit (Maximum Dimensions)

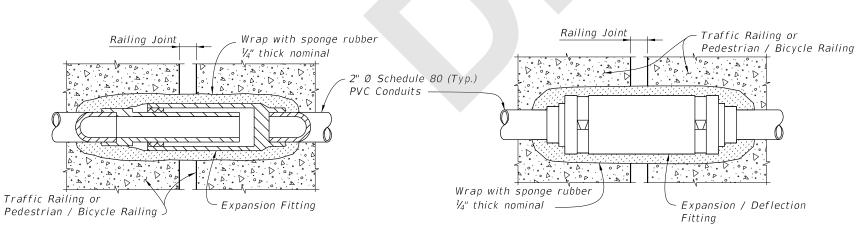

DETAIL "A" EXPANSION FITTING DETAIL

DETAIL "B" EXPANSION / DEFLECTION FITTING DETAIL (CONCRETE / CONCRETE) DETAIL "C" EXPANSION / DEFLECTION FITTING DETAIL (CONCRETE / SOIL)

GENERAL



FY 2020-21 STANDARD PLANS

<u>3</u>

Expansion / Deflection

INDEX

Wrap with sponge rubber

2" Ø PVC Conduits

1/3" thick nominal

SHEET


CONDUIT DETAILS - EMBEDDED

630-010 1 of 4


≥ DESCRIPTION:

- 1. Furnish and install approved Conduits, Fittings and Embedded Junction Boxes (EBJ's) in accordance with Specification Sections 630 and 635, this Standard, the National Electric Code (NEC) and as directed by the Engineer.
- 2. Furnish and install Embedded Junction Boxes (EJB) with weatherproof covers sized in accordance with NEC requirements and the maximum size limits shown. Install EJB adjacent to the Begin and End of Bridges, Begin and End of Retaining Walls, (except omit EJB adjacent to the Bridge unless a precast Traffic Railing with junction slab is used), and at other locations as necessary to maintain 300 foot maximum spacing. See Plans for additional locations and details.
- 3. For Conduit not designated for future use, see Plans for details. For Conduit designated for future use, stub out and cap the Conduit. Drive a 3'-0" \pm long $\frac{3}{4}$ " (min.) diameter Steel Pipe flush with the ground line adjacent to the end of the Conduit as shown on Sheets 2, 3 or 4. Provide the location of the stub out with Steel Pipe to the Engineer for inclusion on the As-Built Plans.
- 4. Shift vertical Railing reinforcement symmetrically to provide 2" clearance to EJB. Space shifted vertical reinforcement at minimum 3" centers. Cut horizontal Railing reinforcement to provide 2" clearance to EJB and provide supplemental reinforcement as shown. To facilitate placement of Conduit, Expansion Fittings, and Expansion/Deflection Fittings, shift reinforcing a maximum of 1" but do not cut railing reinforcing to facilitate Conduit or Fittings. Do not bundle Conduits, or Conduit and horizontal reinforcement.
- 5. Place conduits as indicated in this Standard unless Structures Plans indicate fewer.


* Reduce to 6" maximum when installed in Pedestrian/ Bicycle Railings.



EJB "A" Double or Triple Conduit (Maximum Dimensions)



EJB "B" Single Conduit (Maximum Dimensions)

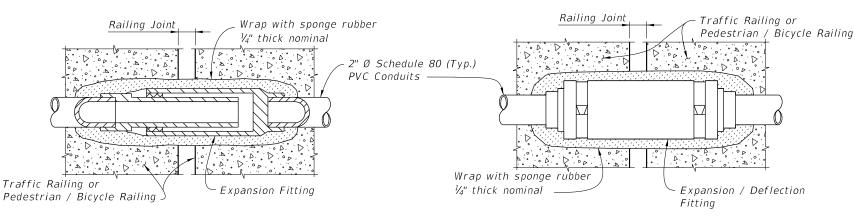

DETAIL "A" **EXPANSION FITTING DETAIL**

DETAIL "B" EXPANSION / DEFLECTION FITTING DETAIL (CONCRETE / CONCRETE) DETAIL "C" EXPANSION / DEFLECTION FITTING DETAIL (CONCRETE / SOIL)

GENERAL

REVISION 11/01/20

DESCRIPTION:

FDOT

FY 2021-22 STANDARD PLANS

CONDUIT DETAILS - EMBEDDED

<u>3</u>

Expansion / Deflection

INDEX

.Wrap with sponge rubber 1/3" thick nominal

' Ø PVC Conduits

SHEET