ORIGINATION FORM -

Proposed Revisions to a Standard Plans Index

(Please provide all information — Incomplete forms will be returned)

Contact Information:

Standard Plans: Index Number: 639-001 Date: June 29, 2023 Sheet Number (s): 1 Originator: Richard Stepp

Index Title: SERVICE POINT DETAILS Phone: (850) 414-4313

Email: richard.stepp@dot.state.fl.us

Summary of the changes:

Sheet 1:

Added pole dimensions for the new Type P-IID concrete pole option in Detail B.

Removed height dimensions for the meter and service disconnect in Details A and B;

Added reference to Note 6 in the meter and service disconnect callouts in Details A and B;

Added Note 5 to reference Index 641-010 for prestressed concrete pole details and explain optional pole usage;

Added Note 6 to provide height information for the meter and service disconnect


Commentary / Background:

Per District request, the 16-foot concrete pole (Type P-IID) was recently added to Index 641-010 in the FY2023-24 Standard Plans. As a result, this new 16-foot pole option will now be accommodated in Index 639-001. Leeway is provided for the raised height of the meter and service disconnect to allow for project-specific District and power company needs.

Other Affected Offices / Do	ocuments: (Provide na	ame of persor	ı contacted)
-----------------------------	-----------------------	---------------	--------------

Yes	No V	Other Standard Plans — FDOT Design Manual — Basis of Estimates Manual —	
	\checkmark	Standard Specifications –	
	\checkmark	Approved Product List –	
	\checkmark	Construction –	
	\checkmark	Maintenance –	
<u>Origin</u>	atio	n Package Includes: (Submit package to Rick Jenkins)	Implementation:
Yes	N/A	A	Design Bulletin (Interim)
\checkmark		Redline Mark-ups	☐ DCE Memo
		Revised or Proposed Standard Plan Instruction (SPI)	Program Mgmt. Bulletin
		Other Support Documents	FY-Standard Plans (Next Release)


 Contact the Roadway Design Office for assistance in completing this form -Email to: Rick Jenkins rick.jenkins@dot.state.fl.us and Darren Martin darren.martin@dot.state.fl.us

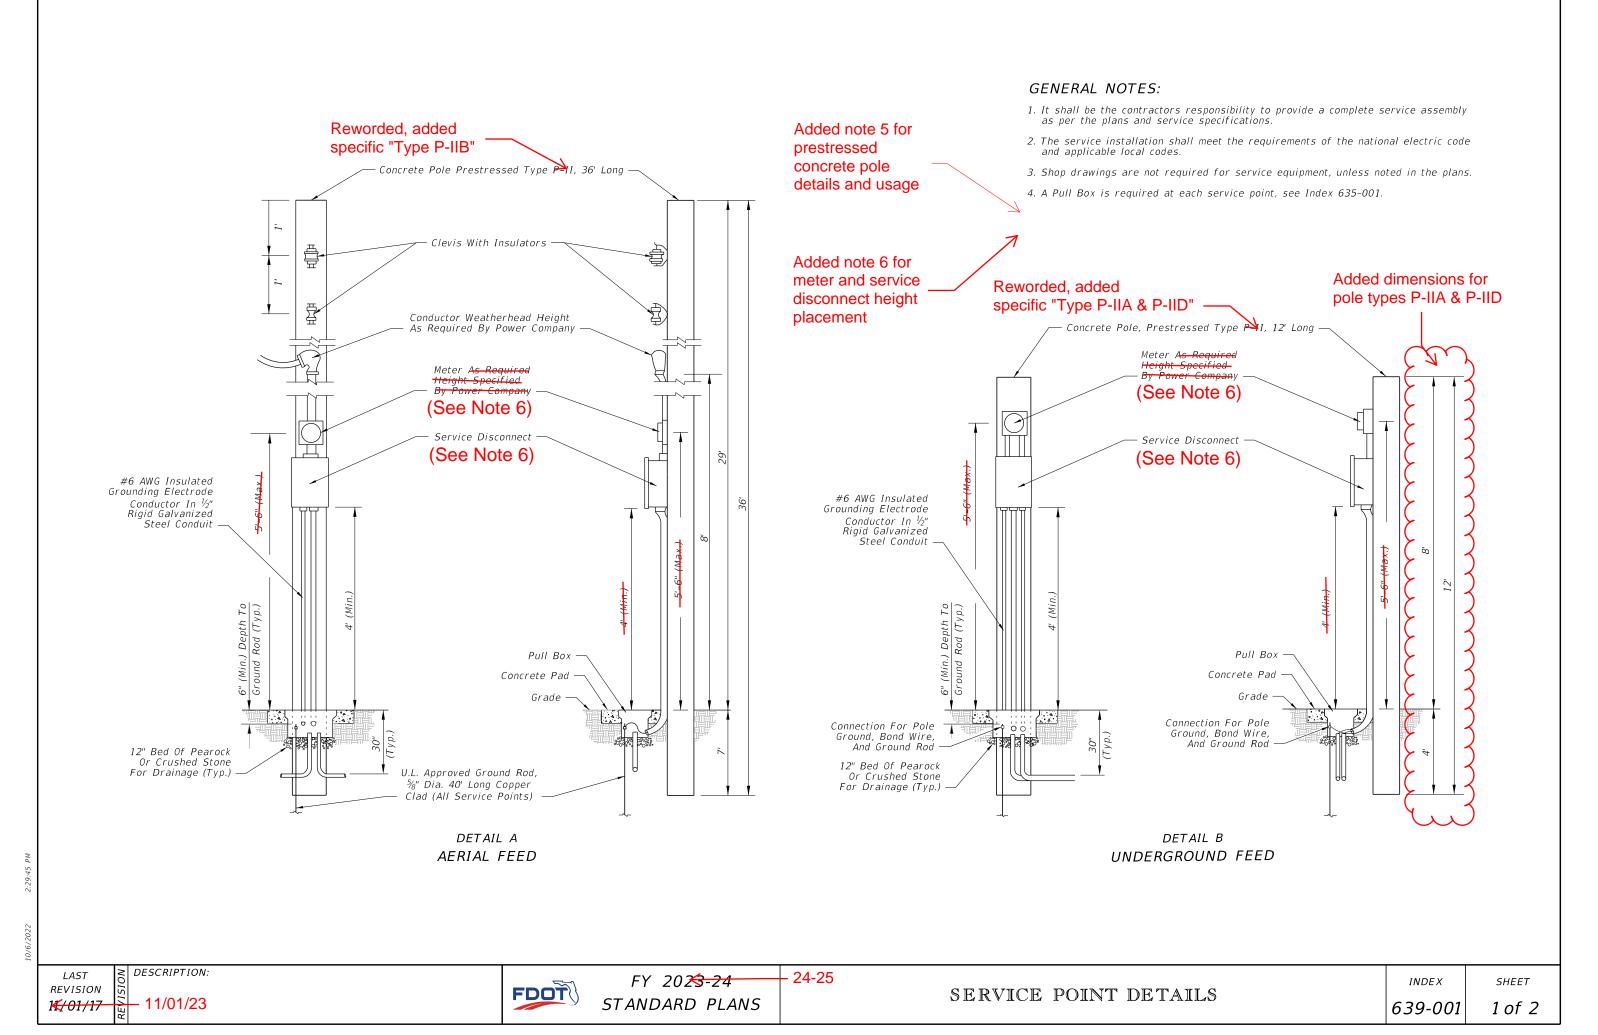

Prestressed Concrete Pole Type P-IIB — Clevis With Insulators Conductor Weatherhead Height As Required By Power Company Meter (See Note 6) Service Disconnect (See Note 6)-#6 AWG Insulated Grounding Electrode Conductor In ½" Rigid Galvanized Steel Conduit Pull Box -Concrete Pad -Grade , o o 12" Bed Of Pearock Or Crushed Stone For Drainage (Typ.) U.L. Approved Ground Rod, 5/8" Dia. 40' Long Copper Clad (All Service Points) DETAIL A AERIAL FEED

GENERAL NOTES:

- 1. It shall be the contractors responsibility to provide a complete service assembly as per the plans and service specifications.
- 2. The service installation shall meet the requirements of the national electric code and applicable local codes.
- 3. Shop drawings are not required for service equipment, unless noted in the plans.
- 4. A pull box is required at each service point; see Index 635-001.
- 5. For prestressed concrete pole details, see Index 641-010. Use the service pole type called for in the Plans.
- 6. Place the meter and service disconnect at the height shown in the Plans or as required by the power company. The service disconnect may be placed above the meter.

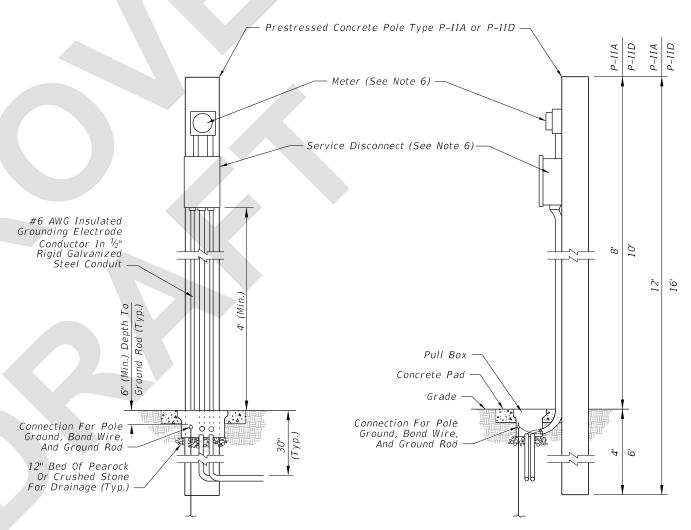

DETAIL B UNDERGROUND FEED

REVISION 11/01/23

≥ DESCRIPTION:

FDOT

FY 2024-25 STANDARD PLANS INDEX

SHEET