


DETAIL A

DETAIL B

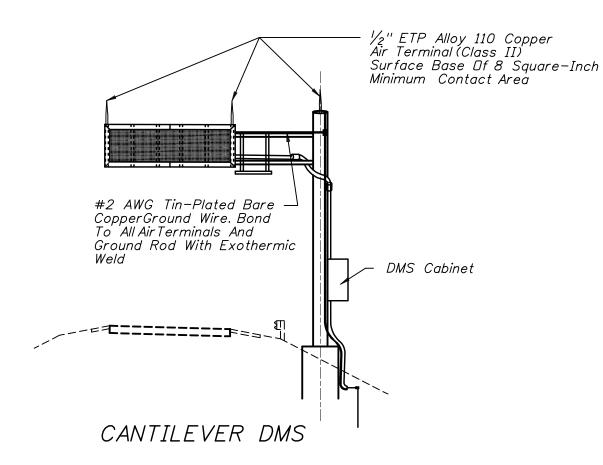

## GENERAL NOTES:

- 1. All grounding materials shall meet the requirements of Section A620 of the current Minimum Specifications For Traffic Control Signal Devices (MSTCSD), except as noted.
- 2. All ground rod resistance readings shall be performed as per Standard Specification 620-3.2 and 620-3.4. Submit data sheets to the engineer.
- 3. Exothermically weld all connections to ground rods.
- 4. Bond #4 AWG solid bare copper wire to the rigid galvanized steel risers.
- 5. The contractor may, upon approval of the engineer, install a 30-foot sectional ground rod for instances when conditions will not allow for the installation of the 3-auxillary ground rods.
- 6. Install marker tape directly above all grounding electrodes and conductors.
- 7. All RS-232 coaxial and power cable to the DMS shall be completely concealed.
- 8. Copper flat surfaces shall be bolted, welded, or brazed securely to framework to maintain electrical continuity.
- 9. All air terminals must meet UL-96A.
- 10. Grounding system shall be placed within right of way.
- 11. See Index 18102 for ground rod placement detail.

Not To Scale

REVISIONS						THE OF FLORID	2006 Interim Design Standard
Date E	Ву	Description	Date	Ву	Description		
01/01/06 17	TS	New Design Standard Index.				PAR ILLE	DMS GROUNDING DETAILS

01/01/06 2 of 2