
Classes II,III,IV,V; Wall A,B,C							
Nominal	Design	Maximum					
Pipe	Bell	Reinforcement					
Diameter	Reinforcement	Under Tolerance					
Diameter	in² per foot	in² per foot					
15"	0.07	0.010					
18"	0.07	0.010					
24"	0.09	0.010					
30"	0.12	0.010					
36"	0.14	0.010					
42"	0.16	0.010					
48"	0.19	0.011					
54"	0.21	0.012					
60"	0.23	0.0135					
66"	0.26	0.015					
7 <i>2</i> "	0.28	0.0165					
78"	0.30	0.018					
84"	0.33	0.0195					
90"	0.35	0.021					
96"	0.37	0.0225					
102"	0.40	0.024					
108"	0.42	0.0255					

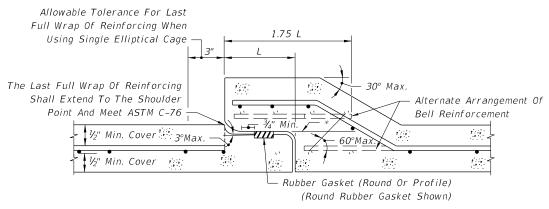

* All circumferential steel located above this line within 1.75 L is defined as bell reinforcement.

Varies


BELL AND SPIGOT


Class NS Concrete

FY 2016-17

ROUND RUBBER GASKET SHOWN DETAIL OF BELL & SPIGOT CONCRETE PIPE JOINT USING ROUND OR PROFILE RUBBER GASKET

Class NS Concrete 12" For Pipes 14"x23" Through 19"x30" Any Wire Mesh Arrangement Which 24" For Pipes 24"x38" And Larger Provides 0.126 Square Inches Of Steel Area Per Linear Foot Both Ways May Be Used; Provided The Wires Are Spaced A Minimum Of 2" And/Or A Maximum Of 6" On Centers CONCRETE JACKET






Filter Fabric Jacket Required PREFORMED PLASTIC JOINT (BEFORE PULL-UP)

Filter Fabric Jacket Required PROFILE RUBBER GASKET (BEFORE PULL-UP)

Cost of concrete jacket or filter fabric jacket to be included in cost of elliptical concrete pipe culverts.

ELLIPTICAL CONCRETE PIPE JOINTS

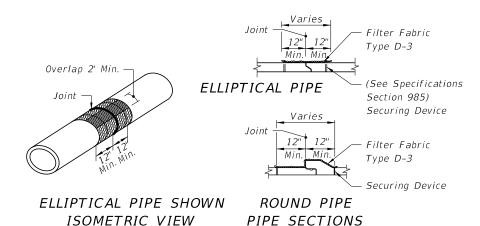

Cost of filter fabric jacket to be included in cost of pipe culverts.

FOR ALL PIPE TYPES - CONCRETE PIPE SHOWN FILTER FABRIC JACKET

DISSIMILAR TYPES CONCRETE JACKET FOR CONNECTING DISSIMILAR TYPES OF PIPE AND CONCRETE PIPES WITH DISSIMILAR JOINTS

b) flexible pipe when the minimum cover required in accordance with

Note: Cost of concrete and bituminous coating to be included in

contract unit price for either new pipe or Mitered End Section.

Alternate connection must be approved by the State Drainage Engineer.

12" For Pipes 15" Thru 24"

TONGUE & GROOVE

24" For Pipes 30" And Larger

- Class NS Concrete

Note: For reinforcement see elliptical pipe concrete jacket. (All Pipe Sizes)

DISSIMILAR JOINTS

Collar Of Class NS Concrete (May Be Formed Existina By Any Method Approved By The Engineer) Proposed Existing Endwall Less Than 1' Below Grade 2-1/3" Ø Hoops $6 - \frac{1}{2}$ " Ø x 16" Dowels Set In Adhesive Existing Endwall Bonded Material System Spigot End To Be Placed In Cut Toe Of Existing Endwall Existing Endwall Regardless To Contour Of Pipe Of Direction Of Flow

SECTION AA

Class NS Concrete

Bituminous Coating Required For

Bituminous Material May Be Field

Extend 12" Beyond Concrete Collar


Applied) Bituminous Coating To

All Metal Pipes (Any Suitable

LONGITUDINAL SECTION


Note: Cost for removal and disposal of portions of top and toe of existing endwall and cost of concrete, reinforcing steel and construction of collar to be included in the contract unit price for pipe culvert.

CONCRETE COLLAR FOR EXTENSION OF EXISTING PIPE CULVERTS

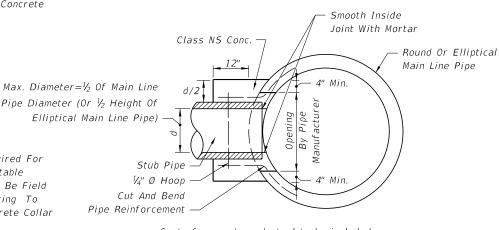

Cost of concrete and steel to be included in contract unit price for pipe culvert.

CONCRETE COLLAR FOR JOINING MAINLINE PIPE AND STUB PIPE



Note: Unless otherwise called for in the plans, the cost of plugging pipes to be included in contract unit price for new pipe.

PIPE PLUG

REVISION 07/01/14

DESCRIPTION:


DESIGN STANDARDS

A concrete jacket shall not be used to join: a) metal pipe of dissimilar materials

Index No. 205 cannot be obtained

Note: PVC pipe, Schedule 40, to be paid for under the contract unit price for Polyvinyl Chloride Pipe Culvert (4"), LF.


CONCRETE GUTTER AND DRAINS AT RETAINING WALLS

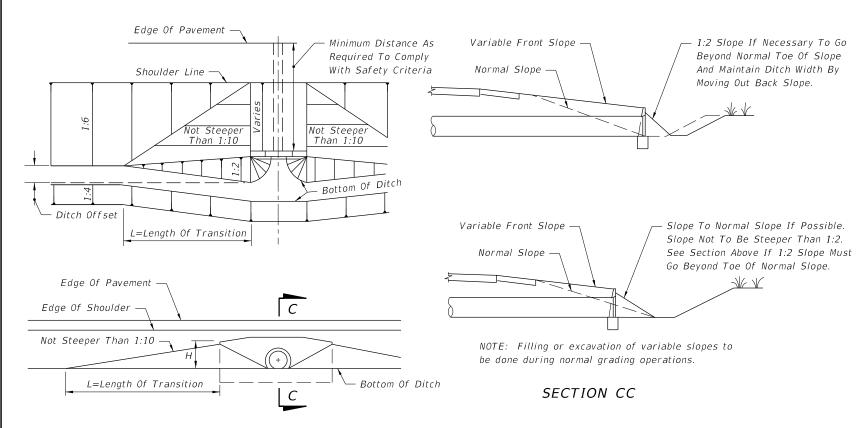


Use Larger Value Of Either:


- 1. L=10xH (No Maximum)
- 2. L=10xDitch Offset (Maximum L=100')

METHOD FOR SETTING LIMITS OF VARIABLE FRONT SLOPES AT DRAINAGE STRUCTURES






CLIP DETAIL

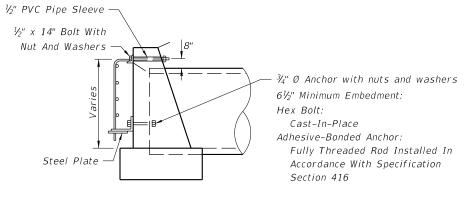

SIDE VIEW

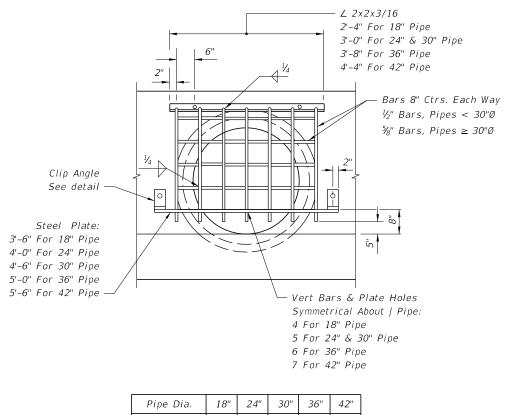

Pipe Dia.	18"	24"	30"	36"	42"
Grate (Lbs.)	48	58	74	90	111

FRONT VIEW

Note: Guards to be constructed only at locations specifically called for in plans. Guard, plate & clips, bolts, nuts and sleeves to be included in the contract unit price for Reinforcing Steel (Miscellaneous).

GUARD AT PIPE ENDS

REVISION 07/01/07

DESCRIPTION:



FY 2016-17 DESIGN STANDARDS


MISCELLANEOUS DRAINAGE DETAILS

INDEX NO. 280


SHEET NO. 2 of 3

	CLEARANCE	STRENGTH	
RAILROAD COMPANY	BELOW BOTTOM OF RAIL (FEET) ⁽²⁾	ASTM (C76) CLASS	
Alabama & Gulf Coast Railway (Rail America)	5.5	IV	
AN Railway & Bay Line Railroad (Genesee & Wyoming)	5.5 / 4.5 (1)	V	
CSX Transportation	5.5	V	
First Coast Railroad (Genesee & Wyoming)	5.5 / 4.5 (1)	V	
Florida Midland, Central, and Northern Railroads (Pinsly Railroad)	5.5	V	
Florida East Coast (FEC) Railway Company	5.5	IV	
Florida West Coast Railroad Company	5.5	V	
Georgia & Florida Railway, Inc.	5.5	V	
Norfolk Southern (NS) Railway Corporation	5.5 / 4.5 (1)	V	
Port of Palm Beach District Railroad	5.5	IV	
Seminole Gulf Railway (LP)	6.0	V	
South Central Florida Express	6.0	V	
Talleyrand Terminal Railroad (Genesee & Wyoming)	5.5 / 4.5 (1)	V	
South Florida Regional Transportation Authority (Tri-County Commuter Rail)	5.5	V	

- (1) Distance standard for yard and industrial tracks.
- (2) Clearance is for casing pipe. All subgrade carrier pipelines and wirelines will be installed within a casing pipe which will extend from Right-of-Way line to Right-of-Way line.

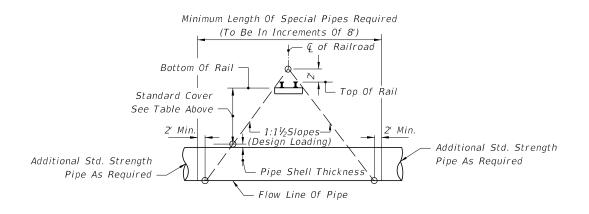

METHOD FOR DETERMINING THE LENGTH OF SPECIAL PIPE REQUIRED UNDER RAILROADS

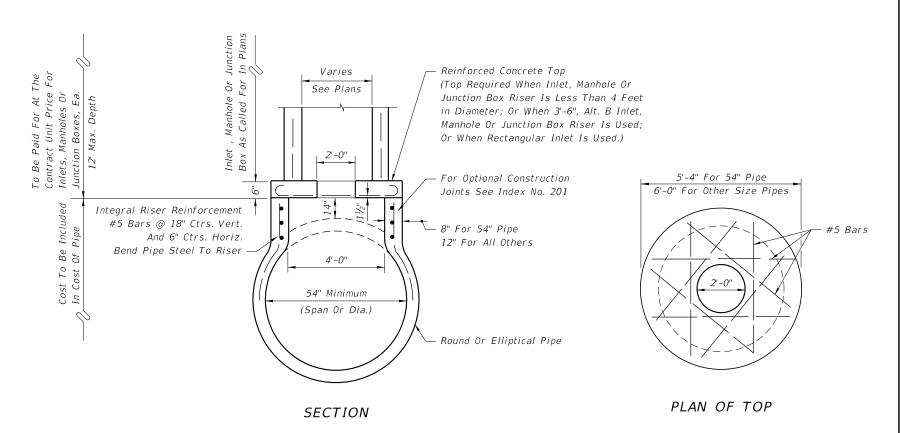

INLETS, MANHOLES OR JUNCTION BOXES ON INTEGRAL PRECAST CONCRETE RISER FOR CONCRETE PIPE

DESCRIPTION: