



WIRING DIAGRAM

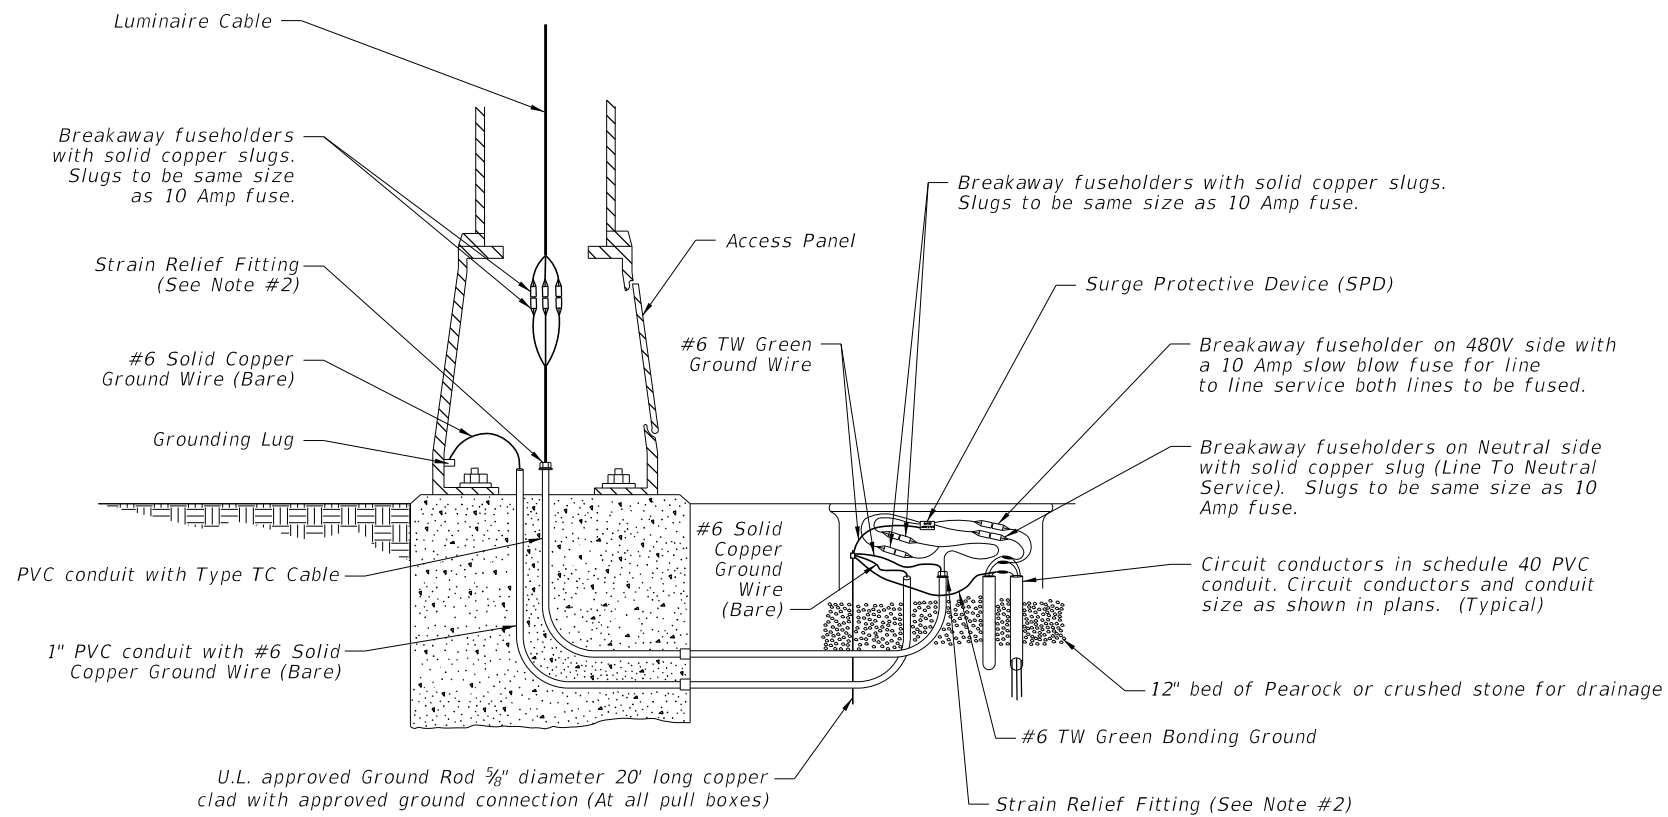

METAL POLE WIRING DETAIL

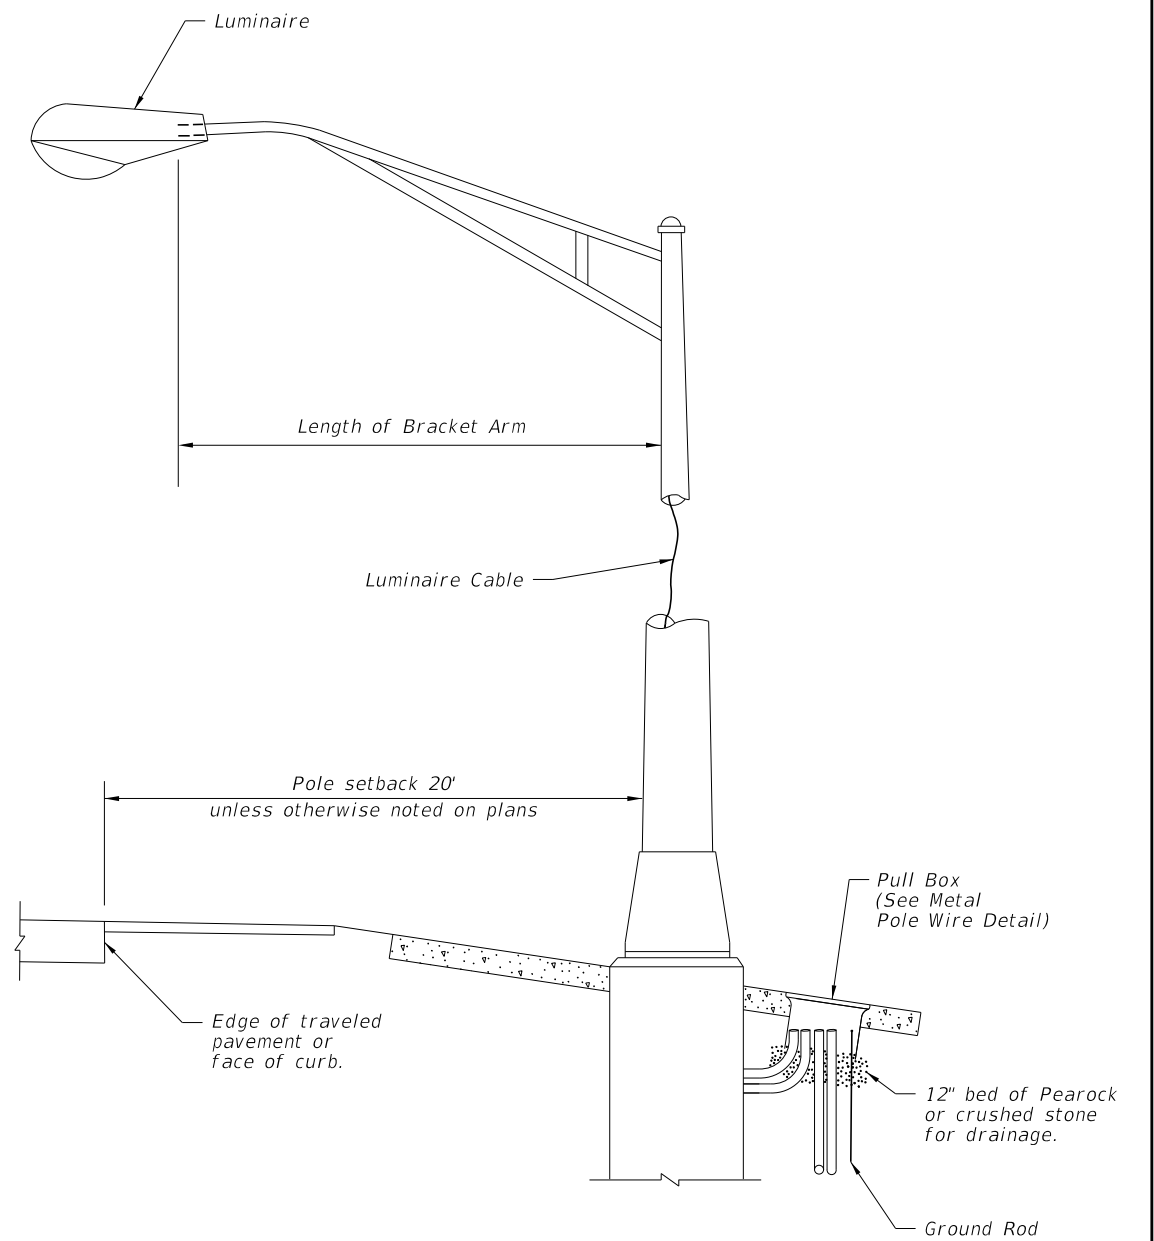


METAL POLE DETAIL

NOTES:

1. Barrier wall or bridge mounted poles: The wiring shall be in accordance with Section 992 of the Standard Specifications.
2. Provide cable length to remove fuseholders from transformer base, pole base or pullbox for maintenance. Remove slack from the luminaire cable to provide tension on the fuseholders if the pole breaks away. Pull excess cable into pull box tighten strain relief fittings or cable clamps at both ends of conduit to prevent cable from slipping.


11/30/2015 2:05:40 PM

| | | | | | | |
|---------------------------|----------|--------------|--|------------------------------|--------------------|---------------------|
| LAST REVISION 07/01/14 | REVISION | DESCRIPTION: |  FY 2016-17 DESIGN STANDARDS | CONVENTIONAL LIGHTING | INDEX NO. 17500 | SHEET NO. 1 of 3 |
|---------------------------|----------|--------------|--|------------------------------|--------------------|---------------------|


WIRING DETAILS

NOTES:

1. Use compacted select material in accordance with Index 505.
2. Concrete shall be Class NS with a minimum strength at 28 days of $f'c=2.5$ ksi.
3. Outside edge of slab shall be cast against formwork.
4. The pull box shown is 13" x 24"; others approved under Section 635 of the Standard Specifications may be used.
5. Slabs to be placed around all Poles and Pull Boxes in rural locations. In urban areas or where space is limited slab dimensions may be adjusted as shown in the plans.
6. Concrete for slabs around pull boxes shall be included in the price of pull box.

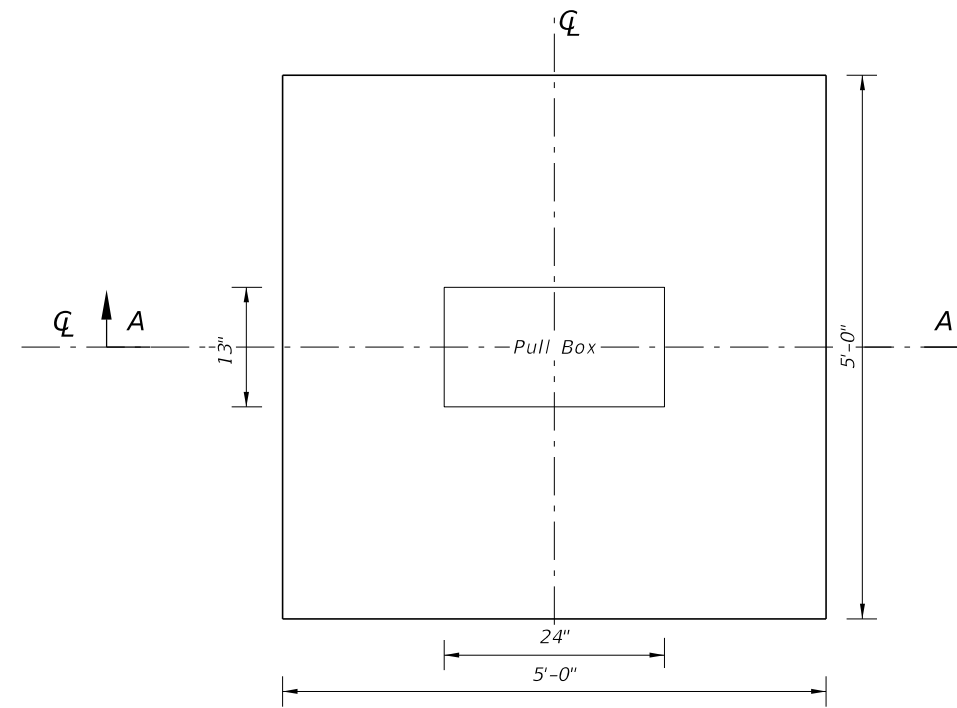


SLAB DIMENSIONS

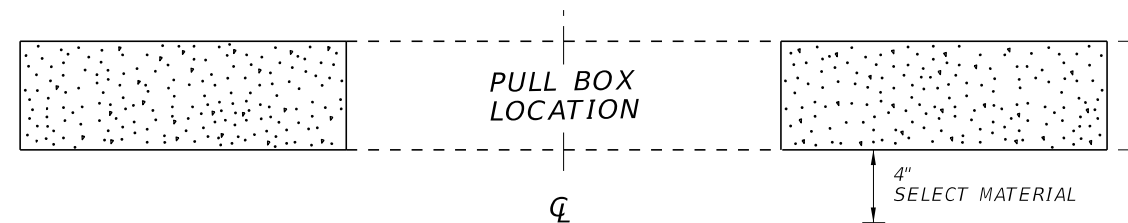

SECTION A-A


SLAB DETAILS FOR INTERMEDIATE PULLBOX LOCATIONS

11/30/2015 2:05:41 PM


| | | | | | | |
|---------------------------|----------|--------------|--|------------------------------|---------------------------|----------------------------|
| LAST REVISION 01/01/12 | REVISION | DESCRIPTION: |  FY 2016-17 DESIGN STANDARDS | CONVENTIONAL LIGHTING | INDEX NO. 17500 | SHEET NO. 2 of 3 |
|---------------------------|----------|--------------|--|------------------------------|---------------------------|----------------------------|

NOTES:

1. Use compacted select material in accordance with Index 505.
2. Concrete shall be Class NS with a minimum strength at 28 days of $f'c=2.5$ ksi.
3. Outside edge of slab shall be cast against formwork.
4. The pull box shown is 13" x 24"; others approved under Section 635 of the Standard Specifications may be used.
5. Slabs to be placed around all Poles and Pull Boxes. In urban areas or where space is limited slab dimensions may be adjusted as shown in the plans.
6. Concrete for slabs around poles and pull boxes shall be included in the price of pole or pull box.
7. The expansion joint shall consist of $\frac{1}{2}$ " of closed-cell polyethelene foam expansion material. The top $\frac{1}{2}$ " of expansion material shall be removed after pouring the slab and sealed with an APL approved Type A sealant meeting the requirements of Section 932.

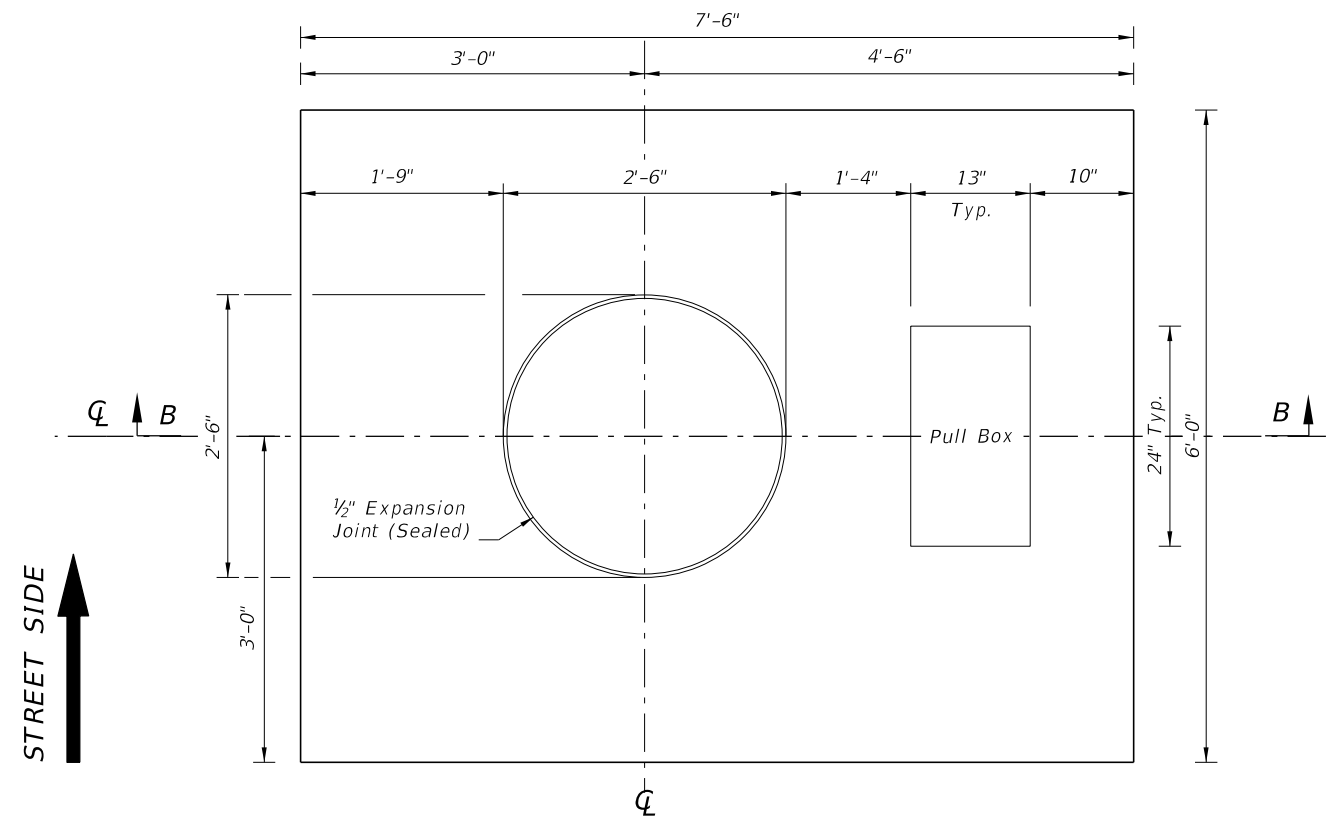


SLAB DIMENSIONS

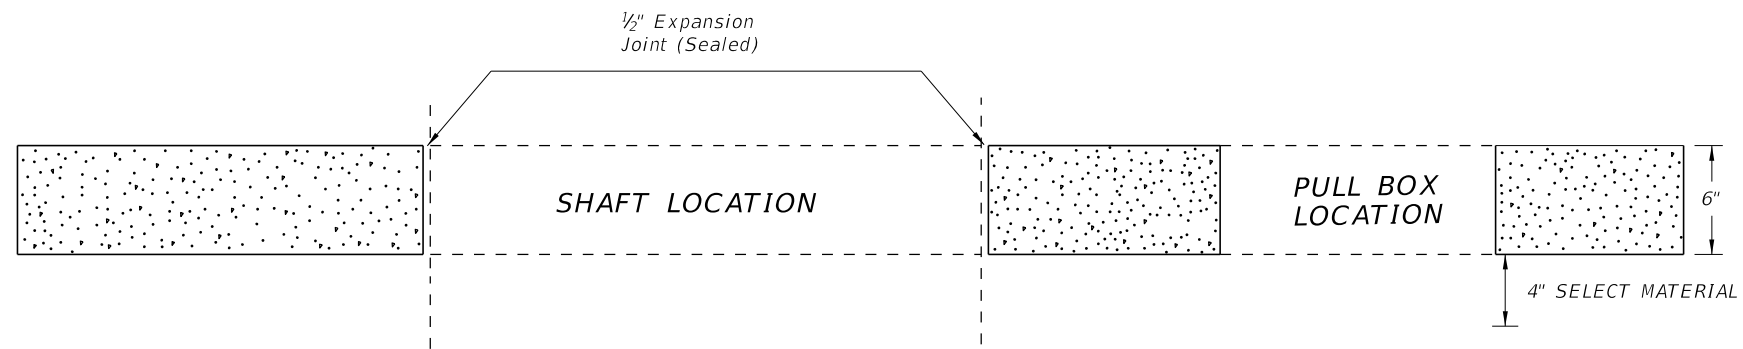

SECTION B-B

SLAB DETAILS
FOR POLE AND PULL BOX LOCATIONS

11/30/2015 2:05:42 PM

| | | | | | | |
|---------------------------|----------|--------------|--|-----------------------|--------------------|---------------------|
| LAST REVISION 07/01/14 | REVISION | DESCRIPTION: |  FY 2016-17 DESIGN STANDARDS | CONVENTIONAL LIGHTING | INDEX NO. 17500 | SHEET NO. 3 of 3 |
|---------------------------|----------|--------------|--|-----------------------|--------------------|---------------------|