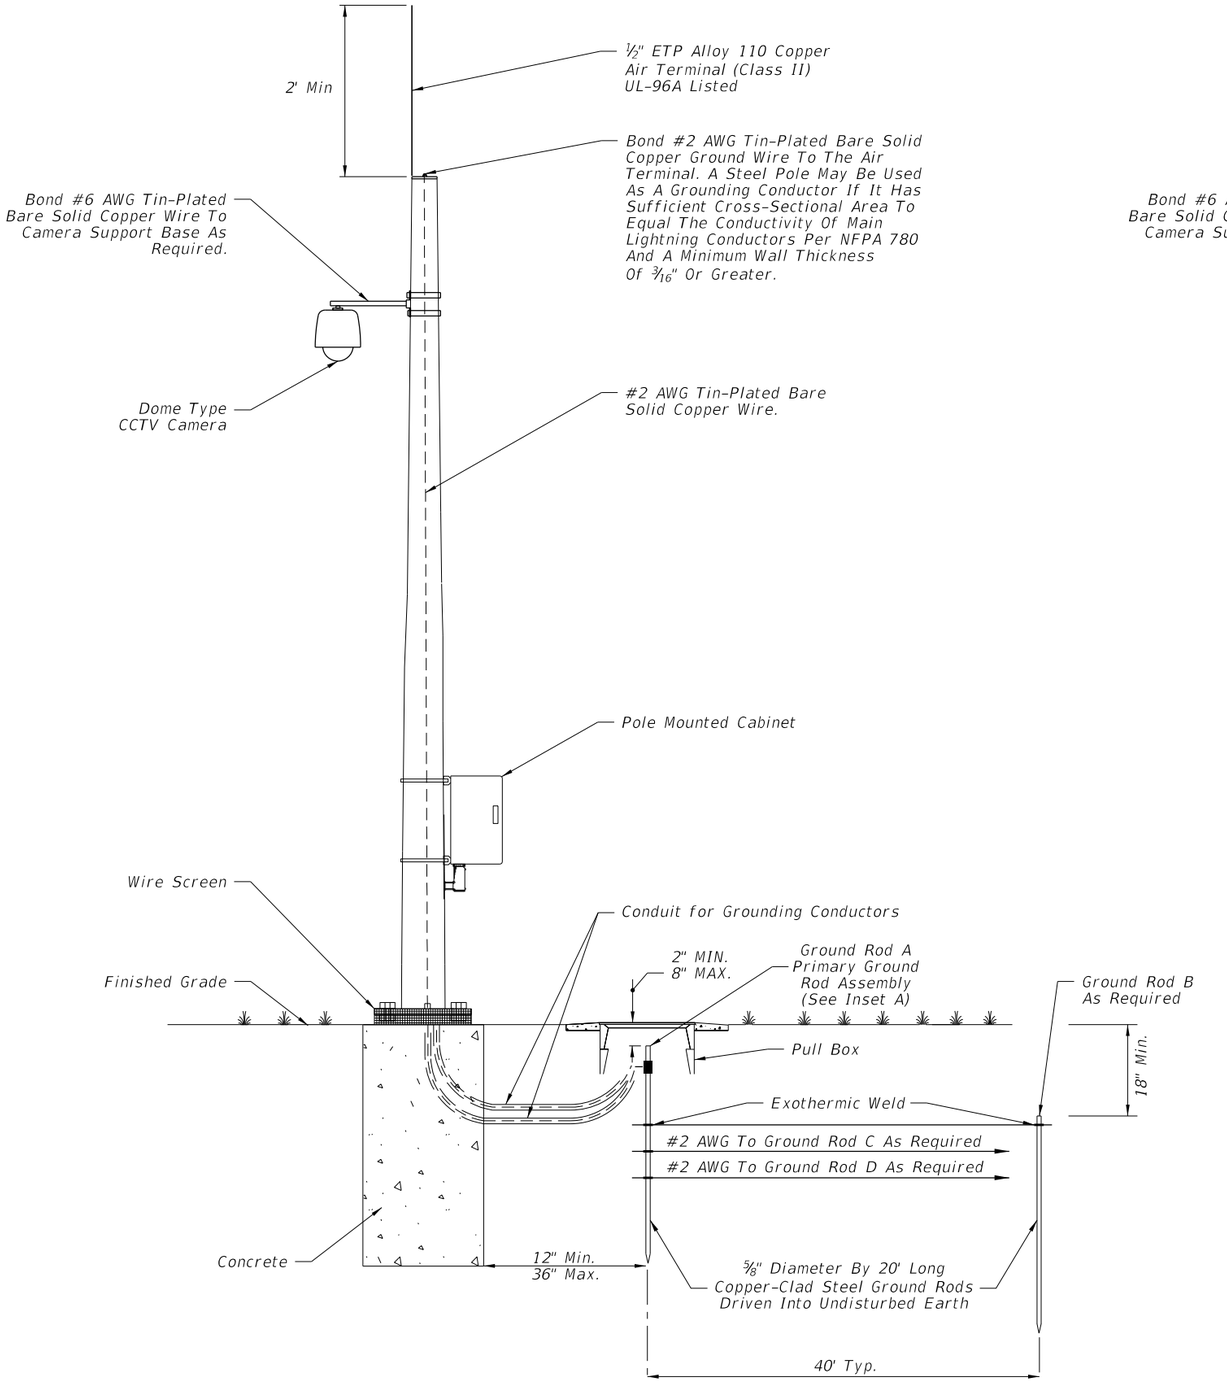


STEEL CCTV POLE

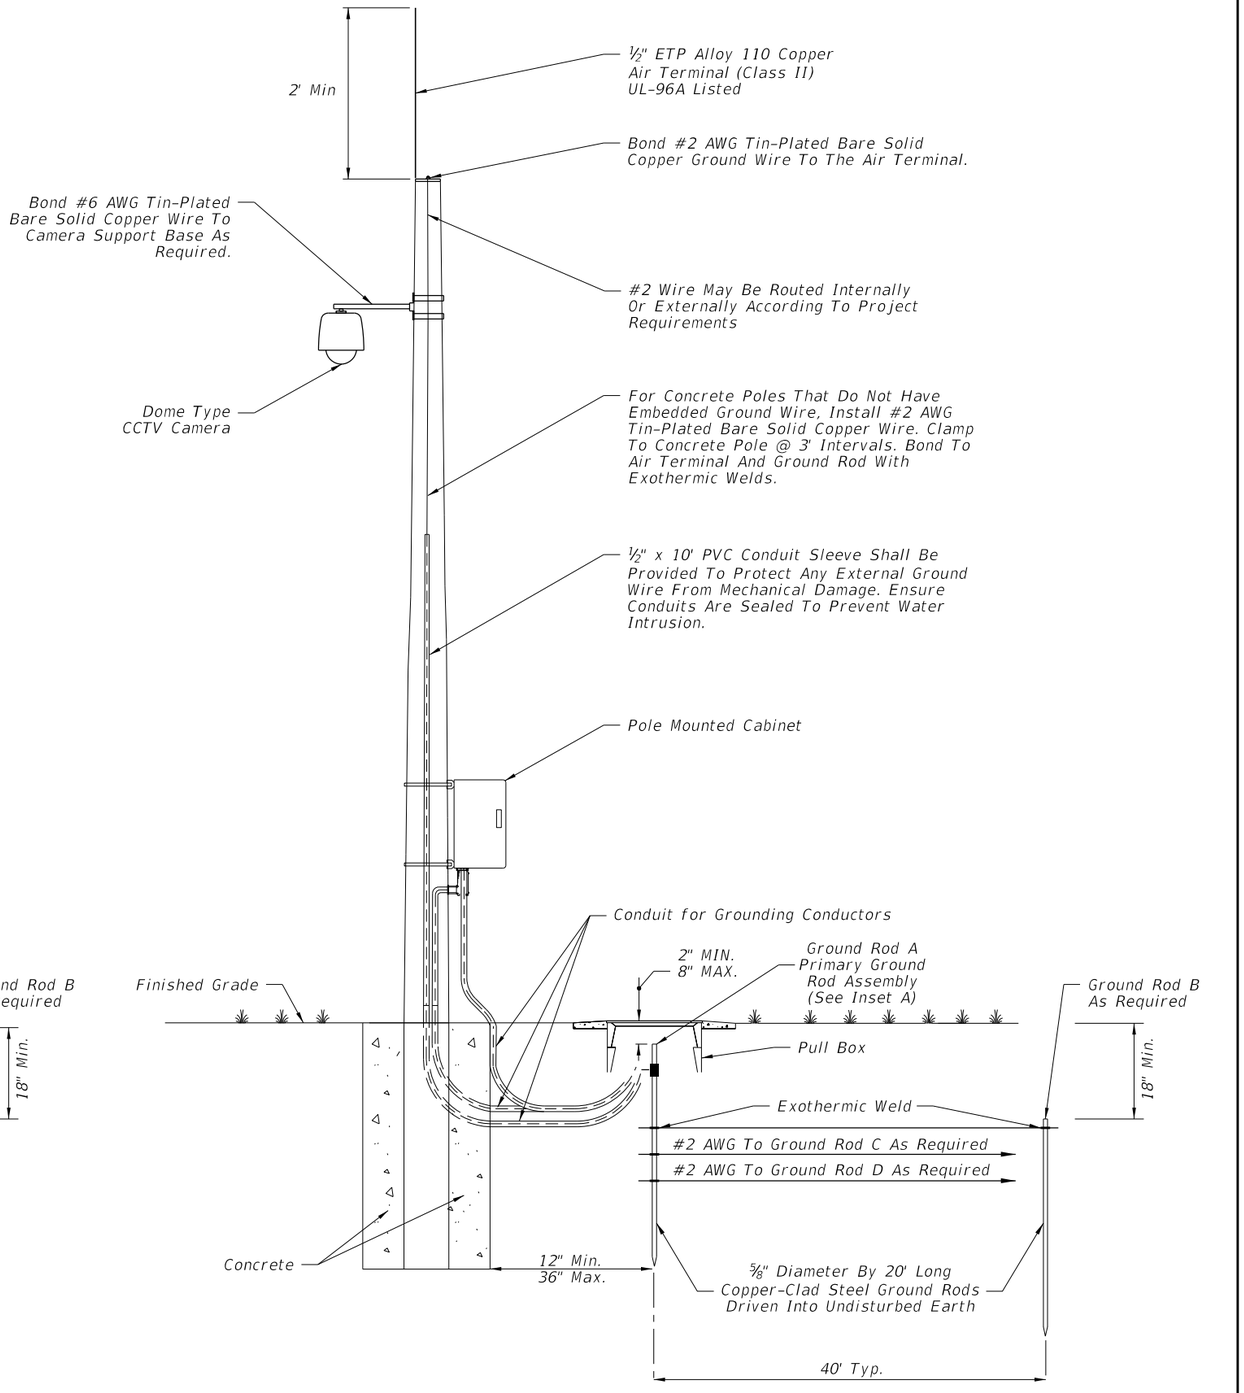


CONCRETE CCTV POLE

11/30/2015 11:30:56 AM

| LAST REVISION | REVISION | DESCRIPTION: | FDOT | FY 2016-17 DESIGN STANDARDS | GROUNDING AND LIGHTNING PROTECTION | INDEX NO. | SHEET NO. |
|---|---|---|---|---|---|---|---|
| 07/01/14 | | | | | | 18102 | 1 of 4 |

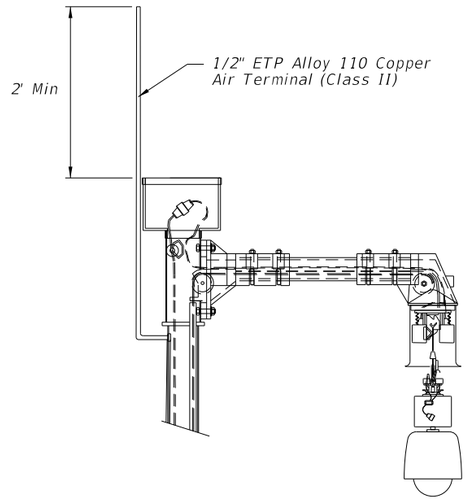


*AIR TERMINAL PLACEMENT*
*(Lowering Device Pole)*

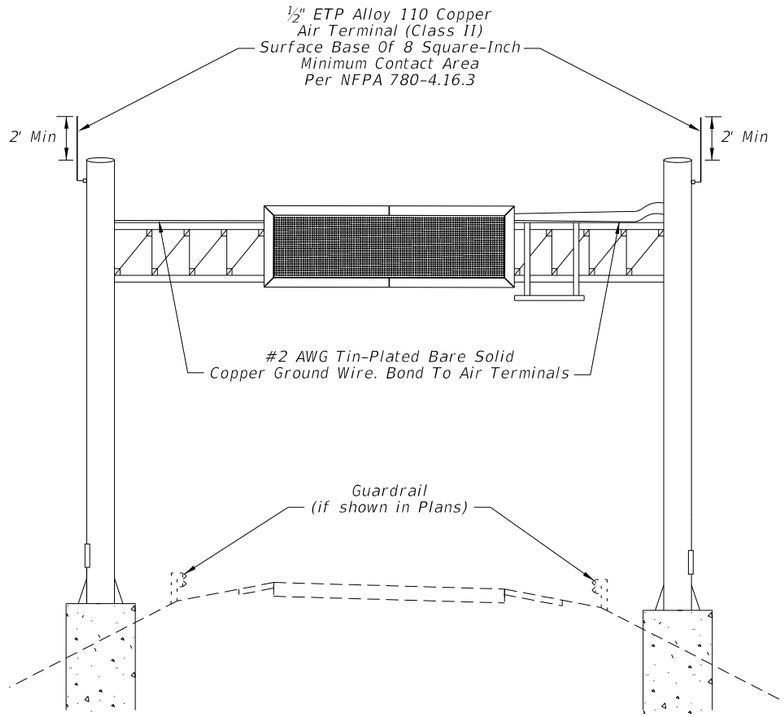


*AIR TERMINAL PLACEMENT*
*(Span DMS)*

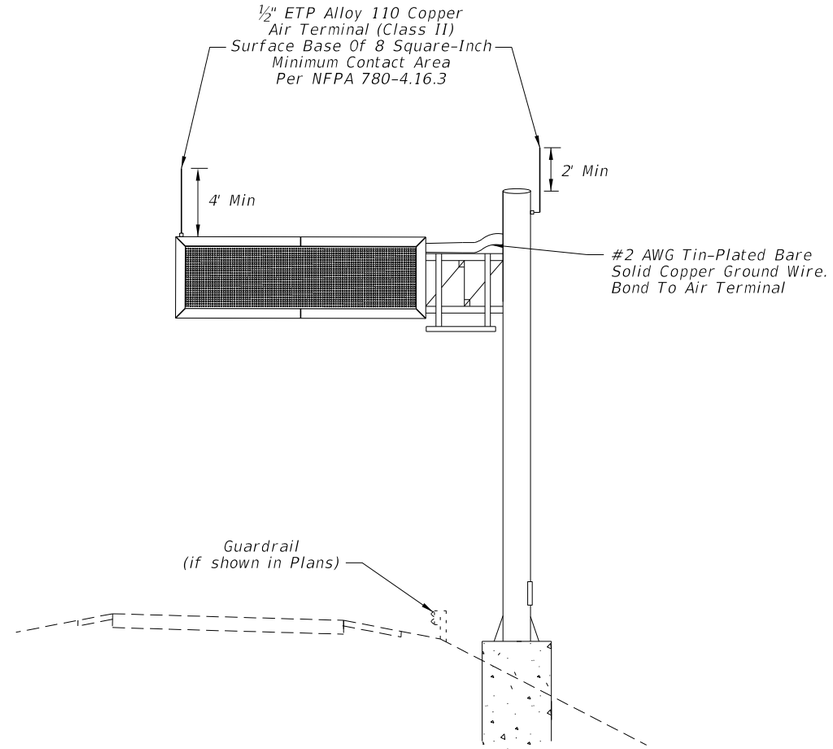


*AIR TERMINAL PLACEMENT*
*(Cantilever DMS)*

11/30/2015 11:30:57 AM

| LAST REVISION | REVISION | DESCRIPTION: | FDOT FY 2016-17 DESIGN STANDARDS | GROUNDING AND LIGHTNING PROTECTION | INDEX NO. | SHEET NO. |
|---|---|---|---|---|---|---|
| 07/01/15 | | | | | 18102 | 2 of 4 |

"Sphere Of Influence: 120 Degree"

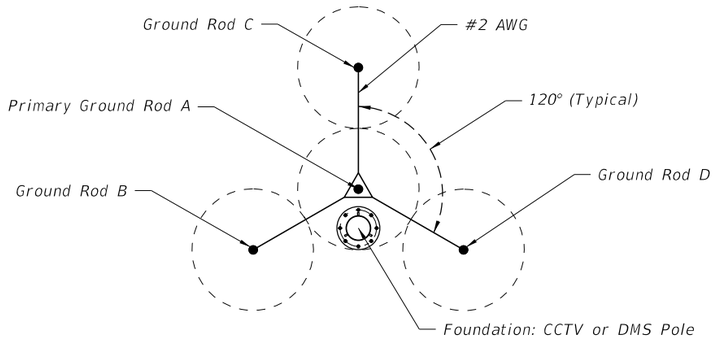


GROUND ROD ARRAY PLACEMENT
(Typical)
20' RODS, 40' SPACING

"Modified Sphere Of Influence: 90 Degree"

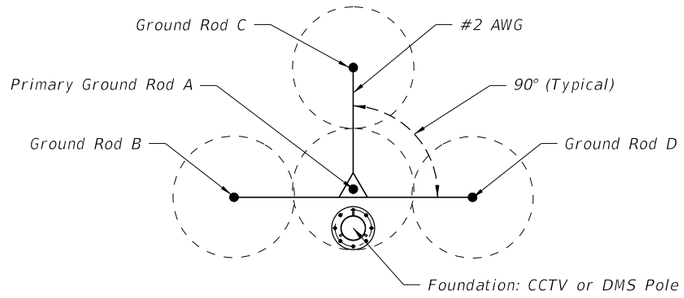


GROUND ROD ARRAY PLACEMENT
(Typical Modified)
20' RODS, 40' SPACING

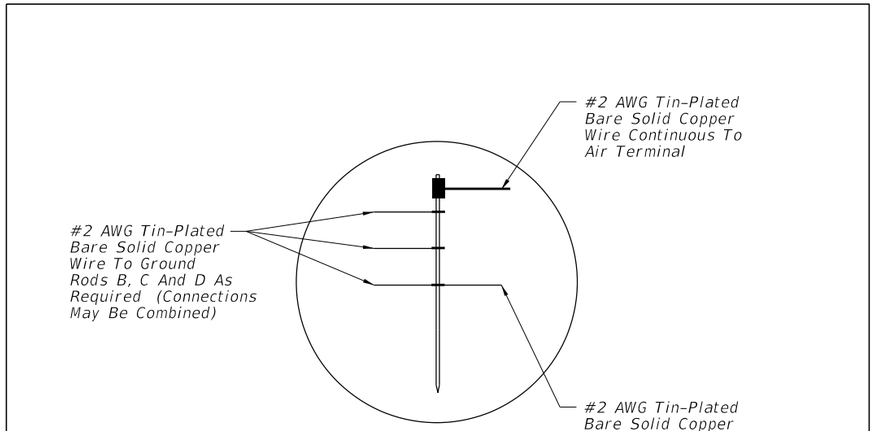


INSET "A"

11/30/2015 11:30:59 AM

| LAST REVISION | REVISION | DESCRIPTION: | | | | |
|---|---|---|---|---|---|---|
| 07/01/14 | | | FDOT FY 2016-17 DESIGN STANDARDS | GROUNDING AND LIGHTNING PROTECTION | INDEX NO. 18102 | SHEET NO. 3 of 4 |

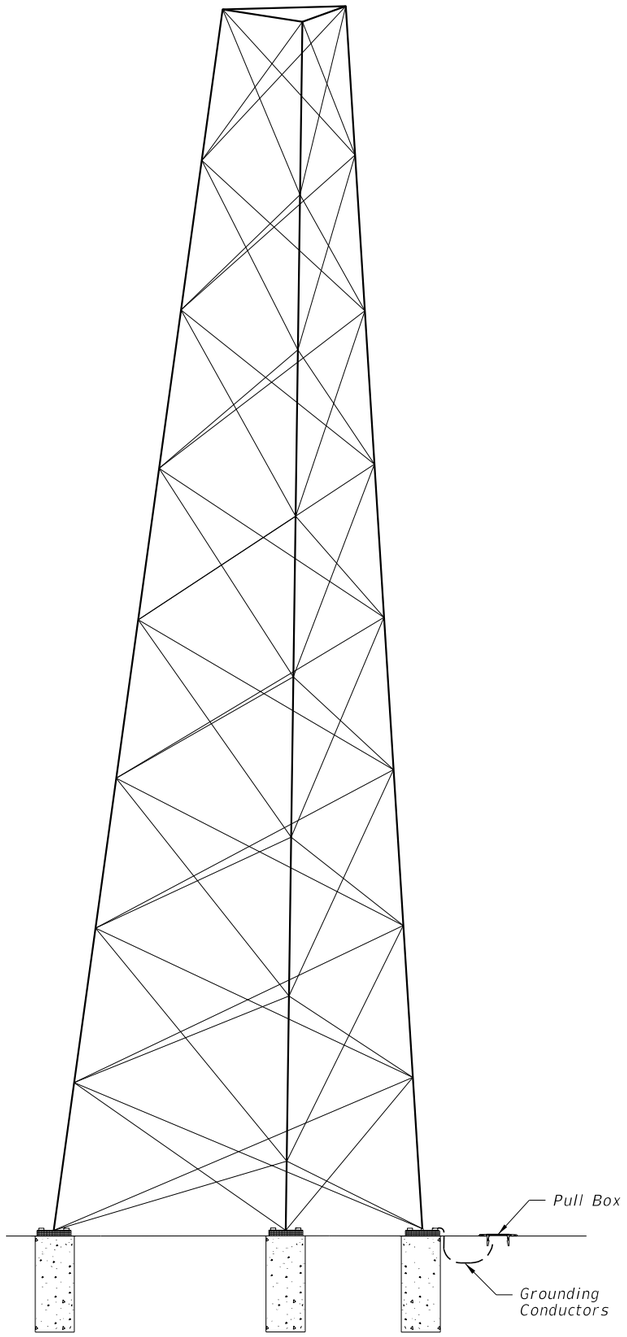


COMMUNICATION TOWER

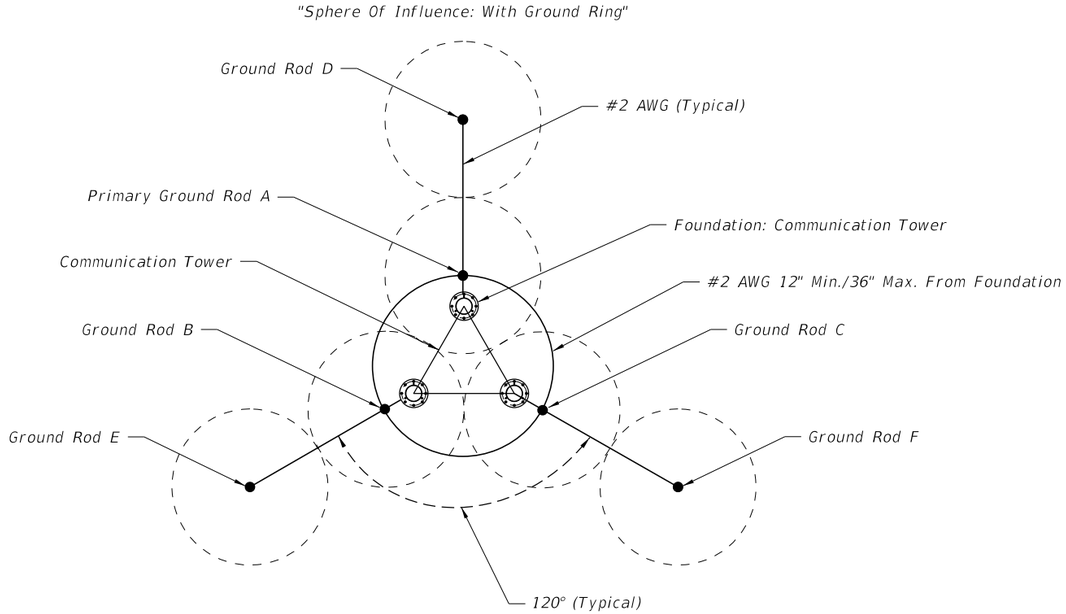


GROUND ROD ARRAY PLACEMENT
(Communication Tower)
20' RODS, 40' SPACING

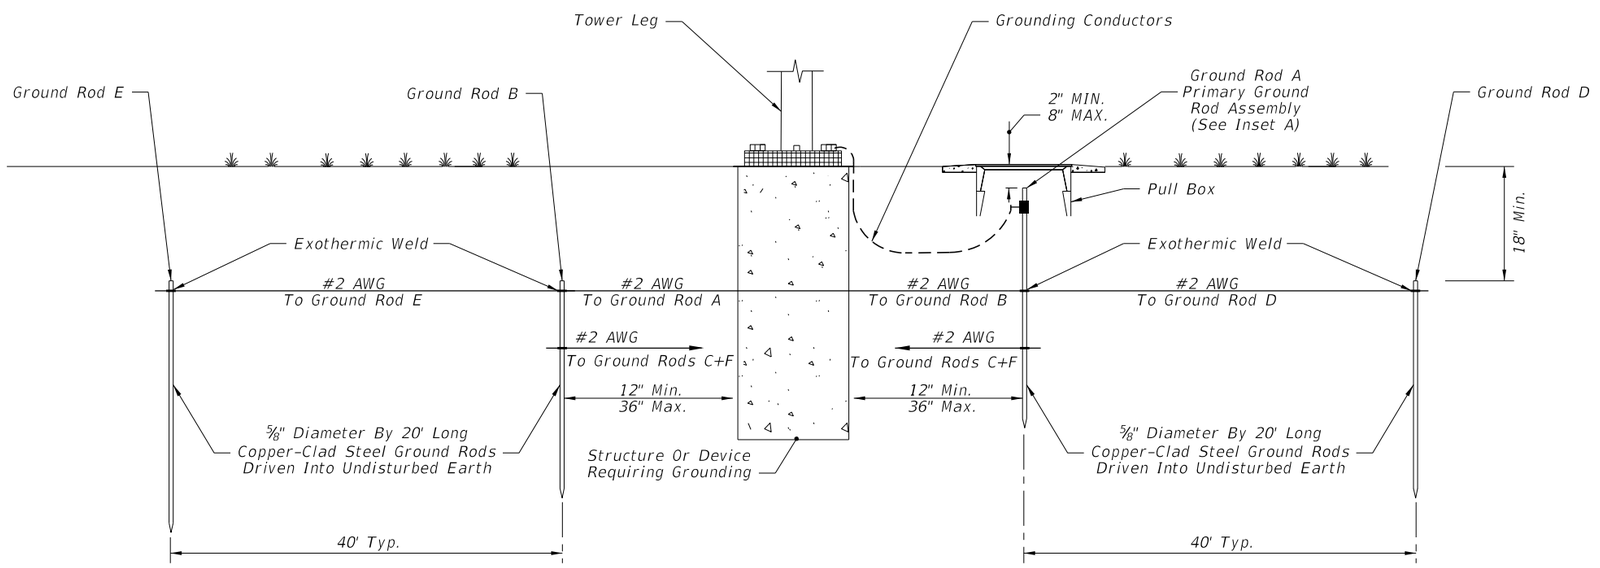


GROUND ROD ARRAY PROFILE
(Communication Tower)

11/30/2015 11:30:59 AM

| LAST REVISION | REVISION | DESCRIPTION: | | | INDEX NO. | SHEET NO. |
|---|---|---|---|---|---|---|
| 07/01/14 | | | FDOT FY 2016-17 DESIGN STANDARDS | GROUNDING AND LIGHTNING PROTECTION | 18102 | 4 of 4 |