



☐ Inlet
Symmetrical About ☐ For Inlet Types 2 & 4 and for Double Throat Side of Inlet Type 5. See Tabular Description of Inlets, General Note 1.

GRATE SLOPE & DROP HEIGHT				
Shoulder Slope	Grate Slope Rate	Drop Height		Remarks
		CIPL	Precast	
0.03	1:6	1 1/16"	1 5/16"	Std. Median Concrete Shoulder
0.05	1:6	1 1/16"	7/8"	Std. Median Flexible Shoulder
0.06	1:6	1 3/16"	5/8"	
0.07	1:5	1 3/8"	1 3/8"	
0.08	1:5	1 3/8"	1 3/16"	
0.09	1:5	1 1/8"	1 5/16"	
0.10	1:5	7/8"	1 1/16"	e (max)

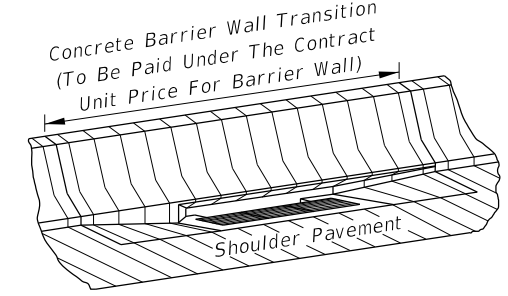


PICTORIAL VIEW (TYPE 1 SHOWN)

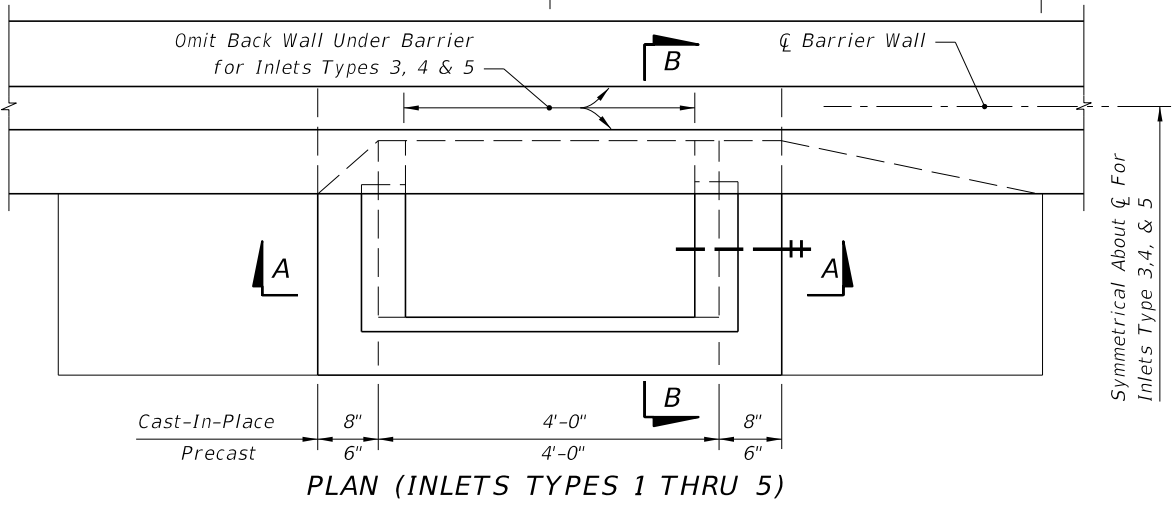


HORIZONTAL WALL REINFORCING SCHEDULE (TABLE 1)


WALL DEPTH	SCHEDULE	AREA (in. ² /ft.)	MAX. SPACING	
			BARS	WWF
0'-3'	A12	0.20	12"	8"
3'-6'	A6	0.20	6"	5"
6'-9'	B5.5	0.24	5 1/2"	5"
9'-15'	C6.5	0.37	6 1/2"	6"

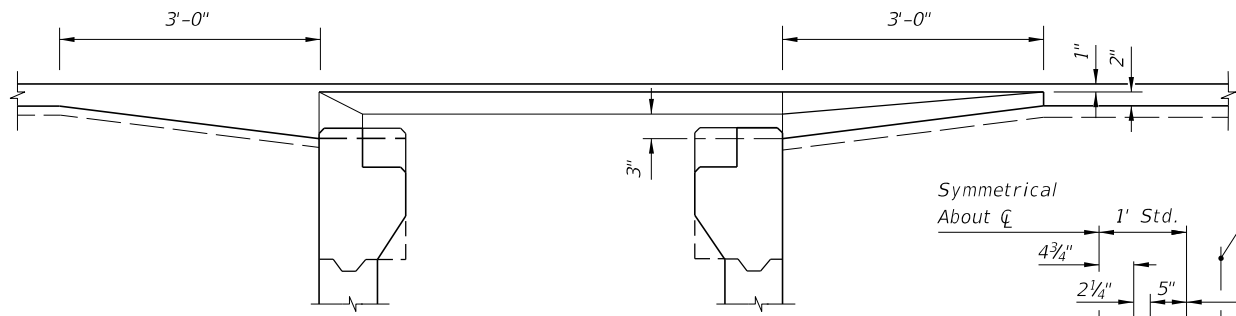


SECTION CC

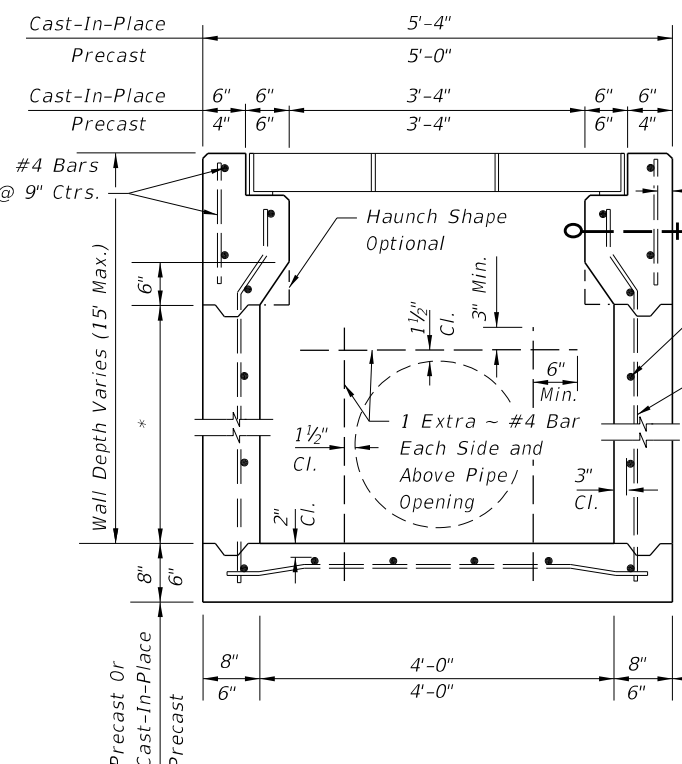

(Pipe Opening Shown) SECTION AA

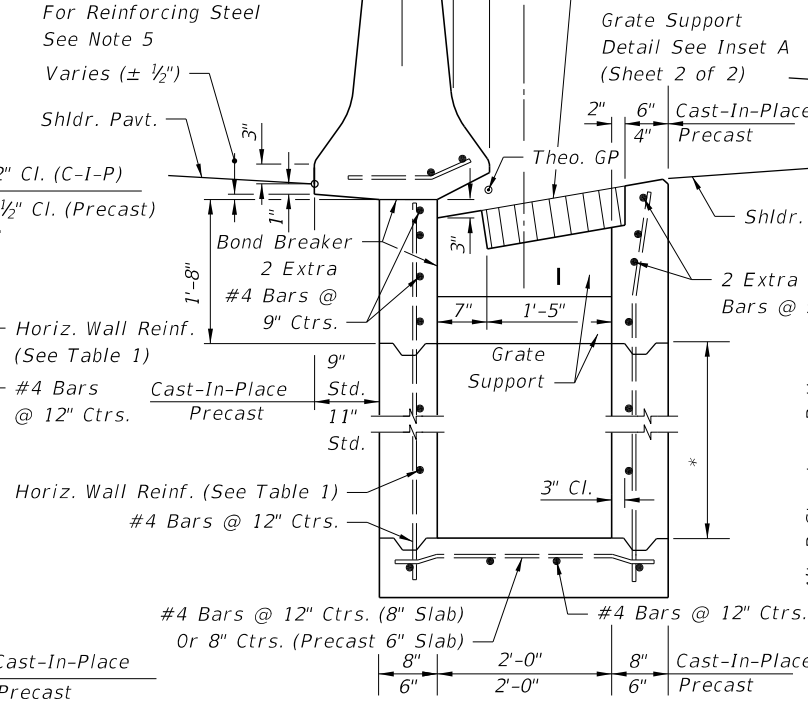

SECTION FOR INLETS TYPES 1 & 2 (Pipe Opening Shown) SECTION BB

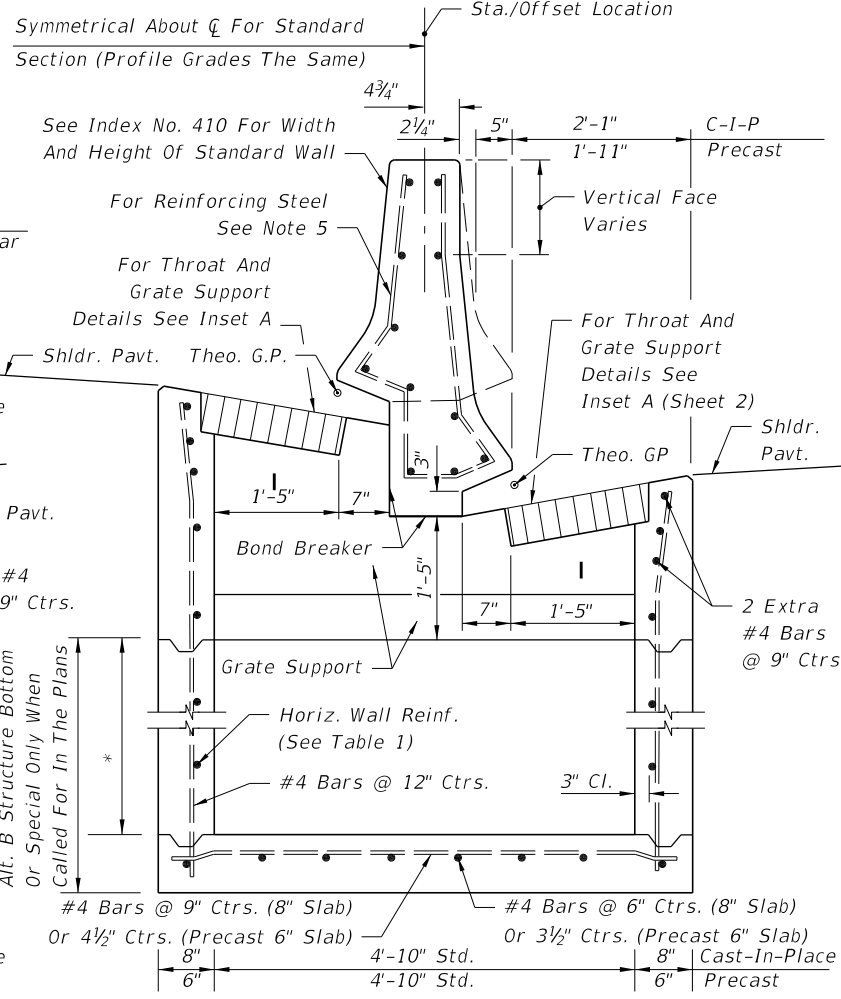


SECTION FOR INLETS TYPES 3, 4 & 5 (NON-SYMMETRICAL SECTION SHOWN)

GENERAL NOTES


- Inlet Descriptions:
Type 1 Single throat, one side of barrier wall.
Type 2 Double throats, one side of barrier wall.
Type 3 Two single throats, opposite side of barrier wall.
Type 4 Two double throats, opposite sides of barrier wall.
Type 5 Double throats, one side of barrier wall, and single throat other side of barrier wall.
- For grate details see Index No. 220. The parallel bar grate shall be used unless the reticulate grate is called for in the plans. The reticulate grate shall be specified where bicycle traffic is anticipated. Used in areas of occasional pedestrian traffic. Not suitable for use in pedestrian traffic or bicycle way.
- All exposed edges and corners shall be 3/4" chamfer or tooled to 1/4" radius.
- For standard concrete barrier wall dimensions, and for dimensions of concrete barrier wall incorporating light standards within the wall, see Index No. 410.
- Reinforcing steel shall have 2" minimum cover. Horizontal wall reinforcing must be positioned 3" from the inside face unless otherwise shown.
- All reinforcing is Grade 60 #4 bars. See Index No. 201 for equivalent area of welded wire fabric for inlet. Longitudinal steel bars extend over full length of concrete barrier wall transition. Tie bars @ 12" ctrs. Reinforcing to be paid for under the contract unit price for Concrete Barrier Wall, LF.
- For supplemental details see Index No. 201.
- All dimensions are for both precast and cast-in-place inlets unless otherwise noted.
- Inlets to be paid for under the contract unit price for inlets (Median Barrier Type_), EA. Barrier wall to be paid for under the contract unit price for Concrete Barrier Wall, LF.
- Bond Breaker: One layer of ASTM D6380 Class S, Type III organic felt between inlet and barrier, including footings.

10/25/2016 8:15:33 AM


LAST REVISION 11/01/16	DESCRIPTION:	FY 2017-18 DESIGN STANDARDS	MEDIAN BARRIER INLETS TYPES 1, 2, 3, 4 AND 5	INDEX NO. 217	SHEET NO. 1 of 2
---------------------------	--------------	--------------------------------	--	------------------	---------------------

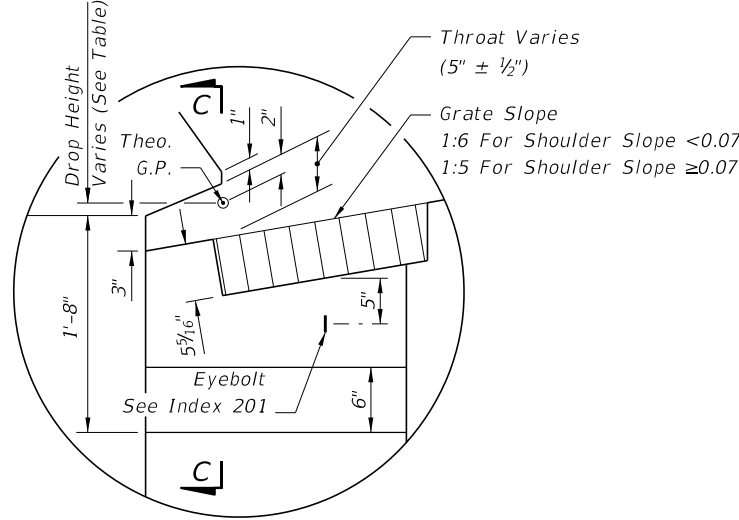


INSET A

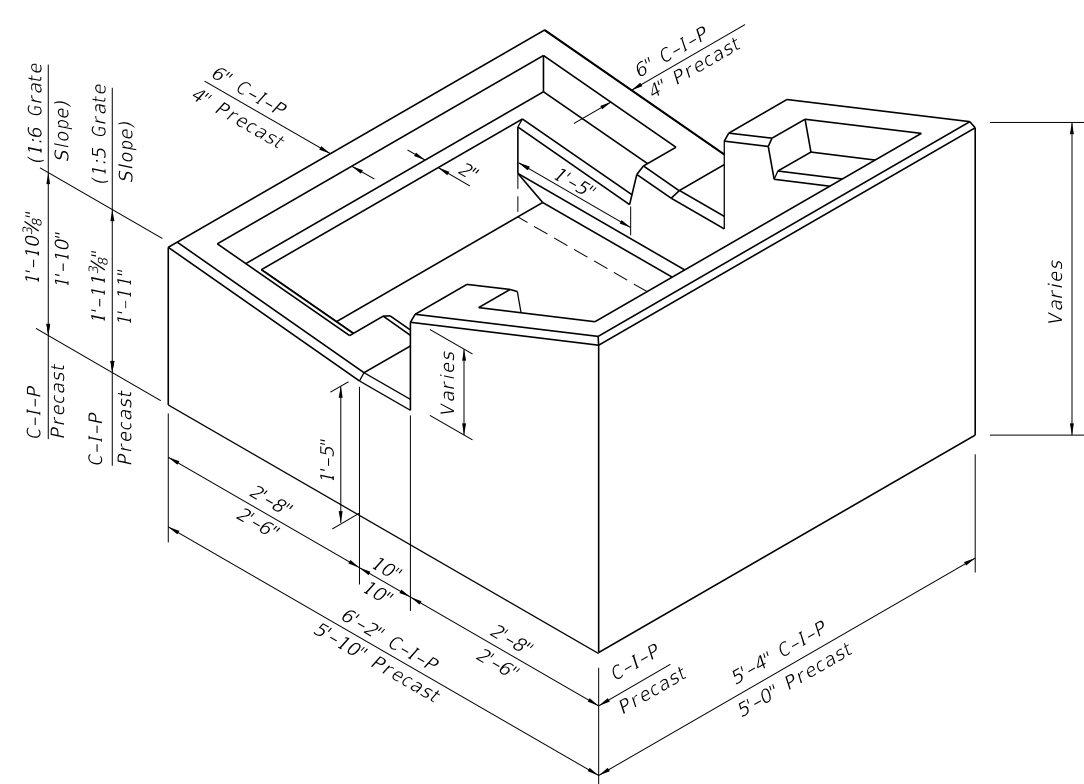


PICTORIAL VIEW OF INLET COLLAR (TYPES 3, 4, & 5)

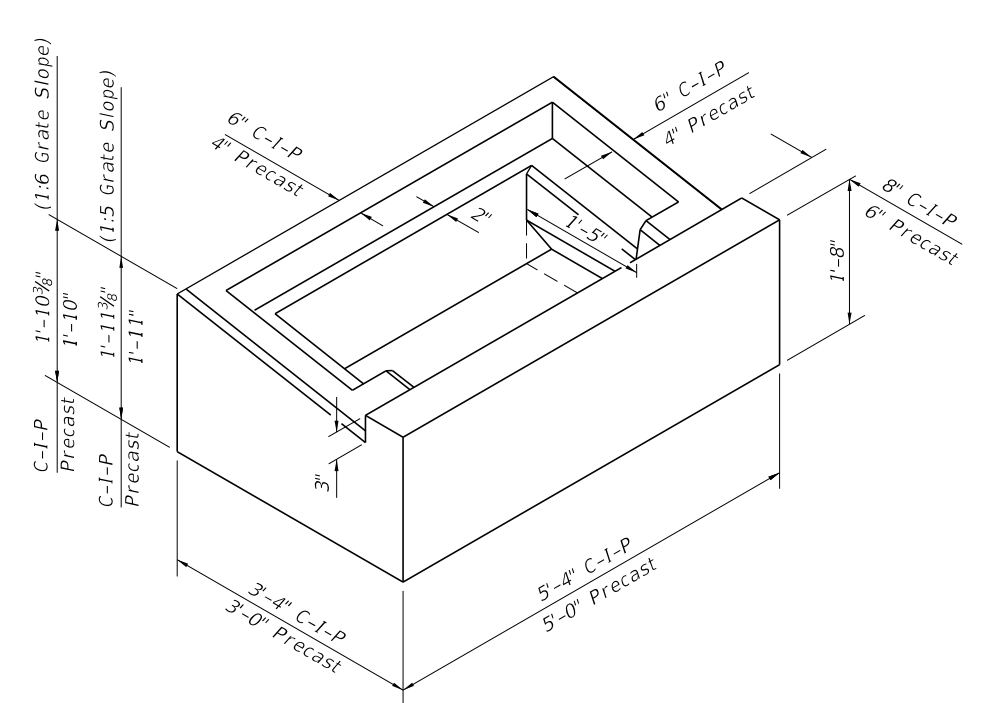


PICTORIAL VIEW OF INLET COLLAR (TYPES 1 & 2)

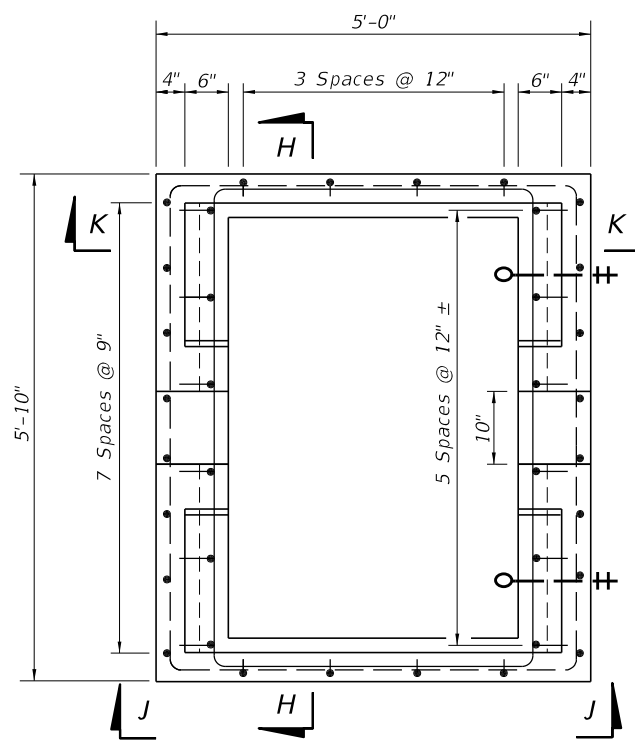


TOP VIEW OF INLET COLLAR WITHOUT GRATE

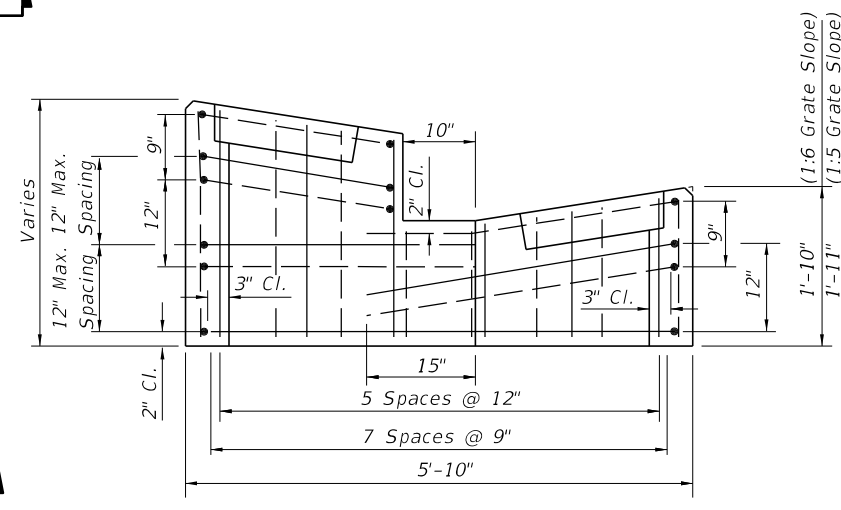


SECTION HH

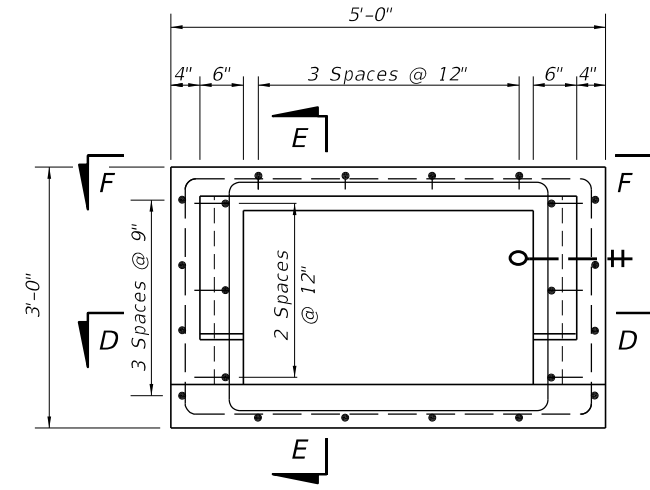


TOP VIEW OF INLET COLLAR WITHOUT GRATE

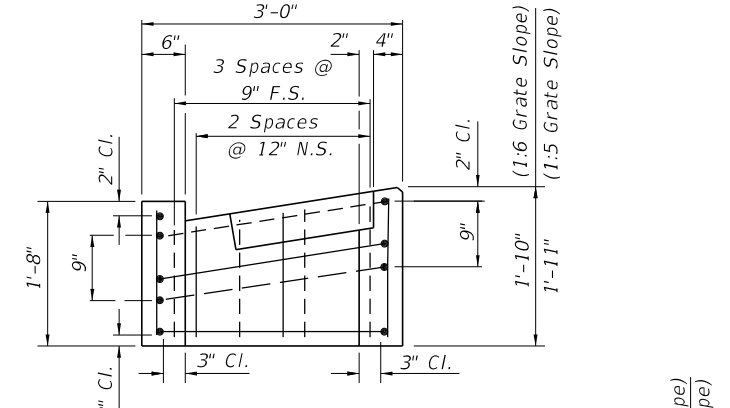

SECTION EE

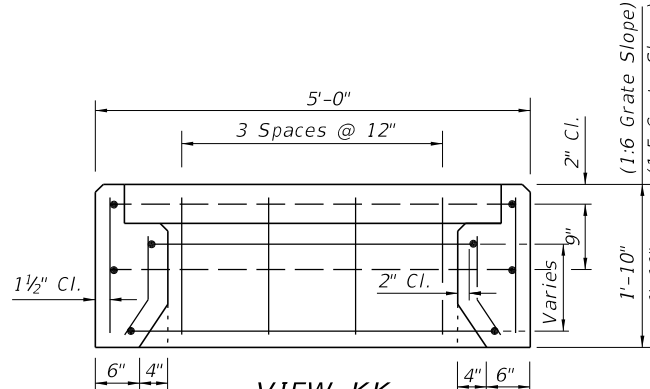


VIEW KK

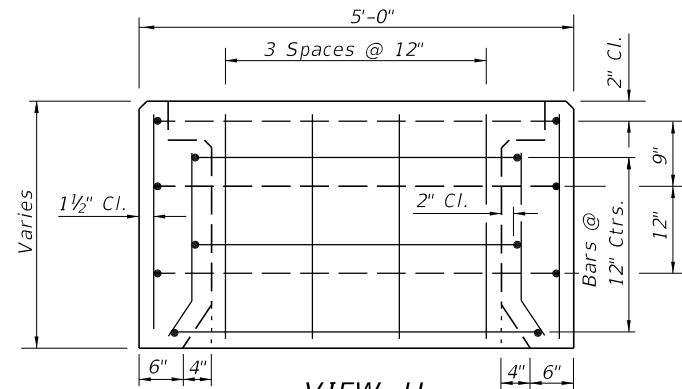


VIEW JJ

PRECAST COLLAR REINFORCING DETAILS (TYPES 3, 4 & 5)
(C-I-P COLLAR REINFORCING DETAILS SIMILAR)

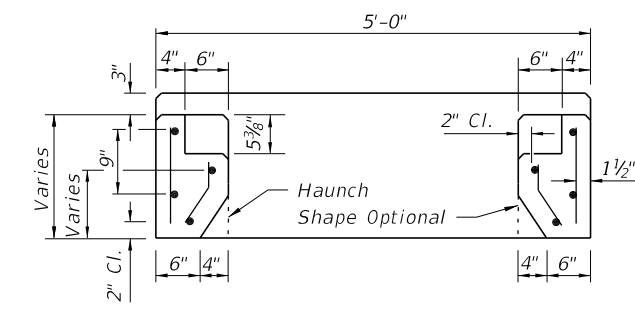

SECTION DD

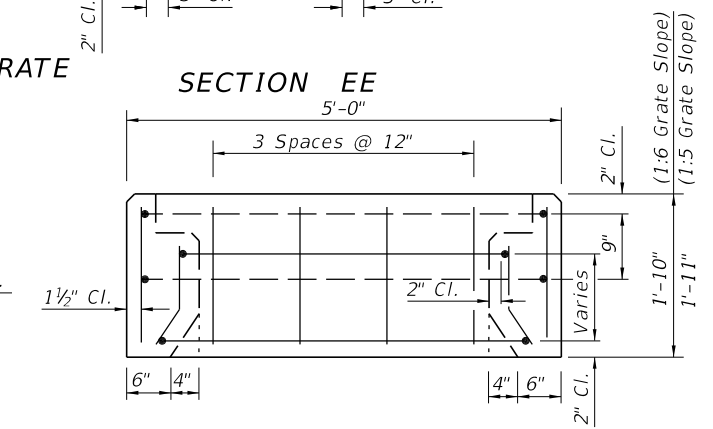

VIEW FF

PRECAST COLLAR REINFORCING DETAILS (TYPES 1 & 2)
(C-I-P COLLAR REINFORCING DETAILS SIMILAR)

10/11/2016 10:23:31 AM

LAST REVISION 07/01/05	REVISION	DESCRIPTION:	 FY 2017-18 DESIGN STANDARDS	MEDIAN BARRIER INLETS TYPES 1, 2, 3, 4 AND 5	INDEX NO. 217	SHEET NO. 2 of 2
---------------------------	----------	--------------	---	---	------------------	---------------------