



LOW SIDE SUPERELEVATION PAVEMENT WARP FOR SHOULDERS IN SUPERELEVATION
HIGH SIDE TRANSITION PAVEMENT WARP FOR SHOULDERS IN SUPERELEVATION

Joint And Bond Breaker:
Cast-In-Place Inlets:
One layer ASTM D6380 Class S, Type III Organic Felt bond breaker between inlet and barrier, including footings.
Precast Inlets:
Joint width 1" max. Seal with backer rod and Department-approved pavement joint sealant. See Section BB For Other Barrier Shape.

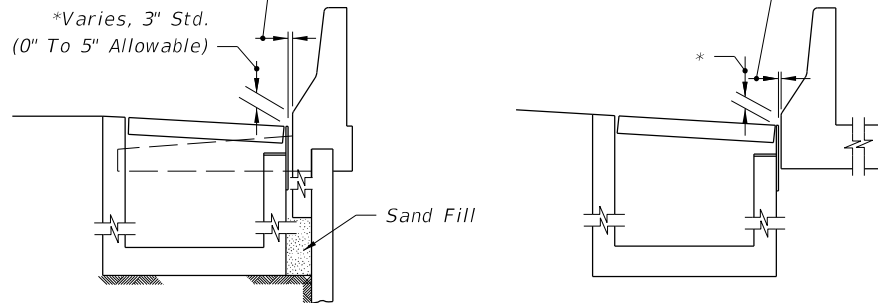


BARRIER WALL / RETAINING WALL INLET SECTION AT WALLS
SINGLE FACE ROADWAY BARRIER INLET SECTION AT WALLS

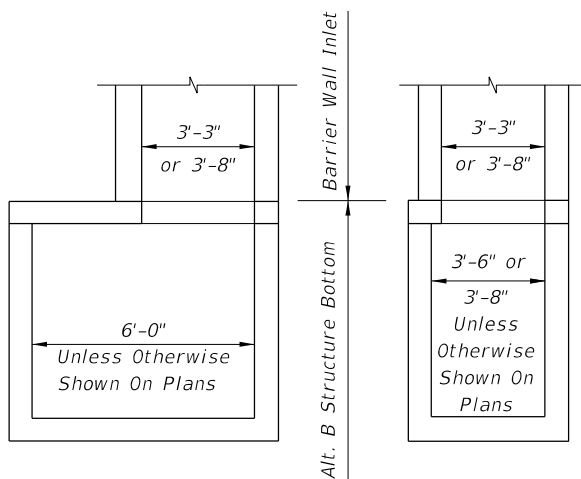


Note: Alt. B Structure Bottom Only. See Index No. 200.

INLET WITH STRUCTURE BOTTOM

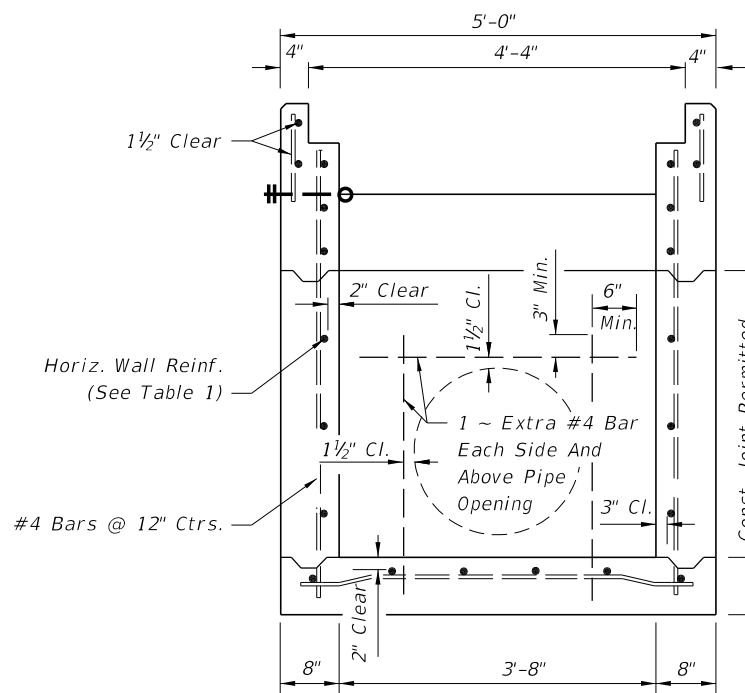


(Pipe Opening Shown)
SECTION AA (WITHOUT GRATE)

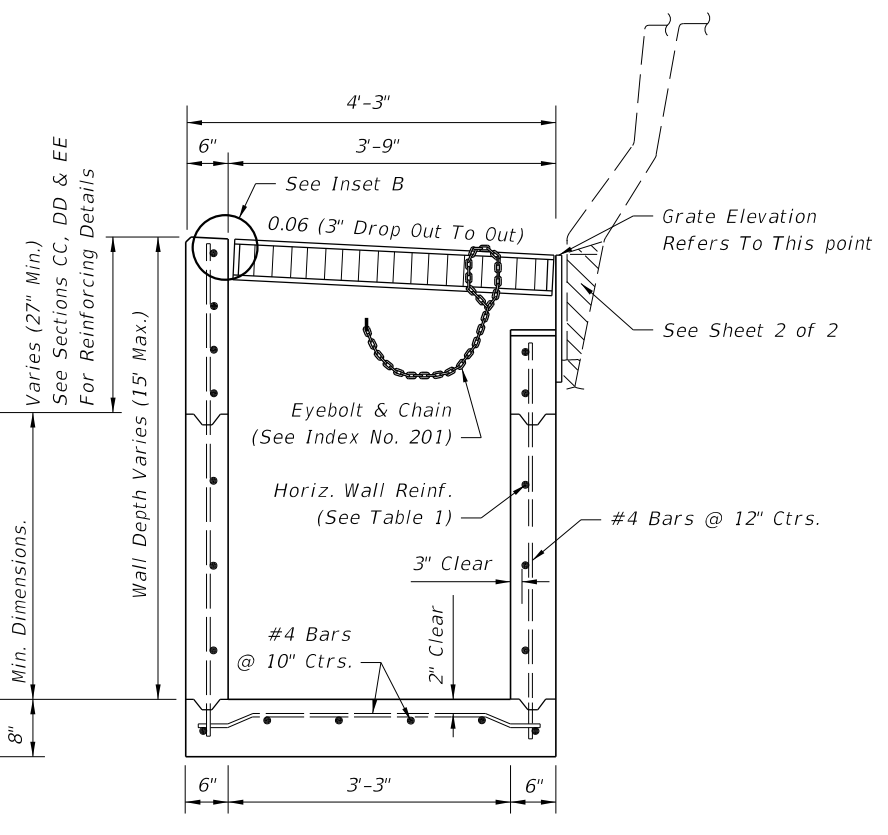

(Pipe Opening Not Shown)
SECTION BB

GENERAL NOTES

1. This inlet is primarily intended for use adjacent to concrete barrier walls on paved shoulders. Use of the inlet adjacent to other wall types shall be approved by the Drainage Engineer. The inlet is suitable for bicycle and occasional pedestrian traffic, with roller bar installation (see inset B) but should not be placed in a designated pedestrian travel way. It is not intended for use in curb and gutter or other areas where throated inlets are required, nor areas subject to high debris.
2. Inlets located in embankments constructed with earth anchored retaining wall shall be designed with minimum depths to reduce adverse impact on the anchorage system. Runs of pipe parallel to and near anchored wall shall be avoided wherever practical. Special coordination must be exercised during the design and construction of storm water systems within anchored wall systems.
3. Inlet bottoms and/or tops may be either precast or cast-in-place. Whether cast as a single unit or as multiple segments, and whether precast or cast-in-place, the upper 2'-3" of the inlet shall be reinforced in accordance with sections CC, DD and EE.
4. All exposed edges and corners shall be 3/4" chamfer or tooled to 1/4" radius.
5. When Alternate G grate is specified in the plans, the grate is to be hot-dip galvanized after fabrication. Field installation of the filler bar called for in Inset B will not be permitted, thereby requiring tolerance adjustment during fabrication and/or casting, or, matching grate to structure prior to galvanizing.
6. All reinforcing is Grade 60 bars. See Index No. 201 for equivalent area of welded wire fabric.
7. All dimensions are for both precast and cast-in-place inlets unless otherwise noted.
8. For supplemental details see Index Nos. 200 and 201.
9. Inlets to be paid for under the contract unit for Inlets (Barrier Wall), Each.

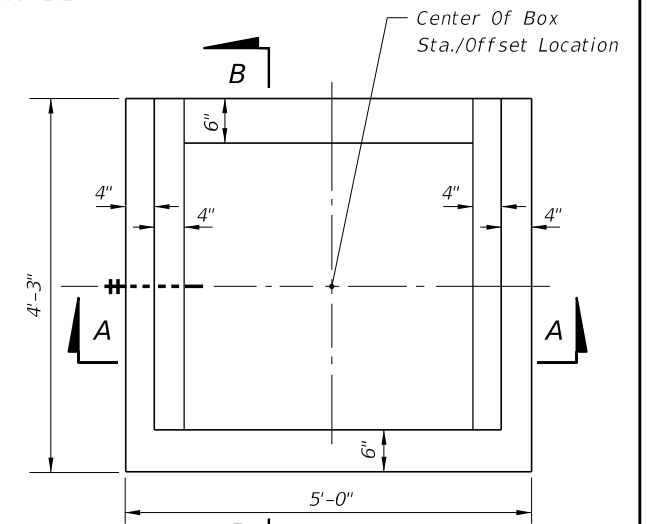


TOP VIEW (WITHOUT GRATE)

HORIZONTAL WALL REINFORCING SCHEDULE (TABLE 1)


WALL DEPTH	SCHEDULE	AREA (in. ² /ft.)	MAX. SPACING	
			BARS	WWF
0'-5'	A12	0.20	12"	8"
5'-10'	A6	0.20	6"	5"
10'-15'	A4	0.20	4"	3"
10'-15'	B5.5	0.24	5 1/2"	5"

10/11/2016 10:23:52 AM


LAST REVISION 11/01/16	DESCRIPTION:
---------------------------	--------------

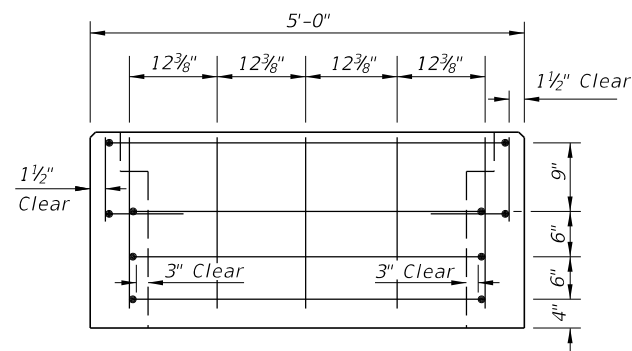


SECTION CC

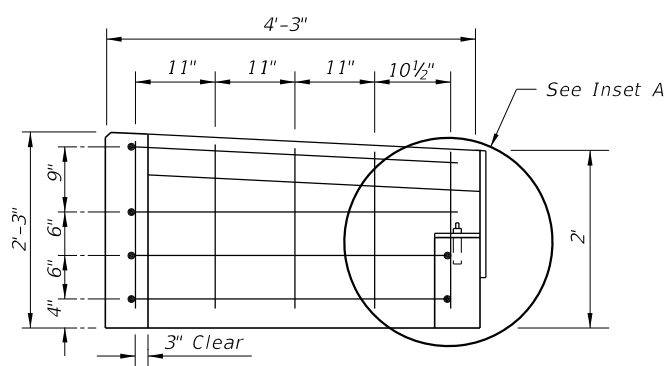

SECTION DD

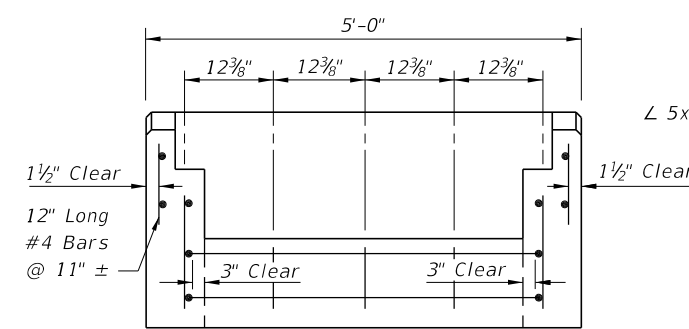


SECTION EE

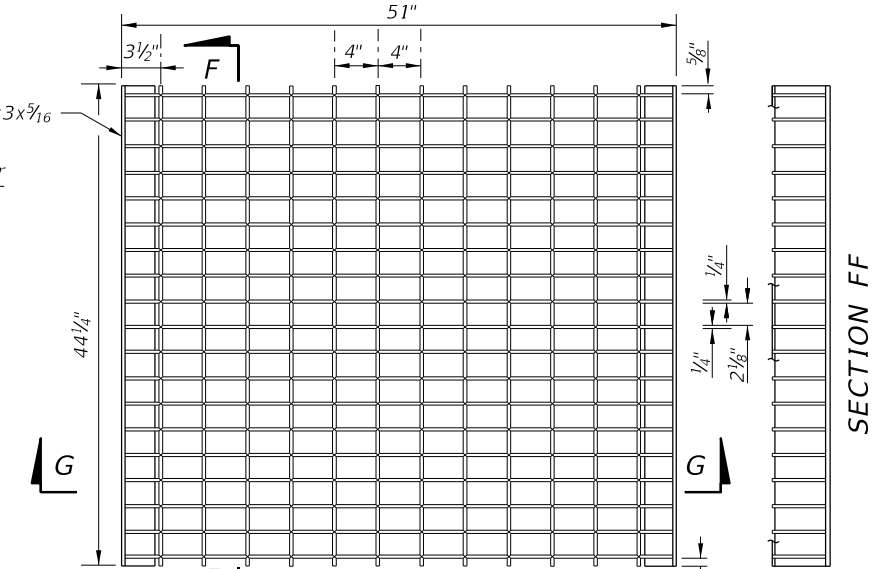

SECTION FF

Main Bars: 5"x1/4"
Cross Bars: Either 3/8"Ø Electroformed or 1/2"Ø Welded


TOP VIEW

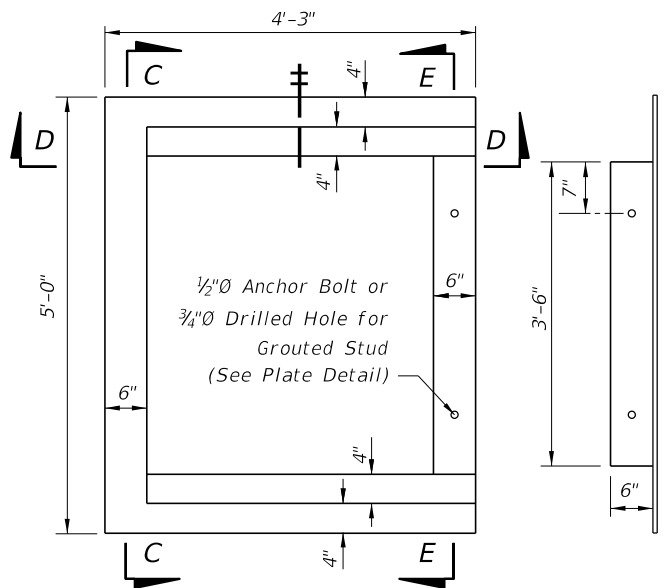


SECTION GG

TOP VIEW OF INLET WITHOUT GRATE


TOP VIEW OF METAL PLATE

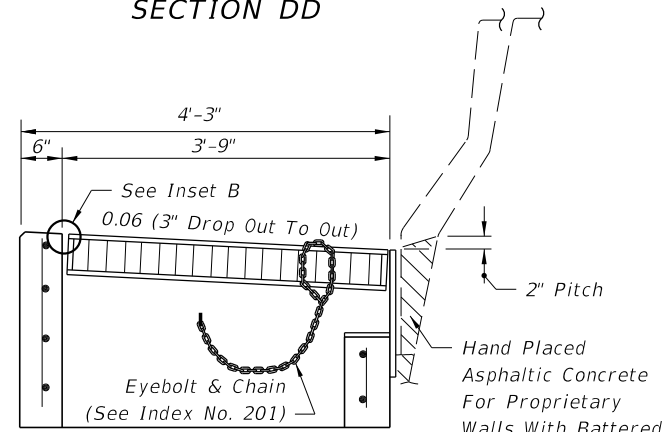


TRANSVERSE SECTION WITH GRATE & PLATE

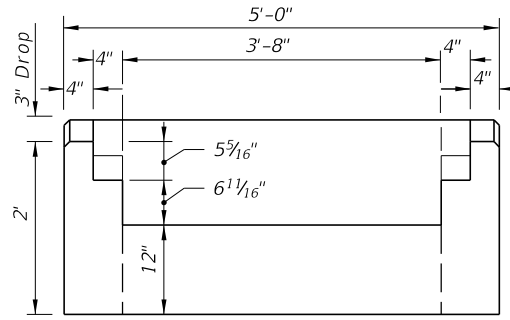


BACK VIEW WITHOUT BACK PLATE

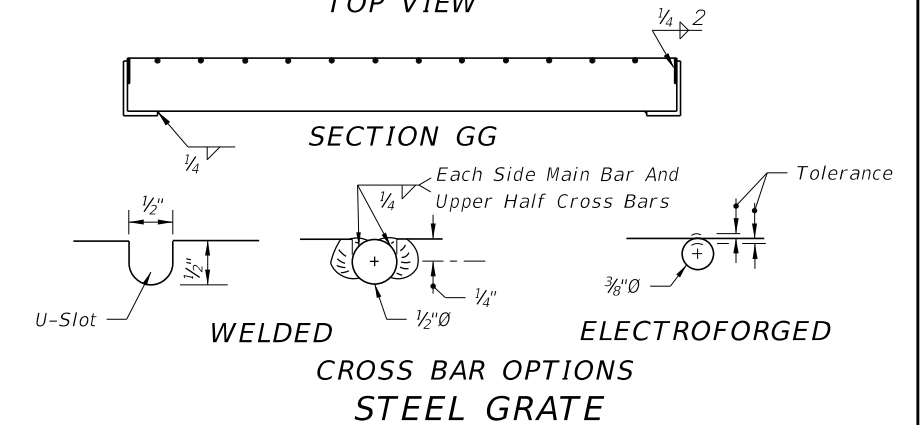


WELDED CROSS BAR OPTIONS
ELECTROFORMED STEEL GRATE

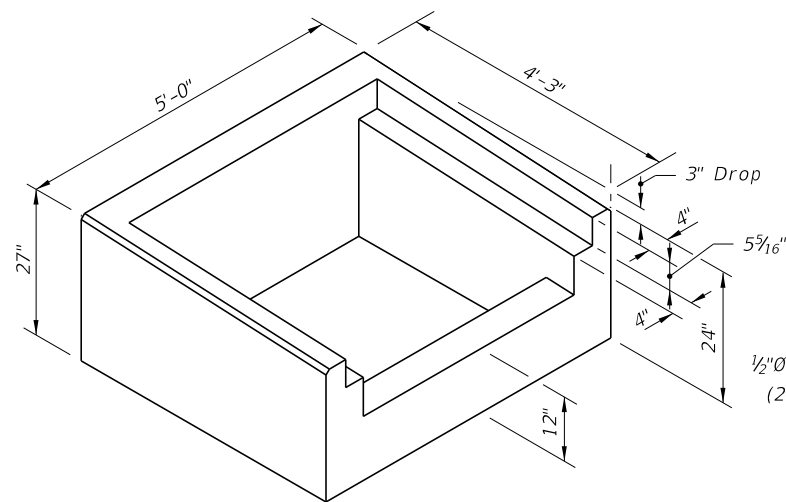


PICTORIAL VIEW OF INLET COLLAR

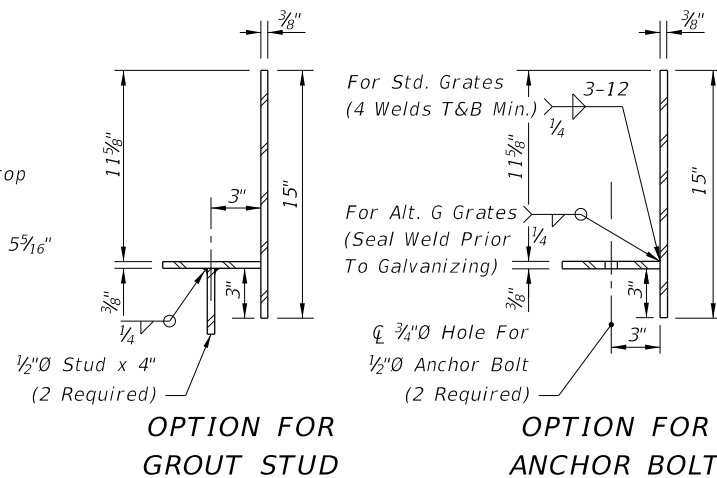

TRANSVERSE SECTIONS THRU BACKWALL PLATE

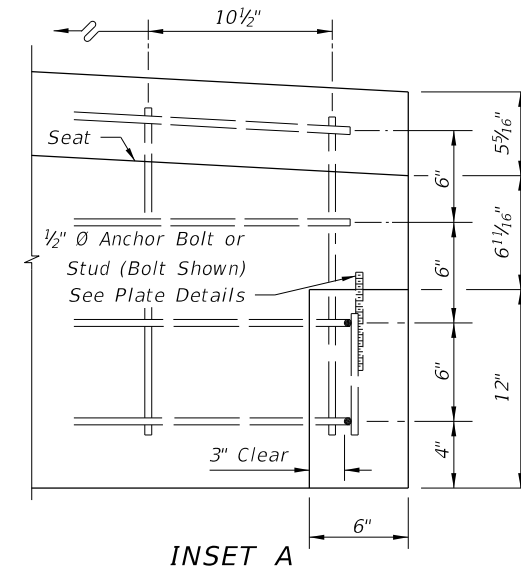

INSET A

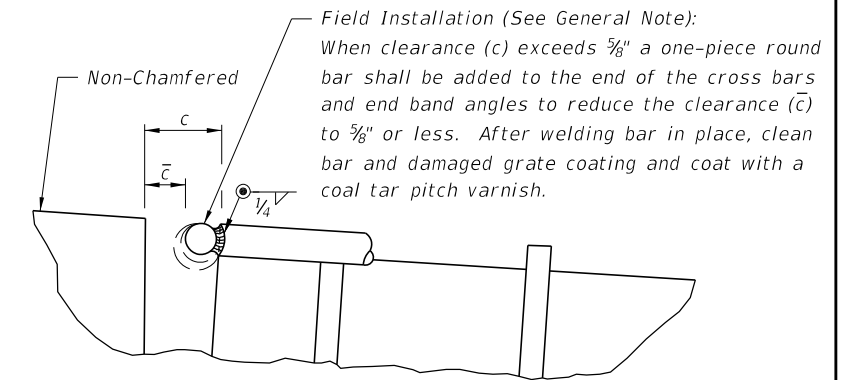

INSET B

Field Installation (See General Note):
When clearance (c) exceeds 5/8" a one-piece round bar shall be added to the end of the cross bars and end band angles to reduce the clearance (c) to 5/8" or less. After welding bar in place, clean bar and damaged grate coating and coat with a coal tar pitch varnish.

NOTES

- All bars #4.
- Anchor bolts shall be either ASTM A307 hex head bolts cast-in-place, or ASTM A36 or F1554 (Grade 36) galvanized fully threaded rod, adhesive bonded anchors installed in accordance with Specification Section 416. Bolts or rods shall be 6" long (4" min. embedment) with one heavy hex head nut (ASTM 194 or A563) and one flat washer (ASTM F436) each. All anchor bolts, nuts and washers shall be hot-dip galvanized.

10/11/2016 10:23:55 AM

LAST REVISION 07/07/07	DESCRIPTION:
---------------------------	--------------