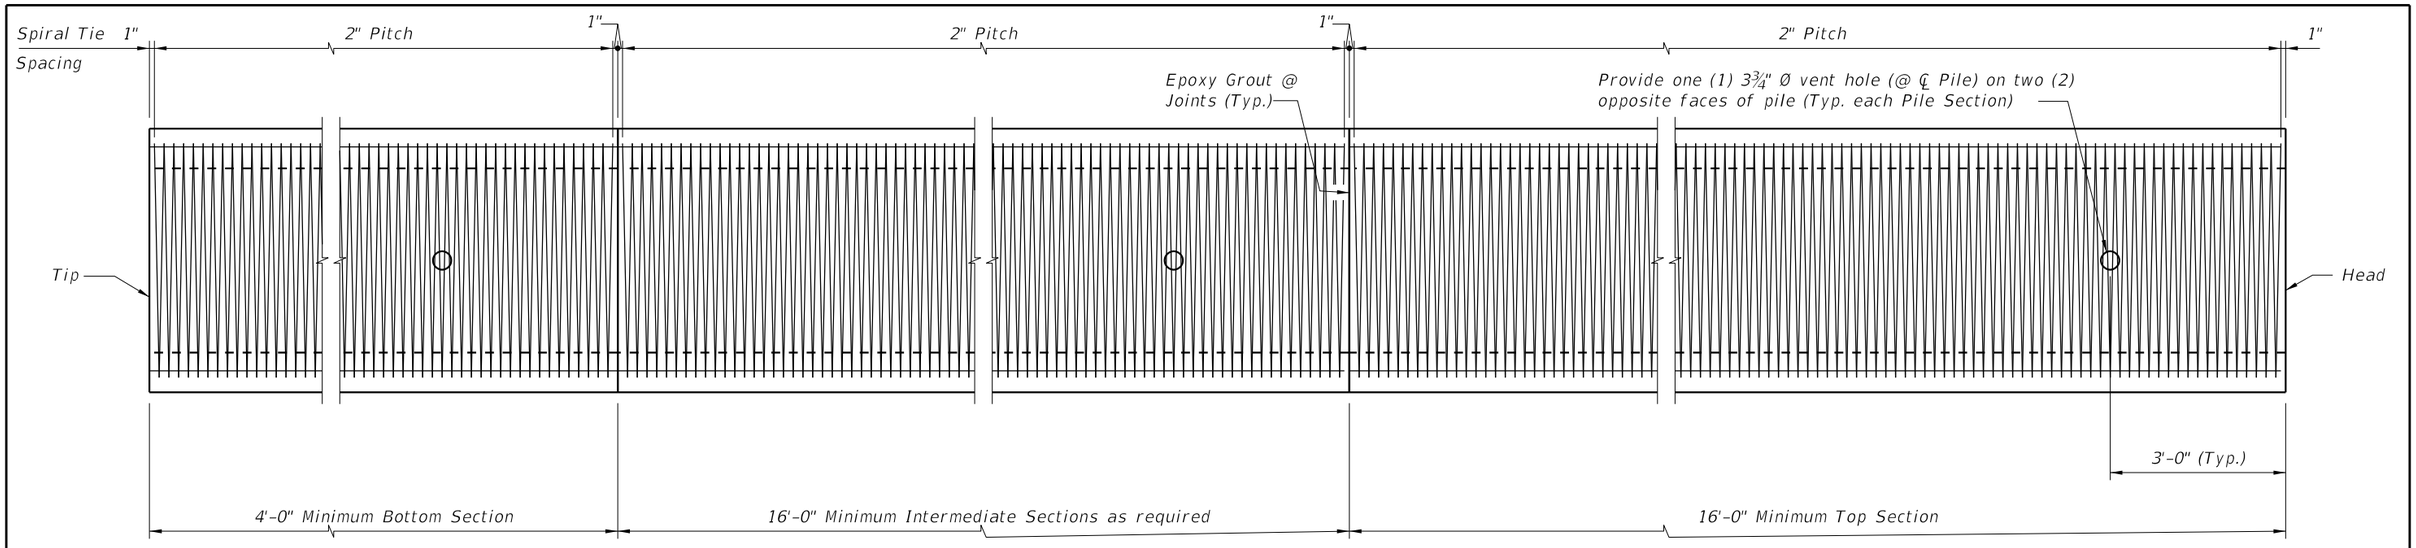

ELEVATION

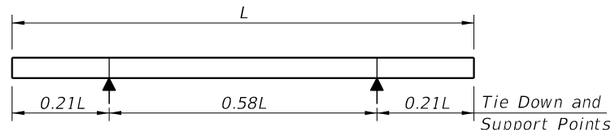

2-POINT SUPPORT

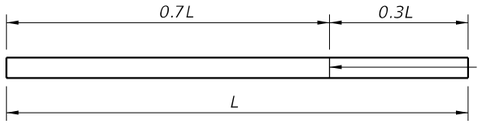

1-POINT PICK-UP

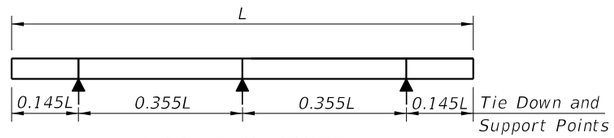

3-POINT SUPPORT

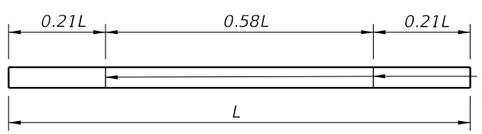

2-POINT PICK-UP

PILE PICK-UP DETAILS

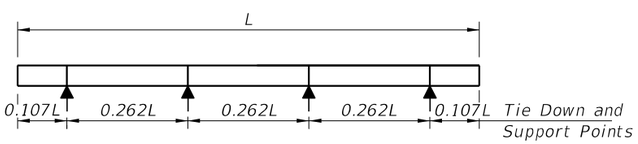

4-POINT SUPPORT

STORAGE AND TRANSPORTATION SUPPORT DETAILS

TABLE OF MAXIMUM PILE PICK-UP AND SUPPORT LENGTHS		
Maximum Pile Length (Feet)	Required Storage and Transportation Detail	Pick-Up Detail
119	2, 3, or 4 point	1 Point
170	2, 3, or 4 point	2 Point

NOTES

1. Work this Index with the Pile Data Table in the Structures Plans.
2. Concrete:
   - A. Piles: Class V (Special).
   - B. Splice: Class IV.
   - C. Silica Fume: See "GENERAL NOTES" in Structures Plans for locations where the use of silica fume, metakaolin or ultra-fine flyash is required.
3. Concrete Strength at time of prestress transfer:
   - A. Piles: 6,000 psi minimum.
4. Carbon-Steel Reinforcing:
   - A. Bars: Meet the requirements of Specification Section 415.
   - B. Prestressing Strands: Meet the requirements of Specification Section 933.
   - C. Tendons: Two seven-wire ½" dia. (Special) Grade 270, low-relaxation strands tensioned to 33.8 kips.
   - D. Protect all carbon-steel strands permanently exposed to the environment and not embedded under final conditions in accordance with Specification Section 450.
   - E. Spiral Ties:
     - a. One half turn is required for carbon-steel spiral splice.
     - b. One full turn is required at the pile head and tip.
5. Pile Splices:
   - A. Epoxy: Type AB Epoxy Compound or Mortar must meet the requirements of Specification Section 926.
     - a. Use a Type AB Epoxy Bonding Compound or Epoxy Mortar, as recommended by the Manufacturer, to form the joint between pile sections
     - b. Use a Type AB Epoxy Bonding Compound as a bonding agent on internal pile surfaces.
   - B. Driving: Resume pile driving after splice concrete reaches a minimum strength of 5,500 psi.
6. Mark piles at the pick-up points to indicate the proper points for attaching handling lines.

10/26/2016 9:03:09 AM

LAST REVISION	REVISION	DESCRIPTION:			INDEX NO.	SHEET NO.
11/01/16			FDOT	FY 2017-18 DESIGN STANDARDS	20654	1 of 2

54" PRECAST/POST-TENSIONED CONCRETE CYLINDER PILE

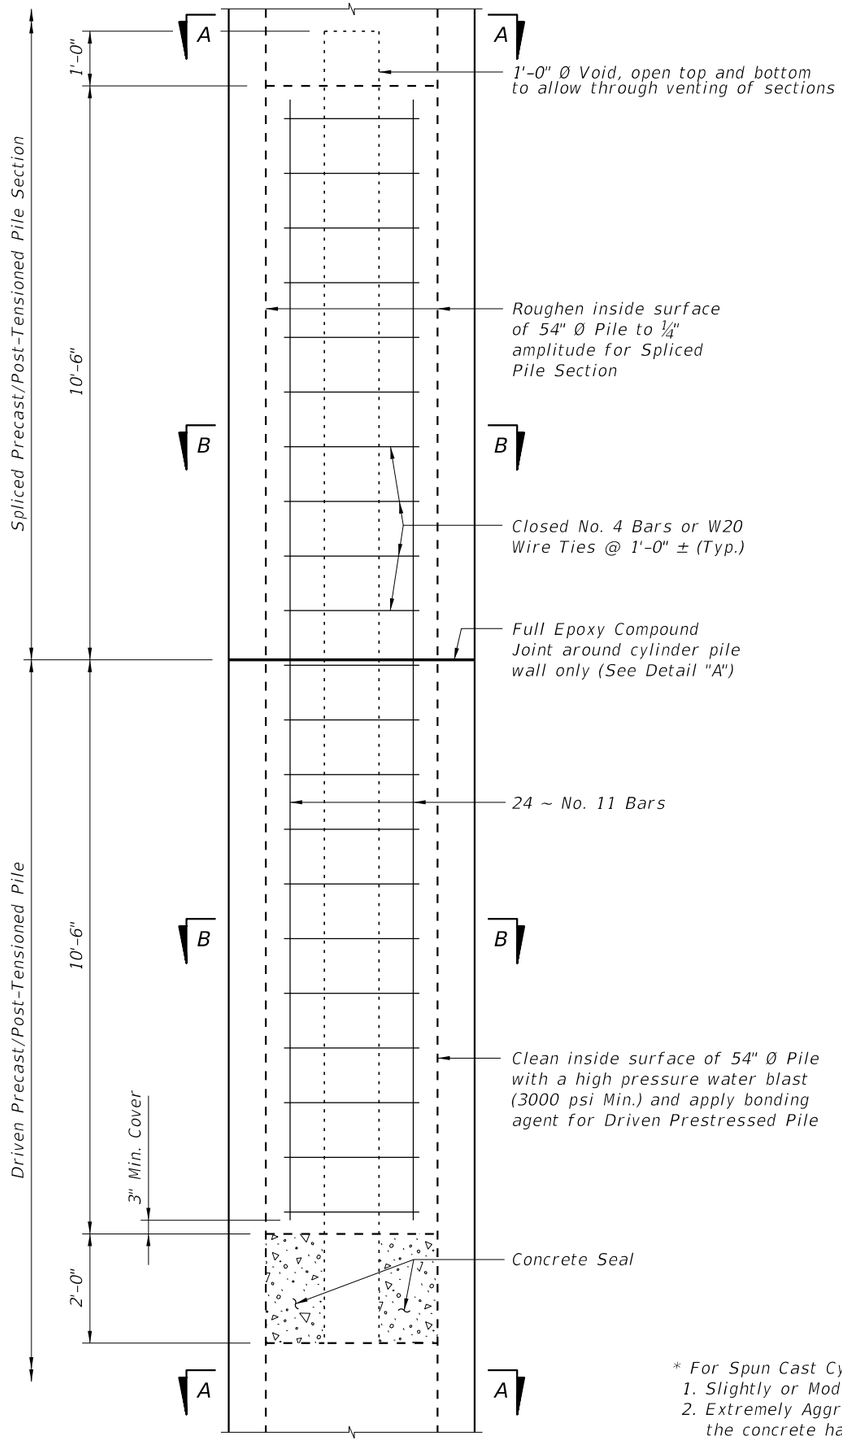

DRIVABLE UNFORESEEN FIELD SPLICE DETAIL
(Cast-In-Place Plug)

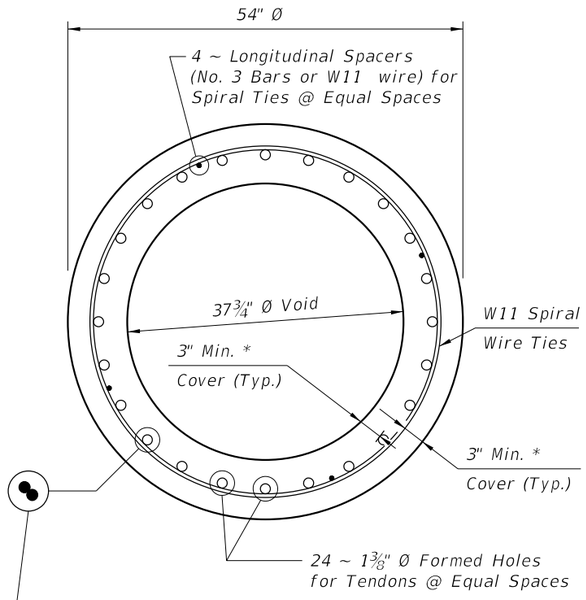

SECTION A-A

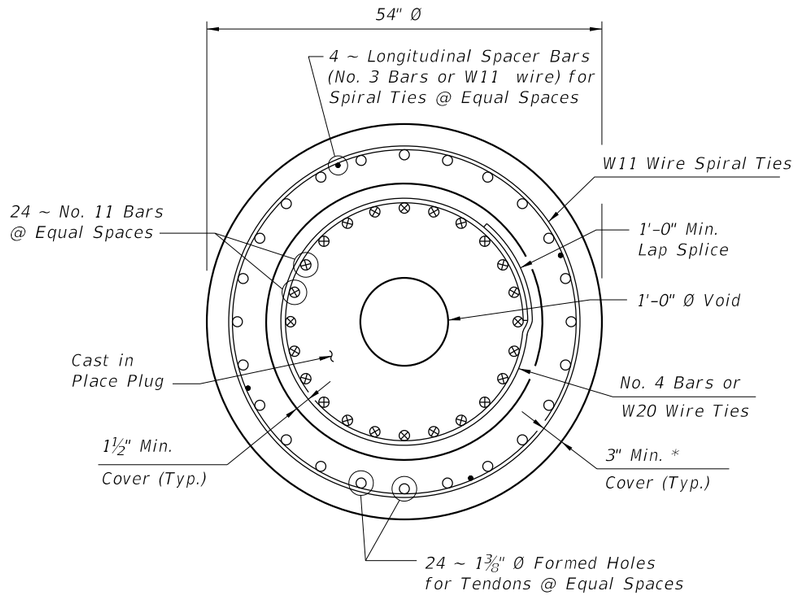

SECTION B-B

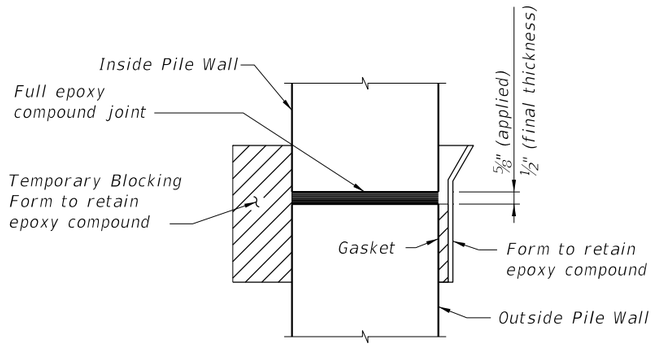

DETAIL "A"

* For Spun Cast Cylinder Piles, the following requirements for concrete cover apply:
1. Slightly or Moderately Aggressive Environments: The concrete cover may be reduced to 2 inches.
2. Extremely Aggressive Environments: The concrete cover may be reduced to 2 inches as long as the concrete has a documented chloride ion penetration apparent diffusion coefficient with a mean value of 0.005 in² per year or less; otherwise, a 3-inch concrete cover is required.

10/26/2016 9:03:11 AM

LAST REVISION	REVISION	DESCRIPTION:			
07/01/13			FY 2017-18 DESIGN STANDARDS	54" PRECAST/POST-TENSIONED CONCRETE CYLINDER PILE	INDEX NO. 20654 / SHEET NO. 2 of 2