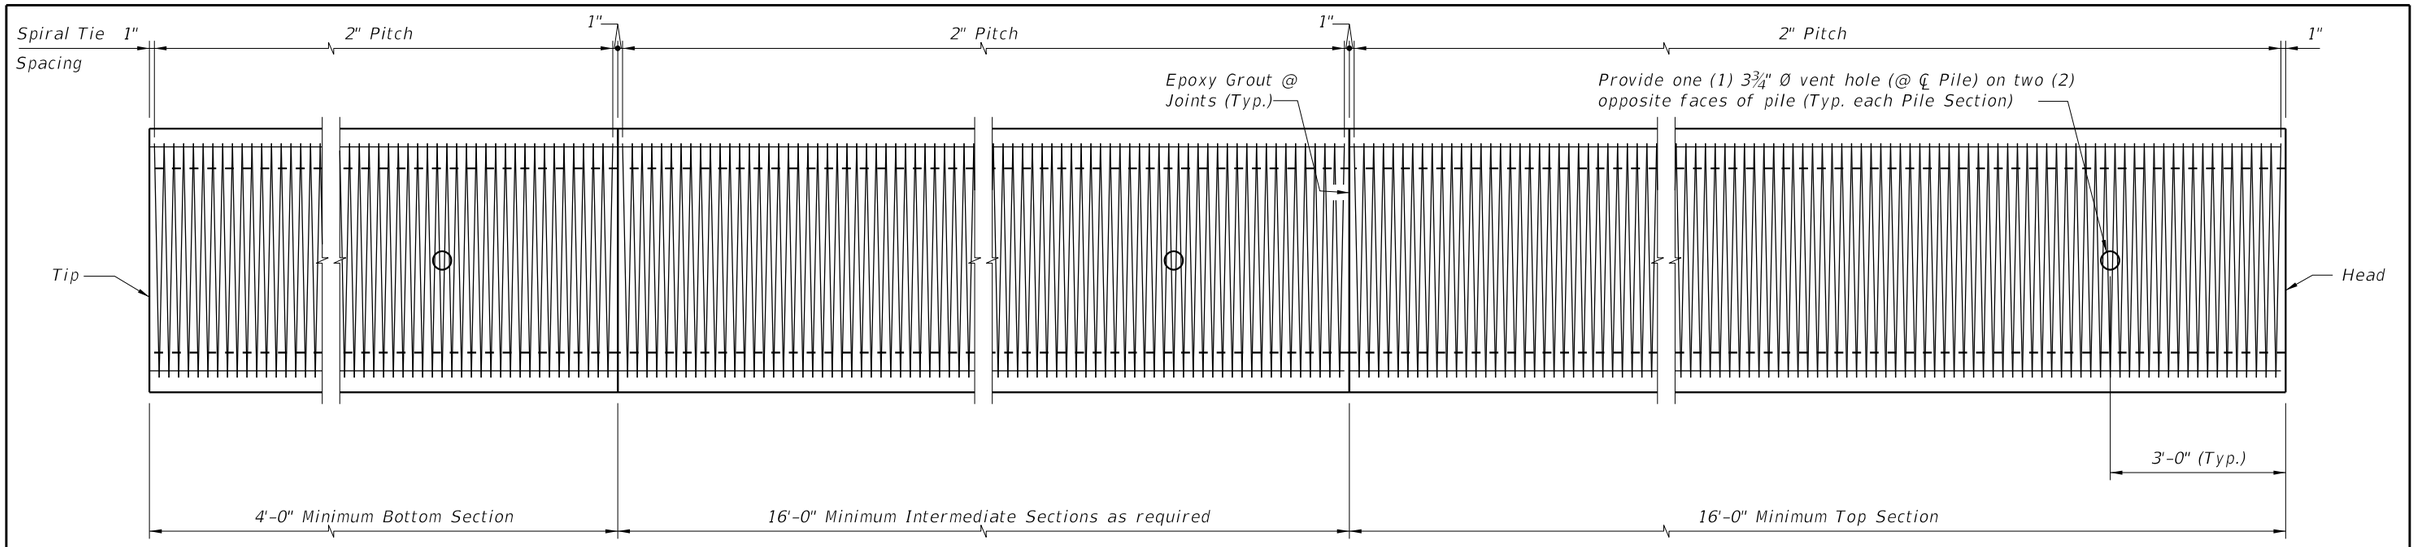

ELEVATION

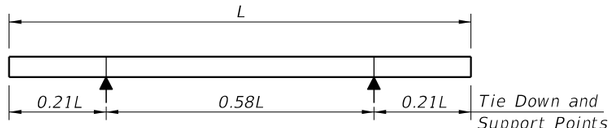

2-POINT SUPPORT

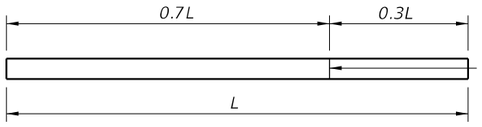

1-POINT PICK-UP

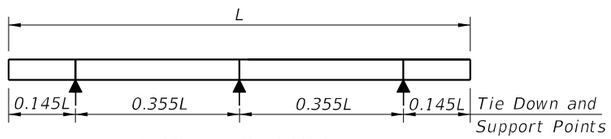

3-POINT SUPPORT

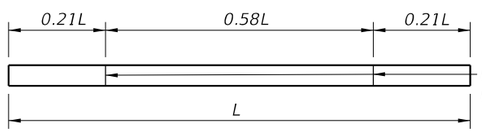

2-POINT PICK-UP

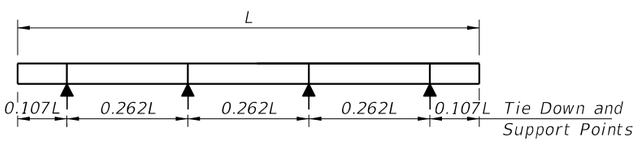

4-POINT SUPPORT

PILE PICK-UP DETAILS

STORAGE AND TRANSPORTATION SUPPORT DETAILS

TABLE OF MAXIMUM PILE PICK-UP AND SUPPORT LENGTHS		
Maximum Pile Length (Feet)	Required Storage and Transportation Detail	Pick-Up Detail
119	2, 3, or 4 point	1 Point
170	2, 3, or 4 point	2 Point

NOTES

1. Work this Index with the Pile Data Table in the Structures Plans.
2. Concrete:
   - A. Piles: Class V (Special)
   - B. Splice: Class IV
   - C. Silica Fume: See "GENERAL NOTES" in Structures Plans for locations where the use of silica fume, metakaolin or ultra-fine flyash is required for options using stainless steel strand and reinforcing.
3. Concrete Strength at time of prestress transfer:
   - A. Piles: 6,000 psi minimum.
4. Reinforcing:
   - A. Bars:
     - a. Stainless Steel: Meet the requirements of Specification Section 931 for Type 304, Grade 75.
     - b. Carbon FRP: Meet the requirements of Specification Section 932.
   - B. Prestressing Strands:
     - a. Stainless Steel: Seven-wire HSSS, UNS S32205 (Type 2205) or UNS S31803 strand, meeting the requirements of Specification Section 933.
     - b. Carbon FRP: Meet the requirements of Specification Section 933.
   - C. Spiral Ties:
     - a. One half turn is required for carbon steel spiral splice.
     - b. One full turn is required at the pile head and tip.
5. Pile Splices:
   - A. Epoxy: Type AB Epoxy Compound or Mortar must meet the requirements of Specification Section 926.
     - a. Use a Type AB Epoxy Bonding Compound or Epoxy Mortar, as recommended by the Manufacturer, to form the joint between pile sections.
     - b. Use a Type AB Epoxy Bonding Compound as a bonding agent on internal pile surfaces.
   - B. Driving: Resume pile driving after splice concrete reaches a minimum strength of 5,500 psi.
6. Mark piles at the pick-up points to indicate the proper points for attaching handling lines.

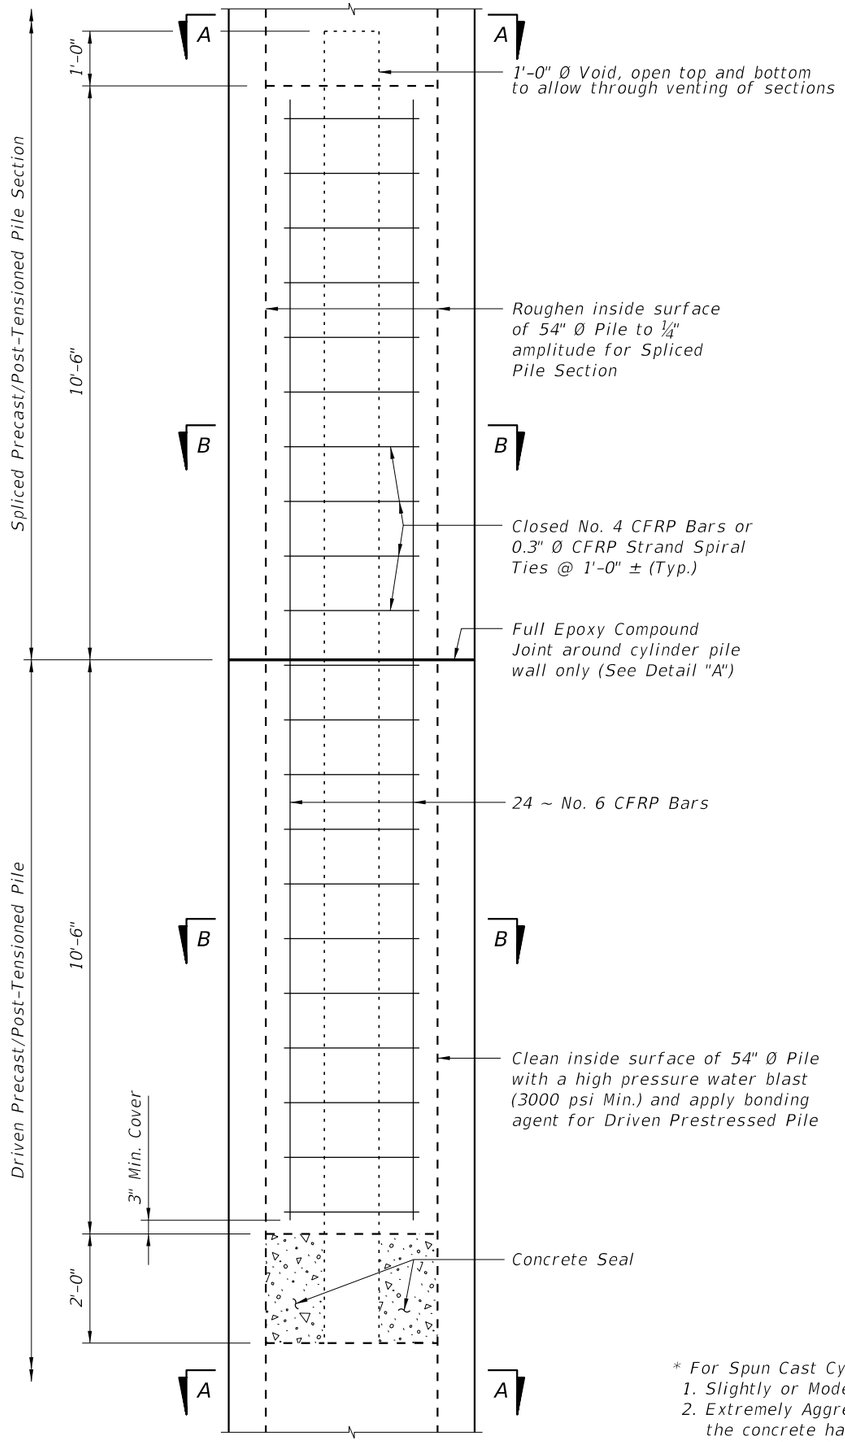

DRIVABLE UNFORESEEN FIELD SPLICE DETAIL
(Cast-In-Place Plug)

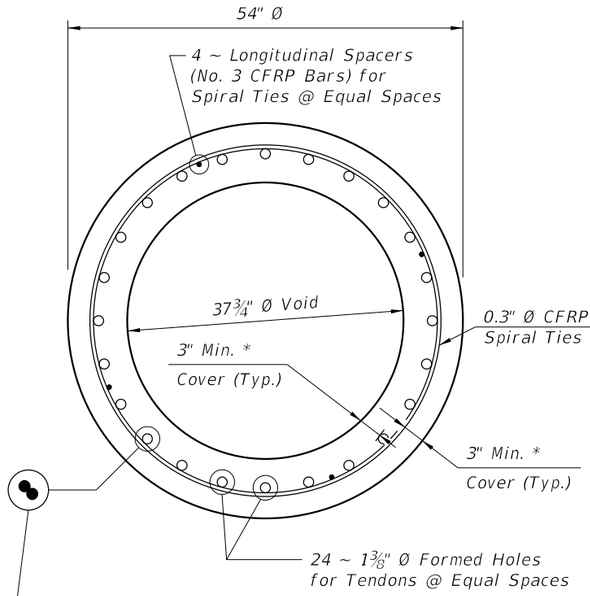

SECTION A-A

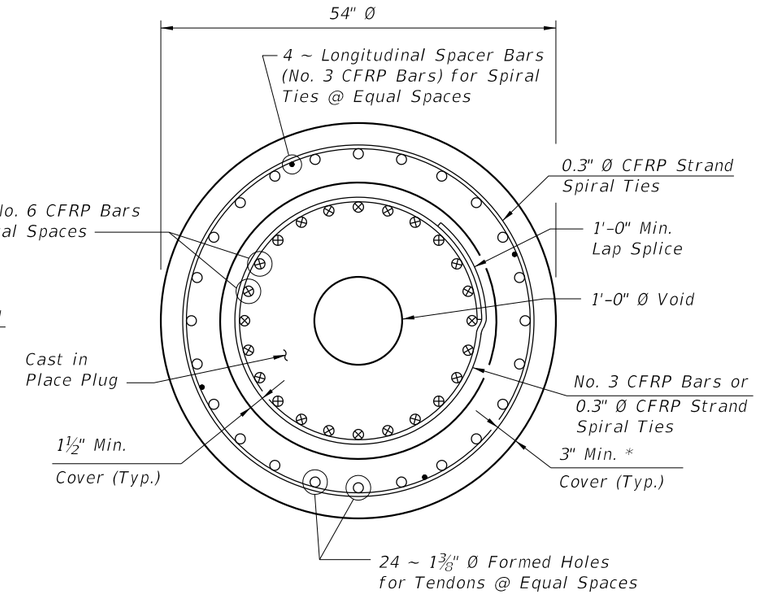

SECTION B-B

ALTERNATE STRAND PATTERNS

48 ~ 0.5" Ø, Single-Strand, at 28 kips
48 ~ 0.6" Ø, 7-Strand, at 29 kips

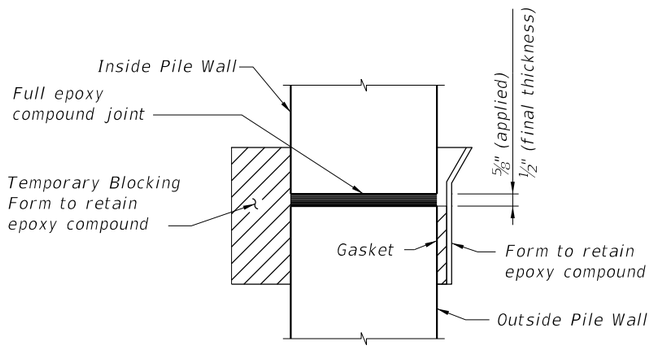

DETAIL "A"

* For Spun Cast Cylinder Piles, the following requirements for concrete cover apply:
1. Slightly or Moderately Aggressive Environments: The concrete cover may be reduced to 2 inches.
2. Extremely Aggressive Environments: The concrete cover may be reduced to 2 inches as long as the concrete has a documented chloride ion penetration apparent diffusion coefficient with a mean value of 0.005 in² per year or less; otherwise, a 3-inch concrete cover is required.

CFRP POST-TENSIONED PILE DETAILS

LAST REVISION	REVISION	DESCRIPTION:			INDEX NO.	SHEET NO.
01/01/16			FDOT FY 2017-18 DESIGN STANDARDS	54" PRECAST/POST-TENSIONED CFRP & SS CONCRETE CYLINDER PILE	22654	2 of 3

10/26/2016 9:23:42 AM

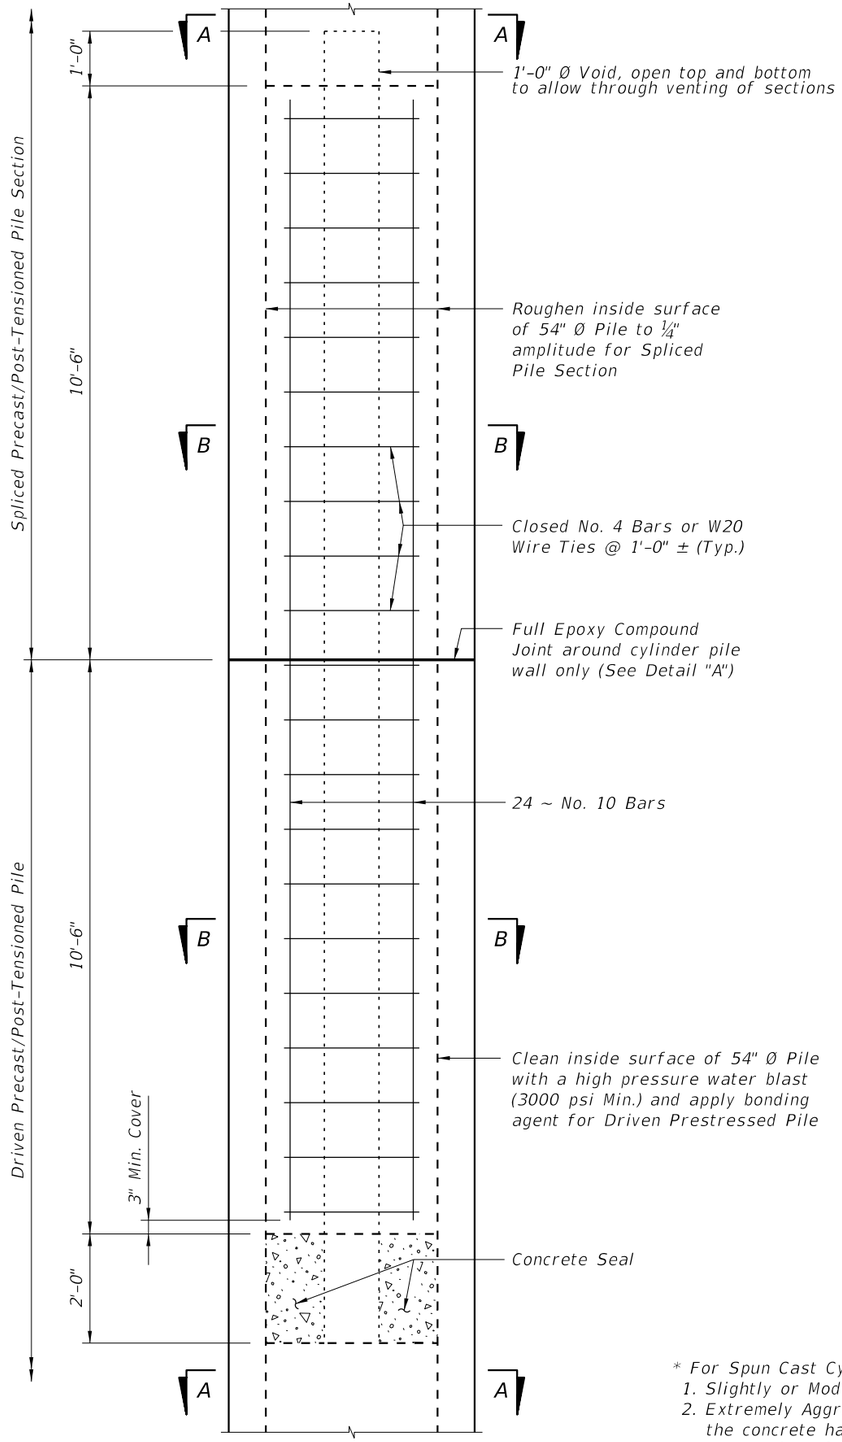

DRIVABLE UNFORESEEN FIELD SPLICE DETAIL
(Cast-In-Place Plug)

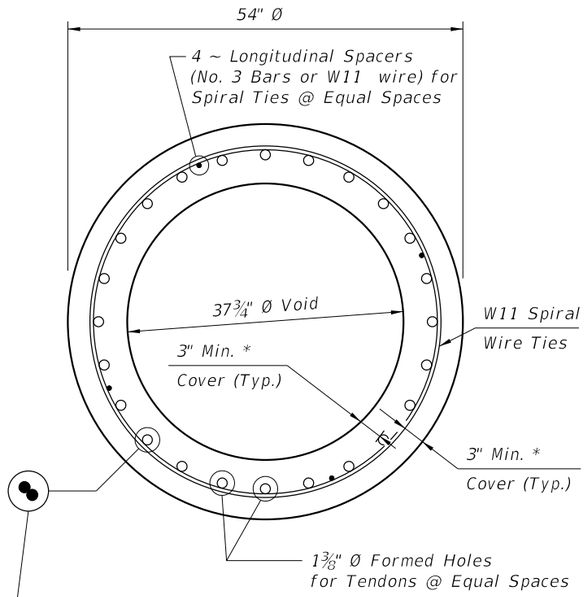

SECTION A-A

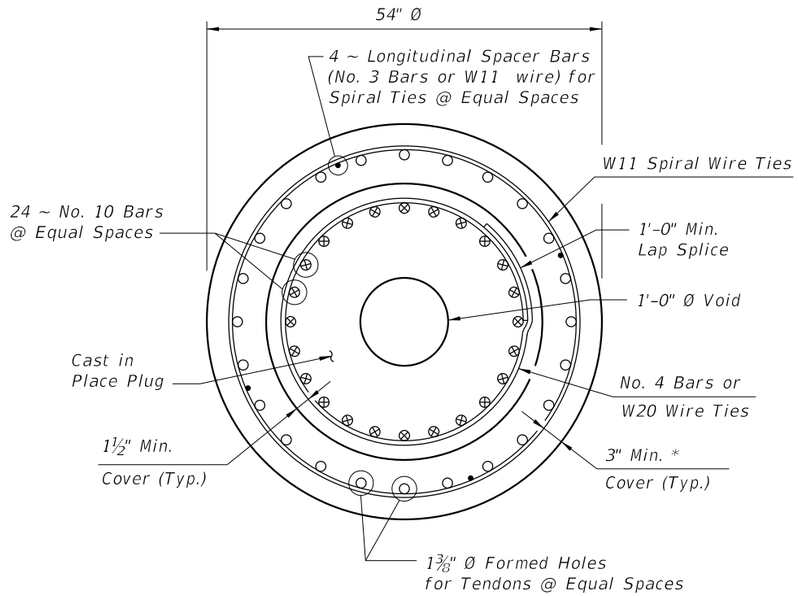

SECTION B-B

ALTERNATE STRAND PATTERNS

72 ~ ½" Ø, HSSS Strands, at 21 kips (24~3 strand tendons)
58 ~ ½" Ø, HSSS Strands, at 24 kips (29~2 strand tendons)
48 ~ 0.6" Ø, HSSS Strands, at 32 kips (24~2 strand tendons)

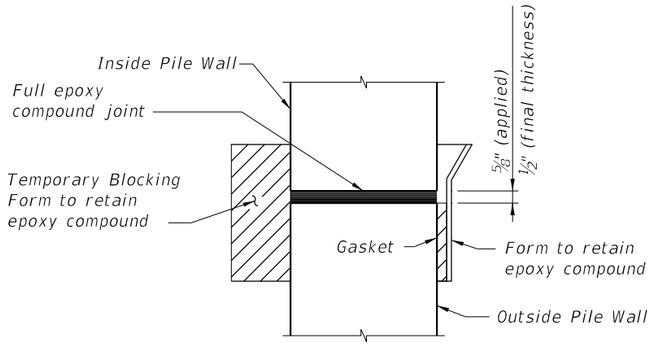

DETAIL "A"

* For Spun Cast Cylinder Piles, the following requirements for concrete cover apply:
1. Slightly or Moderately Aggressive Environments: The concrete cover may be reduced to 2 inches.
2. Extremely Aggressive Environments: The concrete cover may be reduced to 2 inches as long as the concrete has a documented chloride ion penetration apparent diffusion coefficient with a mean value of 0.005 in² per year or less; otherwise, a 3-inch concrete cover is required.

SS POST-TENSIONED PILE DETAILS

LAST REVISION	REVISION	DESCRIPTION:	FY 2017-18 DESIGN STANDARDS	54" PRECAST/POST-TENSIONED CFRP & SS CONCRETE CYLINDER PILE	INDEX NO.	SHEET NO.
01/01/16			FDOT		22654	3 of 3

10/26/2016 9:23:45 AM