


Assembly of anchorage and installation of tendons shall only be performed by qualified post-tensioning specialist personnel.

This installation procedure is generic: follow the specific procedure for each project and the FDoT specifications.







INSTALLATION

1. Preassemble anchor (AN) and plastic trumpet (PT)

threading and the compression of the gasket).

(some silicone grease shall be used to facilitate the

2. Bolt the assembled AN to the pocket former using the two threaded holes located on the front surface of AN.

AN shall be placed perpendicular to the tendon's axis

and rotated such as the side injection hole points up. 3. The position of the spiral rebar (SR) shall be secured to the AN or to adjacent rebar by tack-welding or proper fixing. The SR shall be rotated such that it won't interfere with 3/4" NPT pipe attachment (if using side injection hole). Align axis of SR with AN. Seal unused port in AN.

4. Install the smooth duct as shown on shop drawings and insert it into PT, sealing the connection by heat shrink sleeve (or, if not possible, with heat shrink wrap) in

order to prevent concrete from penetrating.

6. After completion of concrete placement, remove the

pocket former and prove that duct is clear of any obstructions or damage and that all injection vents are

7. Install strands by pushing or pulling individually or as a

bundle into duct. Allow sufficient extra length at the

wedge holes with wire brush if necessary. Lightly grease

8. Check the wedge plate (WP) for rust and dirt, clean

9. Check wedges for rust. Discard rusty wedges and use

10. Install wedge plate (keeping up the inspection hole),

slip the wedges over the strands and securely place

11. Do not apply post-tensioning forces until the concrete

values shown on the spiral table. These values refer to

mean compressive strength f'ci is not less than the

(!) Appropriate clearance must be kept behind the hydraulic

12. Stressing operation shall be executed according to the

engineer form and requires the simultaneous reading of pressure and elongation. Check the conformity of the

final elongations measurement with prescribed values. 13. Install the protection cap (PC) with 0-ring sealing on

AN using six bolts (some silicone grease shall be used to

14. Thread 1/2" NPT pipe for injection onto the PC and the 3/4" NPT pipe onto AN. Use a 1/2" plug to secure the hole

16. Wax shall be injected through the filler inlet until it

high points or inclined tendons to avoid voids.

operation and inspection are completed.

escapes from the filler outlet. Special measures shall be

applied for long tendons, for tendon paths with distinct

17. All vents and injection inlets/outlets have to be sealed

18. Fill holes with non-shrink grout after post injection

on PC not used (some thread seal tape shall be used to

facilitate the compression of the O-ring).

improve the tightness of the threadings).

15. Carry out the pressure test. Injection can now proceed.

with plugs soon after injection.

5. Carry out the pressure test. Concreting can now proceed.

active anchorage for stressing.

free and secured.

only clean ones.

them into wedge holes

cvlindrical strength

Stressing can now proceed.

jack while stressing.

w/ welded port

butt welding


electrofused

3 15/16"

[100mm]

INTERMEDIATE COUPLING DETAILS

see installation procedures





Protection Cap

Protection Cap Bolts

NPT Pipe Nipple 1/2"

NPT Ball Valve 1/2"

NPT Plug 1/2"

Wedge Plate

NPT Plug 3/4"

Wedges

Trumpet Compression Seal

E-IU-19-07-08 | Smooth Plastic Duct 4.5"

F-IU-19-07-13 High Temp Heat Shrink Sleeve

Electrofusion Duct Coupler 4.5"

Vent Port 3/4" NPT PE

Spiral

Anchor 00-03-01-M NPT Pipe Nipple 3/4"

00-03-02-M NPT Ball Valve 3/4"

Protection Cap O-Ring

DESCRIPTION

ITEM

2

3

4

8

9 10

11

12

13

14

15

17

18

19

20

PART#

19-01-00

19-01-01

19-01-02

00-01-03-M

00-01-04-M

00-01-05 E-IU-19-02-00

19-03-00

00-03-03

00-04-00

19-05-00


19-06-00

19-06-01

E-IU-19-07-12

00-07-04-EM

00-08-00 Strand 0.6"

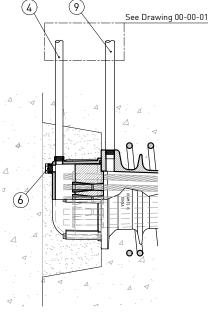

SECTION B-B top injection and venting

MATERIAL

Ductil Iron ASTM A536 GR80-55-06 + Galvanization according to ASTM A123

BILL OF MATERIALS

SCH40 steel

SCH40 steel

SCH40 steel

SCH40 steel

Steel AISI C1045 Normalized

Nylon S-PA0401 - according to ASTM D5989

Stainless Steel GR316L - according to ASTM F593

High Density Polyethylene - according to ASTM D3350

Coated Polyolefin Backing - according to FDoT Tab.2.2.1.8-1 Sec.960

NBR - according to FDoT Tab.2.2.1.7-1 Sec.960


Steel GR60, #5 - according to ASTM A615

Polyethylene - according to ASTM D3350

Steel GR270 - according to ASTM A416

Steel AISI 12L14 - according to ASTM A108 + Heat treatment

NBR - according to FDoT Tab.2.2.1.7-1 Sec.960

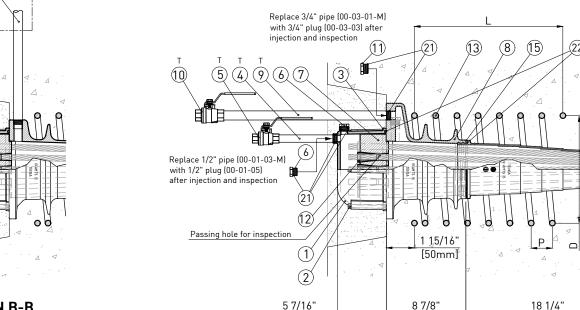

[138mm]

SECTION A-A front injection and venting

[464mm]

[225mm]

N

MISCELLANEOUS MATERIALS				
ITEM DESCRIPTION				
21 Commercially available thread seal tape				
22	Commercially available and compatible silicone grease			


SPIRAL				
CONCRETE CLASS	4000PSI [27.5MPA]	6500 PSI [45MPA]		
LENGTH (L)	18-3/8" [466mm]	16" [406mm]		
DIAMETER (D)	16-1/4" [414mm]	12-3/8" [314mm]		
PITCH (P)	2-3/8" [60mm]			
BAR DIAMETER	#5 - 5/8" [16mm]			
N. OF TURNS	9.5	8.5		

0	0 02/13/20 First i			sue	L.C.	T.C.
Rev.	Date		Descrip	tion	Drawn	Checked
Mate -	rial :			Treatment :		
	TE	NSA DE ECCHER	AMERICA	EXTERNAL UNI PT SYSTEM AS: for 19AMTS15 (EMBLY	
			om - PHONE: +1 305-866-9917 RBOR ISLAND - 33154 FL	Drawn : L.CIVATI Che	cked : T.CIC	CONE
Date	: 02/13/202	0	Dimensions : INCH [mm] mm FOR REFERENCE ONLY	Part # : E-19-00-00 Cod	e : -	
				ISA AMERICA LLC roject and may not be reproduced in whole or i Il safequard its rights according to the civil and		

NOTE: Comp	ponents marked with "T" on the drawing are temporary
	MISCELLANEOUS MATERIALS
ITEM	DESCRIPTION
21	Commercially available thread seal tape
22	Commercially available and compatible silicone grease
	SPIRAL

PT SYSTEM ASSEMBLY for 19AMTS15 (19-0.6")		
Drawn : L.CIVATI	Checked : T.CICCONE	
Part # : E-19-00-00	Code : -	
NI	Drawn : L.CIVATI	

Replace 1/2" ball valve (00-01-04-M) with 1/2" female plug (00-01-06) at the end of operations

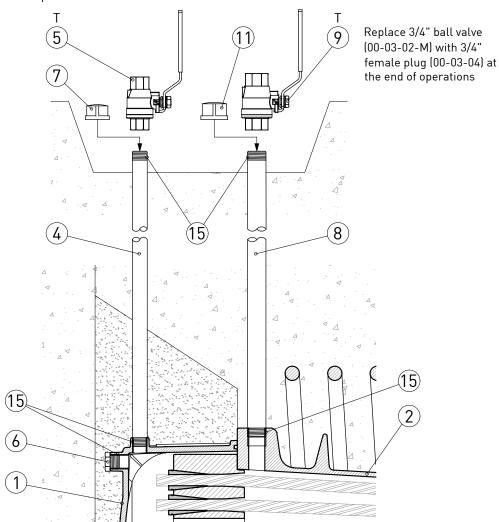


ANCHORAGE CONFIGURATION

top venting and injection

	BILL OF MATERIALS						
ITEM	PART #	DESCRIPTION	MATERIAL				
1	XX-01-00*	Protection Cap	Nylon S-PA0401 - according to ASTM D5989				
2	XX-03-00*	Anchor	Ductil Iron ASTM A536 GR80-55-06 + Galvanization according to ASTM A123				
3	E-IU-XX-07-08*	Smooth Plastic Duct	High Density Polyethylene - according to ASTM D3350				
4	00-01-03-M	NPT Pipe Nipple 1/2"	SCH40 steel				
5	00-01-04-M	NPT Ball Valve 1/2"	SCH40 steel				
6	00-01-05	NPT Plug 1/2"	High Density Polyethylene - according to ASTM D3350				
7	00-01-06	NPT Female Plug 1/2"	SCH40 steel				
8	00-03-01-M	NPT Pipe Nipple 3/4"	SCH40 steel				
9	00-03-02-M	NPT Ball Valve 3/4"	SCH40 steel				
10	00-03-03	NPT Plug 3/4"	High Density Polyethylene - according to ASTM D3350				
11	00-03-04	NPT Female Plug 3/4"	SCH40 steel				
12	00-07-04-EM	Vent Port 3/4" NPT PE	Polyethylene - according to ASTM D3350				
13	00-07-06	NPT Nipple Coupler 3/4"	SCH40 steel				
14	00-07-07	NPT Elbow 3/4"	SCH40 steel				

^{*} depending from system dimension

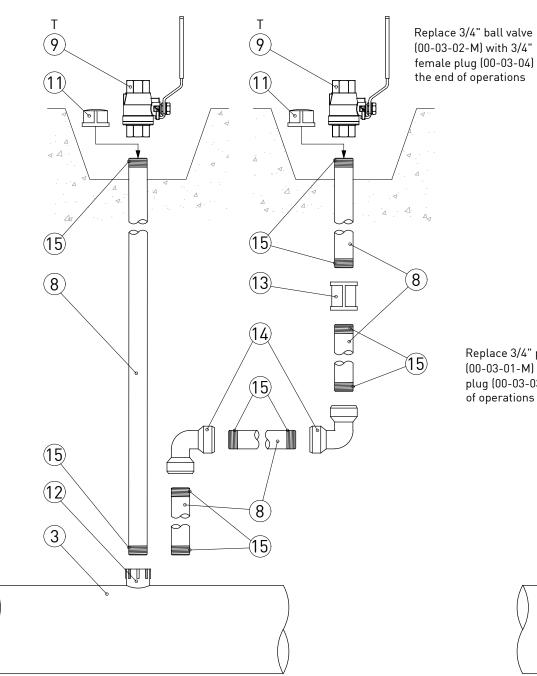

(00-03-02-M) with 3/4" female plug (00-03-04) at the end of operations Replace 3/4" pipe (00-03-01-M) with 3/4" plug (00-03-03) at the end of operations 9 (15) 8 (12) (3)

PIPE INTERNAL CONFIGURATION


NOTE:


- Vent assemblies can be used as inlet, outlet or drain; when elbows are present, the vent cannot be used for injection / inspection;
- Epoxy grout shall be used to fill recessess: make reference to FDoT standard plans index 462-003 for post-tensioning anchorage and tendon filling details
- Concrete cover must meet FDoT Structures Design Guidelines Section 1.4.2
- Components marked with "T" on the drawing are temporary

MISCELLANEOUS MATERIALS				
ITEM	DESCRIPTION			
15	Commercially available thread seal tape			


PIPE EXTERNAL CONFIGURATION

0	04/26/18		First is	sue		L.C.	T.C.
Rev. Date Descrip			tion		Drawn	Checked	
Mate -	rial :			Treatment :			
//=				Title :			
	GRUPPO	NSA DEECCHER	AMERICA	INTERNAL UNBOR			RNAL
TENSA	AMERICA LLC -	DE ECCHER www.tensaamerica.	AMERICA com - PHONE: +1 305-866-9917 RBOR ISLAND - 33154 FL		SEMBI		
TENSA 1111 K	AMERICA LLC -	Www.tensaamerica.	com - PHONE: +1 305-866-9917	VENT ASS	SEMBI	LIES ed : T.CICC	

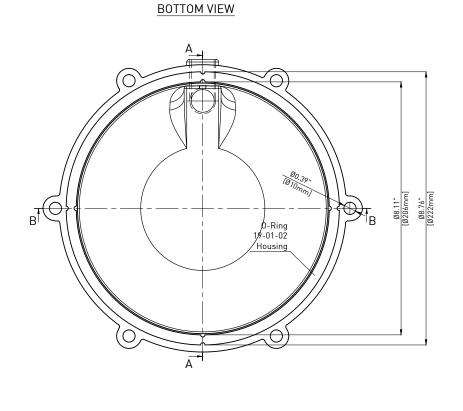


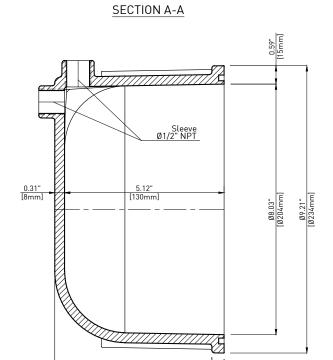

5.43" [138mm]

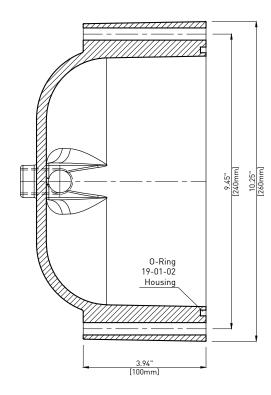


SECTION B-B

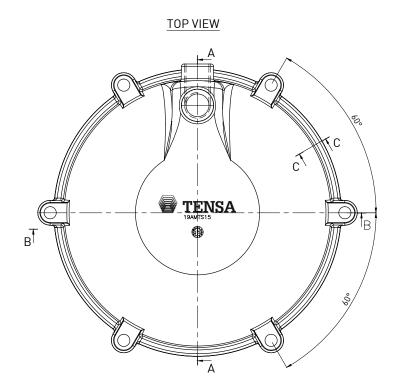







Title :

PROTECTION CAP

for 19AMTS15 Drawn : L.CIVATI Checked : T.CICCONE

Date: 08/23/2016 Dimensions : INCH [mm]
mm FOR REFERENCE ONLY

Nylon S-PA0401 - according to ASTM D5989

Material :

Part # : 19-01-00

Treatment :


Document Property of TENSA AMERICA LLC


This drawing contains proprietary information restricted solely for use on this project and may not be reproduced in whole or in part. For any other use without the expressed written permission of TENSA AMERICA LLC, the company will safeguard its rights according to the civil and penal previsions of the Law.

Marking - Type



0	08/23/16	First issue	L.C.	T.C.	
Rev.	Date	Description	Drawn	Checked	

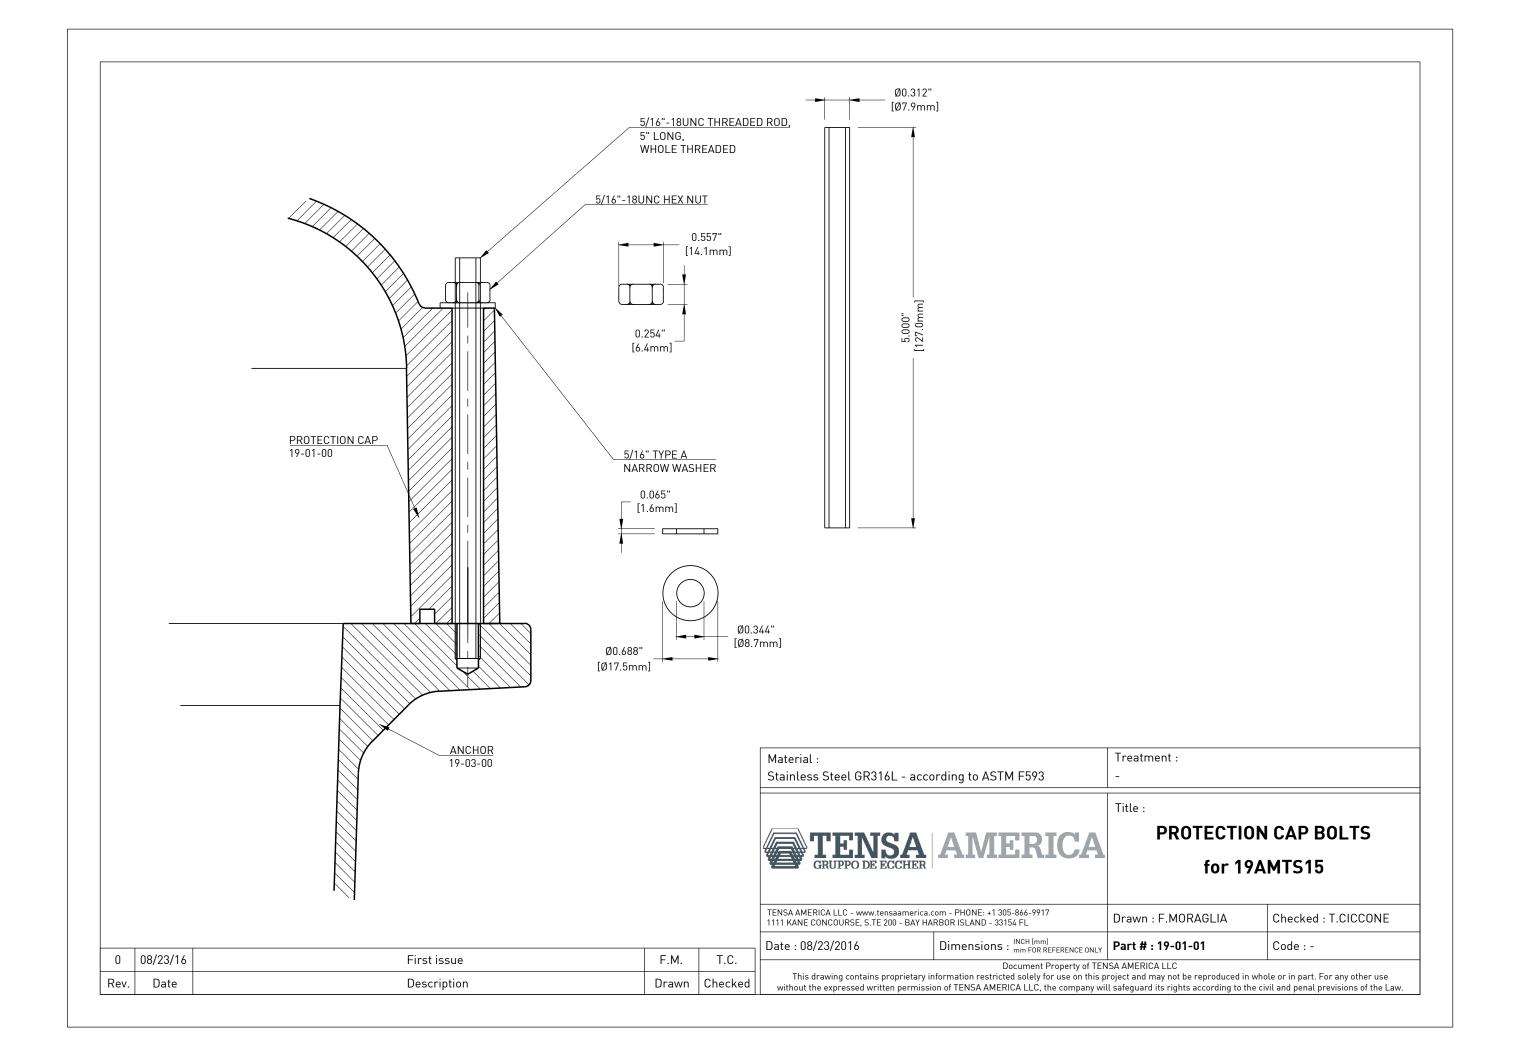

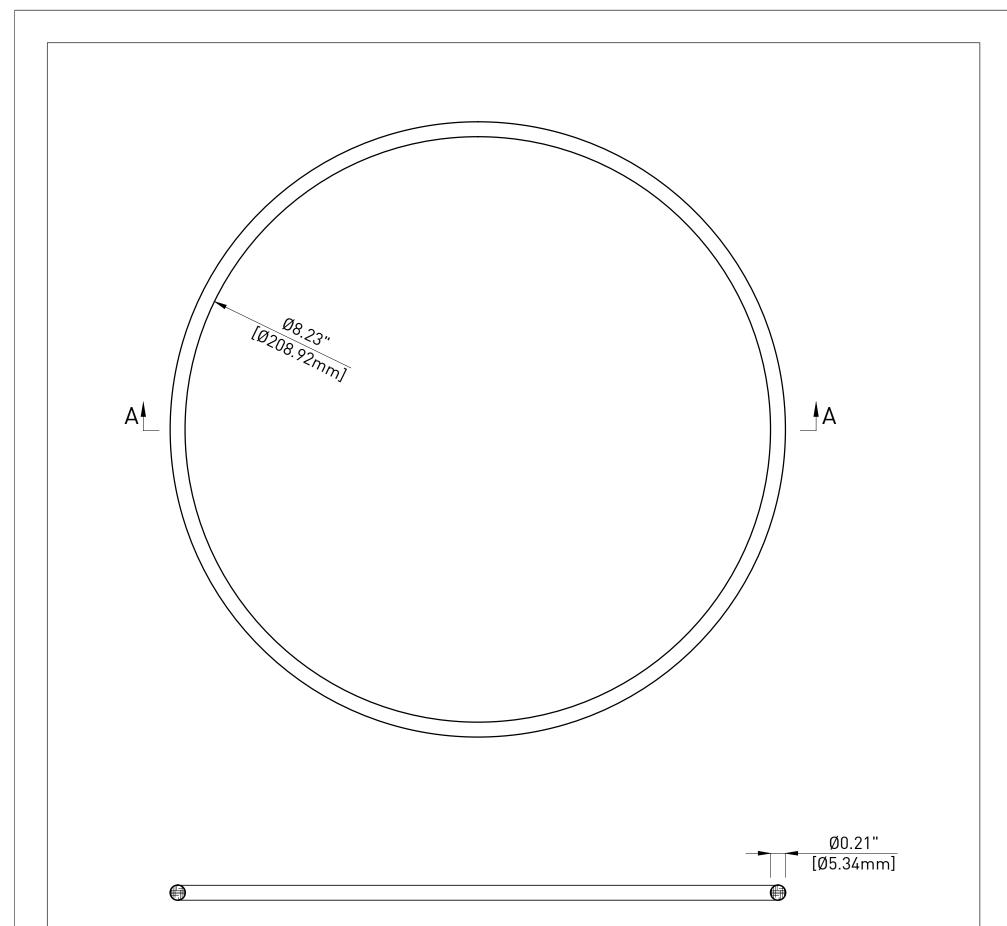

SECTION A-A

0	08/23/16	First issue		T.C.
Rev.	Date	Description	Drawn	Checked
Mate	rial :	Treatment :		·

NBR - according to FDoT Tab. 2.2.1.7-1 Sec.960

NOTE:

This drawing is not intended for manufacturing purposes.

Centro Guarnizioni TIGER s.r.l **PROTECTION CAP 0-RING** for 19AMTS15 PT SYSTEM

TENSA AMERICA LLC - www.tensaamerica.com - PHONE: +1 305-866-9917 1111 KANE CONCOURSE, S.TE 200 - BAY HARBOR ISLAND - 33154 FL

 ${\sf Drawn}: {\sf L.CIVATI}$

Part #: 19-01-02


 ${\sf Checked}: {\sf T.CICCONE}$

Date: 08/23/2016

Dimensions : INCH [mm] mm FOR REFERENCE ONLY

Code : OR 06820


Document Property of TENSA AMERICA LLC

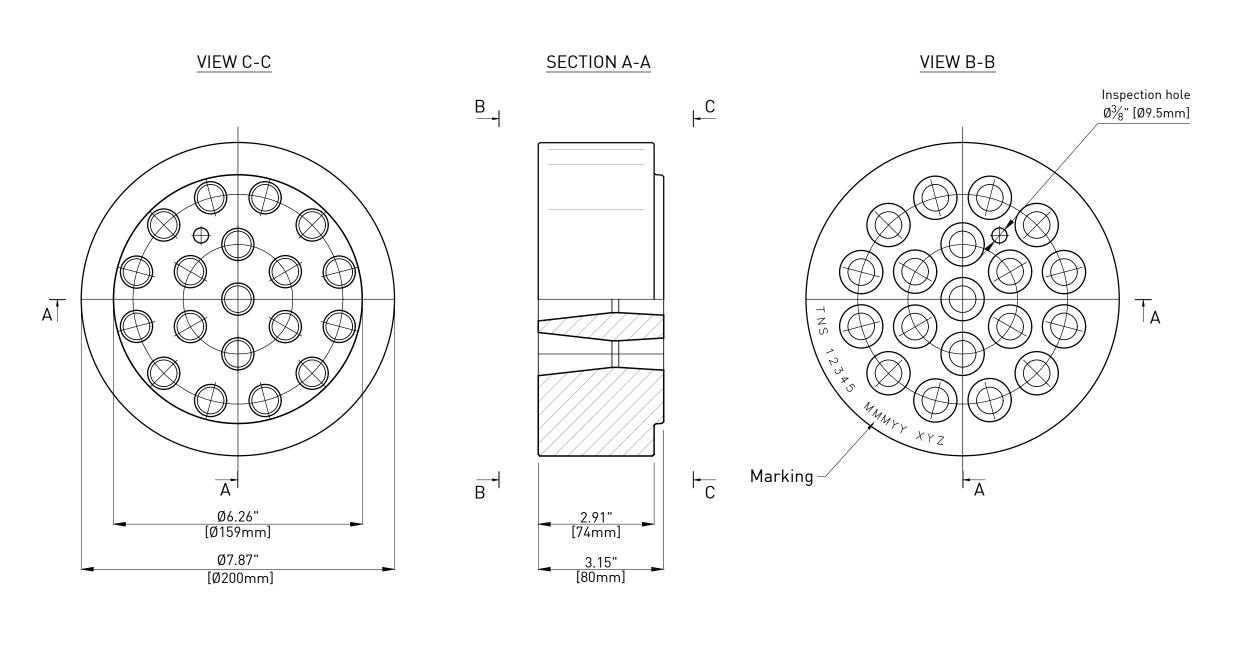



Material : Steel AISI C1045 Normalized		Treatment :				
TENSA GRUPPO DE ECCHER	AMERICA	WEDGE PLATE for 19AMTS15 (19-06") External and Internal Unbonded systems				
TENSA AMERICA LLC - www.tensaamerica. 1111 KANE CONCOURSE, S.TE 200 - BAY HA		Drawn : L.CIVATI	Checked : T.CICCONE			
Date : 08/23/2016	Dimensions : INCH [mm] mm FOR REFERENCE ONLY	Part # : E-IU-19-02-00	Code : -			
	Document Property of TENSA AMERICA LLC This drawing contains proprietary information restricted solely for use on this project and may not be reproduced in whole or in part. For any other use without the expressed written permission of TENSA AMERICA LLC, the company will safeguard its rights according to the civil and penal previsions of the Law.					

 0
 08/23/16
 First issue
 L.C.
 T.C.

 Rev.
 Date
 Description
 Drawn
 Checked

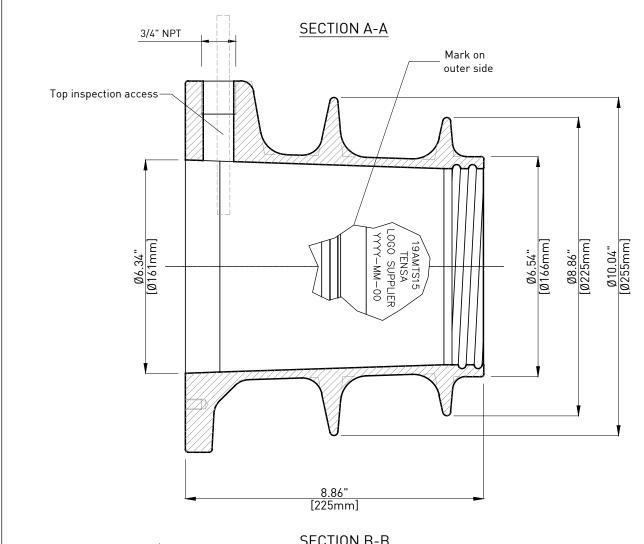

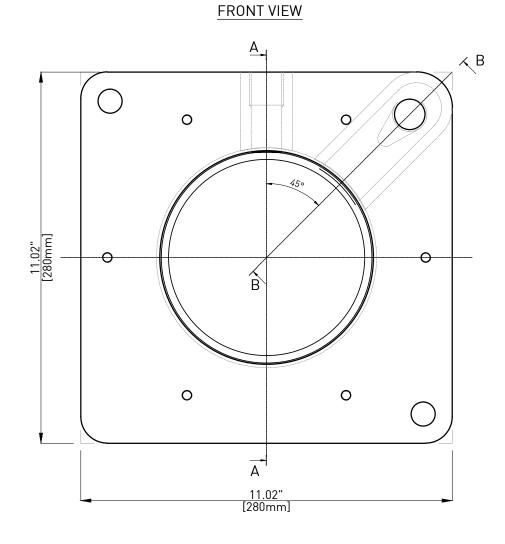

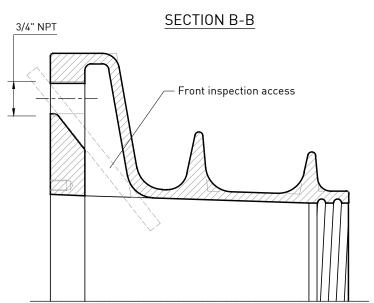

0	12/14/16	First issue	F.M.	T.C.
Rev.	Date	Description	Drawn	Checked

Material: Treatment : Ductil Iron ASTM A536 GR80-55-06 Galvanization according to ASTM A123 Title : **ANCHOR 19AMTS15 (19-0.6")** TENSA AMERICA LLC - www.tensaamerica.com - PHONE: +1 305-866-9917 1111 KANE CONCOURSE, S.TE 200 - BAY HARBOR ISLAND - 33154 FL


Dimensions : INCH [mm] mm FOR REFERENCE ONLY Date : 12/14/2016 Part # : 19-03-00 Document Property of TENSA AMERICA LLC

This drawing contains proprietary information restricted solely for use on this project and may not be reproduced in whole or in part. For any other use without the expressed written permission of TENSA AMERICA LLC, the company will safeguard its rights according to the civil and penal previsions of the Law.

Drawn : F.MORAGLIA

Checked : T.CICCONE

Code : -

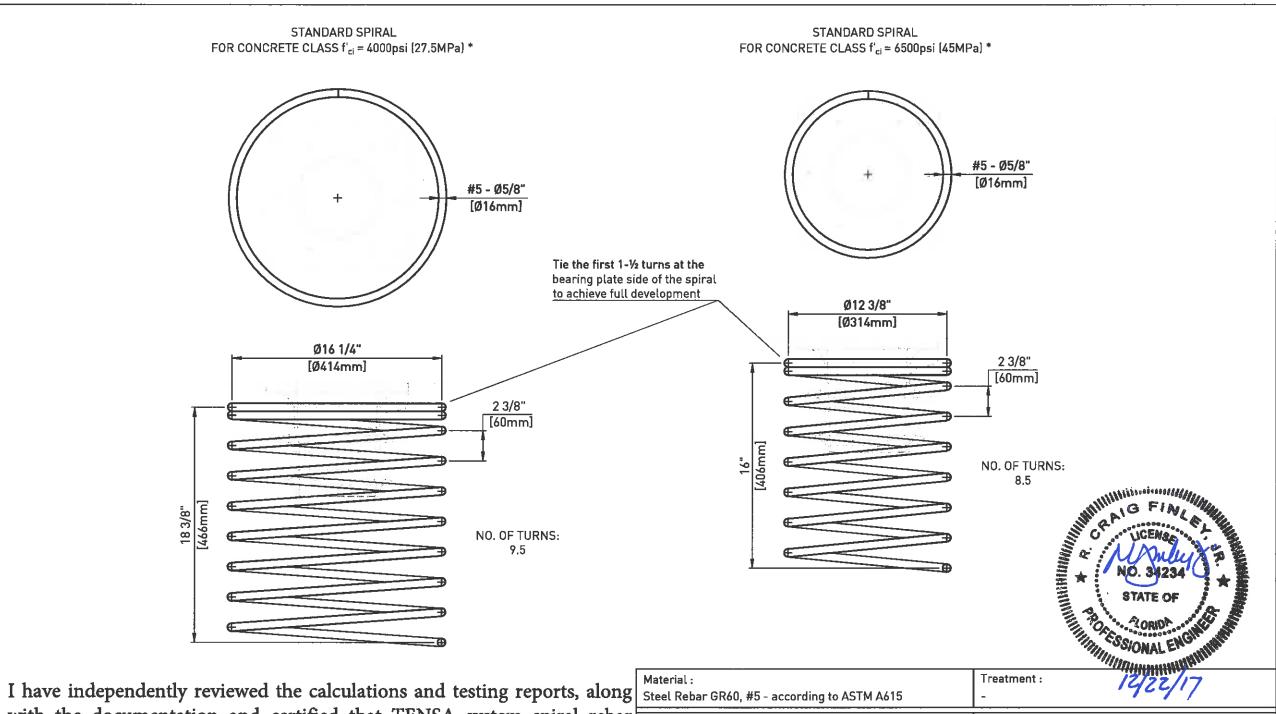

I have independently reviewed the calculations and testing reports, along with the documentation and certified that TENSA system spiral rebar detail meets the requirements as outlined in paragraph 3.3 PTI Anchorage Zone Design.

(*) Do not apply post-tensioning forces until the concrete mean compressive strength f'ci is not less than the values shown in the present drawing.

NOTE: The local zone reinforcement is to be shown on the shop drawings.

0	12/20/17	First issue	F.M.	T.C.
Rev.	Date	Description	Drawn	Checked

TITILE:

SPIRAL REBAR

for 19AMTS15

TENSA AMERICA LLC - www.tensaamerica.com - PHONE: +1 305-866-9917

TENSA AMERICA LLC - www.tensaamerica.com - PHONE: +1 305-866-9917

TENSA AMERICA LLC - www.tensaamerica.com - PHONE: +1 305-866-9917

TITILE:

SPIRAL REBAR

for 19AMTS15

TENSA AMERICA LLC - www.tensaamerica.com - PHONE: +1 305-866-9917

TITILE:

SPIRAL REBAR


for 19AMTS15


TENSA AMERICA LLC - www.tensaamerica.com - PHONE: +1 305-866-9917

Drawn : F.MORAGLIA Checked : T.CICCONE

Date : 12/20/2017 Dimensions : | INCH Imml | part # : 19-05-00 | Code :
Document Property of TENSA AMERICA LLC

This drawing contains proprietary information restricted solely for use on this project and may not be reproduced in whole or in part. For any other use without the expressed written permission of TENSA AMERICA LLC, the company will safeguard its rights according to the civil and penal previsions of the Law.

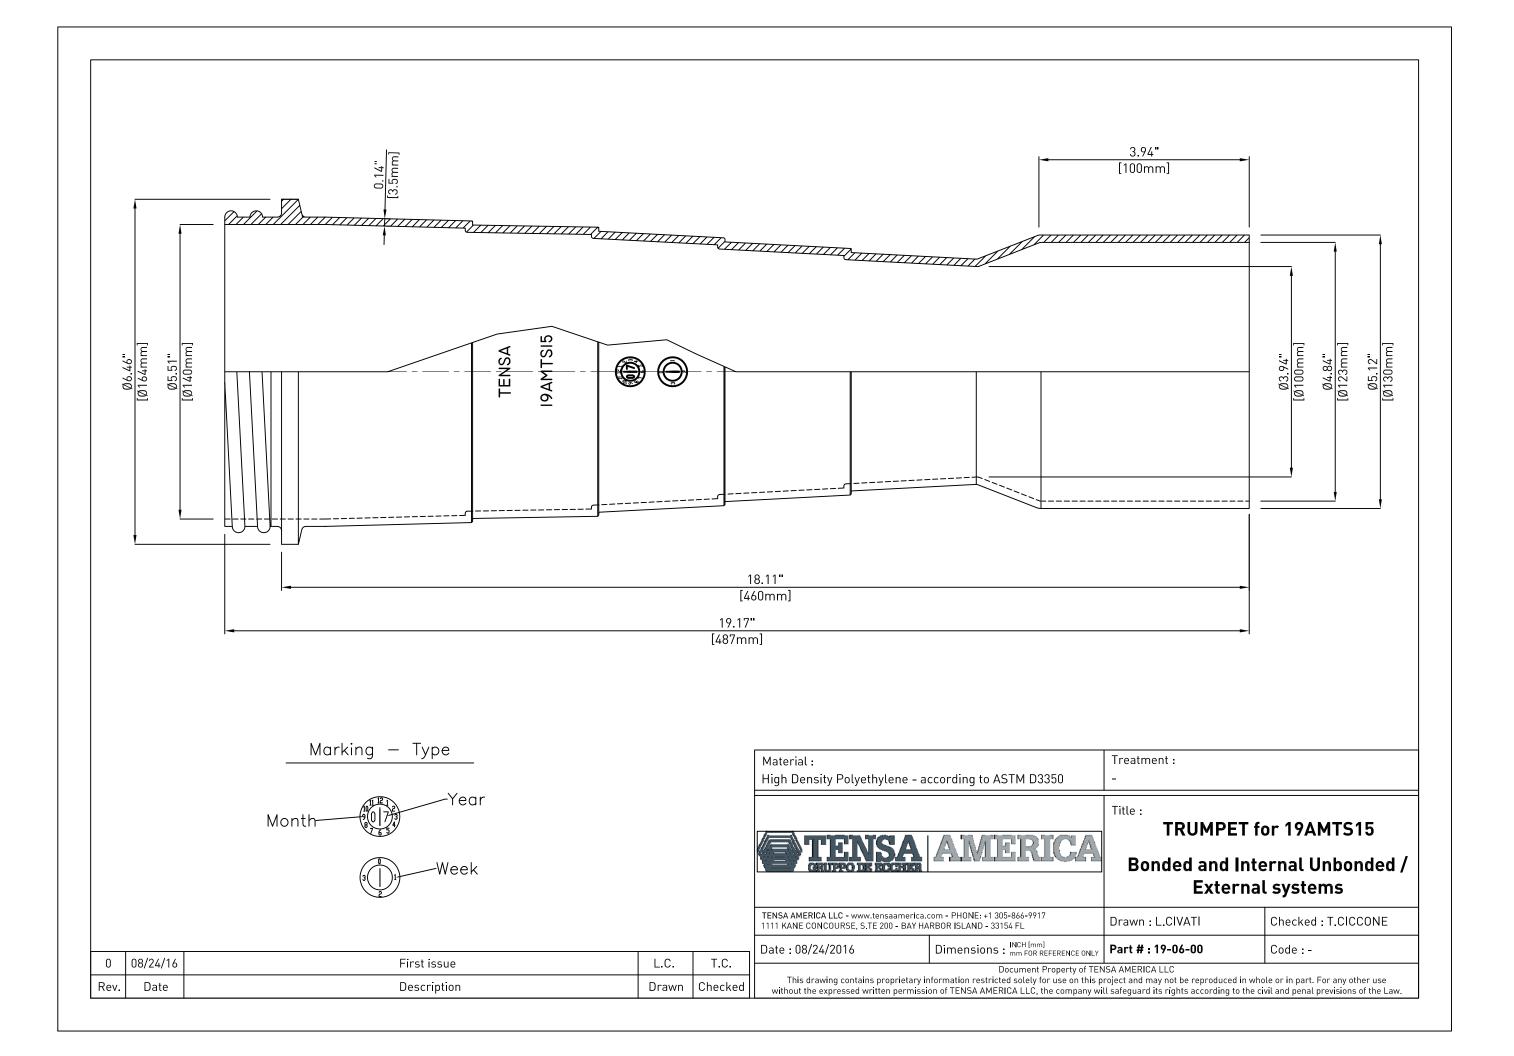

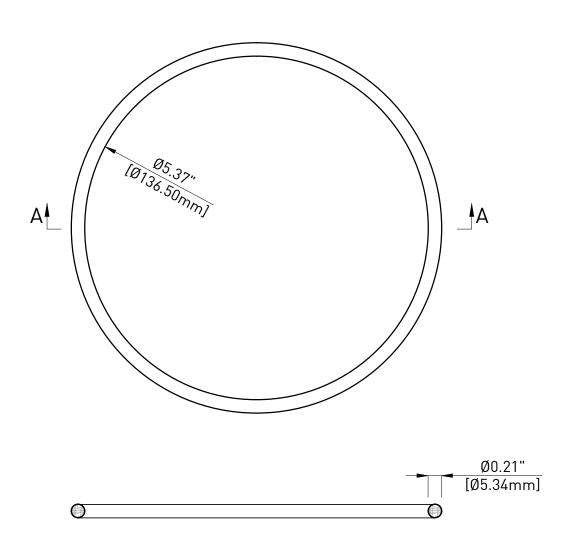

SECTION A-A

0	08/23/16	First issue	L.C.	T.C.		
Rev.	Date	Description	Drawn	Checked		

Material: NBR - according to FDoT Tab. 2.2.1.7-1 Sec.960 Treatment:

NOTE:

This drawing is not intended for manufacturing purposes.


Title : Centro Guarnizioni TIGER s.r.l **COMPRESSION SEAL** for 19AMTS15

 ${\sf Checked}: {\sf T.CICCONE}$

between Anchor and Trumpet TENSA AMERICA LLC - www.tensaamerica.com - PHONE: +1 305-866-9917 1111 KANE CONCOURSE, S.TE 200 - BAY HARBOR ISLAND - 33154 FL ${\sf Drawn}: {\sf L.CIVATI}$

Dimensions : INCH [mm] mm FOR REFERENCE ONLY Code : OR 0213 Date: 08/23/2016 Part #: 19-06-01

Document Property of TENSA AMERICA LLC

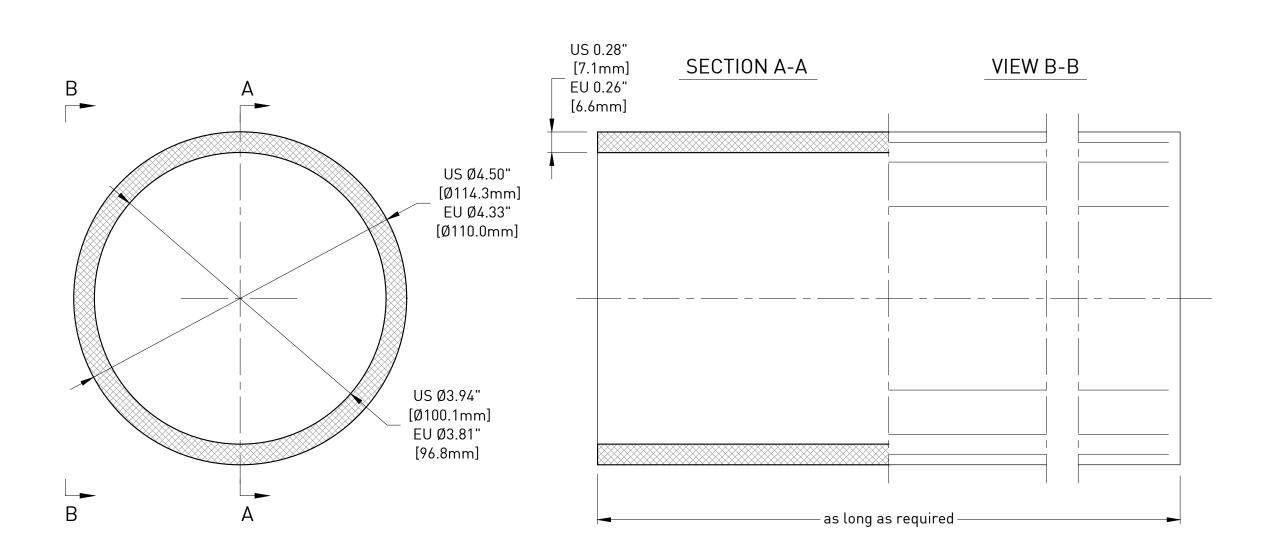



Minimum radius of curvature for prefabricated sections of duct	10 ft (3.05 m)
Minimum radius of curvature for straight sections of duct to be field bent	20 ft (6.10 m)


NOTE:

- This drawing is not intended for manufacturing purposes;
- Duct meets FDoT requirements (Par. 2.2.1.2 and 2.4.4 Section 960):
 - ••• maximum dimensional ratio (DR) of 17 as per ASTM D3035 or ASTM F714
 - ••• 125 psi rated
- ••• minimum cell class of 445574C as per ASTM D3350
- ••• minimum OIT of 40 minutes as per ASTM D3895

Α	10/08/19	Updated with measures for US and European versions	L.C.	T.C.
0	07/04/18	First issue	L.C.	T.C.
Rev.	Date	Description	Drawn	Checked

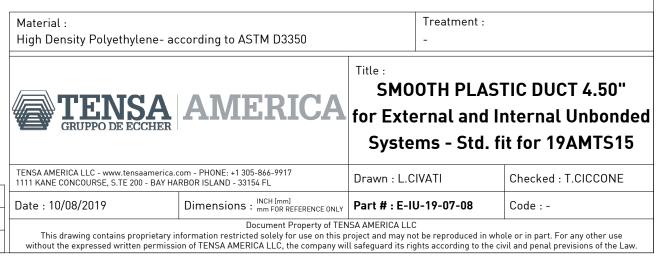

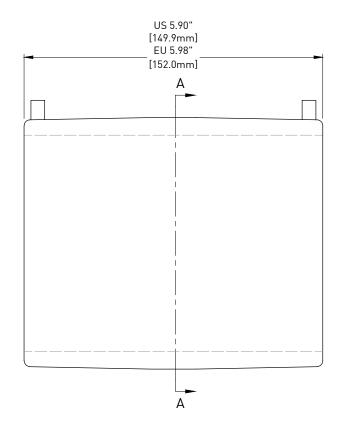

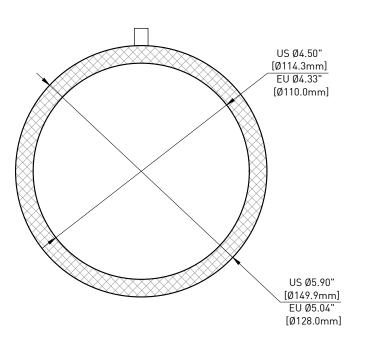

SECTION A-A

INSTALLATION

Preparing the duct

- 1. Scrape the duct up to 0.4" (10mm) beyond the insertion length of the fitting.
- 2. Clean the welding area and let it dry.
- 3. Insert the duct ends straight into the fitting fot the correct length.
- 4. Install the aligners in order to keep straight position.

The Welding Process

- 5. Connect the welding cables to the electrofusion coupler connectors and enter the welding parameters in the device.
- 6. At the end of the welding cycle, disconnect the cables and wait for the cooling.
- 7. Remove the aligners.

NOTE:

- The United States (US) coupler must be used with the corresponding US duct; the European (EU) coupler must be used with the corresponding EU duct;
- The installation procedure is general; reference to manifacturer's instruction manual for the detailed installation instructions;
- This drawing is not intended for manufacturing purposes;
- Coupler meets FDoT requirements (Par. 2.2.1.5 Section 960):
 - ••• 150 psi rated
 - ••• minimum cell class of 445574C as per ASTM D3350
- ••• minimum OIT of 40 minutes as per ASTM D3895

А	10/08/19	Updated with measures for US and European versions	L.C.	T.C.
0	07/04/18	First issue	L.C.	T.C.
Rev.	Date	Description	Drawn	Checked

Material : High Density Polyethylene- according to ASTM D3350 Treatment :

TENSA AMERICA

ELECTROFUSION COUPLER for 4.5" HDPE DUCT CONNECTION

Standard fit for 19AMTS15

TENSA AMERICA LLC - www.tensaamerica.com - PHONE: +1 305-866-9917 1111 KANE CONCOURSE, S.TE 200 - BAY HARBOR ISLAND - 33154 FL

Drawn : L.CIVATI

Title :

Checked : T.CICCONE

Date: 10/08/2019


Dimensions: INCH [mm] | mm FOR REFERENCE ONLY

Part # : E-IU-19-07-12

Code : -

Document Property of TENSA AMERICA LLC

UNWRAPPED PLAN VIEW

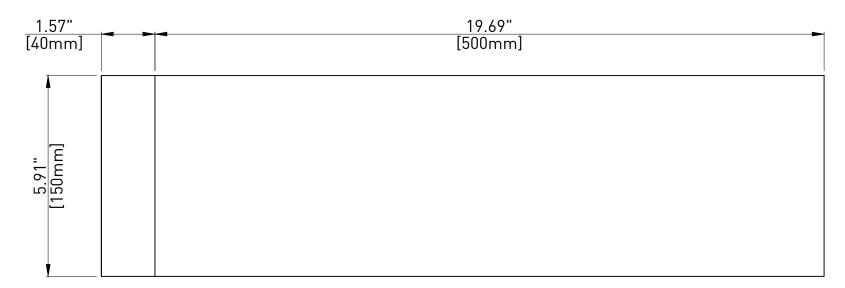

UNWRAPPED LATERAL VIEW

0.08" [2mm]

NOTE:

- Thickness is type L, i.e. 0.035" [0.9 mm] backing + 0.043" [1.1 mm] adhesive;
- This drawing is not intended for manufacturing purposes;
- Heat shrink sleeve meets or exceeds FDoT requirements (Table 2.2.1.8-1 Section 960);
- For the installation make reference to manifacturer procedure

Α	03/06/20	Width reduction from 300 to 150 mm	L.C.	T.C.
0	07/04/18	First issue	L.C.	T.C.
Rev.	Date	Description	Drawn	Checked

Coated Polyolefin Backing - according to FDoT Tab.2.2.1.8-1 Sec.960

Treatment:



Title : **CANUSA-CPS**

HIGH TEMPERATURE HEAT SHRINK SLEEVE Standard fit for 19AMTS15 External and **Internal Unbonded Systems**

TENSA AMERICA LLC - www.tensaamerica.com - PHONE: +1 305-866-9917 1111 KANE CONCOURSE, S.TE 200 - BAY HARBOR ISLAND - 33154 FL

Drawn : L.CIVATI

Checked: T.CICCONE

Date: 03/06/2020

Dimensions: INCH [mm] Part #: E-IU-19-07-13

Code: KLNN-115-150-BK

Document Property of TENSA AMERICA LLC